

TWX 982

Regulatory

File Cy.

50-237

TLXA018 WAG322(2256)(1-039312C190)PD 07/09/73 2255

ICS IPMVEIA MVN

01306 TDVE MORRIS ILL 81 9 430P CDT

PMSMR AGIAMBUSO DEUPTY DIRECTOR FOR REACTOR PROJECT DIRECTORATE OF
LICENSING US ATOMATIC ENERGY COMMISSION WUX

WASHINGTON DC 20545



SUBJECT D.P.R. 19 DRESDEN NUCLEAR POWER STATION UNIT 2 THIS WILL
CONFIRM A CONVERSATION WITH R DANCE OF YOUR OFFICE AT 1600 HOURS
THIS DATE CONCERNING HIGH ACTIVITY IN B FLOOR DRAIN SAMPLE TANK TANK
FILLED AND PLACED ON RECIRC FOR SAMPLE AT 0650 SAMPLE RESULTS RECEIVED

AT 0945 INDICATED CURIE CONTENT WAS 1 CURIE WHICH EXCEEDS LICENSE LIMIT
OF 7 CURIE COMMENCED REPORCESSING AT 1000 AND WERE WITH LICENSED
LIMIT

BY 1030 HIGH ACTIVITY BELIVED CAUSED POOR FILTER FUL
W P WORDEN SUP DRESDEN NUCLEAR POWER STATION COMMONWEATH EDISON

USAEC, HQS GTWN

#

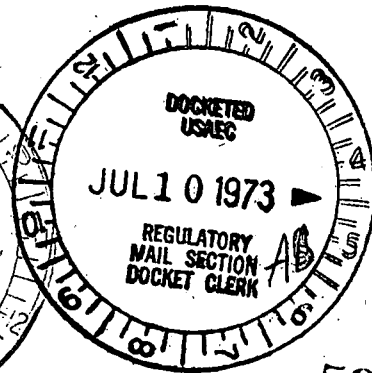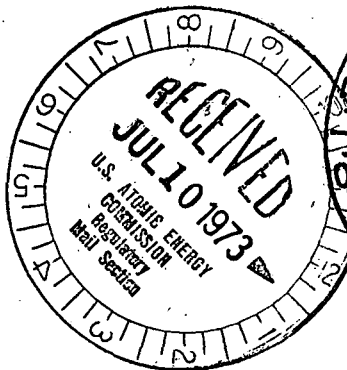

1106A

5347