

James G. Keppler, Regional Director
Directorate of Regulatory Operations
Region III
U.S. Nuclear Regulatory Commission
799 Roosevelt Road
Glen Ellyn, IL 60137


Telecopied Date 5-8-75
or MAA: GE _____
DC 11:40 a.m.
BY AW

cc:
J. P. O'Leary, Director
Directorate of Licensing
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

50-237
File

SUBJECT: DPR-19, Dresden Nuclear Power Station, Unit 2.

This will confirm a conversation with MR. JOHNSON of
your office at 1130 hrs this date concerning FAILURE OF
CONTROL ROD DRIVE RETURN LINE CHECK VALUE
2-301-9B TO PASS LOCAL LEAK RATE TEST AT
1930 7 MAY 1975. CHECK VALUE WILL BE REPAIRED
PRIDE TO START-UP.

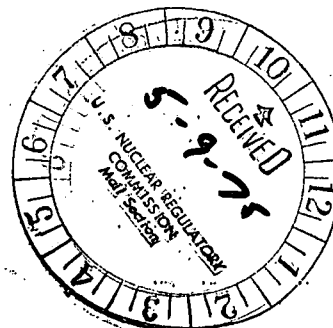

To Call:
GE - 5-838-2660x16 (auto)
DC - 9-1-301-492-7617 (auto) - on 6
WU - 815-942-4449/4321

Station Dist: Originator (copy)
Incident File (copy)
Telegram File (original)

B. B. Stephenson, Superintendent
Dresden Nuclear Power Station
Commonwealth Edison Company
R.R. #1
Morris, IL 60450

Telephone: 815-942-2920/2921x212
(rtaicmv x767)

TO:
James G. Keppler, Regional Director
Directorate of Regulatory Operations
Region III
U.S. Nuclear Regulatory Commission
799 Roosevelt Road
Glen Ellyn, IL 60137

Telecopied Date 5.8.75
OF MAA CE 1:15 p.m.
Teleg. received: DC 11:40 a.m.
By AW

cc:
J. F. O'Leary, Director
Directorate of Licensing
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

SUBJECT: DPR-19, Dresden Nuclear Power Station, Unit 2.

This will confirm a conversation with MR JOHNSON of
your office at 1130 hrs this date concerning FAILURE OF
CONTROL ROD DRIVE RETURN LINE CHECK VALVE
-301-98 TO PASS LOCAL LEAK RATE TEST AT
30 7 MAY 1975. CHECK VALVE WILL BE REPAIRED
BEFORE TO START-UP.

To Call:
CE - 3-858-2650x16 (auto) - on 6
DC - 9-1-301-492-7617 (auto)
WD - 815-942-4449/4321

Rec'd 1:25
5/8/75
B. B. Stephenson, Superintendent
Dresden Nuclear Power Station
Commonwealth Edison Company
R.R. #1
Morris, IL 60450

Freezer Air Mail Original (copy)