


Regulatory Docket File

WESTERN UNION INCOMING

BETH
008

50-237

1974 MAY 22 PM 9 23

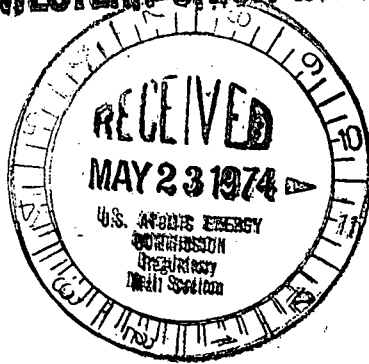

U.S. ATOMIC ENERGY COMM.
T.W.X UNIT

USAEC HQS GTWN

WU WSH

ETLXA201 WAE191(1807)(1-038501C142002)PD 05/22/74 1804

ICS IPM VIA MVN


01272 TDVE MORRIS IL 134 05-22 221P CDT

PMS J F OLEARY DIRECTOR DIRECTORATE OF LICENSING US ATOMIC
ENERGY COMMISSION WUX

WASHINGTON DC 20545

SUBJECT DPR-13 DRESDEN NUCLEAR POWER STATION UNIT 2

THIS WILL CONFIRM A CONVERSATION WITH F MAURA OF YOUR OFFICE
AT 1350 HOURS THIS DATE CONCERNING THE FAILURE IN THE CLOSED
POSITION OF MAIN STEAMLINE DRAIN VALVE MO-2-220-2
ON MAY 22 1974 AT 4AM DURING POST MODIFICATION FUNCTIONAL
TESTING THE VALVE WOULD NOT OPEN FROM THE CONTROL ROOM WHEN
GIVEN AND OPEN SIGNAL WITH THE CONTROL SWITCH THE ISOLATION VALVE
IN SERIES WITH THE FAILED VALVE WAS VERIFIED AND LOGGED IN THE
CLOSED POSITION IN ACCORDANCE WITH THE TECHNICAL SPECIFICATION
AND MAINTENANCE IS TROUBLE SHOOTING THE PROBLEM DETAILS AND

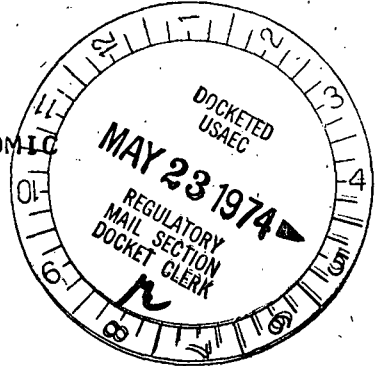

CORRECTIVE ACTION WILL BE FORWARDED IN THE FORM OF A TEN DAY LETTER
IN ACCORDANCE WITH SECTION 6.6..B.1.A OF THE TECHNICAL
SPECIFICATIONS

B B STEPHENSON SUPERINTENDENT DRESDEN NUCLEAR POWER STATION
COMMONWEALTH EDISON COMPANY ROUTE 1 MORRIS IL 60450

NNNN

8103110630

758P EDT +

USAEC HQS GTWN

WU WSH

4601

WESTERN UNION INCOMING

1313.3