

# Commonwealth Edison Company

100 WEST ADAMS STREET \* CHICAGO, ILLINOIS 60690

September 16, 1965

In the Matter of )  
the Application of )  
Commonwealth Edison Company )

AEC Docket  
50-237

U.S. ATOMIC ENERGY COMM.  
REGULATORY  
MAIL SECTION

1965 SEP 16 PM 3 48

RECEIVED

*Journal*  
FILE COPY

Dr. R. L. Doan, Director  
Division of Reactor Licensing  
U. S. Atomic Energy Commission  
Washington, D. C.

Dear Dr. Doan:

Amendment No. 4, dated September 16, 1965, to the Plant Design and Analysis Report previously filed in support of the application of Commonwealth Edison Company for a construction permit and operating license for Dresden Unit 2 is submitted herewith.

Amendment No. 4 consists of the answers to certain questions set forth in your letter addressed to me dated September 3, 1965. As soon as practicable we propose to incorporate the substance of Amendment No. 4 and Amendments No. 2 and 3 as well in the Plant Design and Analysis Report. Until such time as this is accomplished, Amendments No. 2, 3 and 4 should be considered as superseding any inconsistent provisions in the original report. For your convenience, the design changes in Unit 2 reported in Amendments No. 2, 3 and 4 and not yet embodied in the report are as follows:

1. Increase in design pressure of the primary containment suppression pool from 35 psig to 62 psig. See Amendment No. 2, page II-4-1.
2. Substitution of a second core spray system for the core reflooding system. See Amendment No. 2, page II-4-2.
3. Changes in the containment cooling systems increasing flow rates. See Amendment No. 2, page II-4-2.
4. Provision to inert the atmosphere in the primary containment. See Amendment No. 2, page II-4-1, II-4-4.

Dr. R. L. Doan

September 16, 1965

5. Changes in electric power supply for auxiliary systems. See Amendment No. 2, page II-17-1 to II-17-3.
6. Increase in number of TIP assemblies from four to five. See Amendment No. 2, page II-13-1.


As reported in Amendment No. 4, an additional design change to provide a redundant means for controlling potential leakage from the TIP system is currently under consideration.

A request for allocation to Unit 2 of quantities of U-235 for 1967 and subsequent years is also enclosed.

Very truly yours,

COMMONWEALTH EDISON COMPANY


By



Murray Joslin  
Vice-President

Enc.

Subscribed and sworn to  
before me this 16th day  
of September, 1965.

  
Notary Public

File Copy

DRESDEN UNIT 2 FUEL ALLOCATION *(formal)*Assumptions

Thermal power, MW	2,255
Uranium content of core load, lb.	314,430
First core enrichment, w/o U-235	2.00
Reload enrichment, w/o U-235	2.36

## Scrap

3% not recoverable

7% recoverable


Lead time prior to fuel load, reloads

Return schedule:

Scrap: 1 year after withdrawal

Separation products: 1 year after discharge

1 year

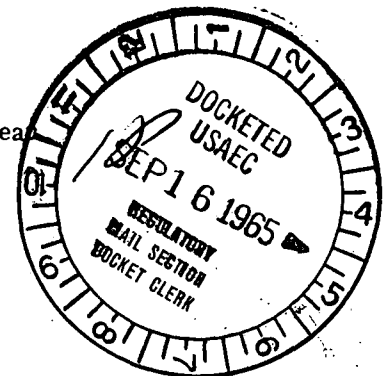Uranium and Plutonium Balances

(All data are weights in Kg)

Year	Withdrawals from AEC U-235	Returns to AEC			Net Yearly Transfers U-235	Cumulative Requirements U-235
		Scrap U-235	U-235	Reprocessed Fuel Fissile Pu		
1967	3133.7	0	0	0	3133.7	3133.7
1968	0	219.4	0	0	-219.4	2914.3
1969	0	0	0	0	0	2914.3
1970	0	0	0	0	0	2914.3
1971	1016.4	0	0	0	1016.4	3930.7
1972	1016.4	71.1	0	0	945.3	4876.0
1973	372.8	71.1	357.1	163.6	-55.4	4820.6
1974	832.5	26.1	386.1	239.7	420.3	5240.9
1975	643.5	58.3	59.7	49.8	525.5	5766.4
1976	643.5	45.0	185.7	91.4	412.8	6179.2
1977	740.6	45.0	116.1	80.9	579.5	6758.7
1978	648.6	51.8	68.1	32.7	528.7	7287.4
1979	556.7	45.4	195.6	119.0	315.7	7603.1
1980	648.6	39.0	220.8	137.2	388.8	7991.9
1981	648.6	45.4	174.8	121.9	428.4	8420.3

NOTE: Future years have essentially the same throughout as 1981.