



Commonwealth Edison  
Dresden Nuclear Power Station  
R.R. #1  
Morris, Illinois 60450  
Telephone 815/942-2920

DSB

February 19, 1981


DJS LTR #81-154

James G. Keppler, Regional Director  
Directorate of Regulatory Operations - Region III  
U.S. Nuclear Regulatory Commission  
799 Roosevelt Road  
Glen Ellyn, IL 60137

Reportable Occurrence Report #81-03/03L-0, Docket #050-249 is being submitted to your office in accordance with Dresden Nuclear Power Station Technical Specification 6.6.B.2.(a), reactor protection system or engineered safety feature instrument settings which are found to be less conservative than those established by the technical specifications but which do not prevent the fulfillment of the functional requirements of affected systems.

*DJ Scott*

D. J. Scott  
Station Superintendent  
Dresden Nuclear Power Station

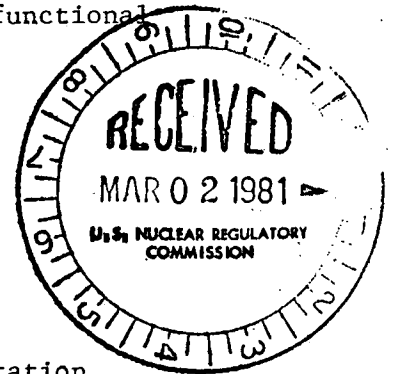

DJS:lg

Enclosure

cc: Director of Inspection & Enforcement  
Director of Management Information & Program Control  
U.S. NRC, Document Mgt. Branch  
File/NRC

A002  
s  
1/1

FEB 23 1981





Commonwealth Edison

# DEVIATION REPORT

DVR NO. \_\_\_\_\_  
 STA UNIT YEAR NO.  
 0 - 12 - 3 - 81 - 7

**PART I** TITLE OF DEVIATION: Isolation Condenser Condensate Line High Flow Switch Above Tech. Spec. Limit  
 OCCURRED DATE: 1-20-81 TIME: 10:00

SYSTEM AFFECTED: 595 PLANT CONDITIONS: Run PWR(MWT): 2440 LOAD(MWE): 809  
 Primary Containment Isolation MODE: Run PWR(MWT): 2440 LOAD(MWE): 809 TESTING:  YES  NO

DESCRIPTION OF EVENT: While performing surveillance DIS 1300-2, switch dPIS3-1349B was found to trip at 34 inches water column differential pressure increasing. Tech. Spec. Limit is less than or equal to 32 inches differential pressure.

DESCRIPTION OF CAUSE: None found

OTHER APPLICABLE INFORMATION

EQUIPMENT FAILURE:  YES  NO DR NO. \_\_\_\_\_ WR NO. \_\_\_\_\_  
 Alan R. Zapotocky 1/20/81  
 RESPONSIBLE SUPERVISOR DATE

**PART 2** OPERATING ENGINEERS COMMENTS: The switch was immediately readjusted to trip within the limits of Tech. Spec. Table 3.2.1

TYPE OF DEVIATION REPORTABLE OCCURRENCE <input type="checkbox"/> 14 DAY <input type="checkbox"/> 10CFR21 <input checked="" type="checkbox"/> 30 DAY NOTIFICATION 6.6.B.2.A	EVENT OF POTENTIAL PUBLIC INTEREST <input type="checkbox"/>	TECH SPEC VIOLATION <input type="checkbox"/>	NON-REPORTABLE OCCURRENCE <input type="checkbox"/>	ANNUAL REPORTING YES <input checked="" type="checkbox"/> NO <input type="checkbox"/>	SAFETY-RELATED WR ISSUED YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>
--	--	---	---	---	---

REPORTABLE OCCURRENCE NUMBER 81-03/03L-0	ACTION ITEM NO.	PROMPT ON-SITE NOTIFICATION R. M. Ragan 1/22/81 11:50 AM TITLE DATE TIME
---	-----------------	--

24-HOUR NRC NOTIFICATION <input type="checkbox"/> TPH REGION III DATE TIME <input type="checkbox"/> TGM REGION III & DOL DATE TIME	PROMPT OFF-SITE NOTIFICATION F. A. Palmer 1/22/81 1:37 PM TITLE DATE TIME
--	---

RESPONSIBLE COMPANY OFFICER INFORMED OF 10CFR21 CONDITIONS AND THEIR REPORT TO NRC \_\_\_\_\_  
 REVIEW AND COMPLETED: Michael Wright 1/22/81 OPERATING ENGINEER DATE

ACCEPTANCE BY STATION REVIEW AS REQUIRED: J. Brunner 2/19/81  
 DATE: 2/19/81  
 RESOLUTION APPROVED AND AUTHORIZED FOR DISTRIBUTION: Douglas J. Cort 2/19/81  
 STATION SUPERINTENDENT DATE