

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR:7902010164 DOC.DATE: 79/01/18 NOTARIZED: NO
 FACIL:50-335 St. Lucie Plant-1, Florida Power & Light Co.
 AUTH.NAME AUTHOR AFFILIATION
 UHRIG,R.E. Florida Power & Light Co.
 RECIP.NAME RECIPIENT AFFILIATION
 O'REILLY,J.P. Region 2, Atlanta, Office of the Director

DOCKET #
0500033

SUBJECT: Forwards Reportable Occurrence 335-B-78-09 on 781227.

DISTRIBUTION CODE: CO03S COPIES RECEIVED:LTR 1 ENCL 1 SIZE: 1+2
 TITLE: ENVIRON. EVENT/ABNORMAL OCCURENCE.

NOTES: _____

ACTION:	RECIPIENT	COPIES		RECIPIENT	COPIES	
	ID CODE/NAME	LTR	ENCL	ID CODE/NAME	LTR	ENCL
	05 BC <i>ORB #4</i>	7	7			
INTERNAL:	01 <u>REG FILE</u>	1	1	02 NRC PDR	1	1
	12 I & E	2	2	14 OELD	1	1
	15 TA/EDO	1	1	16 MPA	1	1
	17 FEB	1	1	18 CROCKER,L.	1	1
	19 ENVI SPEC BR	1	1	20 EFFL TR SYS	1	1
	21 DIR DSE	1	1			
EXTERNAL:	03 LPDR	1	1	04 NSIC	1	1
	22 ACRS	1	1			


FEB 5 1979

5 1979

TOTAL NUMBER OF COPIES REQUIRED: LTR 22 ENCL 22

*NO 4
GD*

1-1

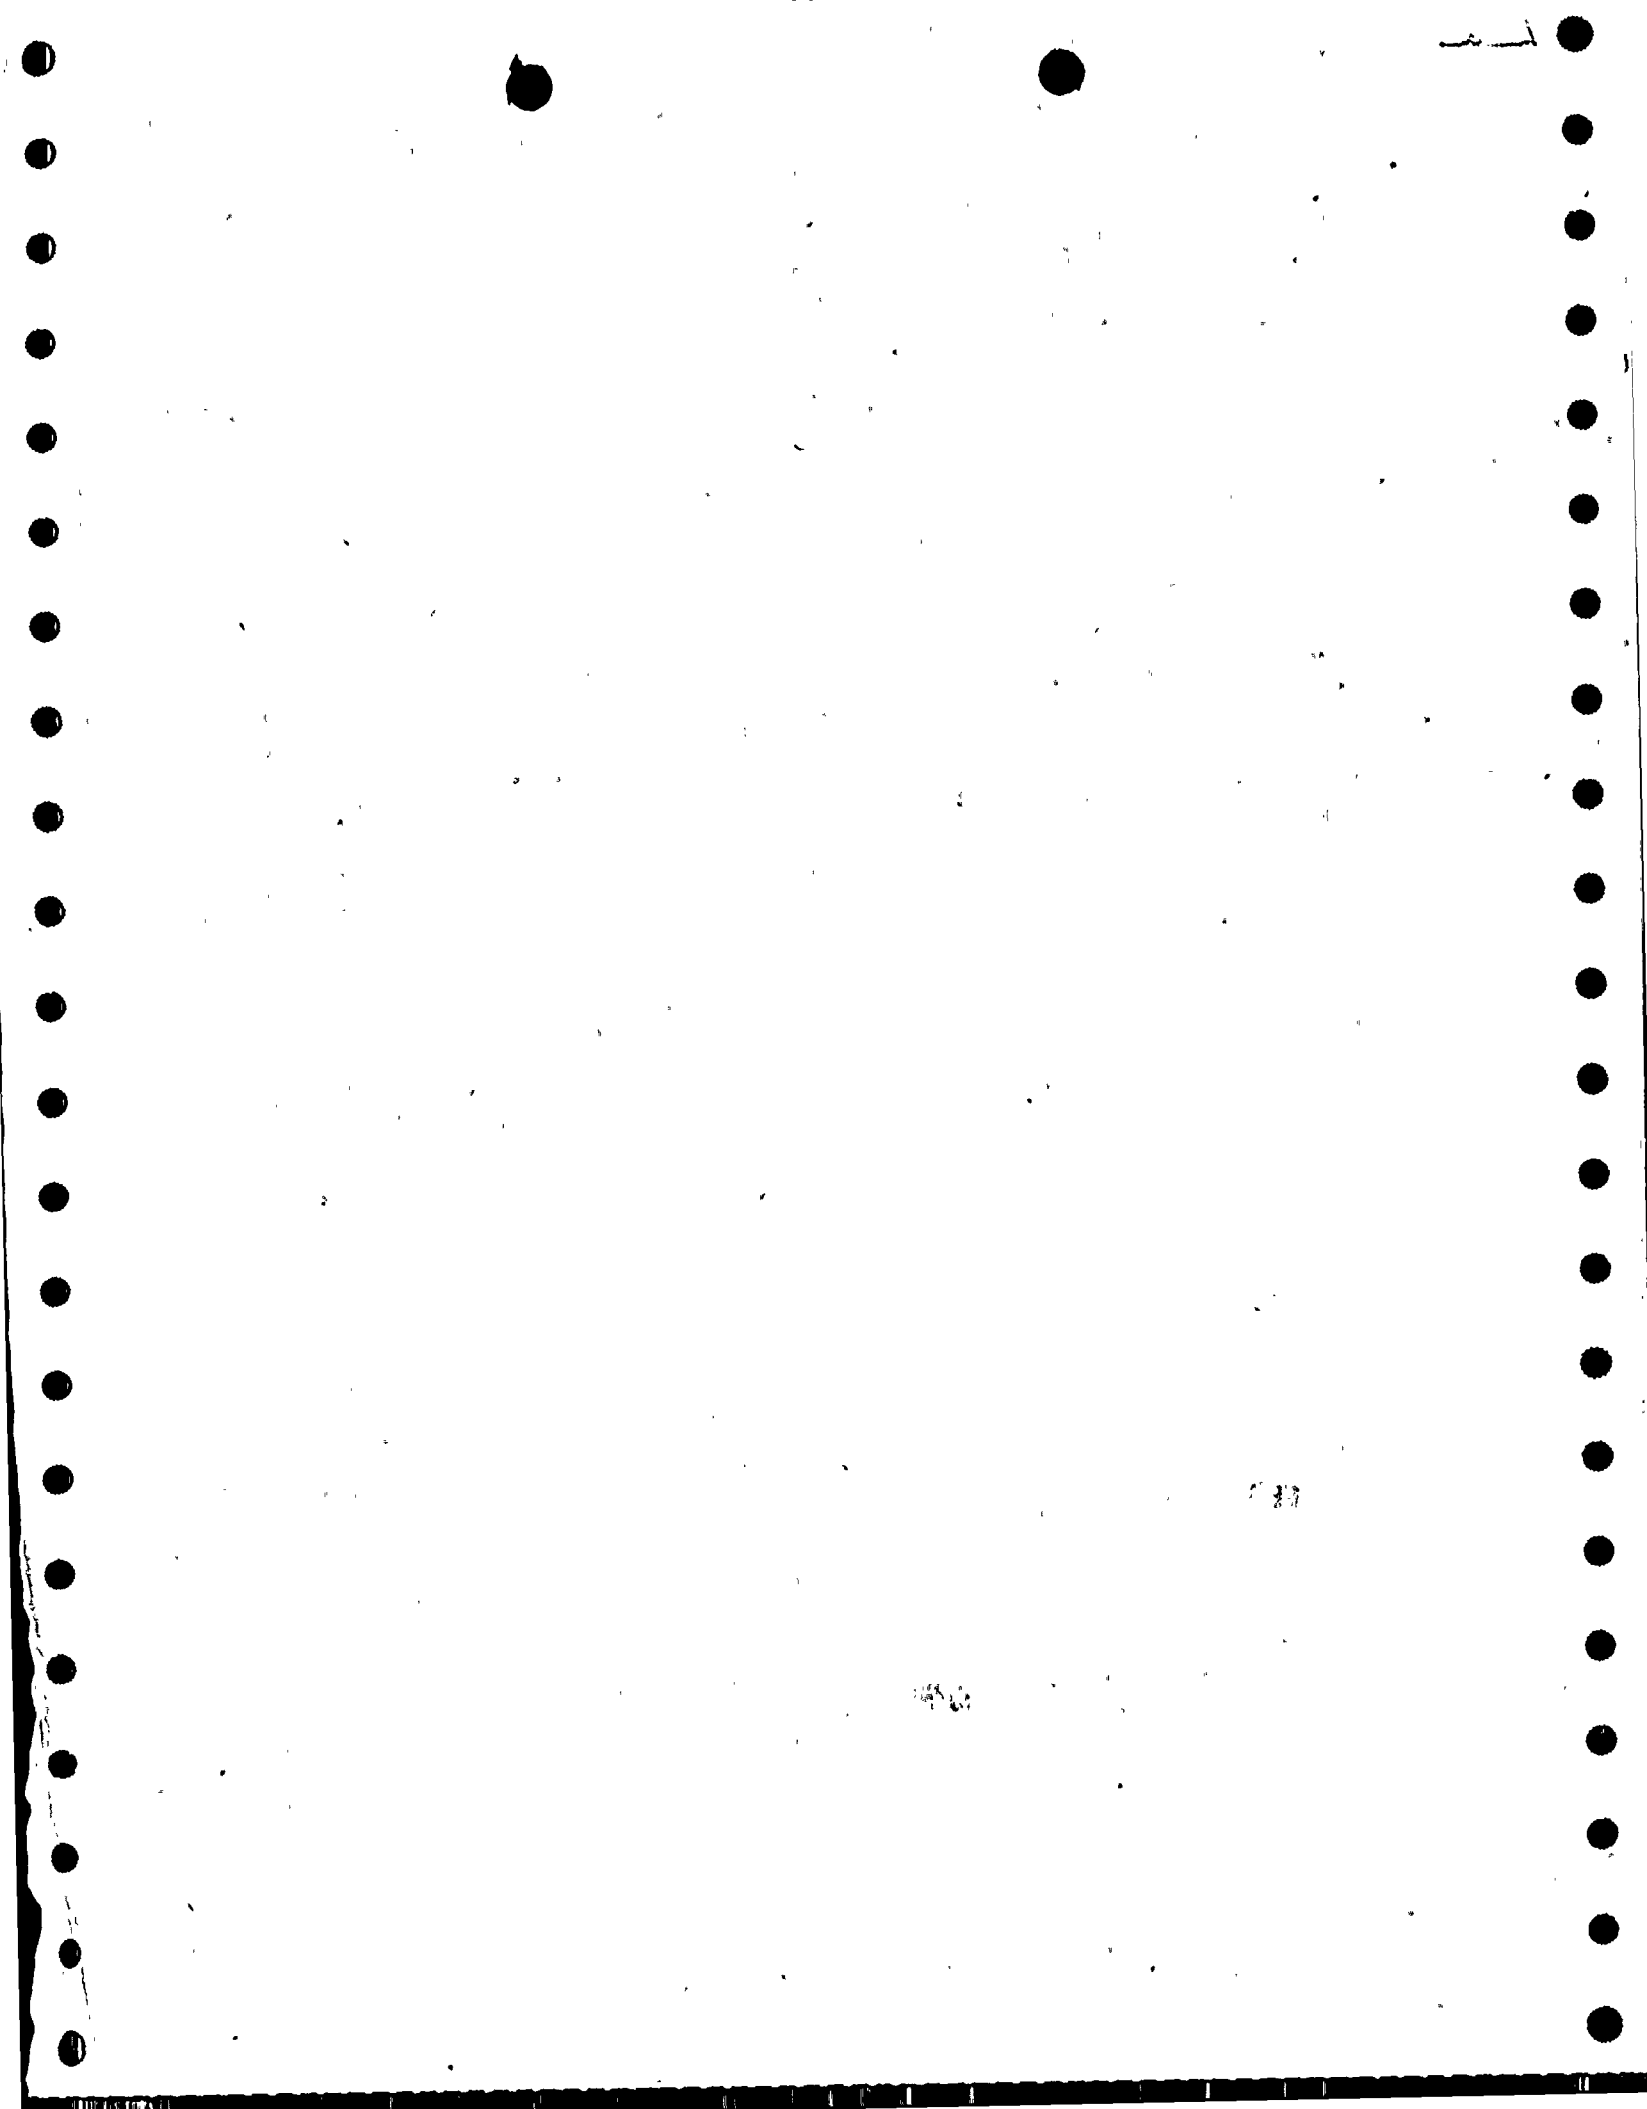



January 18, 1979
L-79-13

Mr. J. P. O'Reilly, Director, Region II
Office of Inspection & Enforcement
U.S. Nuclear Regulatory Commission
101 Marietta St., Suite 3100
Atlanta, GA 30303

Dear Mr. O'Reilly:

Reportable Occurrence No. 335-B-78-09
St. Lucie Plant Unit No. 1
Date of Occurrence: December 27, 1978

Title: Maximum Condenser Temperature Rise

The attached Non-Routine Environmental Operating Report is being submitted in accordance with Environmental Technical Specification 5.6.2.a.2 to provide 30-day notification of the subject occurrence.

Very truly yours,

A handwritten signature in cursive script, appearing to read "R. E. Uhrig".

R. E. Uhrig
Vice President

REU/NLR:jak

cc: Mr. John G. Davis, Acting Director
Office of Inspection & Enforcement

Robert Lowenstein, Esq.

REGULATORY DOCKET FILE COPY

003
S
1/1

7902010 164

YMO 1971-1972