

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR:7905140310 DOC.DATE: 79/05/08 NOTARIZED: NO DOCKET #  
 FACIL:50-335 ST. LUCIE PLANT, UNIT 1, FLORIDA POWER & LIGHT CO. 05000335  
 AUTH.NAME AUTHOR AFFILIATION  
 UHRIG,R.E. FLORIDA POWER & LIGHT CO.  
 RECIP.NAME RECIPIENT AFFILIATION  
 STELLO,V. OFFICE OF NUCLEAR REACTOR REGULATION

SUBJECT: REVIEWS IMPACT OF USING NRC FISSION GAS RELEASE ENHANCEMENT  
 FACTORS ON RESULTS OF CYCLE 3 SAFETY ANALYSES.DETERMINES  
 APPLICATION OF FACTORS DOES NOT ADVERSELY AFFECT CYCLE 3  
 RESULTS OF 790222.

DISTRIBUTION CODE: A001S COPIES RECEIVED:LTR 3 ENCL 0 SIZE: 1  
 TITLE: GENERAL DISTRIBUTION FOR AFTER ISSUANCE OF OPERATING LIC


NOTES:


ACTION:	RECIPIENT	COPIES		RECIPIENT	COPIES	
	ID CODE/NAME	LTR	ENCL		ID CODE/NAME	LTR
	05 BC ORB #4	7				
INTERNAL:	01 REG FILE	1	1	02 NRC PDR	1	1
	12 I&E	2	2	14 TA/EDO	1	1
	15 CORE PERF BR	1	1	16 AD SYS/PROJ	1	1
	17 ENGR BR	1	1	18 REAC SFTY BR	1	1
	19 PLANT SYS BR	1	1	20 EEB	1	1
	21 EFLT TRT SYS	1	1	22 BRINKMAN	1	1
EXTERNAL:	03 LPDR	1	1	04 NSIC	1	1
	23 ACRS	16	16			

MAY 16 1979

MA 4  
 60

TOTAL NUMBER OF COPIES REQUIRED: LTR 38 ENCL <sup>0</sup>38

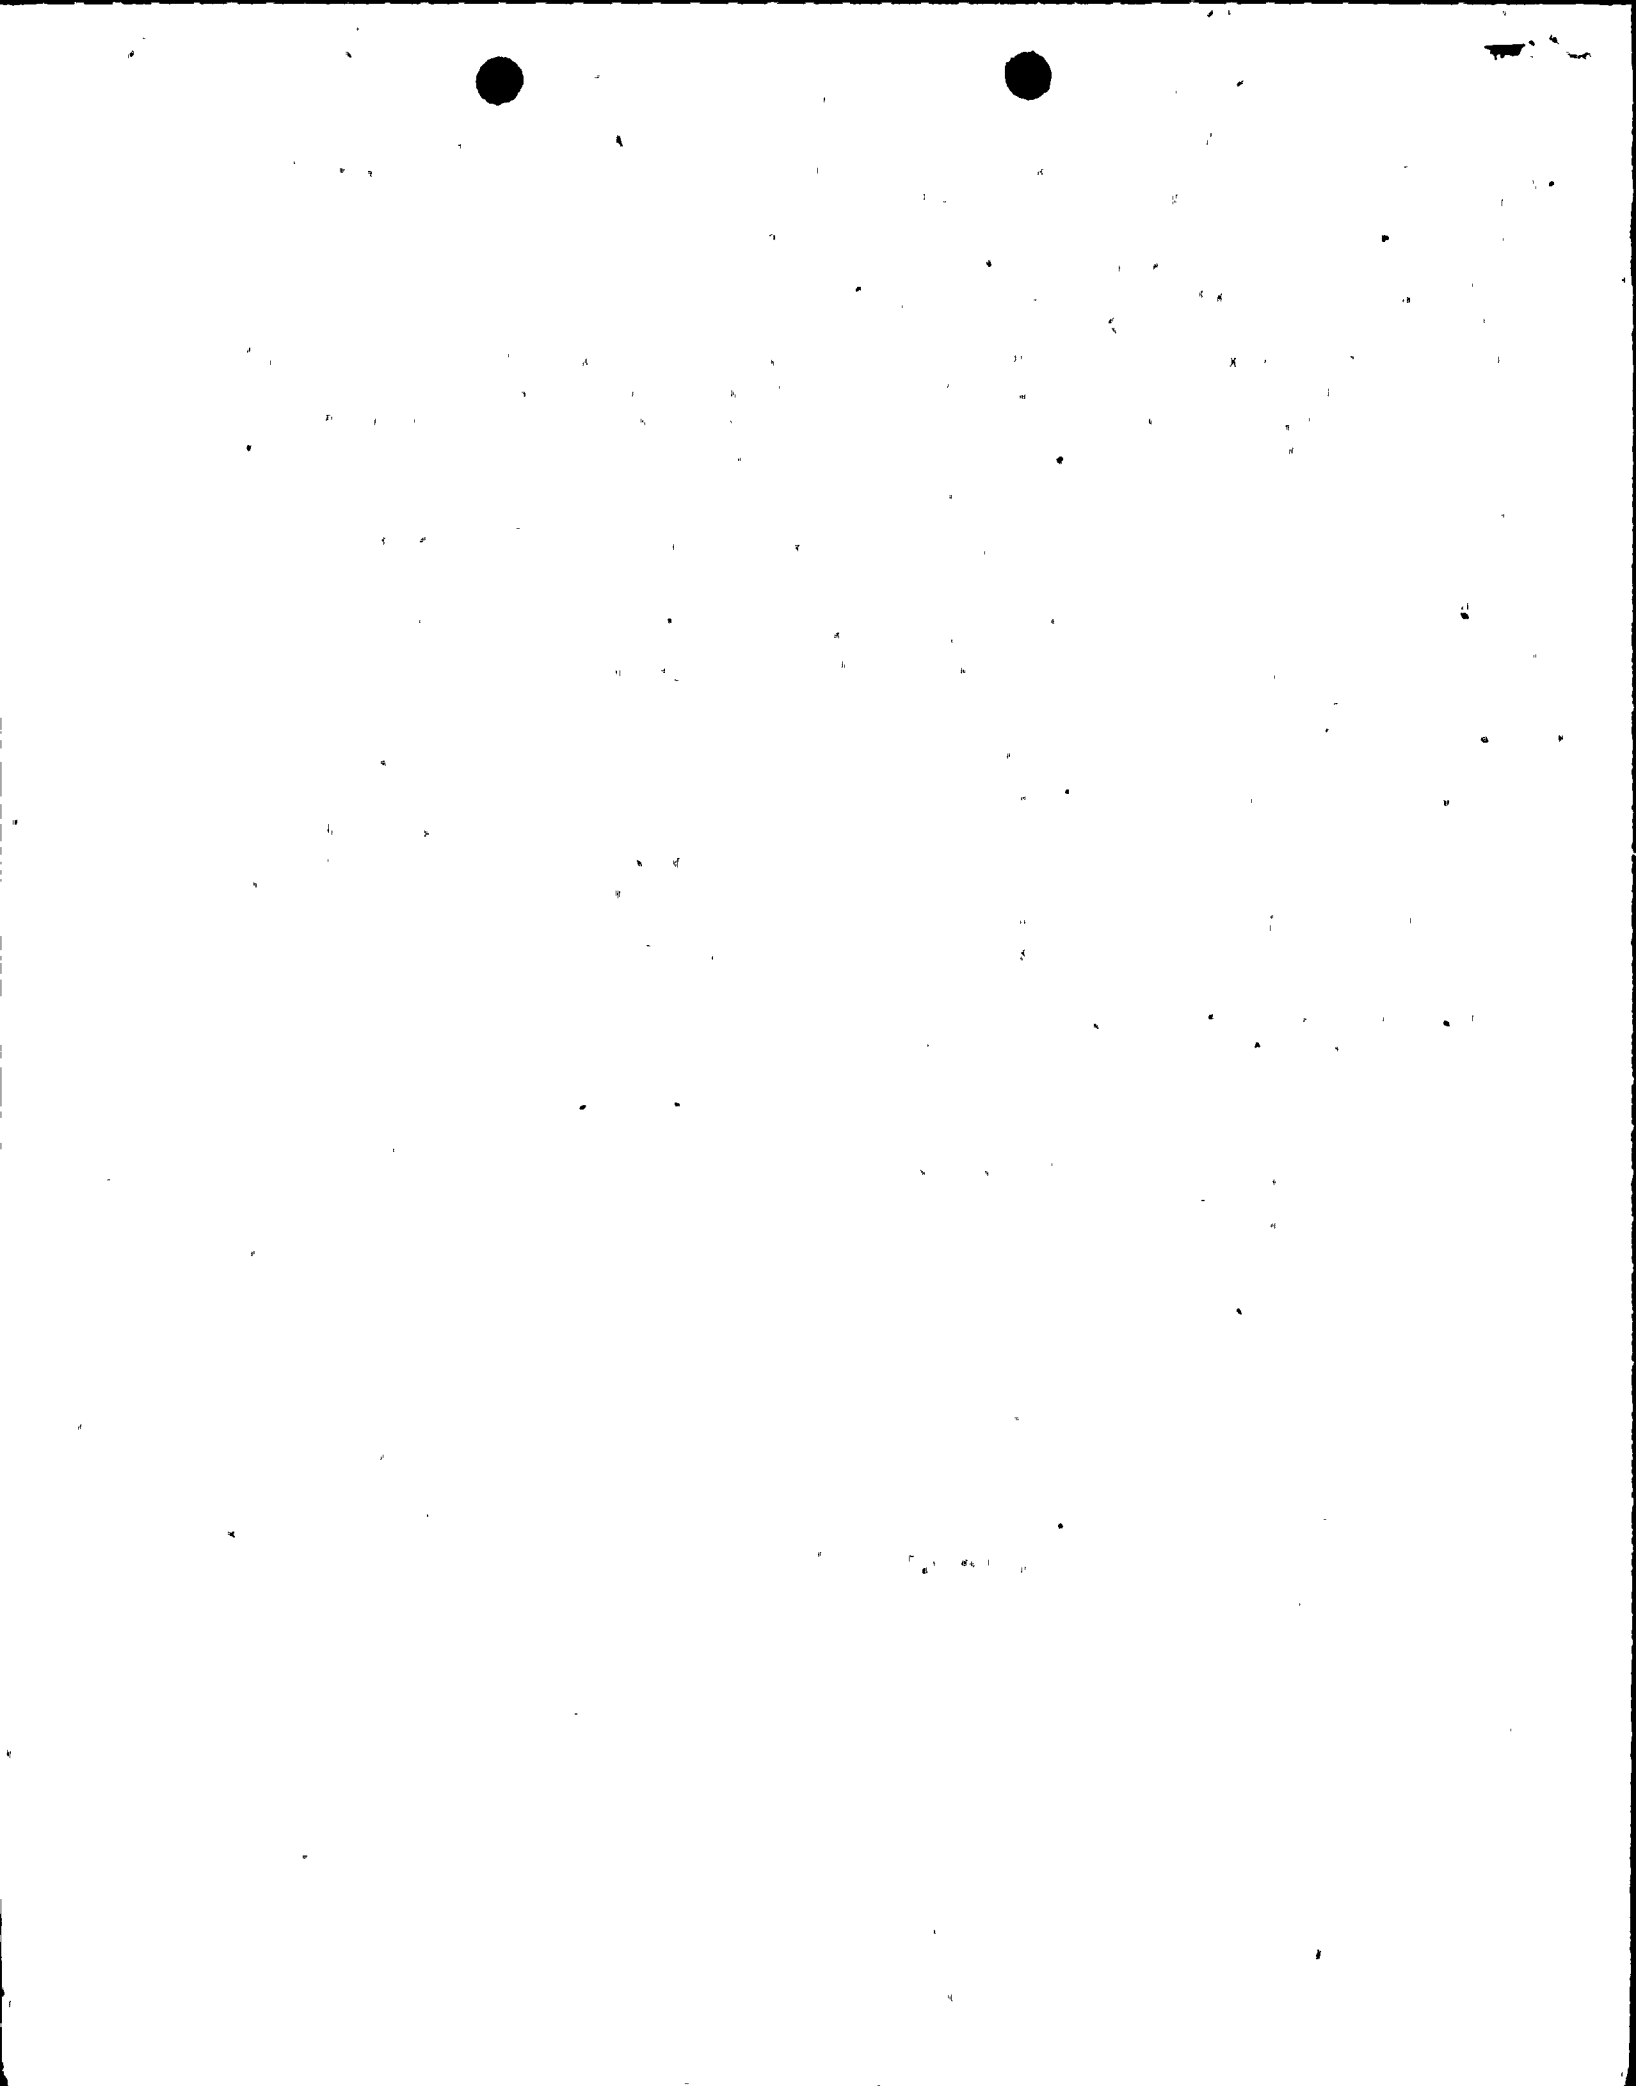

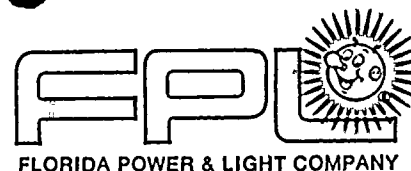

May 8, 1979  
L-79-114

Office of Nuclear Reactor Regulation  
Attention: Mr. Victor Stello, Director  
Division of Operating Reactors  
U. S. Nuclear Regulatory Commission  
Washington, D. C. 20555

Dear Mr. Stello:

Re: St. Lucie Unit 1  
Docket No. 50-335  
Effects of Using NRC Fission Gas Release  
Enhancement Factors on St. Lucie 1  
Cycle 3, Safety Analyses

The impact of using the NRC fission gas release enhancement factors on the results of the St. Lucie - 1 cycle 3 safety analyses has been reviewed. It was determined that the application of these factors does not adversely affect the results of the cycle 3 safety analyses submitted to you on February 22, 1979 (L-79-45).

This information is provided to you in accordance with our commitment of June 27, 1977 (L-77-194).

Very truly yours,

Robert E. Uhrig  
Vice President  
Advanced Systems & Technology

REU:TCG:cf

cc: Mr. James P. O'Reilly, Region II  
Harold F. Reis, Esquire

*Handwritten:* A001  
3/10

7905140370