



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

FLORIDA POWER & LIGHT COMPANY

DOCKET NO. 50-335

ST. LUCIE PLANT UNIT NO. 1


AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 32
License No. DPR-67

- 1: The Nuclear Regulatory Commission (the Commission) has found that:
- A. The applications for amendment by Florida Power & Light Company (the licensee) dated November 9, 1978 and February 22, 1979, as supplemented April 30 and May 1, 10, 18, 22 and 23, 1979, comply with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act), and the Commission's rules and regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the applications, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public;
and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.

7907090

184

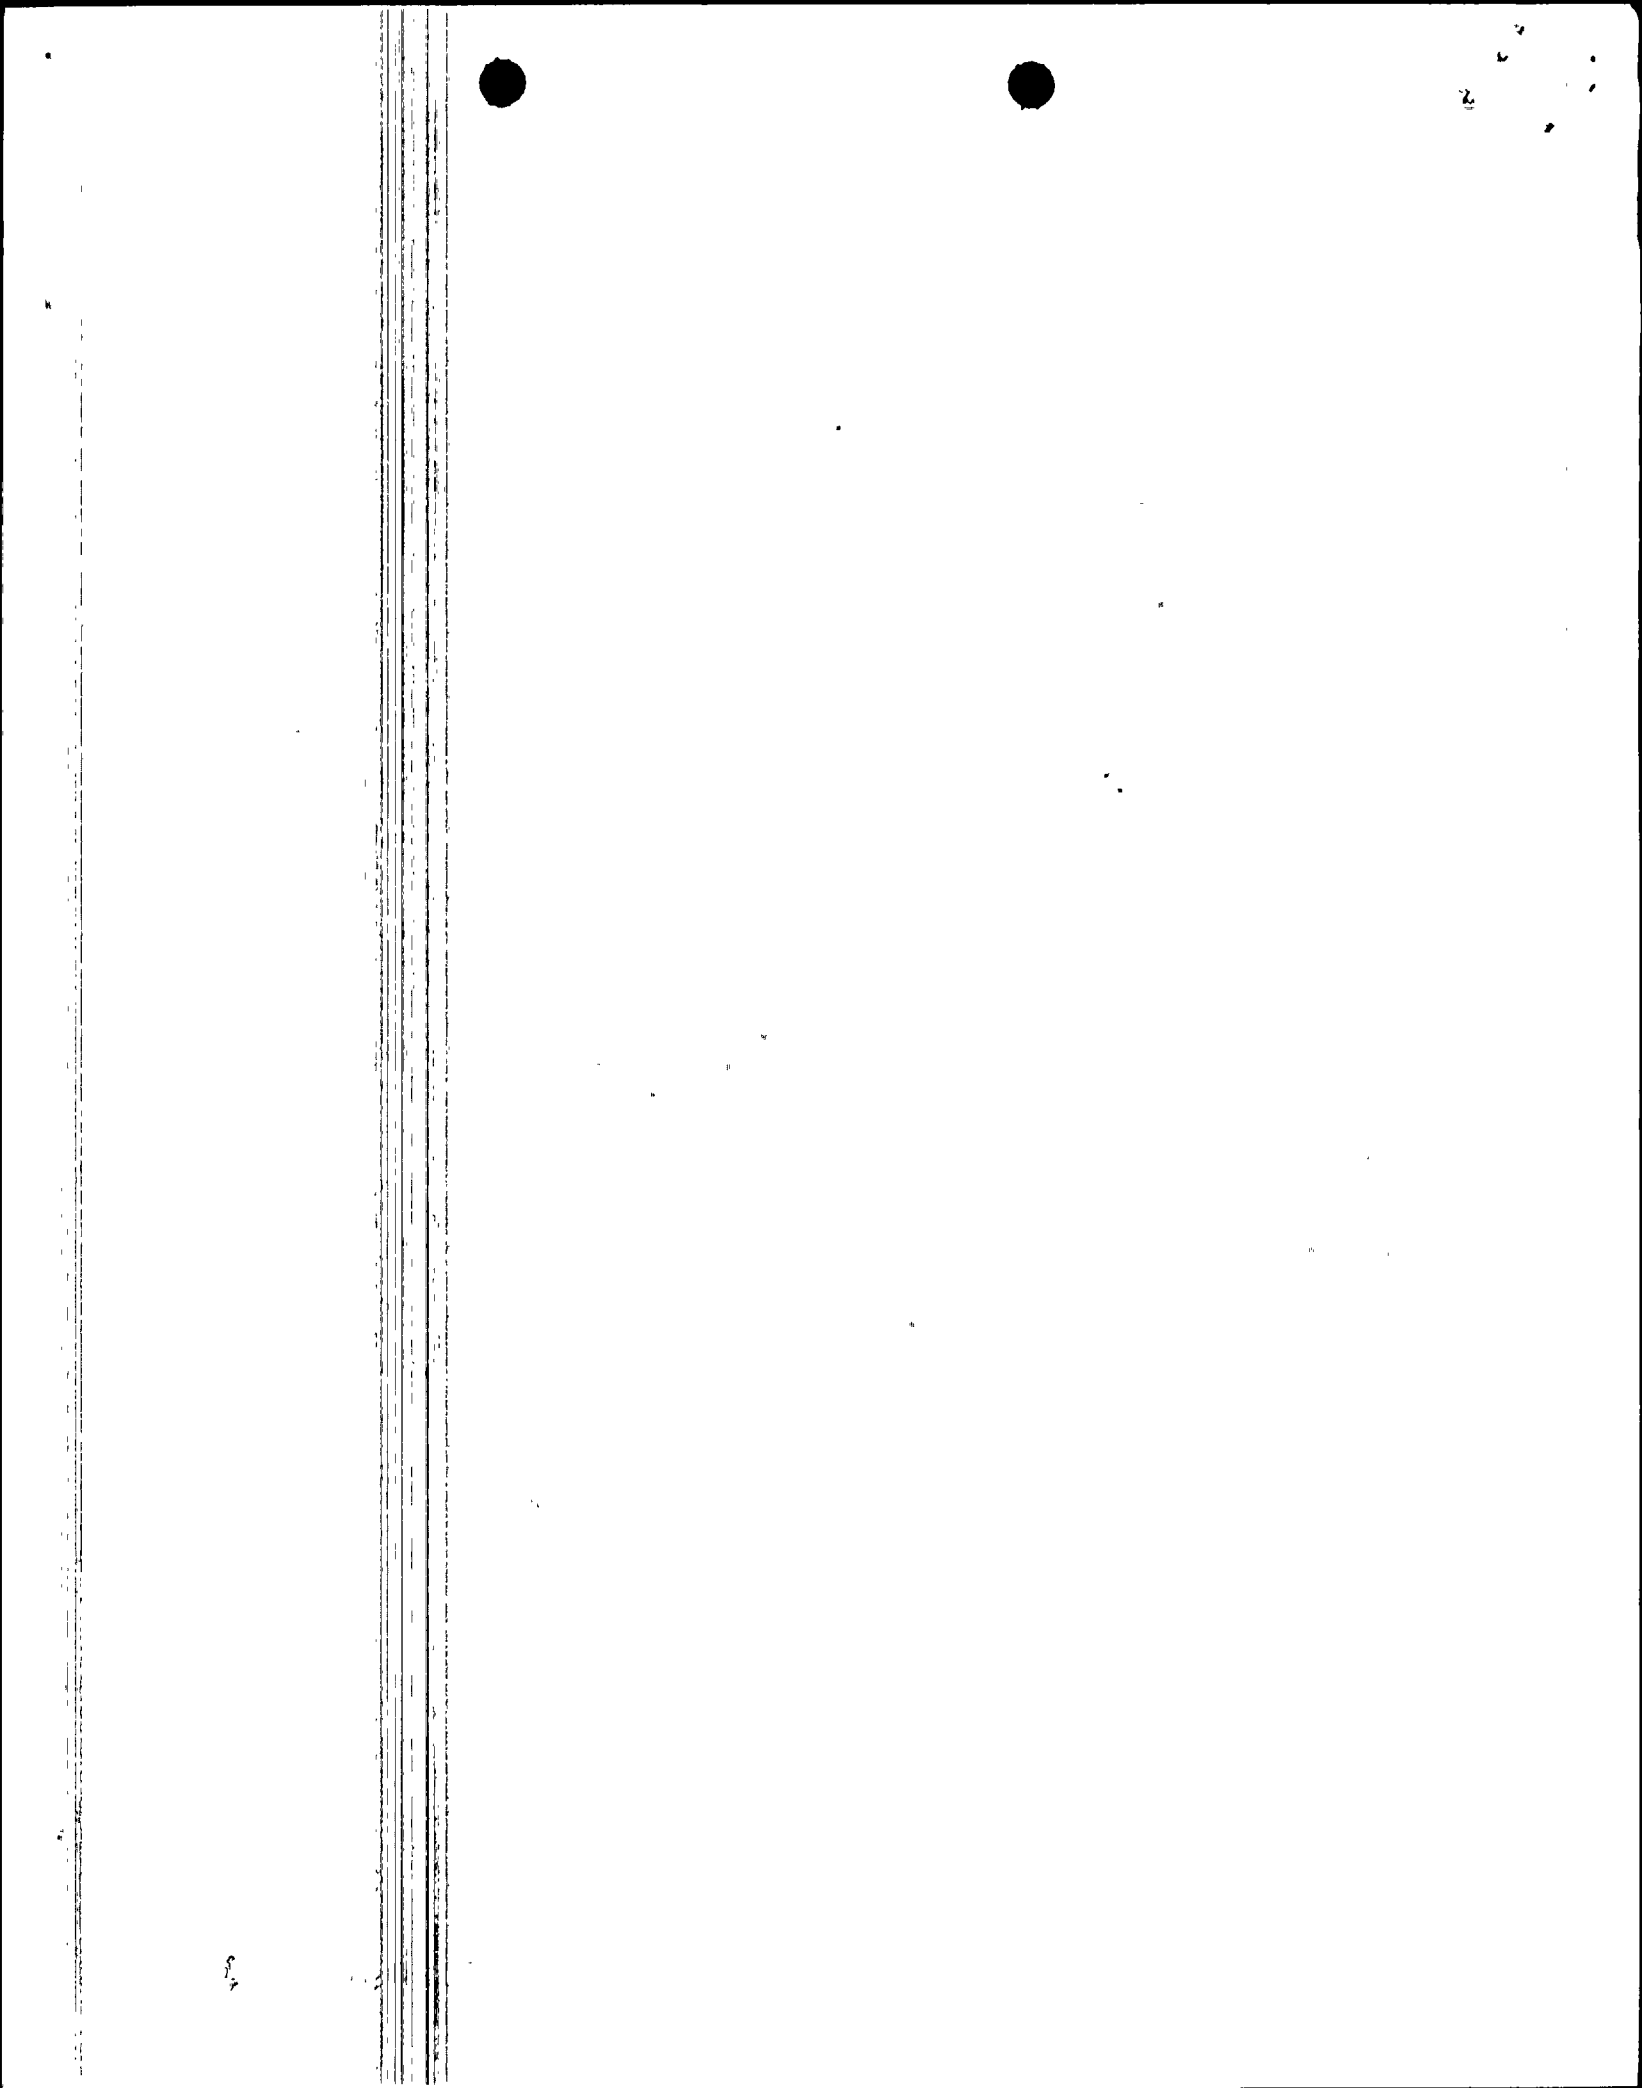

2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment, and by the following changes to Facility Operating License No. DPR-67:

A. Revise paragraph 2.C.(2) in its entirety to read as follows:

Technical Specifications

The Technical Specifications contained in Appendices A and B, as revised through Amendment No. 32, are hereby incorporated in the license. The licensee shall operate the facility in accordance with the Technical Specifications.

B. Delete in its entirety condition D of Enclosure 1 appended to the license.

3. This license amendment is effective as of the date of its issuance.


FOR THE NUCLEAR REGULATORY COMMISSION



Robert W. Reid, Chief
Operating Reactors Branch #4
Division of Operating Reactors

Attachment:
Changes to the Technical
Specifications

Date of Issuance: May 27, 1979

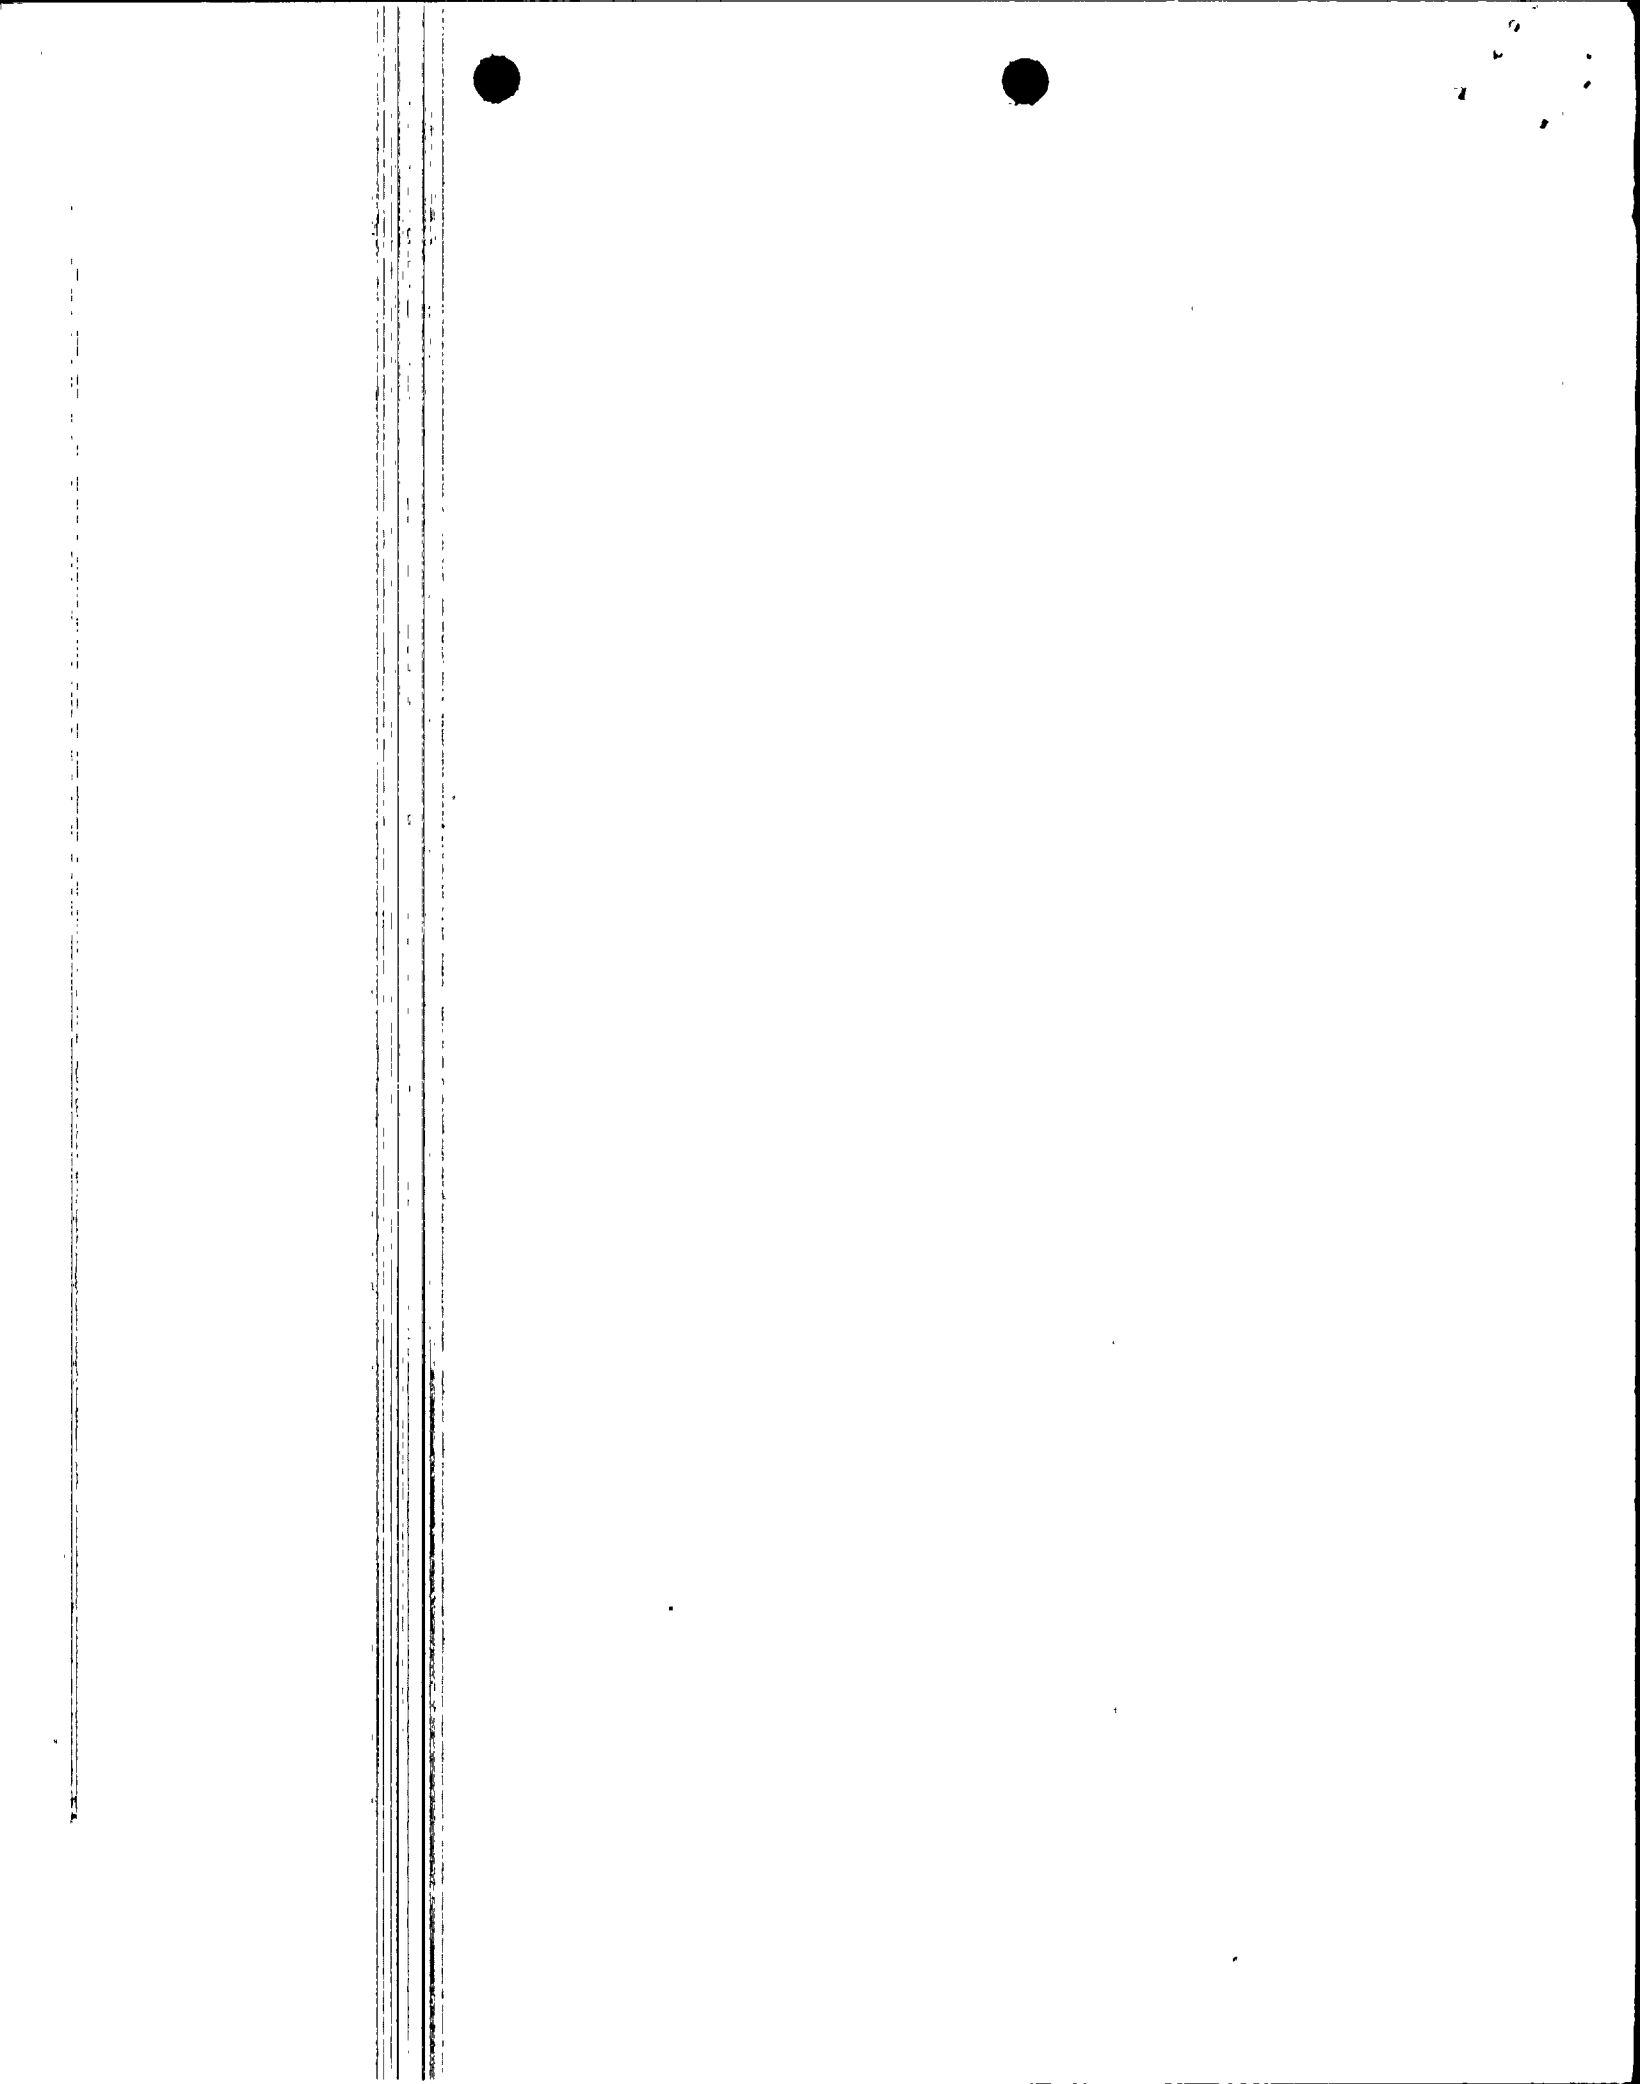

ATTACHMENT TO LICENSE AMENDMENT NO. 32


FACILITY OPERATING LICENSE NO. DPR-67

DOCKET NO. 50-335

Replace the following pages of the Appendix "A" Technical Specifications with the enclosed pages. The revised pages are identified by Amendment number and contain vertical lines indicating the area of change. The corresponding overleaf pages are also provided to maintain document completeness.

Pages

I
1-6
2-4
2-7
B 2-5
3/4 1-26
2/4 2-1
3/4 2-2
3/4 2-3
3/4 2-4
3/4 2-5
3/4 2-6
3/4 2-8
3/4 2-9
3/4 2-11
3/4 2-15
B 3/4 1-4
B 3/4 2-1

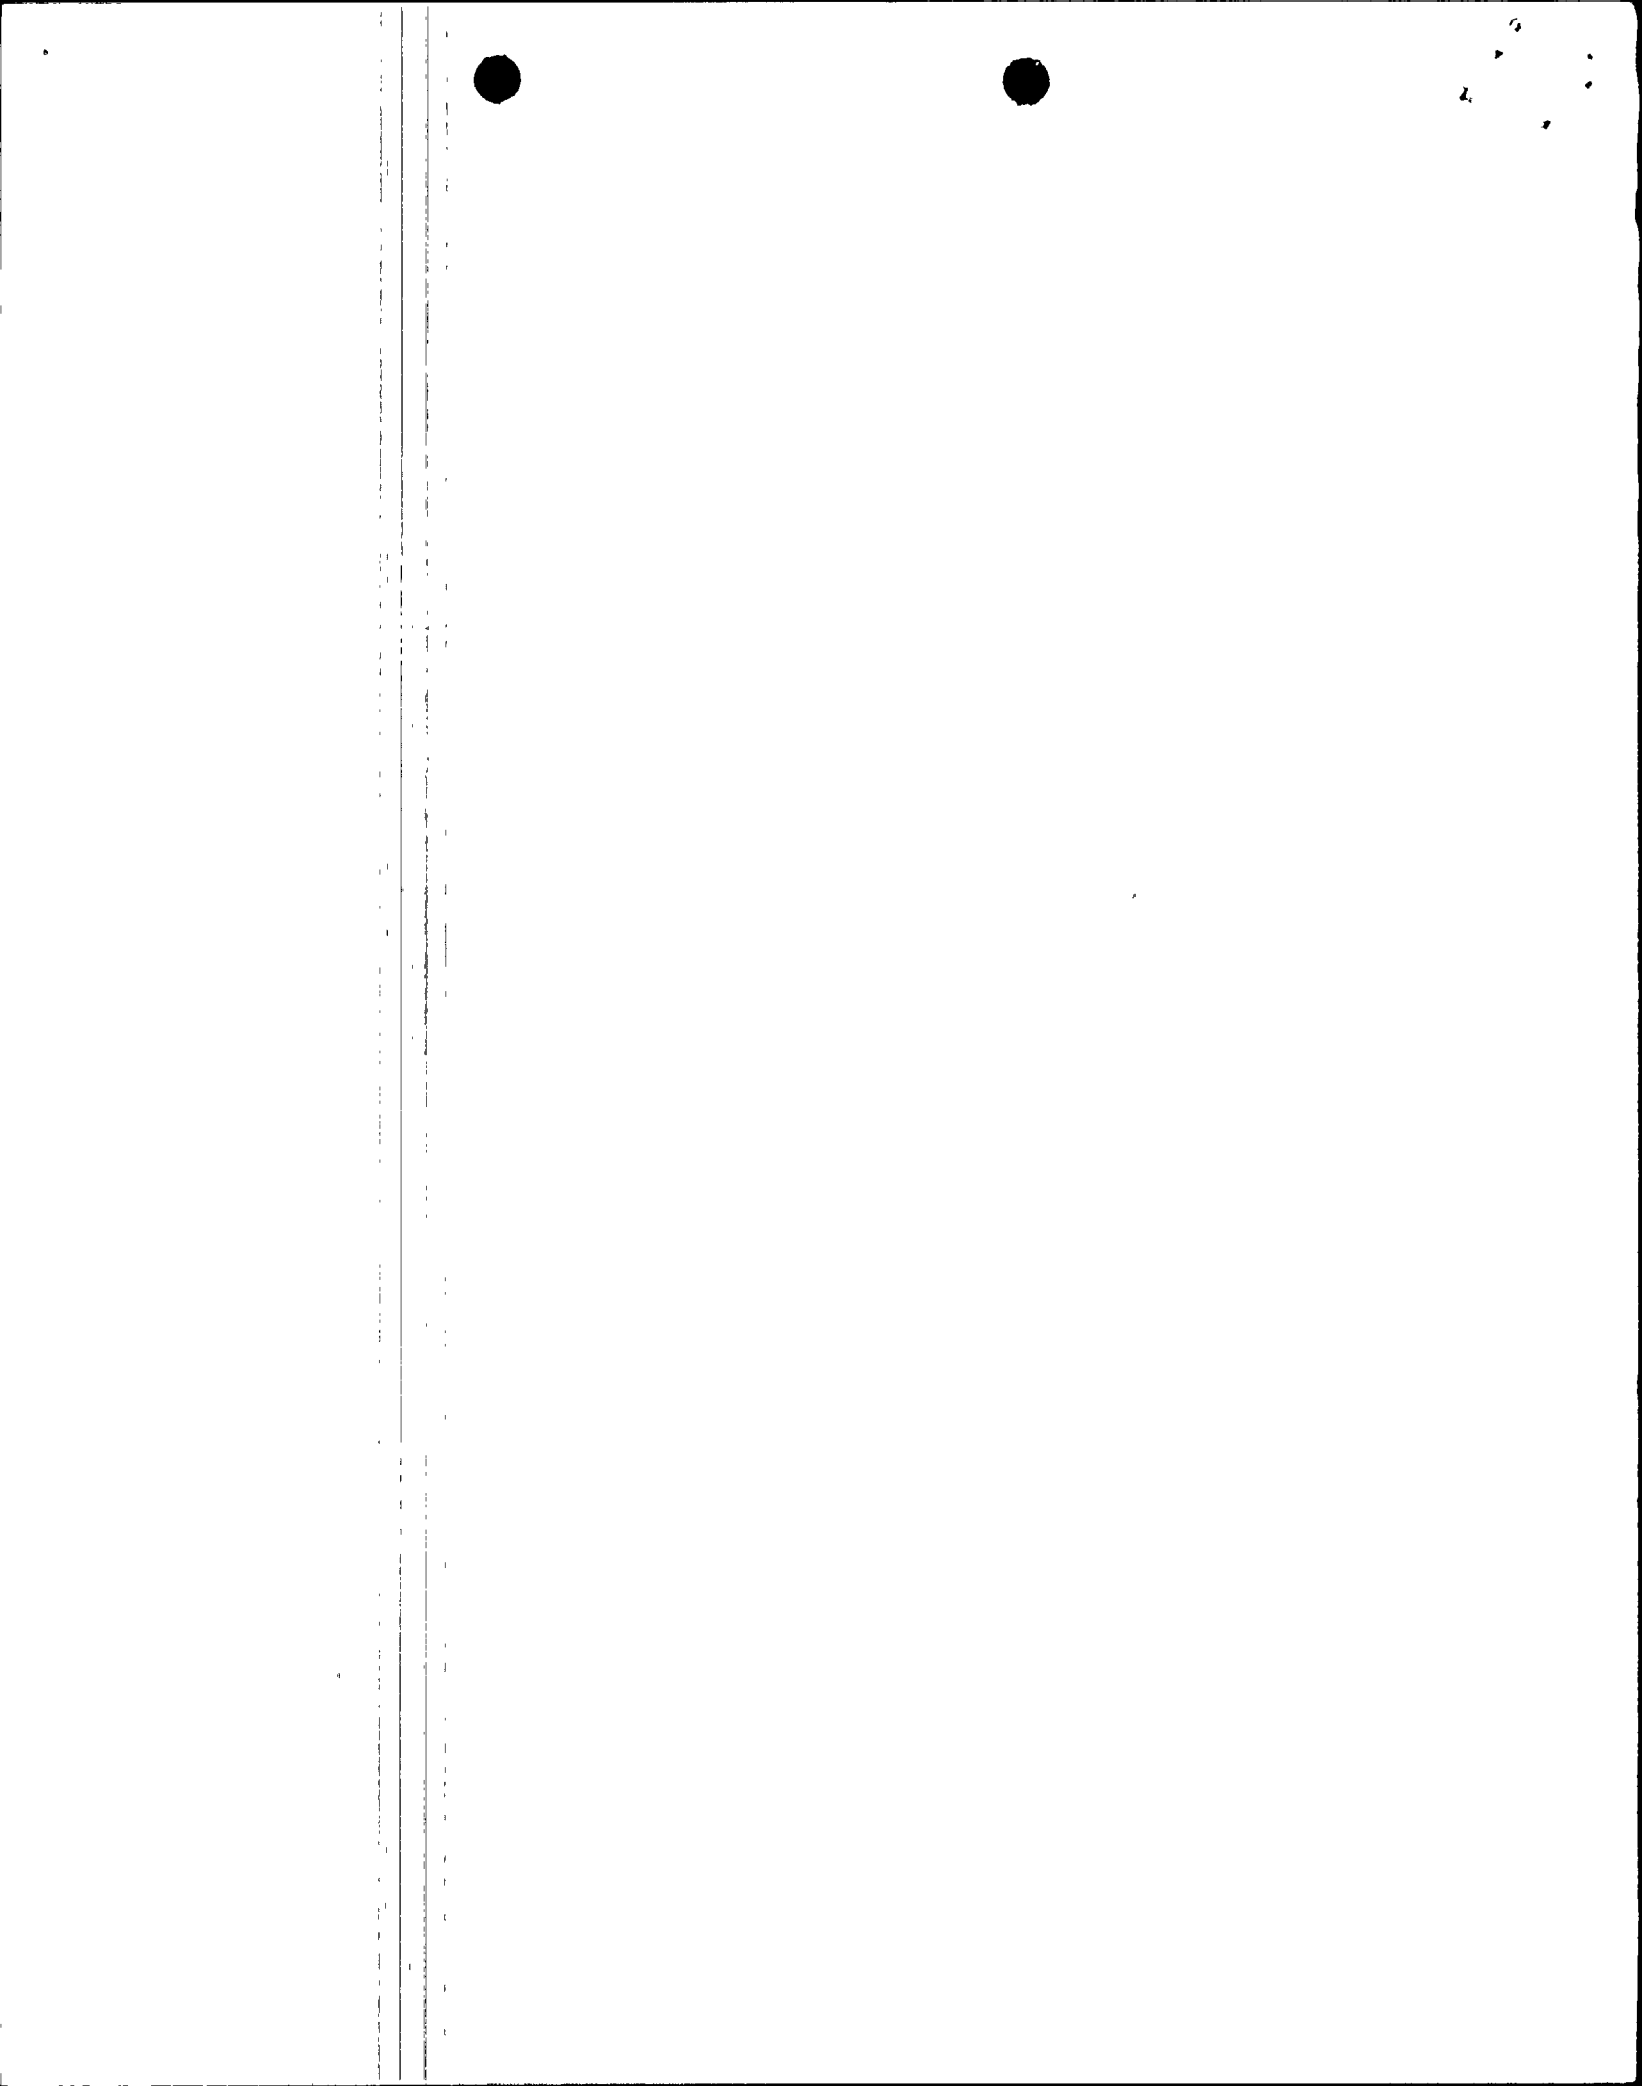

INDEX

DEFINITIONS

<u>SECTION</u>	<u>PAGE</u>
<u>1.0 DEFINITIONS</u>	
Defined Terms.....	1-1
Thermal Power.....	1-1
Rated Thermal Power.....	1-1
Operational Mode.....	1-1
Action.....	1-1
Operable - Operability.....	1-1
Reportable Occurrence.....	1-1
Containment Vessel Integrity.....	1-2
Channel Calibration.....	1-2
Channel Check.....	1-2
Channel Functional Test.....	1-3
Core Alteration.....	1-3
Shutdown Margin.....	1-3
Identified Leakage.....	1-3
Unidentified Leakage.....	1-4
Pressure Boundary Leakage.....	1-4
Controlled Leakage	1-4
Azimuthal Power Tilt.....	1-4
Dose Equivalent I-131.....	1-4
\bar{E} - Average Disintegration Energy	1-4
Staggered Test Basis.....	1-5
Frequency Notation.....	1-5
Axial Shape Index.....	1-5
Unrodded Planar Radial Peaking Factor - F_{xy}	1-5
Shield Building Integrity.....	1-5
Reactor Trip System Response Time.....	1-6
Engineered Safety Feature Response Time.....	1-6
Physics Tests.....	1-6
Unrodded Integrated Radial Peaking Factor.....	1-6
Load Follow Operation.....	1-6

INDEX

SAFETY LIMITS AND LIMITING SAFETY SYSTEM SETTINGS

<u>SECTION</u>	<u>PAGE</u>
<u>2.1 SAFETY LIMITS</u>	
Reactor Core	2-1
Reactor Coolant System Pressure	2-1
<u>2.2 LIMITING SAFETY SYSTEM SETTINGS</u>	
Reactor Trip Setpoints	2-3

BASES

<u>SECTION</u>	<u>PAGE</u>
<u>2.1 SAFETY LIMITS</u>	
Reactor Core.....	B 2-1
Reactor Coolant System Pressure	B 2-3
<u>2.2 LIMITING SAFETY SYSTEM SETTINGS</u>	
Reactor Trip Setpoints	B 2-4

DEFINITIONS

STAGGERED TEST BASIS

1.21 A STAGGERED TEST BASIS shall consist of:

- a. A test schedule for n systems, subsystems, trains or other designated components obtained by dividing the specified test interval into n equal subintervals, and
- b. The testing of one system, subsystem, train or other designated component at the beginning of each subinterval.

FREQUENCY NOTATION

1.22 The FREQUENCY NOTATION specified for the performance of Surveillance Requirements shall correspond to the intervals defined in Table 1.2.

AXIAL SHAPE INDEX

1.23 The AXIAL SHAPE INDEX (Y_E) is the power level detected by the lower excore nuclear instrument detectors (L) less the power level detected by the upper excore nuclear instrument detectors (U) divided by the sum of these power levels. The AXIAL SHAPE INDEX (Y_I) used for the trip and pretrip signals in the reactor protection system is the above value (Y_E) modified by an appropriate multiplier (A) and a constant (B) to determine the true core axial power distribution for that channel.

$$Y_E = \frac{L-U}{L+U}$$

$$Y_I = AY_E + B$$

UNRODDED PLANAR RADIAL PEAKING FACTOR - F_{xy}

1.24 The UNRODDED PLANAR RADIAL PEAKING FACTOR is the maximum ratio of the peak to average power density of the individual fuel rods in any of the unrodded horizontal planes, excluding tilt.

SHIELD BUILDING INTEGRITY

1.25 SHIELD BUILDING INTEGRITY shall exist when:

- 1.25.1 Each door is closed except when the access opening is being used for normal transit entry and exit, and
- 1.25.2 The shield building ventilation system is OPERABLE.

DEFINITIONS

REACTOR TRIP SYSTEM RESPONSE TIME

1.26 The REACTOR TRIP SYSTEM RESPONSE TIME shall be the time interval from when the monitored parameter exceeds its trip setpoint at the channel sensor until electrical power is interrupted to the CEA drive mechanism.

ENGINEERED SAFETY FEATURE RESPONSE TIME

1.27 The ENGINEERED SAFETY FEATURE RESPONSE TIME shall be that time interval from when the monitored parameter exceeds its ESF actuation setpoint at the channel sensor until the ESF equipment is capable of performing its safety function (i.e., the valves travel to their required positions, pump discharge pressures reach their required values, etc.). Times shall include diesel generator starting and sequence loading delays where applicable.

PHYSICS TESTS

1.28 PHYSICS TESTS shall be those tests performed to measure the fundamental nuclear characteristics of the reactor core and related instrumentation and 1) described in Chapter 14.0 of the FSAR, 2) authorized under the provisions of 10 CFR 50.59, or 3) otherwise approved by the Commission.

UNRODDED INTEGRATED RADIAL PEAKING FACTOR - F_r

1.29 The UNRODDED INTEGRATED RADIAL PEAKING FACTOR is the ratio of the peak pin power to the average pin power in an unrodded core, excluding tilt.

LOAD FOLLOW OPERATION

1.30 LOAD FOLLOW OPERATION shall be daily power level changes of more than 10% of RATED THERMAL POWER or daily insertion of CEAs below the Long Term Insertion Limit.

SAFETY LIMITS AND LIMITING SAFETY SYSTEM SETTINGS

2.2 LIMITING SAFETY SYSTEM SETTINGS

REACTOR TRIP SETPOINTS

2.2.1 The reactor protective instrumentation setpoints shall be set consistent with the Trip Setpoint values shown in Table 2.2-1.

APPLICABILITY: AS SHOWN FOR EACH CHANNEL IN TABLE 3.3-1.

ACTION:

With a reactor protective instrumentation setpoint less conservative than the value shown in the Allowable Values column of Table 2.2-1, declare the channel inoperable and apply the applicable ACTION statement requirement of Specification 3.3.1.1 until the channel is restored to OPERABLE status with its trip setpoint adjusted consistent with the Trip Setpoint value.

TABLE 2.2-1

REACTOR PROTECTIVE INSTRUMENTATION TRIP SETPOINT LIMITS

<u>FUNCTIONAL UNIT</u>	<u>TRIP SETPOINT</u>	<u>ALLOWABLE VALUES</u>
1. Manual Reactor Trip	Not Applicable	Not Applicable
2. Power Level - High (1) Four Reactor Coolant Pumps Operating	$\leq 9.61\%$ above THERMAL POWER, with a minimum setpoint of 15% of RATED THERMAL POWER, and a maximum of $\leq 107.0\%$ of RATED THERMAL POWER.	$\leq 9.61\%$ above THERMAL POWER, and a minimum setpoint of 15% of RATED THERMAL POWER and a maximum of $\leq 107.0\%$ of RATED THERMAL POWER.
3. Reactor Coolant Flow - Low (1) Four Reactor Coolant Pumps Operating	$\geq 95\%$ of design reactor coolant flow with 4 pumps operating*	$\geq 95\%$ of design reactor coolant flow with 4 pumps operating*
4. Pressurizer Pressure - High	≤ 2400 psia	≤ 2400 psia
5. Containment Pressure - High	≤ 3.3 psig	≤ 3.3 psig
6. Steam Generator Pressure - Low (2)	≥ 500 psia	≥ 500 psia
7. Steam Generator Water Level -Low	$\geq 37.0\%$ Water Level - each steam generator	$\geq 37.0\%$ Water Level - each steam generator
8. Local Power Density - High (3)	Trip setpoint adjusted to not exceed the limit lines of Figures 2.2-1 and 2.2-2	Trip set point adjusted to not exceed the limit lines of Figures 2.2-1 and 2.2-2.

*Design reactor coolant flow with 4 pumps operating is 370,000 gpm.

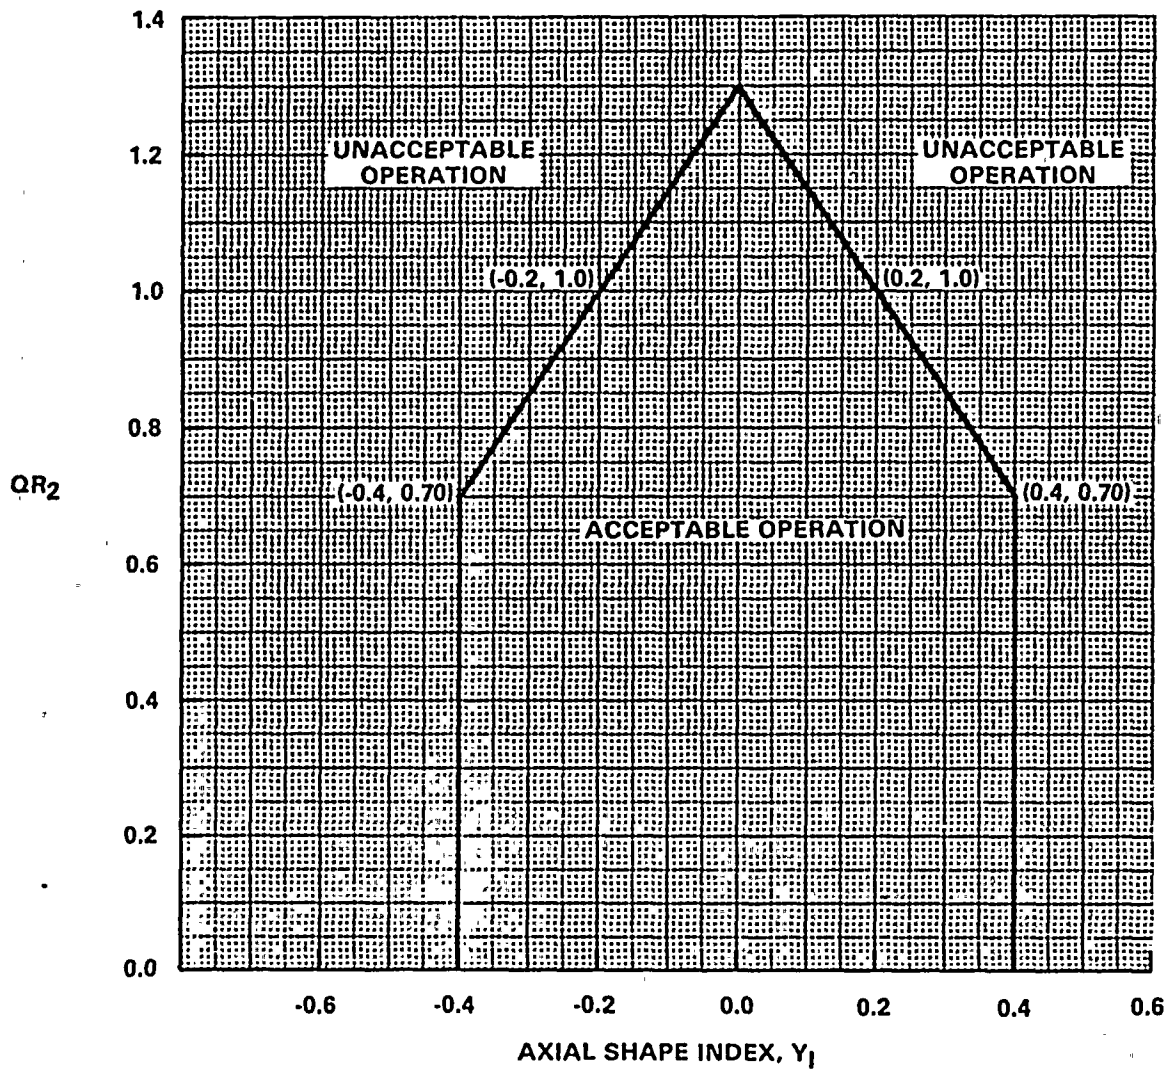


FIGURE 2.2-2
Local Power Density-High Trip Setpoint Part 2 (QR₂ Versus Y₁)

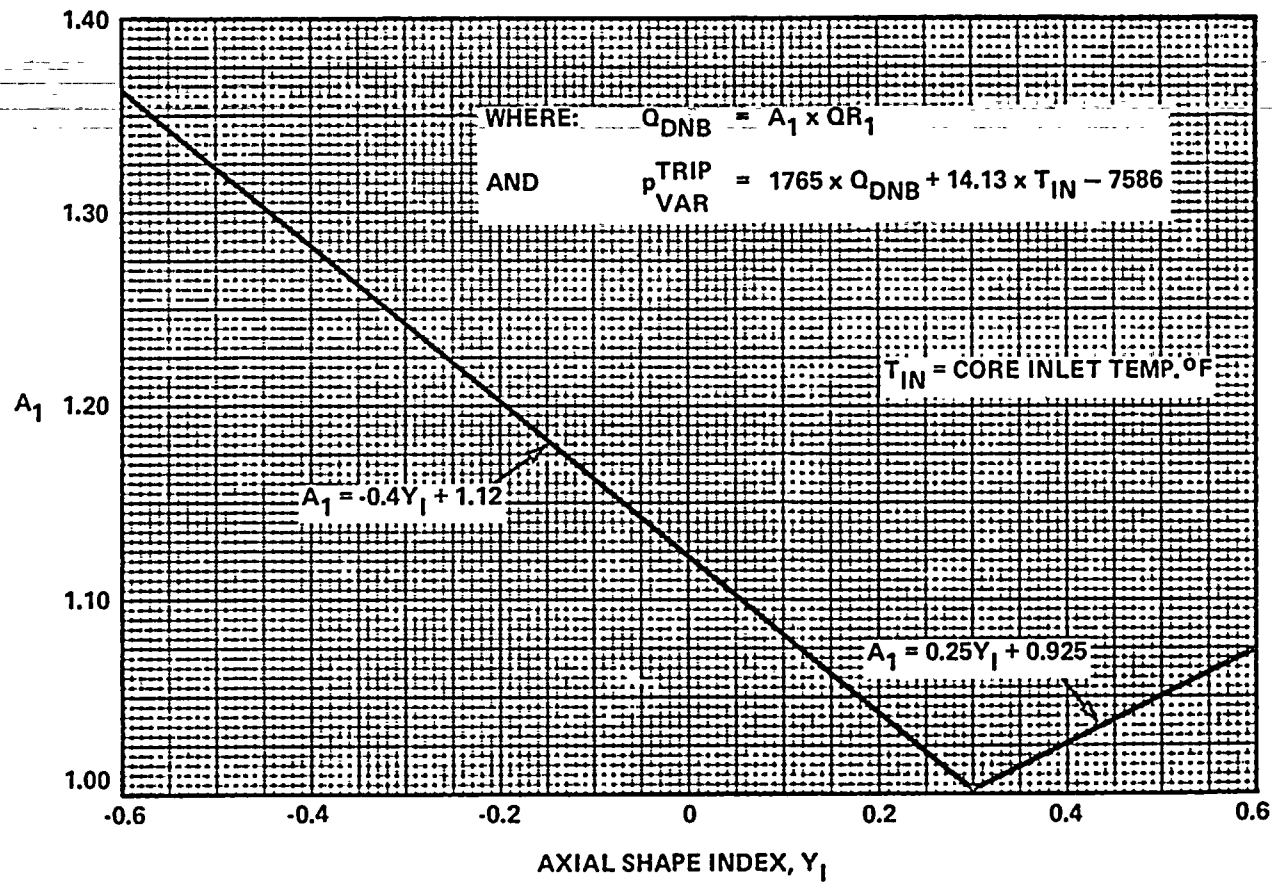


FIGURE 2.2-3
Thermal Margin/Low Pressure Trip Setpoint
Part 1 (Y_1 Versus A_1)

2.2 LIMITING SAFETY SYSTEM SETTINGS

BASES

Reactor Coolant Flow-Low (Continued)

reactor coolant pumps are taken out of service. The low-flow trip setpoints and Allowable Values for the various reactor coolant pump combinations have been derived in consideration of instrument errors and response times of equipment involved to maintain the DNBR above 1.30 under normal operation and expected transients. For reactor operation with only two or three reactor coolant pumps operating, the Reactor Coolant Flow-Low trip setpoints, the Power Level-High trip setpoints, and the Thermal Margin/Low Pressure trip setpoints are automatically changed when the pump condition selector switch is manually set to the desired two- or three-pump position. Changing these trip setpoints during two and three pump operation prevents the minimum value of DNBR from going below 1.30 during normal operational transients and anticipated transients when only two or three reactor coolant pumps are operating.

Pressurizer Pressure-High

The Pressurizer Pressure-High trip, backed up by the pressurizer code safety valves and main steam line safety valves, provides reactor coolant system protection against overpressurization in the event of loss of load without reactor trip. This trip's setpoint is 100 psi below the nominal lift setting (2500 psia) of the pressurizer code safety valves and its concurrent operation with the power-operated relief valves avoids the undesirable operation of the pressurizer code safety valves.

Containment Pressure-High

The Containment Pressure-High trip provides assurance that a reactor trip is initiated concurrently with a safety injection.

Steam Generator Pressure-Low

The Steam Generator Pressure-Low trip provides protection against an excessive rate of heat extraction from the steam generators and subsequent cooldown of the reactor coolant. The setting of 500 psia is sufficiently below the full-load operating point of 800 psig so as not

LIMITING SAFETY SYSTEM SETTINGS

BASES

Steam Generator Pressure-Low (Continued)

to interfere with normal operation, but still high enough to provide the required protection in the event of excessively high steam flow. This setting was used with an uncertainty factor of ± 22 psi in the accident analyses.

Steam Generator Water Level - Low

The Steam Generator Water Level-Low trip provides core protection by preventing operation with the steam generator water level below the minimum volume required for adequate heat removal capacity and assures that the design pressure of the reactor coolant system will not be exceeded due to loss of steam generator heat sink. The specified setpoint provides allowance that there will be sufficient water inventory in the steam generators at the time of trip to provide a margin of more than 10 minutes before auxiliary feedwater is required.

Local Power Density-High

The local Power Density-High trip, functioning from AXIAL SHAPE INDEX monitoring, is provided to ensure that the peak local power density in the fuel which corresponds to fuel centerline melting will not occur as a consequence of axial power maldistributions. A reactor trip is initiated whenever the AXIAL SHAPE INDEX exceeds the allowable limits of Figure 2.2-2. The AXIAL SHAPE INDEX is calculated from the upper and lower ex-core neutron detector channels. The calculated setpoints are generated as a function of THERMAL POWER level with the allowed CEA group position being inferred from the THERMAL POWER level. The trip is automatically bypassed below 15 percent power.

The maximum AZIMUTHAL POWER TILT and maximum CEA misalignment permitted for continuous operation are assumed in generation of the setpoints. In addition, CEA group sequencing in accordance with the Specifications 3.1.3.5 and 3.1.3.6 is assumed. Finally, the maximum insertion of CEA banks which can occur during any anticipated operational occurrence prior to a Power Level-High trip is assumed.

REACTIVITY CONTROL SYSTEMS

POSITION INDICATOR CHANNELS (Continued)

LIMITING CONDITION FOR OPERATION

- b) The CEA group(s) with the inoperable position indicator is fully inserted, and subsequently maintained fully inserted, while maintaining the withdrawal sequence and THERMAL POWER level required by Specification 3.1.3.6 and when this CEA group reaches its fully inserted position, the "Full In" limit of the CEA with the inoperable position indicator is actuated and verifies this CEA to be fully inserted. Subsequent operation shall be within the limits of Specification 3.1.3.6.
- c. With a maximum of one reed switch position indicator channel per group or one pulse counting position indicator channel per group inoperable and the CEA(s) with the inoperable position indicator channel at either its fully inserted position or fully withdrawn position, operation may continue provided:
 1. The position of this CEA is verified immediately and at least once per 12 hours thereafter by its "Full In" or "Full Out" limit (as applicable),
 2. The fully inserted CEA group(s) containing the inoperable position indicator channel is subsequently maintained fully inserted, and
 3. Subsequent operation is within the limits of Specification 3.1.3.6.
- d. With one or more pulse counting position indicator channels inoperable, operation in MODES 1 and 2 may continue for up to 24 hours provided all of the reed switch position indicator channels are OPERABLE.

SURVEILLANCE REQUIREMENTS

4.1.3.3 Each position indicator channel shall be determined to be OPERABLE by verifying the pulse counting position indicator channels and the reed switch position indicator channels agree within 4.5 inches at least once per 12 hours except during time intervals when the Deviation circuit is inoperable, then compare the pulse counting position indicator and reed switch position indicator channels at least once per 4 hours.

REACTIVITY CONTROL SYSTEMS

CEA DROP TIME

LIMITING CONDITION FOR OPERATION

3.1.3.4 The individual full length (shutdown and control) CEA drop time, from a fully withdrawn position, shall be ≤ 3.1 seconds from when electrical power is interrupted to the CEA drive mechanism until the CEA reaches its 90 percent insertion position with:

- a. $T_{avg} \geq 515^{\circ}\text{F}$, and
- b. All reactor coolant pumps operating.

APPLICABILITY: MODE 3.

ACTION:

- a. With the drop time of any full length CEA determined to exceed the above limit, restore the CEA drop time to within the above limit prior to proceeding to MODE 1 or 2.
- b. With the CEA drop times within limits but determined at less than full reactor coolant flow, operation may proceed provided THERMAL POWER is restricted to less than or equal to the maximum THERMAL POWER level allowable for the reactor coolant pump combination operating at the time of CEA drop time determination.

SURVEILLANCE REQUIREMENTS

4.1.3.4 The CEA drop time of full length CEAs shall be demonstrated through measurement prior to reactor criticality:

- a. For all CEAs following each removal of the reactor vessel head,
- b. For specifically affected individual CEAs following any maintenance on or modification to the CEA drive system which could affect the drop time of those specific CEAs, and
- c. At least once per 18 months.

3/4.2 POWER DISTRIBUTION LIMITS

LINEAR HEAT RATE

LIMITING CONDITION FOR OPERATION

3.2.1 The linear heat rate shall not exceed the limits shown on Figure 3.2-1.

APPLICABILITY: MODE 1.

ACTION:

With the linear heat rate exceeding its limits, as indicated by four or more coincident incore channels or by the AXIAL SHAPE INDEX outside of the power dependent control limits of Figure 3.2-2, within 15 minutes initiate corrective action to reduce the linear heat rate to within the limits and either:

- a. Restore the linear heat rate to within its limits within one hour, or
- b. Be in HOT STANDBY within the next 6 hours.

SURVEILLANCE REQUIREMENTS

4.2.1.1 The provisions of Specification 4.0.4 are not applicable.

4.2.1.2 The linear heat rate shall be determined to be within its limits by continuously monitoring the core power distribution with either the excore detector monitoring system or with the incore detector monitoring system.

4.2.1.3 Excore Detector Monitoring System - The excore detector monitoring system may be used for monitoring the core power distribution by:

- a. Verifying at least once per 12 hours that the full length CEAs are withdrawn to and maintained at or beyond the Long Term Steady State Insertion Limit of Specification 3.1.3.6.
- b. Verifying at least once per 31 days that the AXIAL SHAPE INDEX alarm setpoints are adjusted to within the limits shown on Figure 3.2-2.

POWER DISTRIBUTION LIMITS

SURVEILLANCE REQUIREMENTS (Continued)

- c. Verifying that the AXIAL SHAPE INDEX is maintained within the allowable limits of Figure 3.2-2, where 100 percent of maximum allowable power represents the maximum THERMAL POWER allowed by the following expression:

$$M \times N$$

where:

1. M is the maximum allowable THERMAL POWER level for the existing Reactor Coolant Pump combination.
2. N is the maximum allowable fraction of RATED THERMAL POWER as determined by the F_{xy} curve of Figure 3.2-3.

4.2.1.4 Incore Detector Monitoring System - The incore detector monitoring system may be used for monitoring the core power distribution by verifying that the incore detector Local Power Density alarms:

- a. Are adjusted to satisfy the requirements of the core power distribution map which shall be updated at least once per 31 days of accumulated operation in MODE 1.
- b. Have their alarm setpoint adjusted to less than or equal to the limits shown on Figure 3.2-1 when the following factors are appropriately included in the setting of these alarms:
 1. Flux peaking augmentation factors as shown in Figure 4.2-1,
 2. A measurement-calculational uncertainty factor of 1.07,*
 3. An engineering uncertainty factor of 1.03,
 4. A linear heat rate uncertainty factor of 1.01 due to axial fuel densification and thermal expansion, and
 5. A THERMAL POWER measurement uncertainty factor of 1.02.

*An uncertainty factor of 1.10 applies when in LOAD FOLLOW OPERATION.

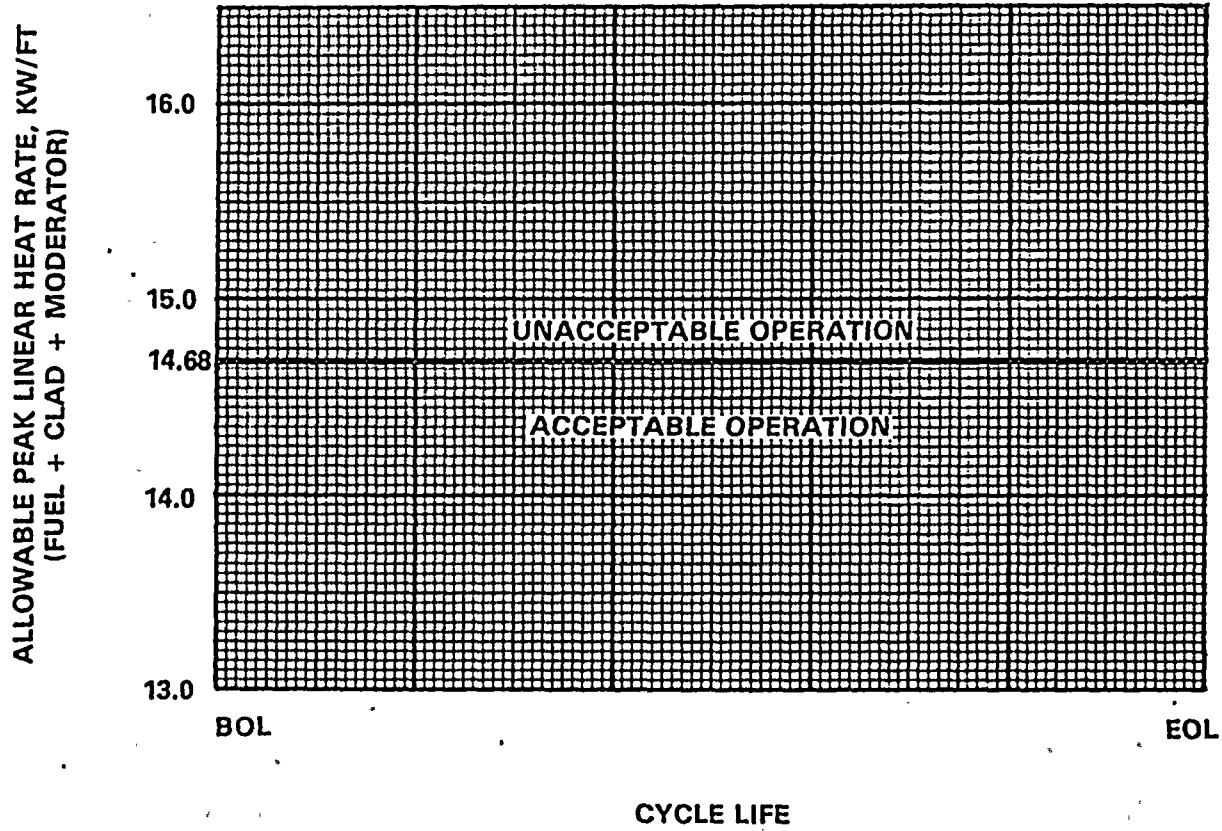


FIGURE 3.2-1 Allowable Peak Linear Heat Rate vs Burnup.

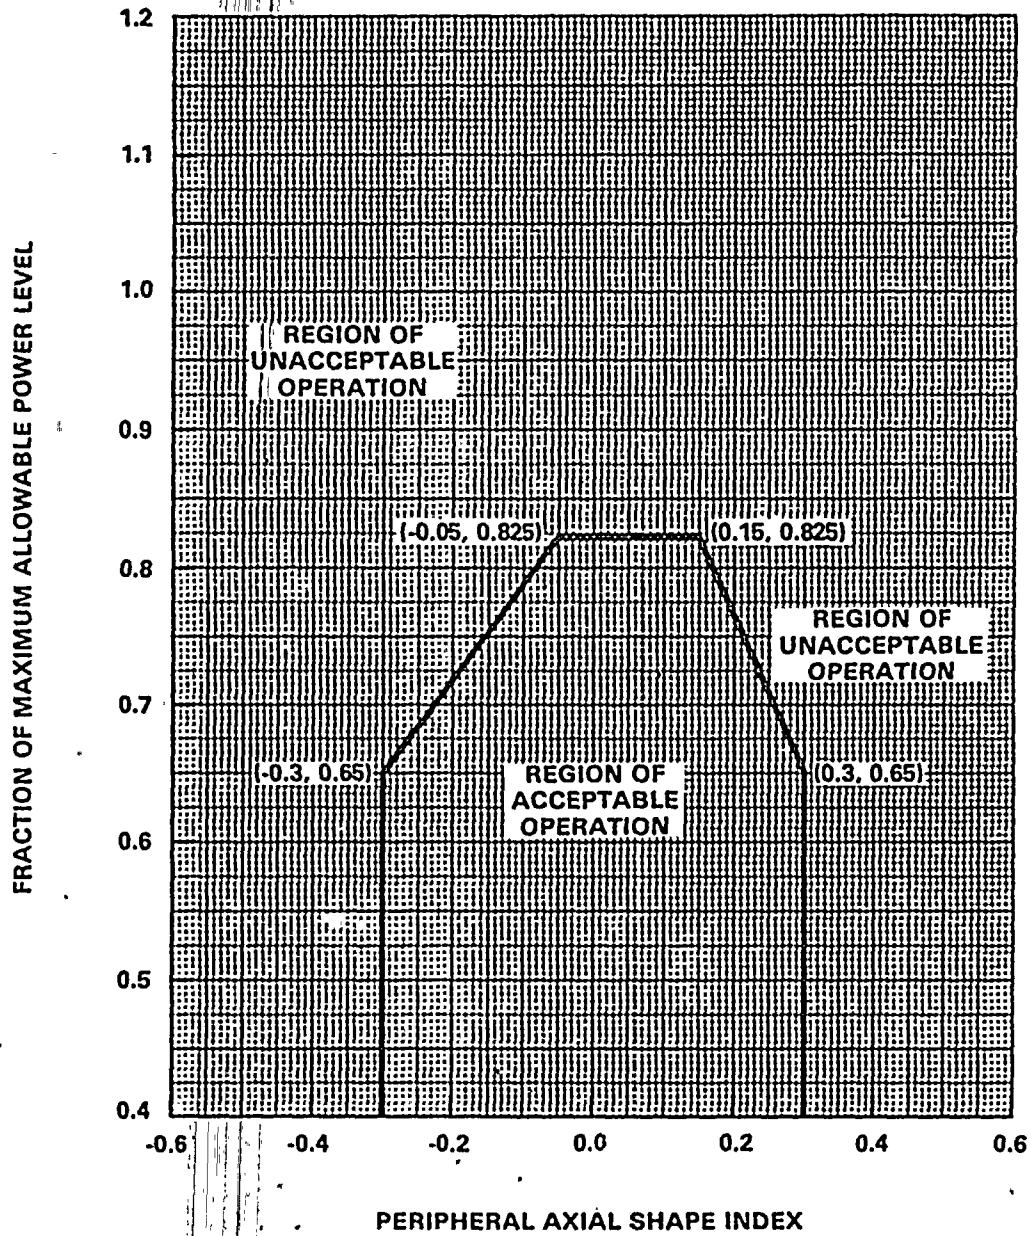


FIGURE 3.2-2
 AXIAL SHAPE INDEX vs Fraction of Maximum Allowable Power Level Per Specification 4.2.1.3

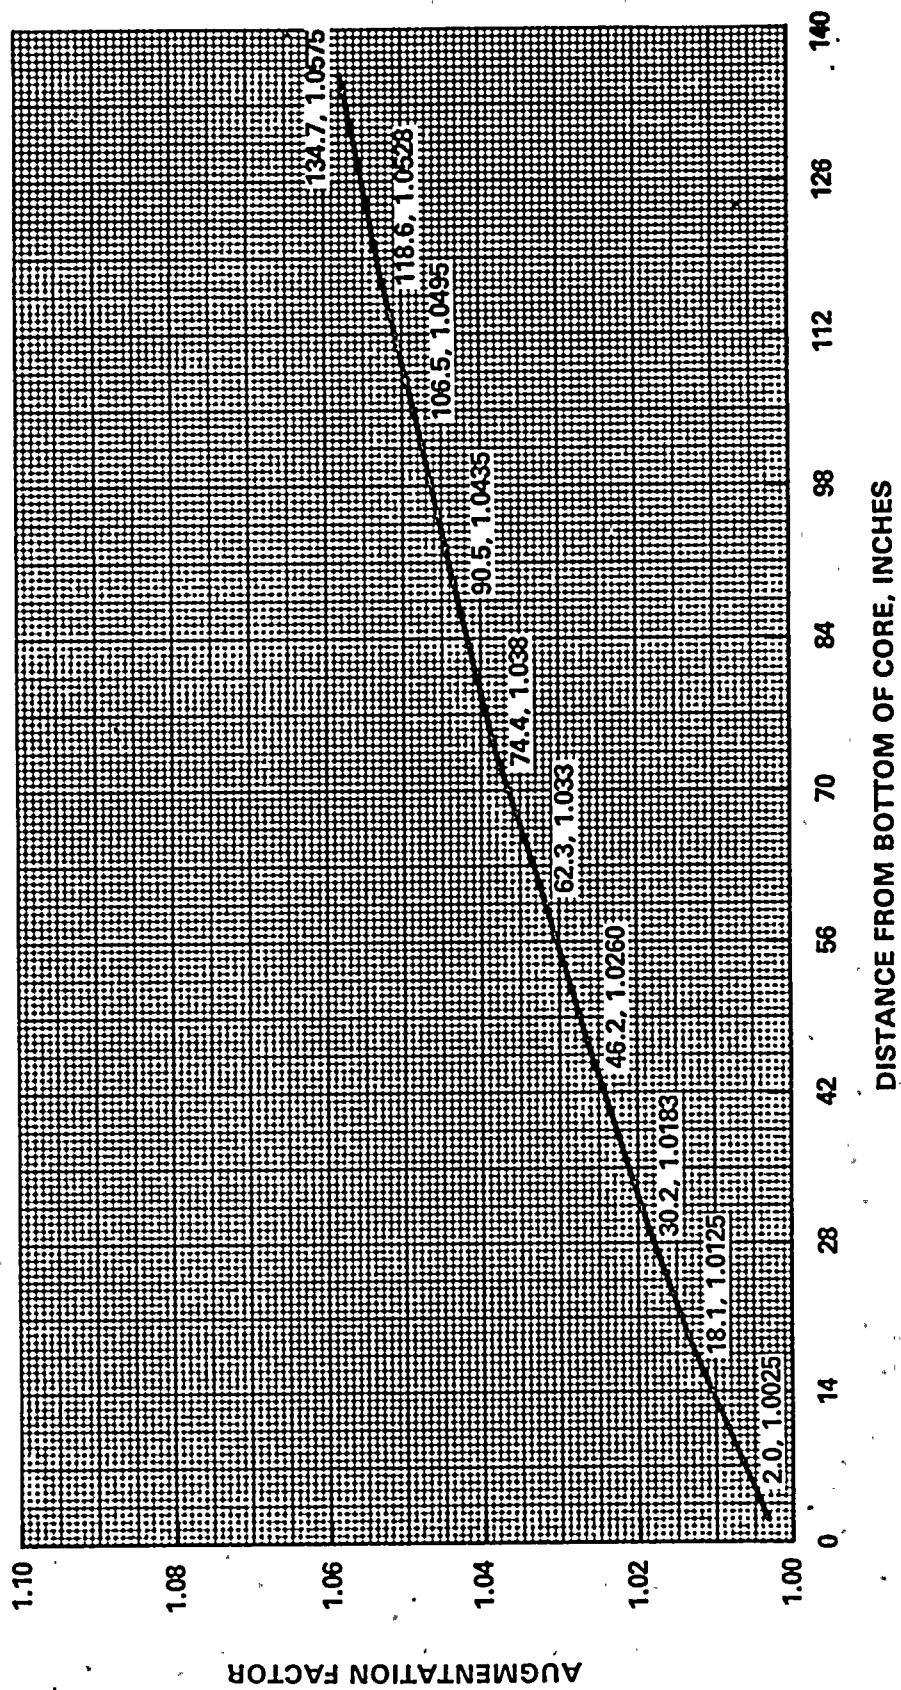


FIGURE 4.2-1
Augmentation Factors vs Distance from Bottom of Core

POWER DISTRIBUTION LIMITS

TOTAL PLANAR RADIAL PEAKING FACTOR - F_{xy}^T

LIMITING CONDITION FOR OPERATION

3.2.2 The calculated value of F_{xy}^T , defined as $F_{xy}^T = F_{xy}(1+T_q)$, shall be limited to ≤ 1.627 .

APPLICABILITY: MODE 1*.

ACTION:

With $F_{xy}^T > 1.627$, within 6 hours either:

- a. Reduce THERMAL POWER to bring the combination of THERMAL POWER and F_{xy}^T to within the limits of Figure 3.2-3 and withdraw the full length CEAs to or beyond the Long Term Steady State Insertion Limits of Specification 3.1.3.6; or
- b. Be in HOT STANDBY.

SURVEILLANCE REQUIREMENTS

4.2.2.1 The provisions of Specification 4.0.4 are not applicable.

4.2.2.2 F_{xy}^T shall be calculated by the expression $F_{xy}^T = F_{xy}(1+T_q)$ when in non-LOAD FOLLOW OPERATION and by the expression $F_{xy}^T = 1.03 F_{xy}(1+T_q)$ when in LOAD FOLLOW OPERATION. F_{xy}^T shall be determined to be within its limit at the following intervals:

- a. Prior to operation above 70 percent of RATED THERMAL POWER after each fuel loading,
- b. At least once per 31 days of accumulated operation in MODE 1, and
- c. Within four hours if the AZIMUTHAL POWER TILT (T_q) is > 0.03 .

*See Special Test Exception 3.10.2.

POWER DISTRIBUTION LIMITS

SURVEILLANCE REQUIREMENTS (Continued)

4.2.2.3 F_{xy} shall be determined each time a calculation of F_{xy}^T is required by using the incore detectors to obtain a power distribution map with all full length CEAs at or above the Long Term Steady State Insertion Limit for the existing Reactor Coolant Pump combination. This determination shall be limited to core planes between 15% and 85% of full core height and shall exclude regions influenced by grid effects.

4.2.2.4 T_q shall be determined each time a calculation of F_{xy}^T is required and the value of T_q used to determine F_{xy}^T shall be the measured value of T_q .

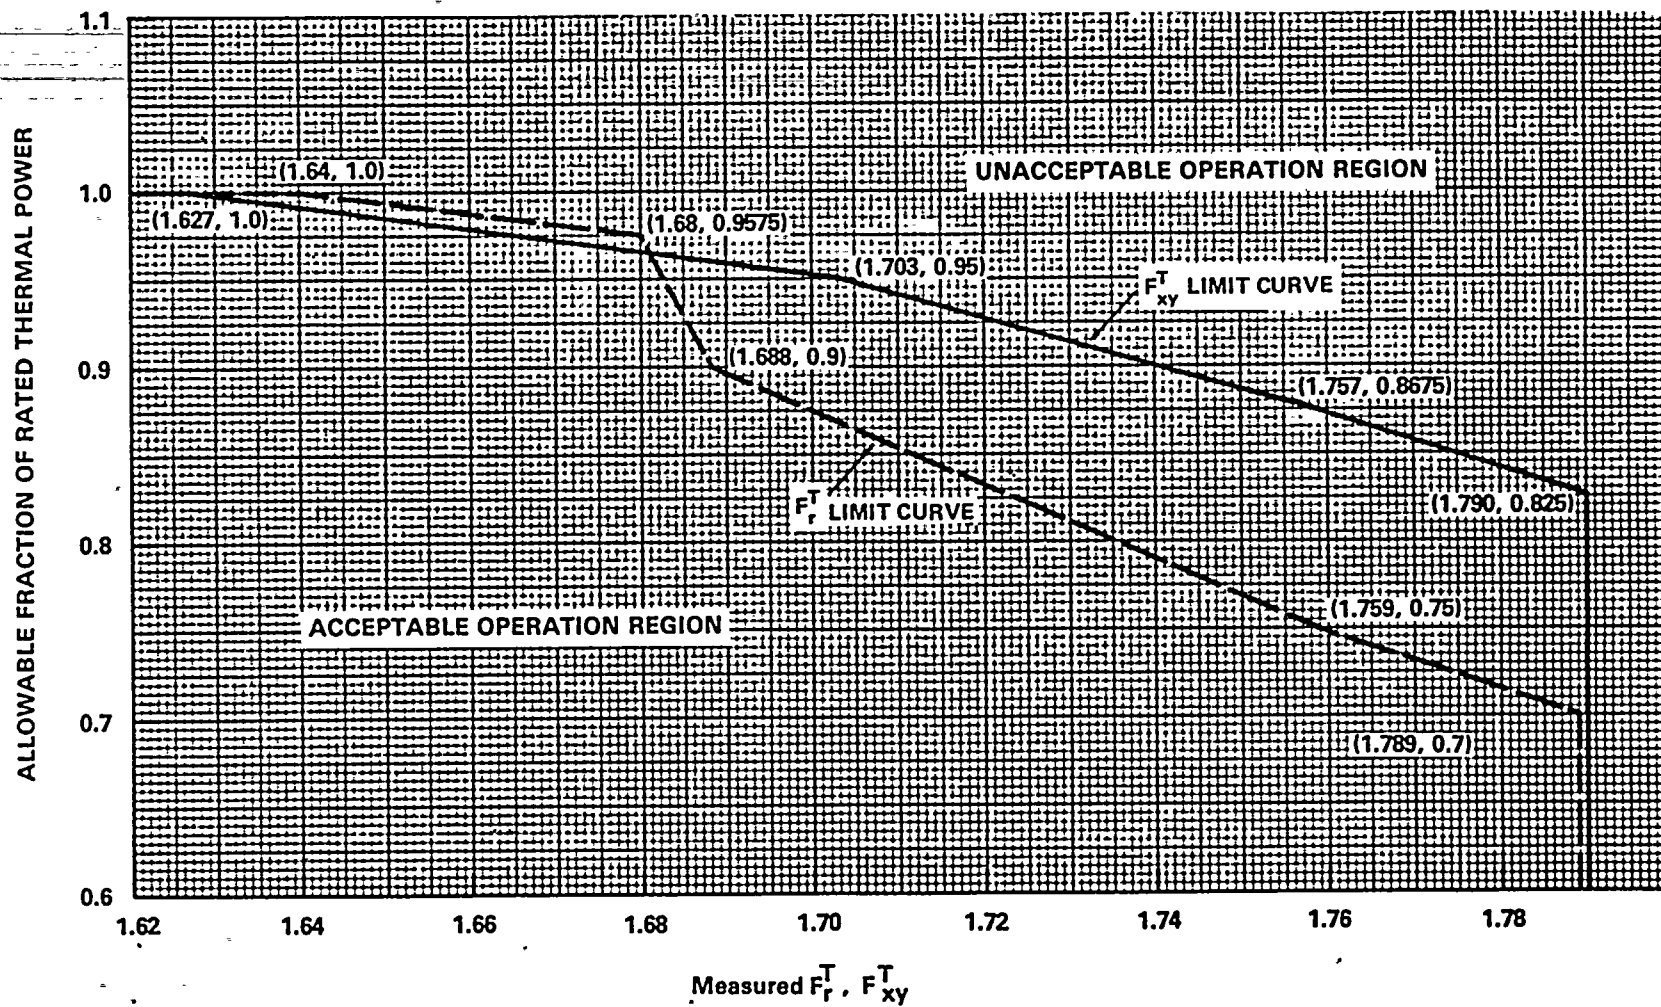


FIGURE 3.2-3
 Allowable Combinations Of Thermal Power And F_r^T, F_{xy}^T

POWER DISTRIBUTION LIMITS

TOTAL INTEGRATED RADIAL PEAKING FACTOR - F_r^T

LIMITING CONDITION FOR OPERATION

3.2.3 The calculated value of F_r^T , defined as $F_r^T = F_r(1+T_q)$, shall be limited to ≤ 1.64 .

APPLICABILITY: MODE 1*.

ACTION:

With $F_r^T > 1.64$, within 6 hours either:

- a. Be in at least HOT STANDBY, or
- b. Reduce THERMAL POWER to bring the combination of THERMAL POWER and F_r^T to within the limits of Figure 3.2-3 and withdraw the full length CEAs to or beyond the Long Term Steady State Insertion Limits of Specification 3.1.3.6. The THERMAL POWER limit determined from Figure 3.2-3 shall then be used to establish a revised upper THERMAL POWER level limit on Figure 3.2-4 (truncate Figure 3.2-4 at the allowable fraction of RATED THERMAL POWER determined by Figure 3.2-3) and subsequent operation shall be maintained within the reduced acceptable operation region of Figure 3.2-4.

SURVEILLANCE REQUIREMENTS

4.2.3.1 The provisions of Specification 4.0.4 are not applicable.

4.2.3.2 F_r^T shall be calculated by the expression $F_r^T = F_r(1+T_q)$ when in non-LOAD FOLLOW OPERATION and by the expression $F_r^T \leq 1.02 F_r(1+T_q)$ when in LOAD FOLLOW OPERATION. F_r^T shall be determined to be within its limit at the following intervals.

- a. Prior to operation above 70 percent of RATED THERMAL POWER after each fuel loading,
- b. At least once per 31 days of accumulated operation in MODE 1, and
- c. Within four hours if the AXIMUTHAL POWER TILT (T_q) is > 0.03 .

*See Special Test Exception 3.10.2.

POWER DISTRIBUTION LIMITS

SURVEILLANCE REQUIREMENTS (Continued)

4.2.3.3 F_r shall be determined each time a calculation of F_r^T is required by using the incore detectors to obtain a power distribution map with all full length CEAs at or above the Long Term Steady State Insertion Limit for the existing Reactor Coolant Pump combination.

4.2.3.4 T_q shall be determined each time a calculation of F_r^T is required and the value of T_q used to determine F_r^T shall be the measured value of T_q .

POWER DISTRIBUTION LIMITS

AZIMUTHAL POWER TILT - T_q

LIMITING CONDITION FOR OPERATION

3.2.4 The AZIMUTHAL POWER TILT (T_q) shall not exceed 0.03.

APPLICABILITY: MODE 1*

ACTION:

- a. With the indicated AZIMUTHAL POWER TILT determined to be $> .030$ but ≤ 0.10 , either correct the power tilt within two hours or determine within the next 2 hours and at least once per subsequent 8 hours, that the TOTAL PLANAR RADIAL PEAKING FACTOR (F_{xy}^T) and the TOTAL INTEGRATED RADIAL PEAKING FACTOR (F_r^T) are within the limits of Specifications 3.2.2 and 3.2.3.
- b. With the indicated AZIMUTHAL POWER TILT determined to be > 0.10 , operation may proceed for up to 2 hours provided that the TOTAL INTEGRATED RADIAL PEAKING FACTOR (F_r^T) and TOTAL PLANAR RADIAL PEAKING FACTOR (F_{xy}^T) are within the limits of Specifications 3.2.2 and 3.2.3. Subsequent operation for the purpose of measurement and to identify the cause of the tilt is allowable provided the THERMAL POWER level is restricted to $\leq 20\%$ of the maximum allowable THERMAL POWER level for the existing Reactor Coolant Pump combination.

SURVEILLANCE REQUIREMENT

4.2.4.1 The provisions of Specification 4.0.4 are not applicable.

4.2.4.2 The AZIMUTHAL POWER TILT shall be determined to be within the limit by:

- a. Calculating the tilt at least once per 7 days when the Subchannel Deviation Alarm is OPERABLE,

* See Special Test Exception 3.10.2.

POWER DISTRIBUTION LIMITS

SURVEILLANCE REQUIREMENTS (Continued)

- b. Calculating the tilt at least once per 12 hours when the Subchannel Deviation Alarm is inoperable, and
- c. Using the incore detectors to determine the AZIMUTHAL POWER TILT at least once per 12 hours when one excore channel is inoperable and THERMAL POWER is $> 75\%$ of RATED THERMAL POWER.


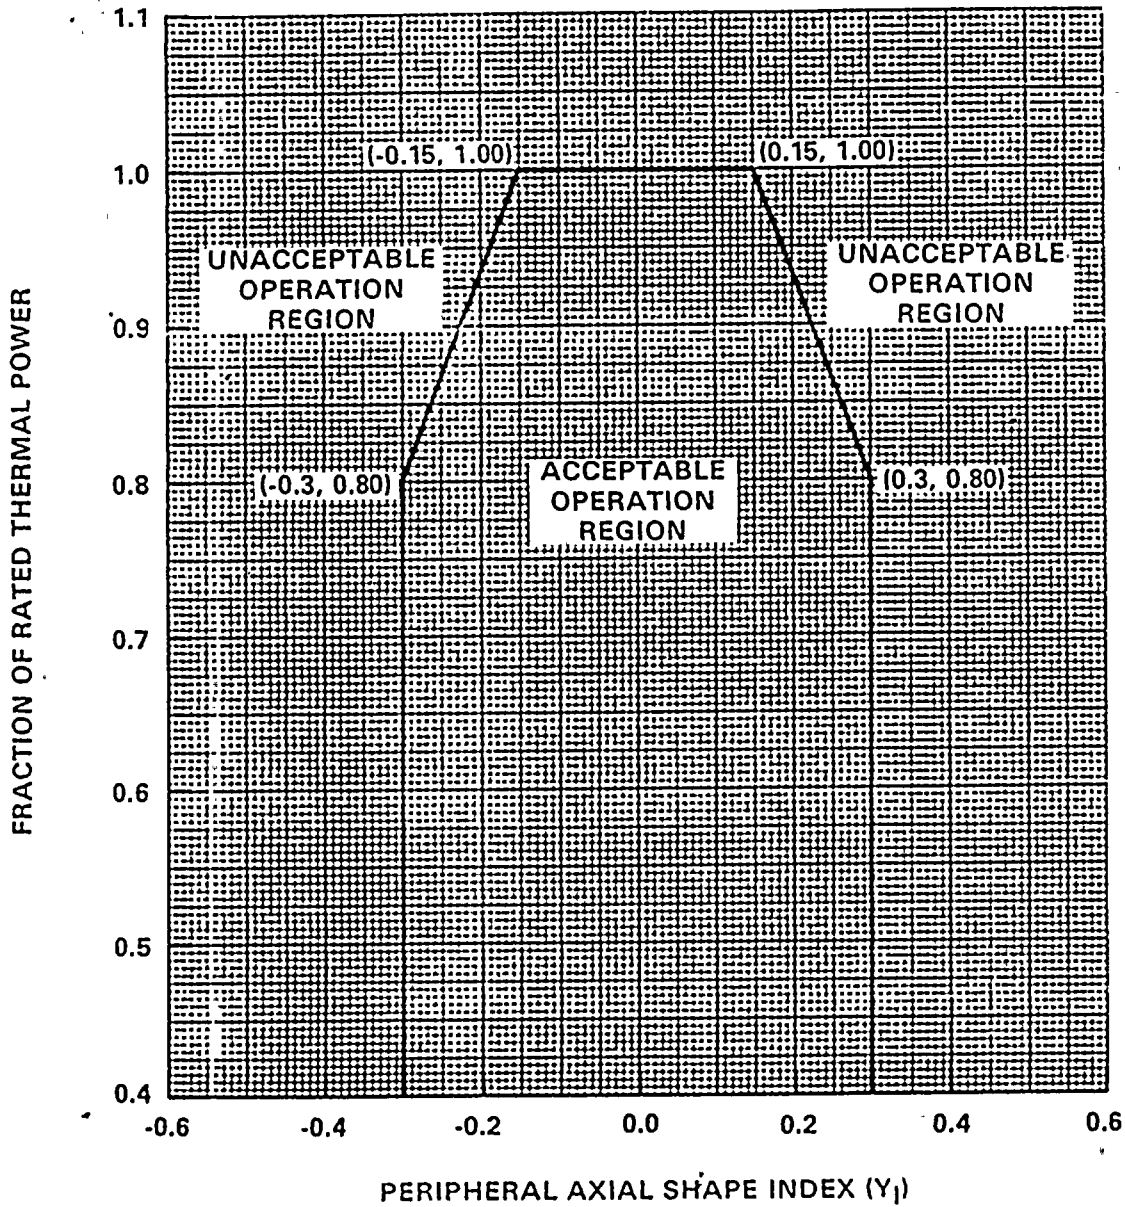


FIGURE 3.2-4
 AXIAL SHAPE INDEX Operating Limits With 4 Reactor Coolant Pumps Operating

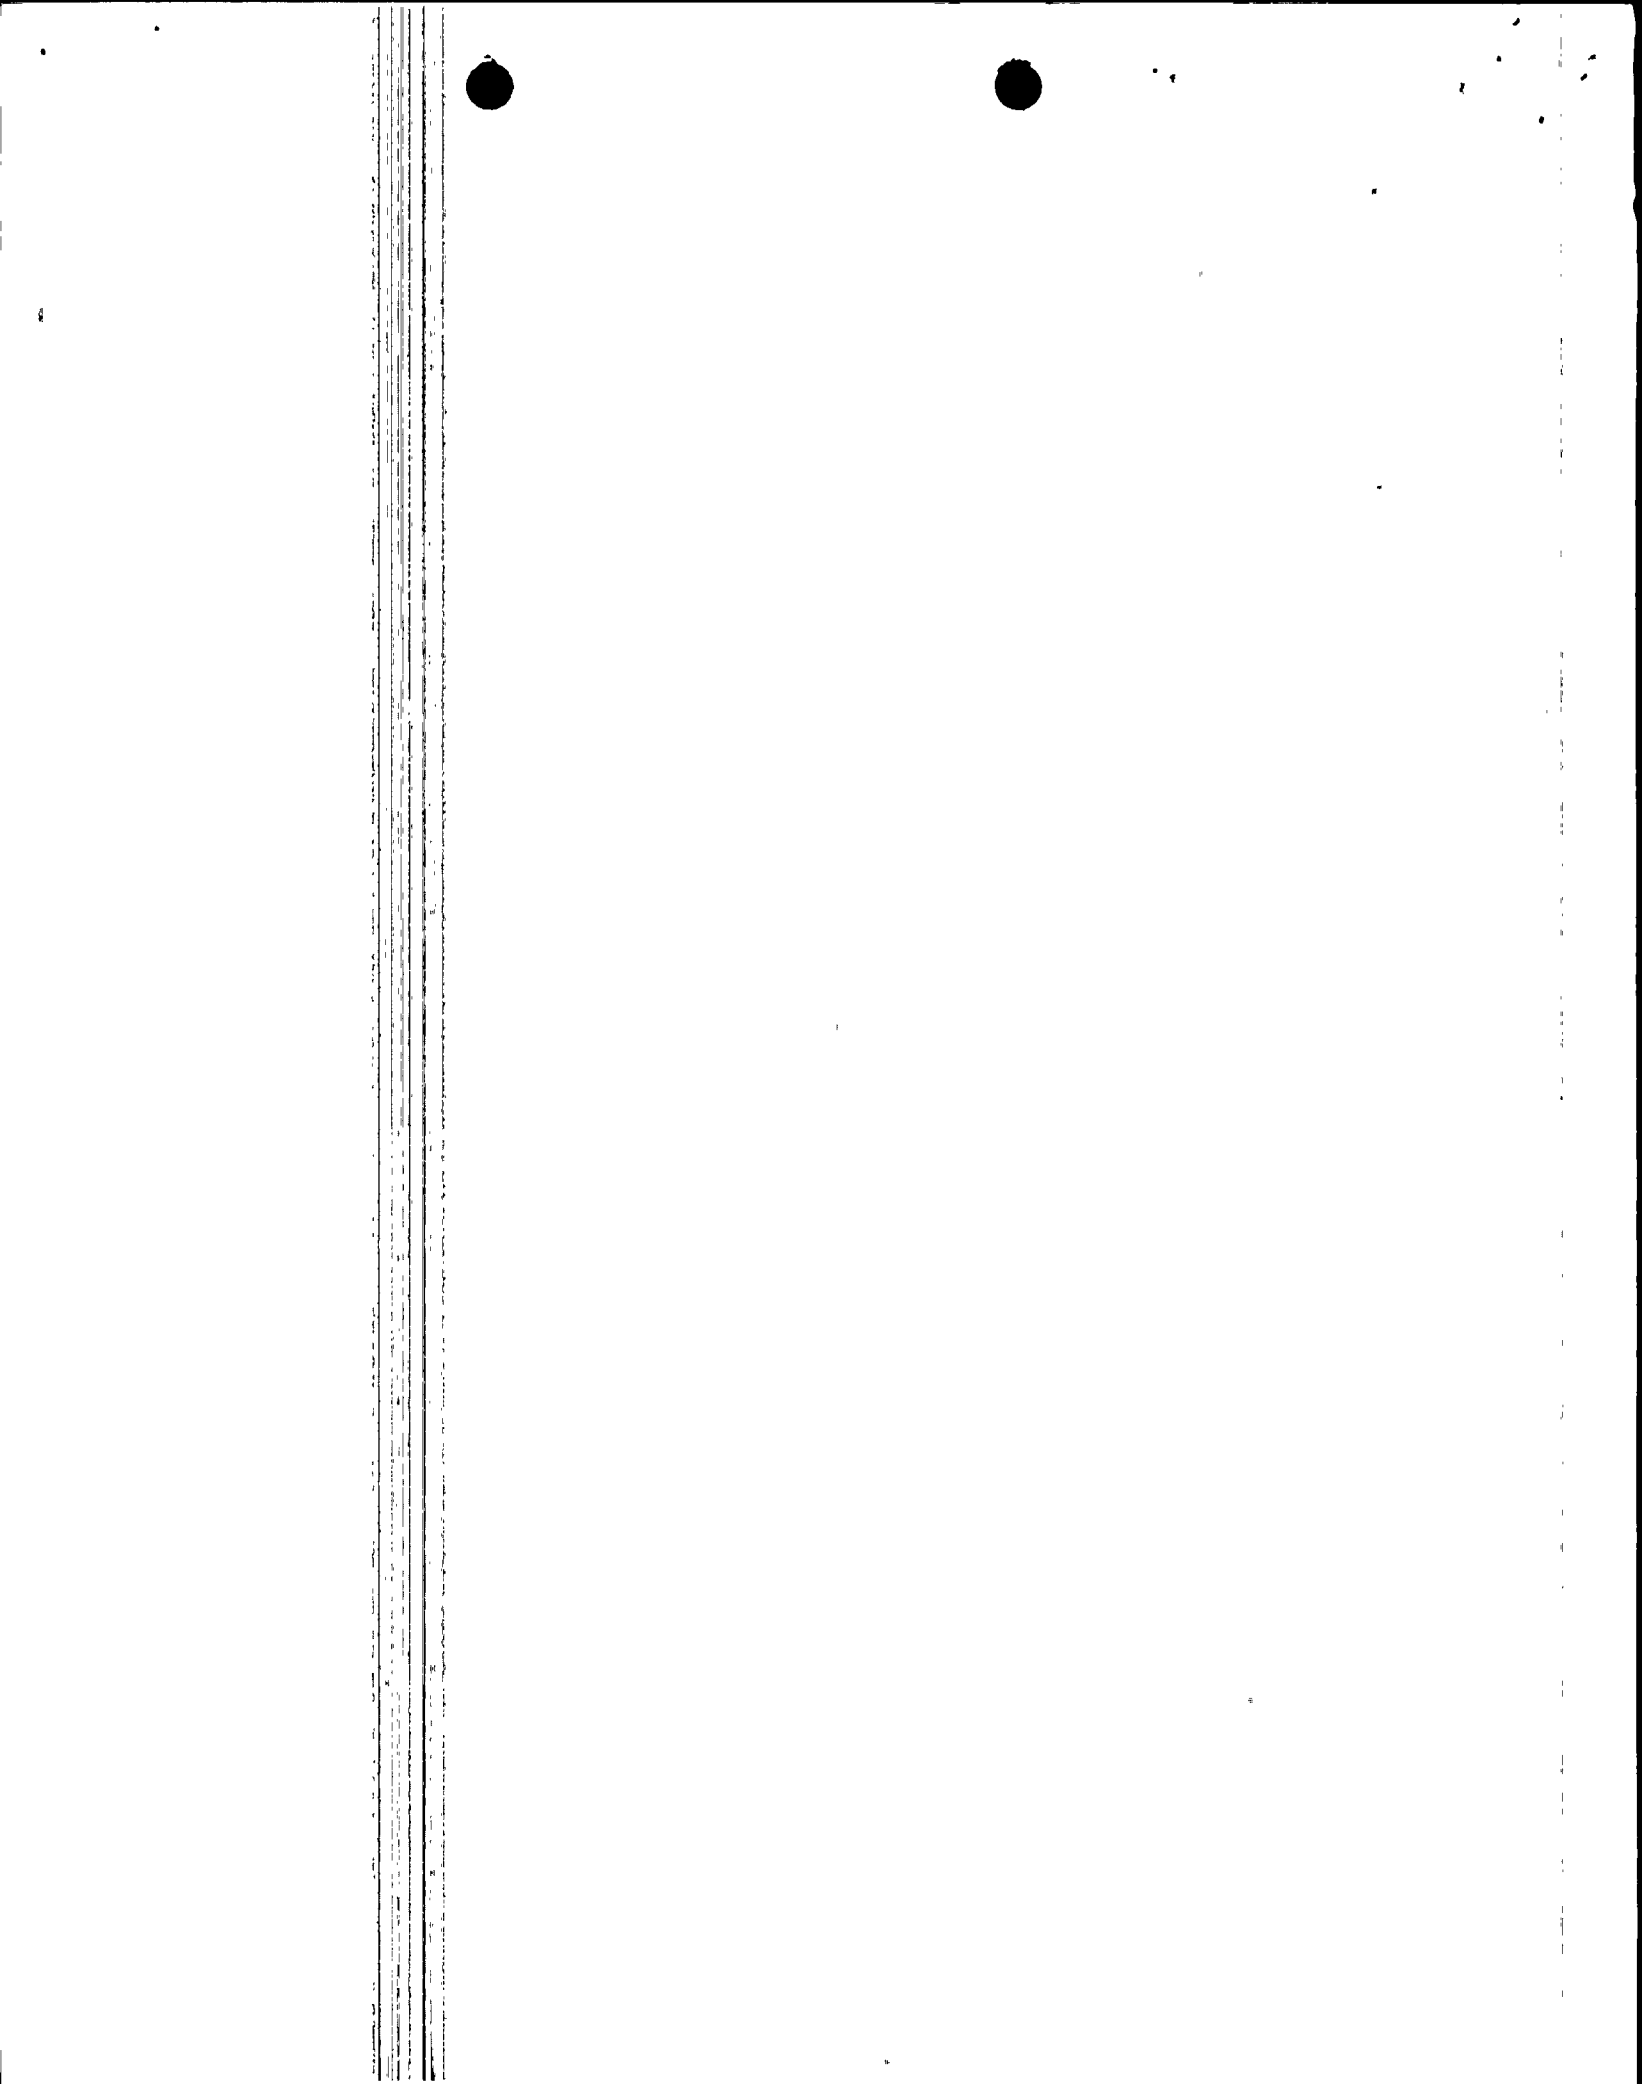

REACTIVITY CONTROL SYSTEMS

BASES

3/4.1.2 BORATION SYSTEMS (Continued)

The boron addition capability after the plant has been placed in MODES 5 and 6 requires either 1660 gallons of 8% boric acid solution from the boric acid tanks or 1630 gallons of 1720 ppm borated water from the refueling water tank to makeup for contraction of the primary coolant that could occur if the temperature is lowered from 200°F to 140°F.

3/4.1.3 MOVABLE CONTROL ASSEMBLIES

The specifications of this section ensure that (1) acceptable power distribution limits are maintained, (2) the minimum SHUTDOWN MARGIN is maintained, and (3) the potential effects of a CEA ejection accident are limited to acceptable levels.

The ACTION statements which permit limited variations from the basic requirements are accompanied by additional restrictions which ensure that the original criteria are met.

The ACTION statements applicable to an immovable or untrippable CEA and to a large misalignment (≥ 15 inches) of two or more CEAs, require a prompt shutdown of the reactor since either of these conditions may be indicative of a possible loss of mechanical functional capability of the CEAs and in the event of a stuck or untrippable CEA, the loss of SHUTDOWN MARGIN.

For small misalignments (< 15 inches) of the CEAs, there is 1) a small degradation in the peaking factors relative to those assumed in generating LCOs and LSSS setpoints for DNBR and linear heat rate, 2) a small effect on the time dependent long term power distributions relative to those used in generating LCOs and LSSS setpoints for DNBR and linear heat rate, 3) a small effect on the available SHUTDOWN MARGIN, and 4) a small effect on the ejected CEA worth used in the safety analysis. Therefore, the ACTION statement associated with the small misalignment of a CEA permits a one hour time interval during which attempts may be made to restore the CEA to within its alignment requirements prior to initiating a reduction in THERMAL POWER. The one hour time limit is sufficient to (1) identify causes of a misaligned CEA, (2) take appropriate corrective action to realign the CEAs and (3) minimize the effects of xenon redistribution.

Overpower margin is provided to protect the core in the event of a large misalignment (≥ 15 inches) of a CEA. However, this misalignment would cause distortion of the core power distribution. The reactor

REACTIVITY CONTROL SYSTEMS

BASES

3/4.1.3 MOVABLE CONTROL ASSEMBLIES (Continued)

protective system would not detect the degradation in radial peaking factors and since variations in other system parameters (e.g., pressure and coolant temperature) may not be sufficient to cause trips, it is possible that the reactor could be operating with process variables less conservative than those assumed in generating LCO and LSSS setpoints. Therefore, the ACTION statement associated with the large misalignment of a CEA requires a prompt and significant reduction in THERMAL POWER prior to attempting realignment of the misaligned CEA.

The ACTION statements applicable to misaligned or inoperable CEAs include requirements to align the OPERABLE CEAs in a given group with the inoperable CEA. Conformance with these alignment requirements bring the core, within a short period of time, to a configuration consistent with that assumed in generating LCO and LSSS setpoints. However, extended operation with CEAs significantly inserted in the core may lead to perturbations in 1) local burnup, 2) peaking factors and 3) available shutdown margin which are more adverse than the conditions assumed to exist in the safety analyses and LCO and LSSS setpoints determination. Therefore, time limits have been imposed on operation with inoperable CEAs to preclude such adverse conditions from developing.

Operability of the CEA position indicators (Specification 3.1.3.3) is required to determine CEA positions and thereby ensure compliance with the CEA alignment and insertion limits and ensures proper operation of the rod block circuit. The CEA "Full In" and "Full Out" limits provide an additional independent means for determining the CEA positions when the CEAs are at either their fully inserted or fully withdrawn positions. Therefore, the ACTION statements applicable to inoperable CEA position indicators permit continued operations when the positions of CEAs with inoperable position indicators can be verified by the "Full In" or "Full Out" limits.

CEA positions and OPERABILITY of the CEA position indicators are required to be verified on a nominal basis of once per 12 hours with more frequent verifications required if an automatic monitoring channel is inoperable. These verification frequencies are adequate for assuring that the applicable LCO's are satisfied.

The maximum CEA drop time permitted by Specification 3.1.3.4 is the assumed CEA drop time of 3.1 seconds used in the safety analyses. Measurement with $T_{avg} \geq 515^{\circ}\text{F}$ and with all reactor coolant pumps operating ensures that the measured drop times will be representative of insertion times experienced during a reactor trip at operating conditions.

3/4.2 POWER DISTRIBUTION LIMITS

BASES

3/4.2.1 LINEAR HEAT RATE

The limitation on linear heat rate ensures that in the event of a LOCA, the peak temperature of the fuel cladding will not exceed 2200°F.

Either of the two core power distribution monitoring systems, the Excore Detector Monitoring System and the Incore Detector Monitoring System, provide adequate monitoring of the core power distribution and are capable of verifying that the linear heat rate does not exceed its limits. The Excore Detector Monitoring System performs this function by continuously monitoring the AXIAL SHAPE INDEX with the OPERABLE quadrant symmetric excore neutron flux detectors and verifying that the AXIAL SHAPE INDEX is maintained within the allowable limits of Figure 3.2-2. In conjunction with the use of the excore monitoring system and in establishing the AXIAL SHAPE INDEX limits, the following assumptions are made: 1) the CEA insertion limits of Specifications 3.1.3.5 and 3.1.3.6 are satisfied, 2) the flux peaking augmentation factors are as shown in Figure 4.2-1, 3) the AZIMUTHAL POWER TILT restrictions of Specification 3.2.4 are satisfied, and 4) the TOTAL PLANAR RADIAL PEAKING FACTOR does not exceed the limits of Specification 3.2.2.

The Incore Detector Monitoring System continuously provides a direct measure of the peaking factors and the alarms which have been established for the individual incore detector segments ensure that the peak linear heat rates will be maintained within the allowable limits of Figure 3.2-1. The setpoints for these alarms include allowances, set in the conservative directions, for 1) flux peaking augmentation factors as shown in Figure 4.2-1, 2) a measurement-calculational uncertainty factor of 1.07,* 3) an engineering uncertainty factor of 1.03, 4) an allowance of 1.01 for axial fuel densification and thermal expansion, and 5) a THERMAL POWER measurement uncertainty factor of 1.02.

3/4.2.2, 3/4.2.3 and 3/4.2.4 TOTAL PLANAR AND INTEGRATED RADIAL PEAKING FACTORS - F_{xy}^T AND F_r^T AND AZIMUTHAL POWER TILT - T_q

The limitations on F_{xy}^T and T_q are provided to ensure that the assumptions used in the analysis for establishing the Linear Heat Rate and Local Power Density - High LCOs and LSSS setpoints remain valid during operation at the various allowable CEA group insertion limits. The limitations on F_r^T and T_q are provided to ensure that the assumptions

* An uncertainty factor of 1.10 applies when in LOAD FOLLOW OPERATION.

POWER DISTRIBUTION LIMITS

BASES

used in the analysis establishing the DNB Margin LCO, and Thermal Margin/Low Pressure LSSS setpoints remain valid during operation at the various allowable CEA group insertion limits. If F_{xy}^T , F_r^T or T_q exceed their basic limitations, operation may continue under the additional restrictions imposed by the ACTION statements since these additional restrictions provide adequate provisions to assure that the assumptions used in establishing the Linear Heat Rate, Thermal Margin/Low Pressure and Local Power Density - High LCOs and LSSS setpoints remain valid. An AZIMUTHAL POWER TILT > 0.10 is not expected and if it should occur, subsequent operation would be restricted to only those operations required to identify the cause of this unexpected tilt.

The value of T_q that must be used in the equation $F_{xy}^T = F_{xy} (1 + T_q)$ and $F_r^T = F_r (1 + T_q)$ is the measured tilt.

The surveillance requirements for verifying that F_{xy}^T , F_r^T and T_q are within their limits provide assurance that the actual values of F_{xy}^T , F_r^T and T_q do not exceed the assumed values. Verifying F_{xy}^T and F_r^T after each fuel loading prior to exceeding 75% of RATED THERMAL POWER provides additional assurance that the core was properly loaded.

3/4.2.5 DNB PARAMETERS

The limits on the DNB related parameters assure that each of the parameters are maintained within the normal steady state envelope of operation assumed in the transient and accident analyses. The limits are consistent with the safety analyses assumptions and have been analytically demonstrated adequate to maintain a minimum DNBR of 1.30 throughout each analyzed transient.

The 12 hour periodic surveillance of these parameters through instrument readout is sufficient to ensure that the parameters are restored within their limits following load changes and other expected transient operation. The 18 month periodic measurement of the RCS total flow rate is adequate to detect flow degradation and ensure correlation of the flow indication channels with measured flow such that the indicated percent flow will provide sufficient verification of flow rate on a 12 hour basis.