

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 7908100466 DOC. DATE: 79/08/07 NOTARI D: NO DOCKET #
 FACIL: 50-335 St. Lucie Plant, Unit 1, Florida Power & Light Co. 05000335
 AUTH. NAME AUTHOR AFFILIATION
 UHRIG, R.E. Florida Power & Light Co.
 RECIP. NAME RECIPIENT AFFILIATION
 DENTON, H.R. Office of Nuclear Reactor Regulation

SUBJECT: Forwards "Reactor Containment Bldg Integrated Leak Rate Test Rept".

DISTRIBUTION CODE: A016S COPIES RECEIVED: LTR 3 ENCL 12 SIZE: 1+79
 TITLE: CONTAINMENT LEAK RATE TESTING - APPENDIX J (WITH DRAWING)

SEE REPORTS

NOTES: -----


ACTION:	RECIPIENT	COPIES		RECIPIENT	COPIES	
	ID CODE/NAME	LTTR	ENCL		ID CODE/NAME	LTTR
	04 PM P. Erickson	2	2	BC ORB#4	7	0
	LA ORB #4	1	0			
INTERNAL:	01 REG FILE	1	1	02 NRC PDR	1	1
	06 HUANG, Y	1	1	07 I&E	2	2
	09 CONTMNT SYS	1	1	10 PLANT SYS BR	1	1
	AD SYS/PROJ	1	0	EEB	1	0
	EFLNT TREAT SYS	1	0	ENGR BR	1	0
	OELD	1	0	REACTOR SFTY BR	1	0
	TA/EDO	1	0			
EXTERNAL:	03 LPDR	1	1	ACRS	16	0
	NSIC	1	0			


AUG 14 1979

MA 2

TOTAL NUMBER OF COPIES REQUIRED: LTTR 42 ENCL 10

60

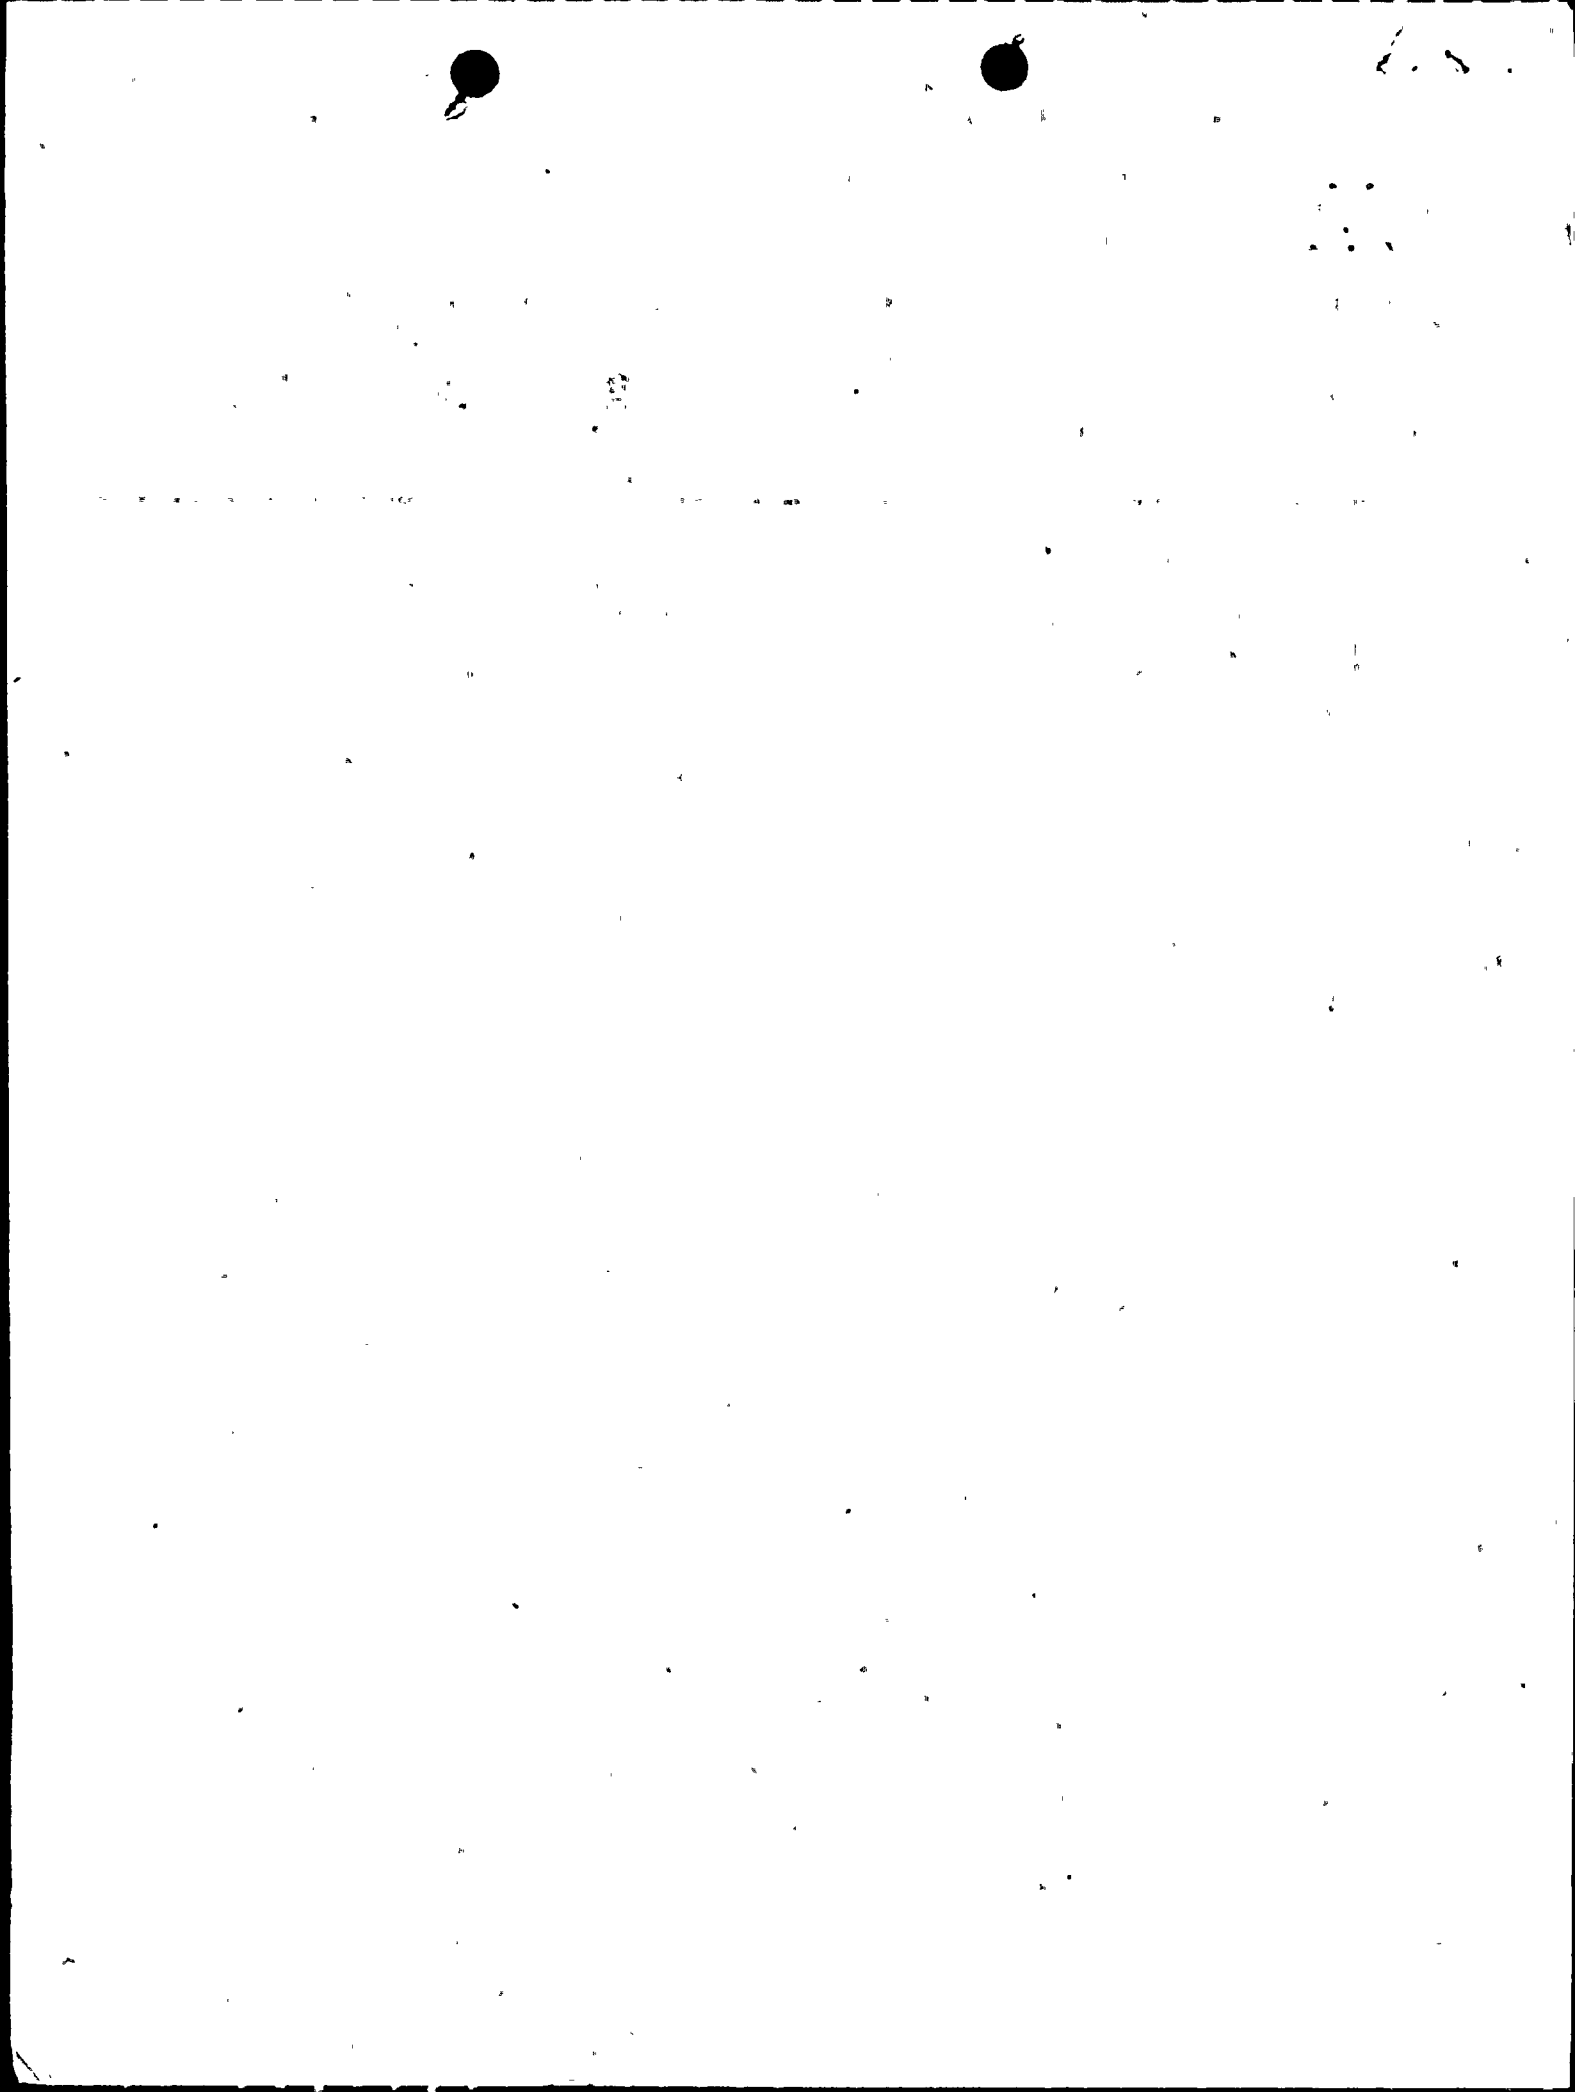

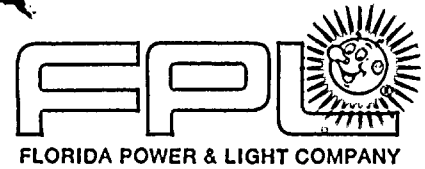

August 7, 1979
L-79-214


Mr. Harold R. Denton, Director
Office of Nuclear Reactor Regulation
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

Dear Mr. Denton:

Re: St. Lucie Unit 1
Docket No. 50-335
Integrated Leak Rate Test Report

In accordance with 10 CFR 50, Appendix J and Regulatory Guide 10.1, 12 copies of the subject report are enclosed for use by your office.

Very truly yours,

REU

Robert E. Uhrig
Vice President
Advanced Systems & Technology

REU/MAS/pg

cc: J. P. O'Reilly, Region II
Harold Reis, Esquire (w/o enclosures)

REGULATORY DOCKET FILE COPY

*A016
S 3/12*

7908100466

