

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8001140446 DOC. DATE: 80/01/09 NOTARIZED: YES DOCKET #  
 FACIL: 50-335 St. Lucie Plant, Unit 1, Florida Power & Light Co. 05000335  
 ADTH. NAME: AUTHOR AFFILIATION  
 URRIG, R.E. Florida Power & Light Co.  
 RECIPIENT NAME: RECIPIENT AFFILIATION  
 EISENHUT, D.G. Division of Operating Reactors.

SUBJECT: Requests amend of License DPR-67. Forwards proposed Tech Spec for safety-related hydraulic snubbers & util safety evaluation. Affidavit encl.

DISTRIBUTION CODE: A001S COPIES RECEIVED: LTR 3 ENCL 3 SIZE: 2+9  
 TITLE: General Distribution for after issuance of Operating Lic

NOTES:


ACTION:	RECIPIENT	COPIES		RECIPIENT	COPIES	
	ID CODE/NAME	LTR	ENCL	ID CODE/NAME	LTR	ENCL
	05 BC ORB #4	1	7			
INTERNAL:	01 REG FILE	1	1	02 NRC PDR	1	1
	12 I&E	2	2	14 TA7ED0	1	1
	15 CORE PERF BR	1	1	17 ENGR BR	1	1
	18 REAC SFTY BR	1	1	19 PLANT SYS BR	1	1
	20 EEB	1	1	21 EFCT TRY SYS	1	1
	22 BRINKMAN	1	1	EPB-DUR	1	1
	OELD	1	0			
EXTERNAL:	03 LPDR	1	1	04 NSIC	1	1
	23 ACRS	16	16			


JAN 15 1980

APP  
2

TOTAL NUMBER OF COPIES REQUIRED: LTR 39 ENCL 38

60

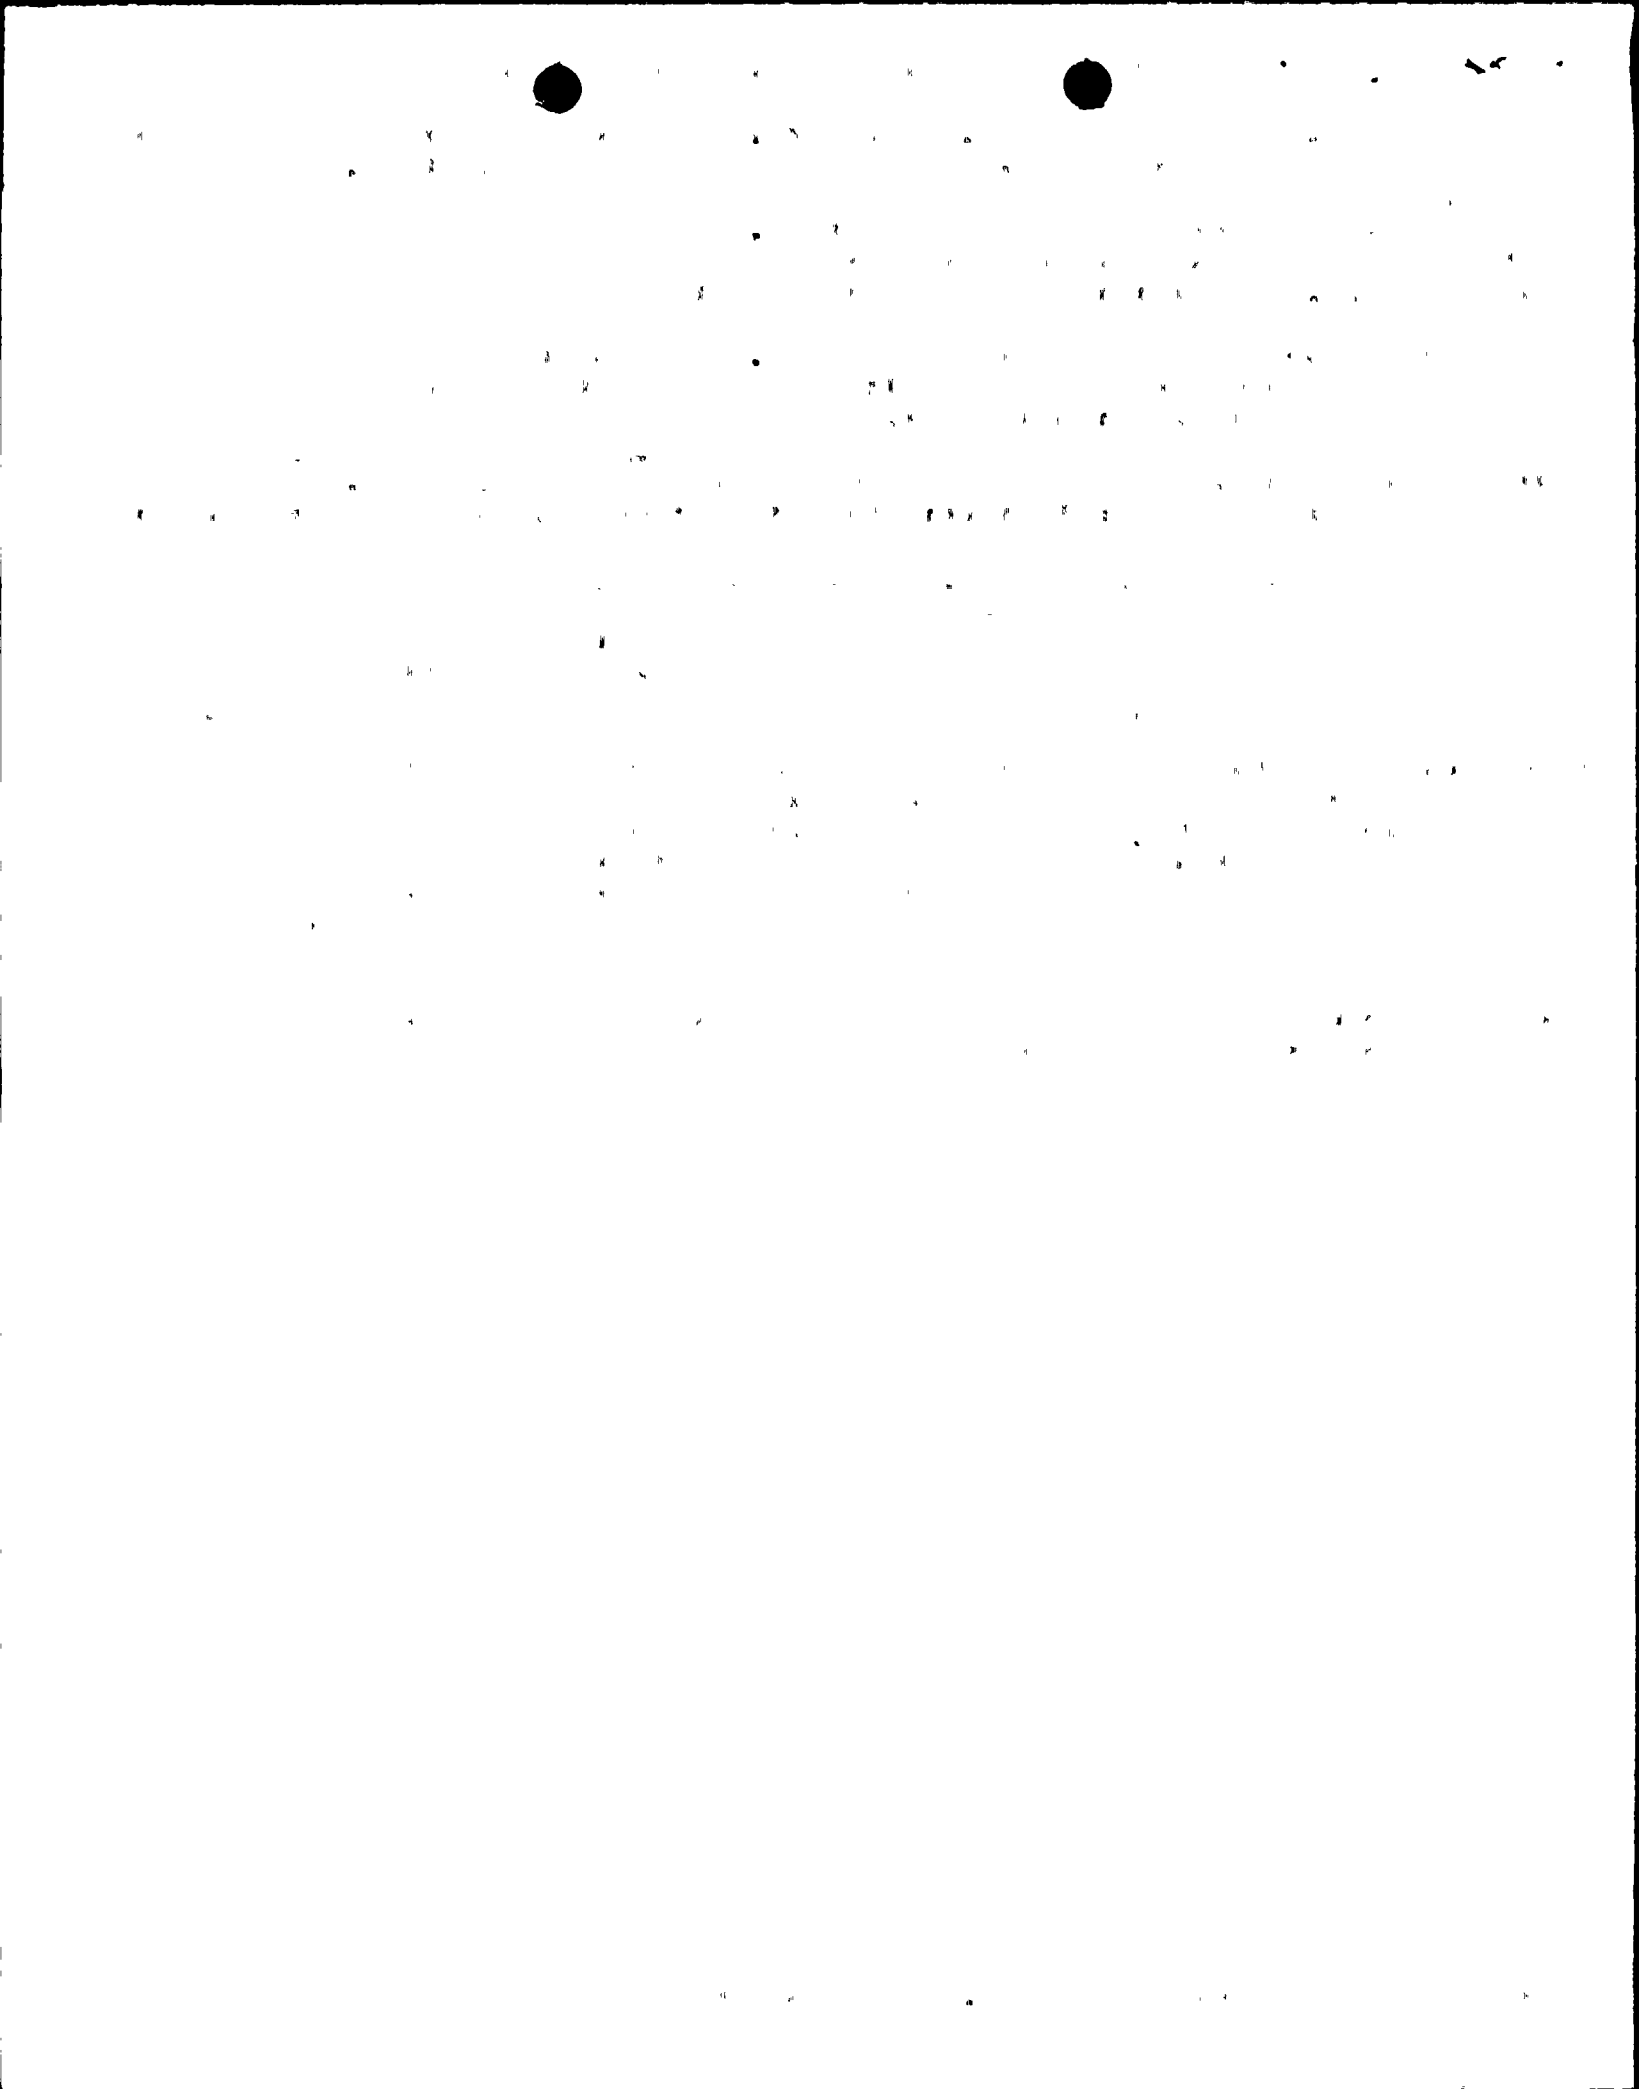

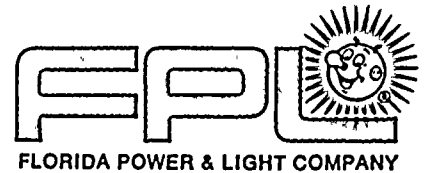

Director of Nuclear Reactor Regulation  
Attention: Mr. Darrell Eisenhut, Acting Director  
Division of Operating Reactors  
U. S. Nuclear Regulatory Commission  
Washington, D. C. 20555

January 9, 1980  
L-80-7

Dear Mr. Eisenhut:

Re: St. Lucie Unit 1  
Docket No. 50-335  
Proposed Amendment to  
Facility Operating License DPR-67

In accordance with 10 CFR 50.30, Florida Power & Light Company submits herewith three (3) signed originals and forty (40) copies of a request to amend Appendix A of Facility Operating License DPR-67.

The purpose of this amendment is to support the replacement of selected safety-related hydraulic snubbers with mechanical snubbers during the upcoming refueling outage. Timely Staff review is requested so that we can implement the proposed changes during the next refueling outage, which is scheduled to begin about March 30, 1980.

The replacement of other selected safety-related hydraulic snubbers with the same type of mechanical snubbers as is proposed in this amendment was reviewed and approved by the staff as Amendment 31 to the St. Lucie Operating License.


The proposed Technical Specification changes are described below and shown on the accompanying Technical Specification pages bearing the date of this letter in the lower right hand corner.

Pages 3/4 7-33 through 3/4 7-37

27 entries are deleted from Table 3.7-2 (SAFETY RELATED HYDRAULIC SNUBBERS). These hydraulic snubbers are scheduled to be replaced with equivalent or better mechanical snubbers during the next refueling outage.

The proposed amendment has been reviewed by the St. Lucie Facility Review Group and the Florida Power & Light Company Nuclear Review Board. They have concluded that it does not involve an unreviewed safety question. A safety evaluation is attached.

Very truly yours,

  
Robert E. Uhrig  
Vice President  
Advanced Systems & Technology

REU/MAS/cph  
Attachment  
cc: Mr. James P. O'Reilly, Region II  
Harold F. Reis, Esquire


8001140446  
Aool  
S 3/3

STATE OF FLORIDA     )  
                              )  
COUNTY OF DADE     )            SS.

Robert E. Uhrig, being first duly sworn, deposes and says:


That he is a Vice President of Florida Power & Light Company,  
the Licensee herein;

That he has executed the foregoing document; that the state-  
ments made in this said document are true and correct to the  
best of his knowledge, information, and belief, and that he  
is authorized to execute the document on behalf of said  
Licensee.

  
Robert E. Uhrig

Subscribed and sworn to before me this

9th day of January, 1980

  
\_\_\_\_\_  
NOTARY PUBLIC, in and for the county of Dade,  
State of Florida

My commission expires: NOTARY PUBLIC STATE OF FLORIDA at LARGE  
MY COMMISSION EXPIRES AUGUST 24, 1981  
BONDED THRU MAYNARD BONDING AGENCY