

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR:8005090424 DOC DATE: 80/05/05 NOTARIZED: NO DOCKET #
 FACIL:50-335 St. Lucie Plant, Unit 1, Florida Power & Light Co. 05000335
 AUTH.NAME AUTHOR AFFILIATION
 UHRIG,R.E. Florida Power & Light Co.
 RECIP.NAME RECIPIENT AFFILIATION

SUBJECT: Application for proposed amend to License DPR-67 to allow greater flexibility in surveillance of turbine driven auxiliary feedwater pump during startup.

DISTRIBUTION CODE: A001S COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 1x1
 TITLE: General Distribution for after Issuance of Operating Lic


NOTES: W/CHECK \$ 4000.00

ACTION:	RECIPIENT	COPIES		RECIPIENT	COPIES	
	ID CODE/NAME	LTR	ENCL		ID CODE/NAME	LTR
	05 BC ORB#4	7	7			
INTERNAL:	01 REG FILE	1	1	02 NRC PDR	1	1
	12 I&E	2	2	15 CORE PERF BR	1	1
	17 ENGR BR	1	1	18 REAC SFTY BR	1	1
	19 PLANT SYS BR	1	1	20 EEB	1	1
	21 EFLT TRT SYS	1	1	EPB-DOR	1	1
	OELD	1	0	STS GROUP LEADR	1	1
EXTERNAL:	03 LPDR	1	1	04 NSIC	1	1
	23 ACRS	16	16			

MAY 12 1980


SD

App
2

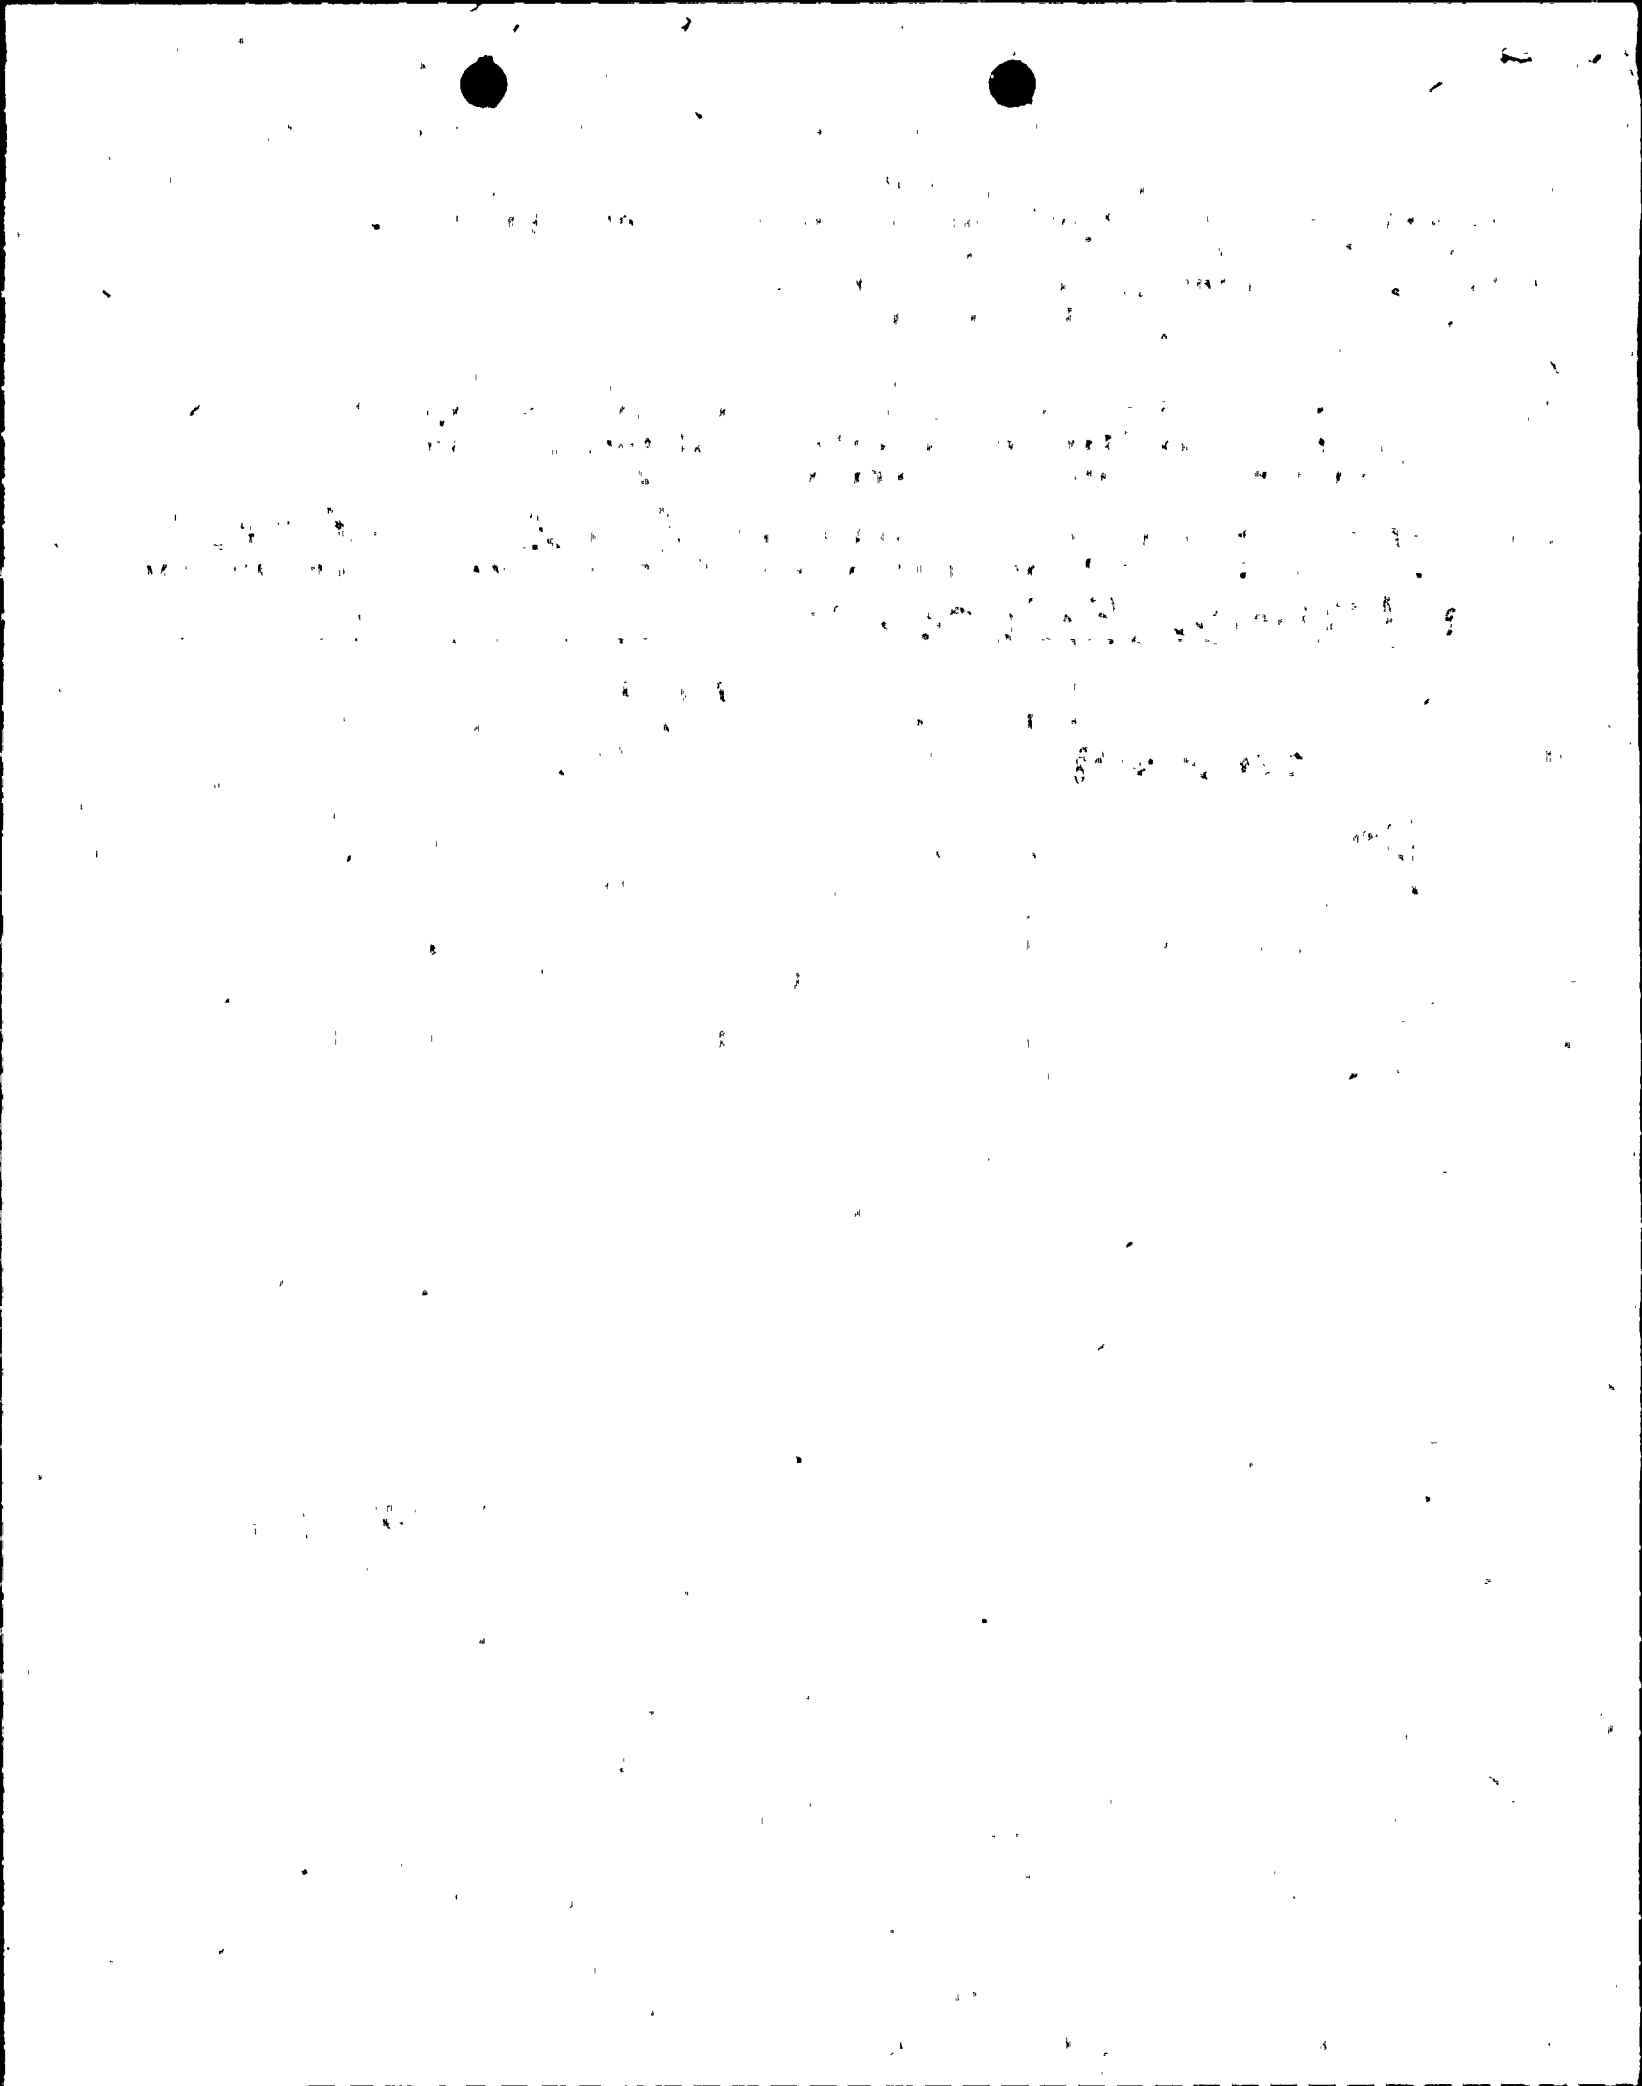

8005090424

P.O. BOX 529100 MIAMI, FL 33152

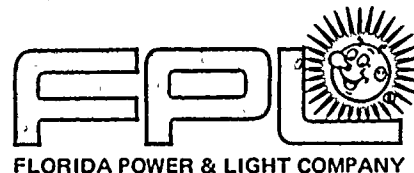

May 5, 1980
L-80-138

Director of Nuclear Reactor Regulation
Attention: Mr. Darrell G. Eisenhut, Director
Division of Project Management
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

Dear Mr. Eisenhut:

Re: St. Lucie Unit 1
Docket No. 50-335
Proposed Amendment to
Facility Operating License DPR-67

In accordance with 10 CFR 50.30, Florida Power & Light Company submits herewith three (3) signed originals and forty (40) copies of a request to amend Appendix A of Facility Operating License DPR-67.

The proposed amendment is described below and shown on the accompanying Technical Specification pages bearing the date of this letter in the lower right hand corner.

Page 3/4 7-4

A footnote is added to Specification 4.7.1.2.a.2.(b) to allow greater flexibility in the surveillance of the turbine driven auxiliary feedwater pump during startup. After entering Mode 3 (Hot Standby, >325°F) from Mode 4 (Hot Shutdown, <325°F), a 24 hour grace period is established within which the pump must satisfy the discharge pressure requirement.

The proposed amendment has been reviewed by the St. Lucie Facility Review Group and the Florida Power & Light Company Nuclear Review Board. They have concluded that it does not involve an unreviewed safety question.

Very truly yours,

Robert E. Uhrig
Vice President
Advanced Systems & Technology

REU/MAS/ah
Attachment

cc: J. P. O'Reilly, Region II
Harold F. Reis, Esquire

A001
S
1/1
w/attach:
#4000.00

