


MAY 29 1981

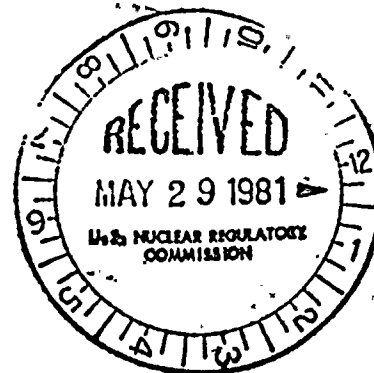

Docket No. 50-335

Dr. Robert E. Uhrig
Vice President
Advanced Systems & Technology
Florida Power & Light Company
P. O. Box 529100
Miami, Florida 33152

SUBJECT: ENVIRONMENTAL QUALIFICATION OF SAFETY-RELATED ELECTRICAL EQUIPMENT

RE: ST. LUCIE UNIT 1, LICENSE NO. DPR-67 *See rept. acc# 8106020208*

Reference (a) - Order for Modification of License Concerning the Environmental Qualification of Safety-Related Electrical Equipment dated October 24, 1980.

Dear Dr. Uhrig:

This letter transmits the Safety Evaluation for the Environmental Qualification of Safety-Related Electrical Equipment at your facility. This evaluation was based on your submittals dated July 3, August 6 and October 31, 1980 and April 8, 1981. Our letter of March 26, 1981, which forwarded our preliminary results, indicated that an item-by-item re-evaluation would be required at a later date. This safety evaluation identifies the specific information required by the staff and the actions, on your part, necessary to comply with Reference (a). We request that you provide the information identified in sections 3 and 4 of this Safety Evaluation to us within 90 days.

This safety evaluation addresses only the safety-related electrical equipment exposed to a harsh environment resulting from an accident (i.e., the IEB 79-01B review). Reference (a) requires that all safety-related electrical equipment be qualified by June 30, 1982. The NRC review effort for the equipment in mild environments will be addressed by separate correspondence.

Your response may present alternatives to the staff positions in the evaluation. The staff will consider alternative approaches if these methods are within the DOR Guidelines or NUREG-0588, as appropriate. For example, an acceptable alternative to the NRC staff's temperature criterion used for the service conditions (i.e. Section 3.3) must base that service condition on the FSAR analysis or other NRC approved analysis, provided that the specific analysis, together with reference to the previous NRC acceptance of that analysis, accompanies the 90 day response. In addition, some of the information in the Safety Evaluation may require clarification. Contact your project manager for assistance in these matters.

MR 4

OFFICE
SURNAME
DATE	8106020204

It remains your responsibility to assure that the qualification deadline is met for all safety-related electrical equipment. The staff's review of your response to this letter should not delay any action which is required in order to meet the deadline.

Sincerely,

Robert A. Clark, Chief
Operating Reactors Branch #3
Division of Licensing


Enclosures:

- 1. SER
- 2. TER

cc w/enclosures:
See next page

DISTRIBUTION: *w/enclosures
 Docket File * OELD
 NRC PDR* I&E (3)
 L PDR* Gray File
 NSIC* ACRS (10)
 TERA*
 ORB#3 Rdg
 DEisenhut
 JHeltemes
 MWilliams
 Project Manager
 PMKreutzer (3)
 RAClark

OFFICE	ORB#3:DL	ORB#3:DL	ORB#3:DL	ORB#3:DL			
SURNAME	PMKreutzer	CNEyson/pn	MWilliams	RAClark			
DATE	5/22/81	5/22/81	5/22/81	5/22/81			

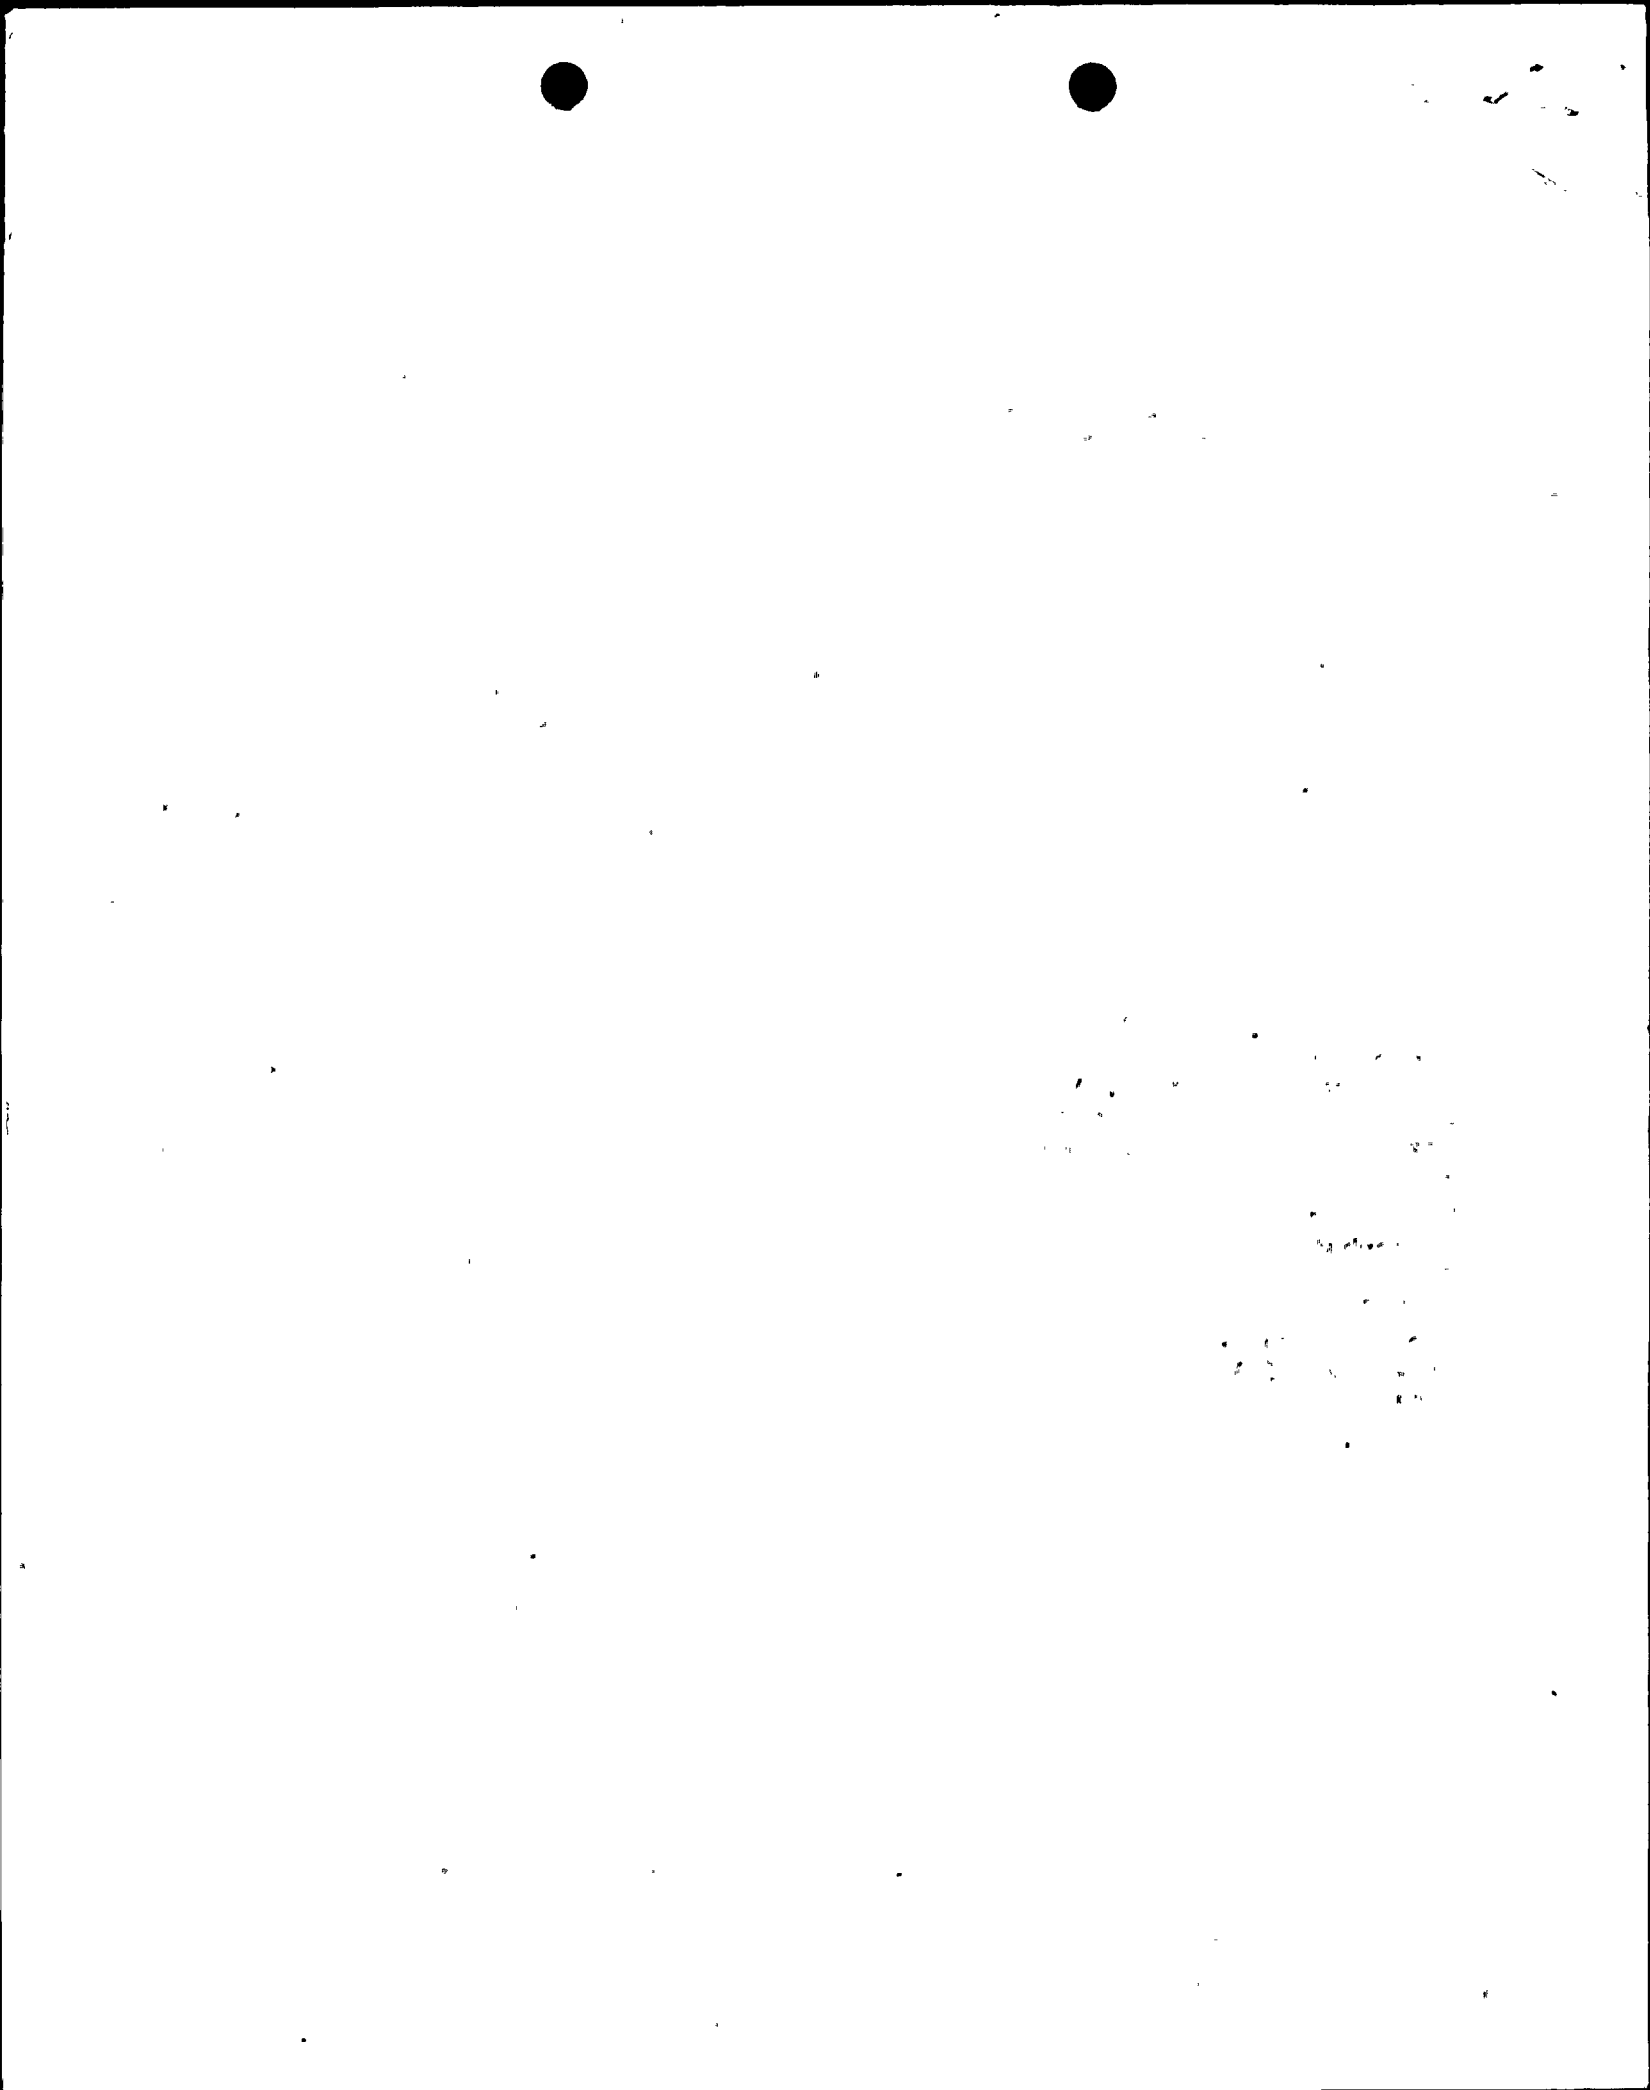



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

Docket file

May 29, 1981

Docket No. 50-335

Dr. Robert E. Uhrig
Vice President
Advanced Systems & Technology
Florida Power & Light Company
P. O. Box 529100
Miami, Florida 33152

SUBJECT: ENVIRONMENTAL QUALIFICATION OF SAFETY-RELATED ELECTRICAL EQUIPMENT

RE: ST. LUCIE UNIT 1, LICENSE NO. DPR-67

Reference (a) - Order for Modification of License Concerning the Environmental Qualification of Safety-Related Electrical Equipment dated October 24, 1980.

Dear Dr. Uhrig:

This letter transmits the Safety Evaluation for the Environmental Qualification of Safety-Related Electrical Equipment at your facility. This evaluation was based on your submittals dated July 3, August 6 and October 31, 1980 and April 8, 1981. Our letter of March 26, 1981, which forwarded our preliminary results, indicated that an item-by-item re-evaluation would be required at a later date. This safety evaluation identifies the specific information required by the staff and the actions, on your part, necessary to comply with Reference (a). We request that you provide the information identified in sections 3 and 4 of this Safety Evaluation to us within 90 days.

This safety evaluation addresses only the safety-related electrical equipment exposed to a harsh environment resulting from an accident (i.e., the IEB 79-01B review). Reference (a) requires that all safety-related electrical equipment be qualified by June 30, 1982. The NRC review effort for the equipment in mild environments will be addressed by separate correspondence.

Your response may present alternatives to the staff positions in the evaluation. The staff will consider alternative approaches if these methods are within the DOR Guidelines or NUREG-0588, as appropriate. For example, an acceptable alternative to the NRC staff's temperature criterion used for the service conditions (i.e. Section 3.3) must base that service condition on the FSAR analysis or other NRC approved analysis, provided that the specific analysis, together with reference to the previous NRC acceptance of that analysis, accompanies the 90 day response. In addition, some of the information in the Safety Evaluation may require clarification. Contact your project manager for assistance in these matters.

8106020204

It remains your responsibility to assure that the qualification deadline is met for all safety-related electrical equipment. The staff's review of your response to this letter should not delay any action which is required in order to meet the deadline.

Sincerely,

A handwritten signature in cursive script, appearing to read "Robert A. Clark", with a long horizontal line extending to the right.

Robert A. Clark, Chief
Operating Reactors Branch #3
Division of Licensing

Enclosures:

1. SER
2. TER

cc w/enclosures:
See next page

Florida Power & Light Company

cc:

Robert Lowenstein, Esquire
Lowenstein, Newman, Reis & Alexrad
1025 Connecticut Avenue, N.W.
Washington, D. C. 20036

Norman A. Coll, Esquire
McCarthy, Steel, Hector & Davis
14th Floor, First National Bank Building
Miami Florida 33131

Indian River Junior College Library
3209 Virginia Avenue
Fort Pierce, Florida 33450

Administrator
Department of Environmental Regulation
Power Plant Siting Section
State of Florida
2600 Blair Stone Road
Tallahassee, Florida 32301

Mr. Weldon B. Lewis
County Administrator
St. Lucie County
2300 Virginia Avenue, Room 104
Fort Pierce, Florida 33450

Director, Criteria and Standards Division
Office of Radiation Programs (ANR-460)
U.S. Environmental Protection Agency
Washington, D. C. 20460

U.S. Environmental Protection Agency
Region IV Office
ATTN: EIS COORDINATOR
345 Courtland Street, N.E.
Atlanta, Georgia 30308

Mr. Charles B. Brinkman
Manager - Washington Nuclear Operations
C-E Power Systems
Combustion Engineering, Inc.
4853 Cordell Avenue, Suite A-1
Bethesda, Maryland 20014

Mr. Jack Schreve
Office of the Public Counsel
Room 4, Holland Building
Tallahassee, Florida 32304

Resident Inspector/St. Lucie
Nuclear Power Station
c/o U.S.N.R.C.
P. O. Box 400
Jensen Beach, Florida 33457

Bureau of Intergovernmental
Relations
660 Apalachee Parkway
Tallahassee, Florida 32304