

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8109290256 DOC. DATE: 81/09/22 NOTARIZED: NO
 FACIL: 50-335 St. Lucie Plant, Unit 1, Florida Power & Light Co.
 AUTH. NAME: UHRIG, R. E. AUTHOR AFFILIATION: Florida Power & Light Co.
 RECIP. NAME: EISENHUT, D. G. RECIPIENT AFFILIATION: Division of Licensing

DOCKET #
05000335

SUBJECT: Informs of progress towards implementing NUREG-0737 Item II, E, 1, 2 Safety-grade equipment associated w/automatic initiation of auxiliary feedwater flow will be installed during current refueling outage.

DISTRIBUTION CODE: A0465 COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 11x14
 TITLE: Response to NUREG-0737/NUREG-0660 TMI Action Plan Rgnmts (OL's)


NOTES:

	RECIPIENT ID CODE/NAME	COPIES LTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTR ENCL
ACTION:	ORR #3 BCI 05	7		
INTERNAL:	A/D C&S SYS 27	1	A/D C&S ENG 22	1
	A/D FORI TECH 32	1	A/D GEN PROJ 31	1
	A/D LICENS 16	1	A/D M&O ENG 23	1
	A/D OP REACT 15	1	A/D PLANT SYS 25	1
	A/D RAD PROT 26	1	A/D SAFETY AS 17	1
	DEP DIR, DHFS 29	1	DIR, EM PREP 33	1
	DIRECTOR, DEI 21	1	DIRECTOR, DHFS 28	1
	DIRECTOR, DLI 14	1	DIRECTOR, DSI 24	1
	DIRECTOR, DST 30	1	I&E 12	2
	IE/EPDBI	1	IE/EPDBI	1
	OELD	1	OR ASSESS BR 18	3
	PDR	1	RAD ASMT BR	1
	<u>REG. FILE</u> 01	1		
EXTERNAL:	ACRS 34	16 16	FEMA-REP. DIV	1
	INPO, J. STARNES	1	LPDR 03	1
	NSIC 04	1	NTIS	1

MA
4


OCT 01 1981

TOTAL NUMBER OF COPIES REQUIRED: LTR 56 ENCL 0

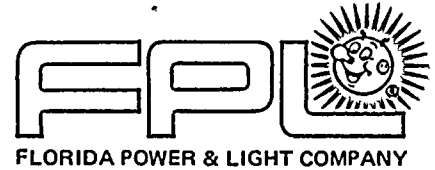

September 22, 1981
L-81-416

Office of Nuclear Reactor Regulation
Attention: Mr. Darrell G. Eisenhut, Director
Division of Licensing
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

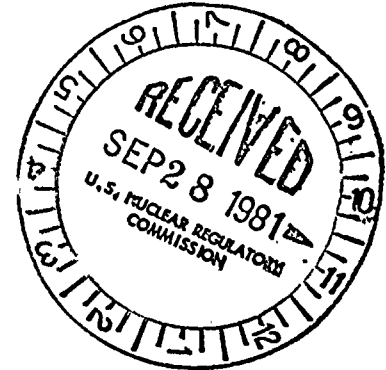

Dear Mr. Eisenhut:

Re: St. Lucie Unit 1
Docket No. 50-335
Post-TMI Requirements

This letter is to inform you of our progress toward the implementation of NUREG-0737 item II.E.1.2. In our letter of January 2, 1981 (L-81-4) we described the Auxiliary Feedwater (AFW) System modifications which would be implemented by January 1, 1982. We intend to install the safety-grade equipment associated with the automatic initiation of AFW flow during the current refueling outage. Upon implementation, St. Lucie 1 will have addressed all the NUREG requirements regarding auto-initiation of AFW.

However, the Auxiliary Feedwater Logic Cabinet which incorporates additional AFW capabilities (automatic isolation of a faulted steam generator or high energy line break) not required by the NUREG cannot be installed and tested during this refueling outage due to the equipment delivery dates. We plan to implement this portion of the system during the next refueling outage.

We will inform you should we meet any unexpected delays that would affect this schedule.

Very truly yours,

Robert E. Uhrig
Vice President
Advanced Systems & Technology

REU/PKG/ras

cc: Mr. J. P. O'Reilly, Region II
Harold F. Reis, Esquire

*AOAB
5/10*

8109290256 810922
PDR ADOCK 05000335
PDR

SECRET

SECRET

SECRET

SECRET

SECRET

SECRET