


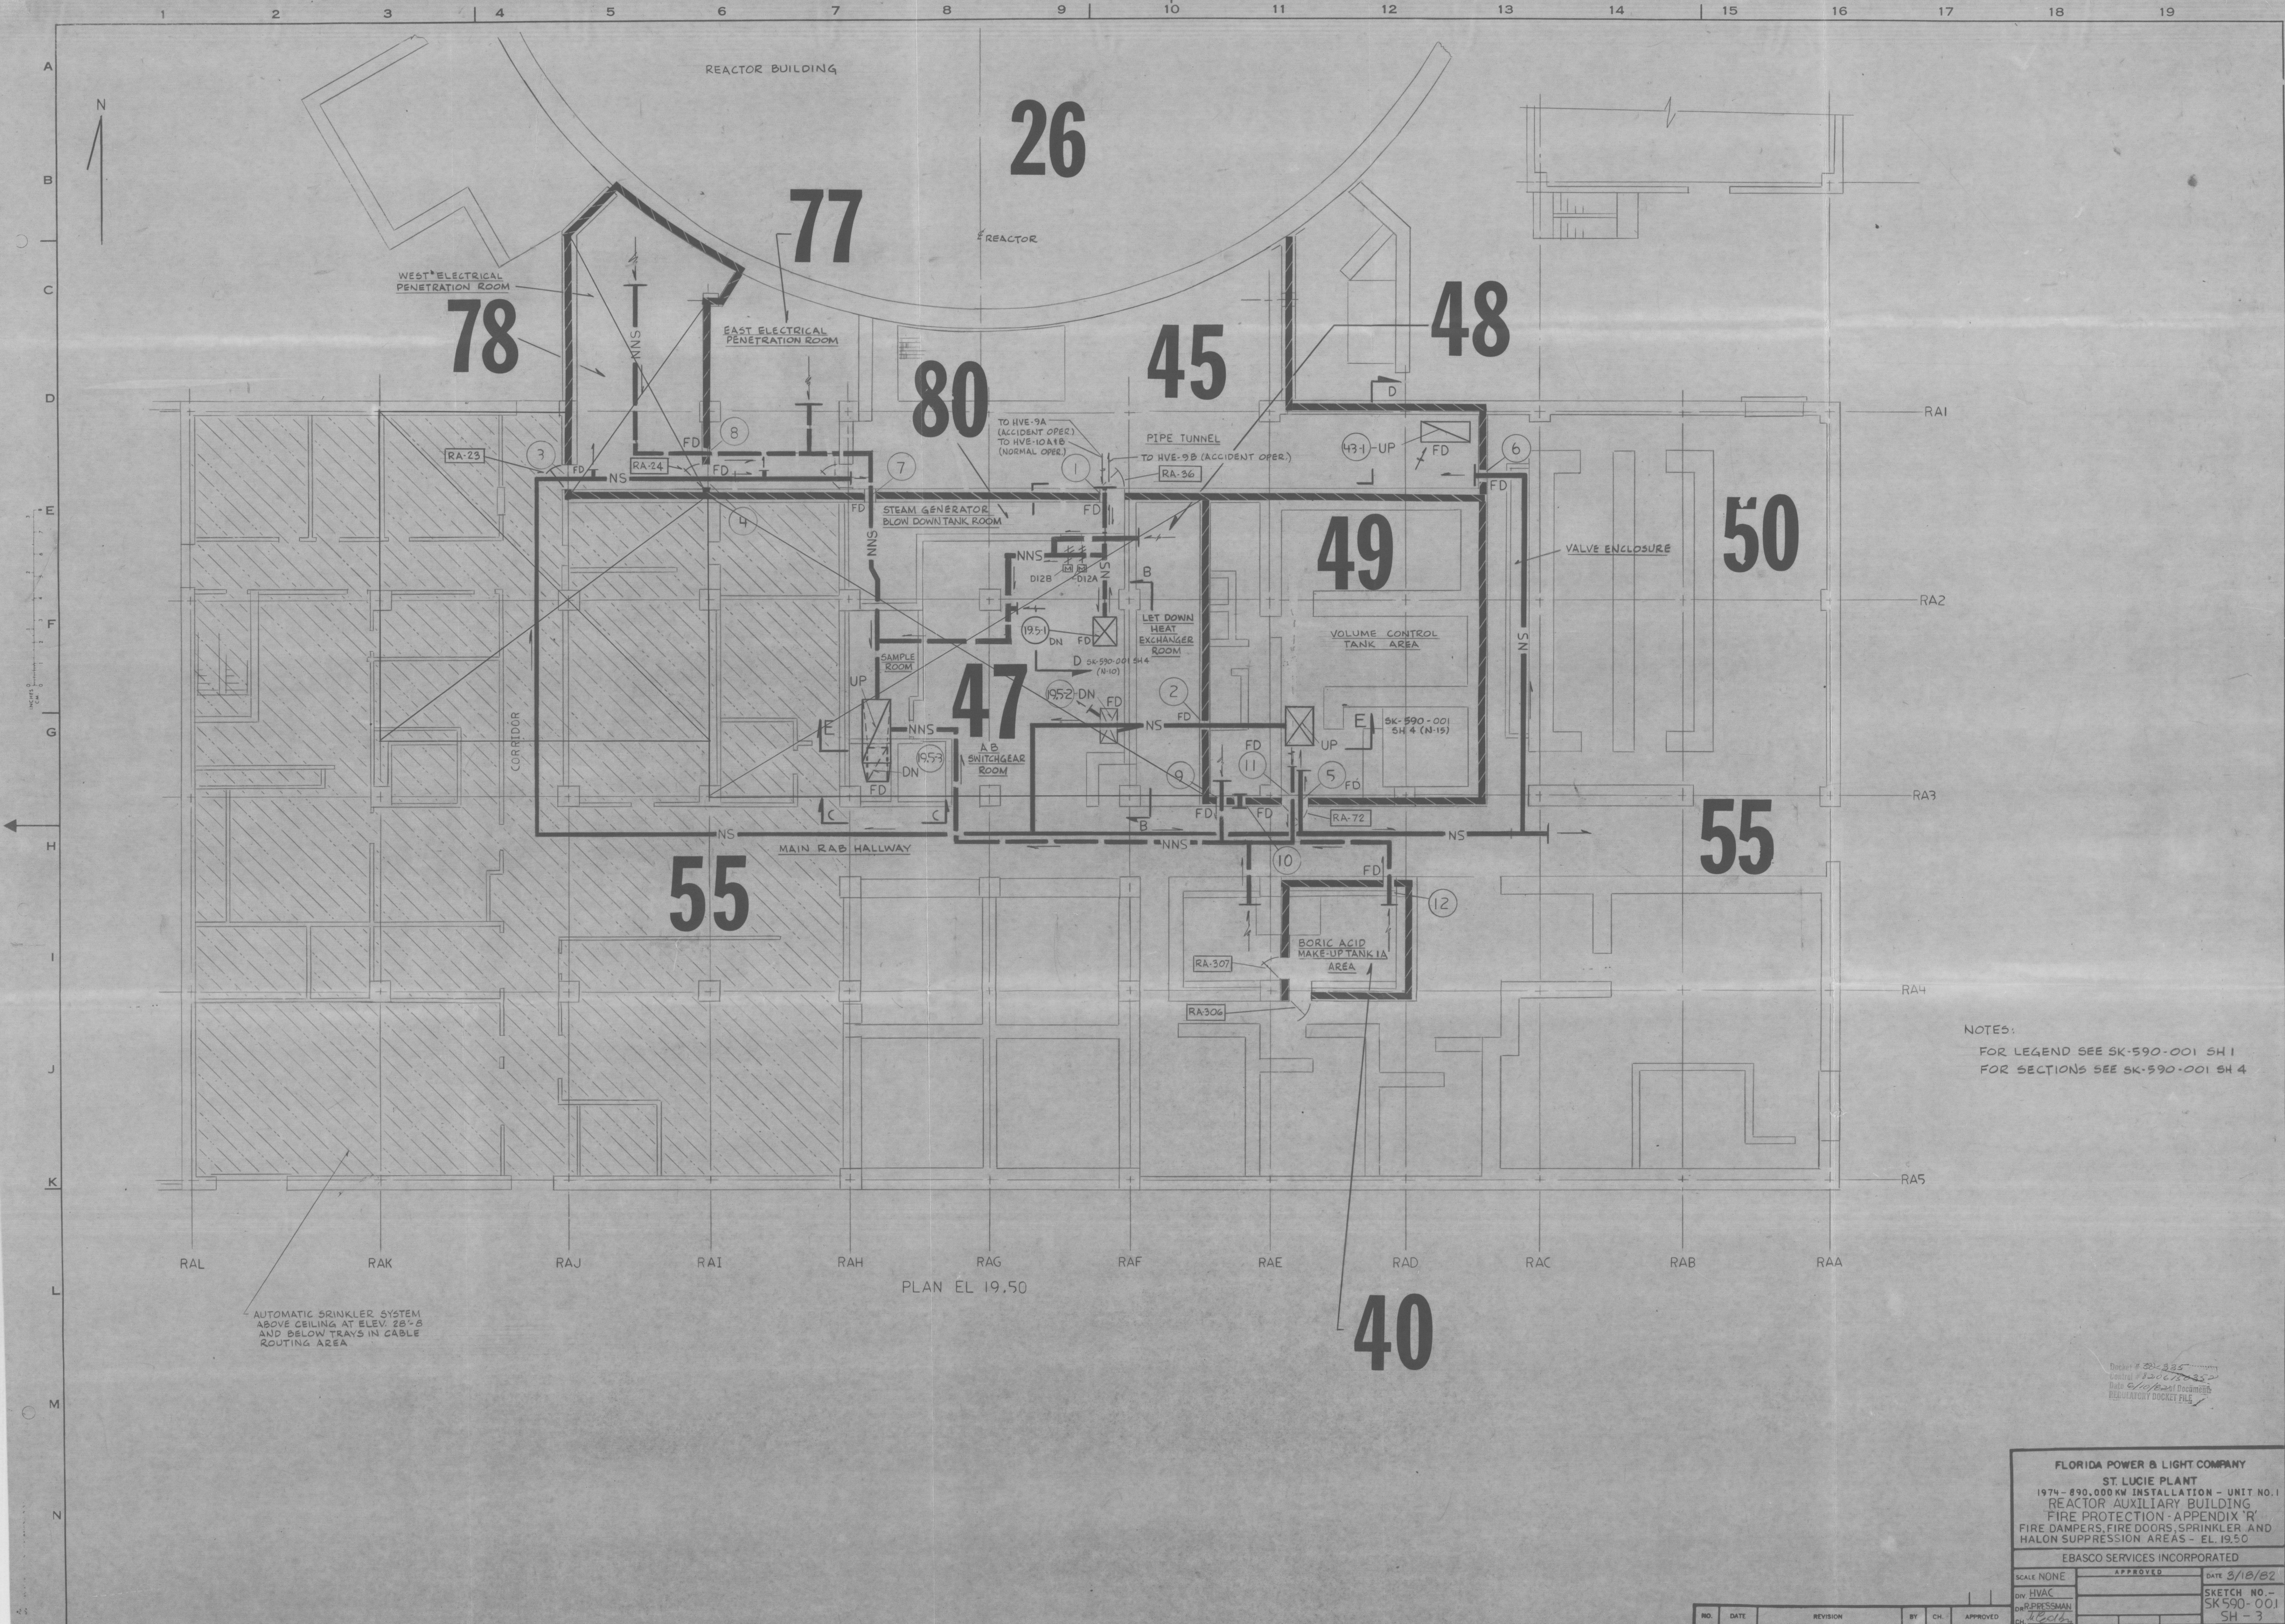

NOTES:
FOR LEGEND SEE SK-590-001 SH 1
FOR SECTIONS SEE SK-590-001 SH 4

FLORIDA POWER & LIGHT COMPANY			
ST. LUCIE PLANT			
1974 - 890,000 KW INSTALLATION - UNIT NO. 1			
REACTOR AUXILIARY BUILDING			
FIRE PROTECTION - APPENDIX 'R'			
FIRE DAMPERS, FIRE DOORS, SPRINKLER AND			
HALON SUPPRESSION AREAS - EL. 19.50			
EBASCO SERVICES INCORPORATED			
SCALE NONE		APPROVED	
DIV. HVAC		DATE 3/18/82	
DR. R. PRESSMAN		SKETCH NO. -	
CH. [Signature]		SK-590-001	
		SH - 3	

NO.	DATE	REVISION	BY	CH.	APPROVED
17					
18					
19					