

NOV 3 1982

Docket No.: 50-389

APPLICANT: Florida Power and Light Company (FP&L)

FACILITY: St. Lucie Plant, Unit 2

SUBJECT: SUMMARY OF MEETING HELD IN BETHESDA, MARYLAND WITH FP&L ON OCTOBER 29, 1982 REGARDING ENVIRONMENTAL QUALIFICATION (EQ) ITEMS

A meeting was held on October 29, 1982 between the NRC and FP&L to discuss EQ items and the course of action needed to resolve outstanding issues. A summary of the results of this meeting is given below.

1. FP&L will provide a description of how the heat flux, (Q/A) was calculated for the solenoid valve.
2. Thermal lag analysis does not appear to consider if a spectrum of break sizes will conservatively envelope the temperature and heat flux conditions that might occur for a small break. FP&L will provide clarification.
3. FP&L will provide a description of the effects of thermal shock on the solenoid used in the thermal lag analysis. FP&L will answer the question of whether thermal shock is a problem with a high ramp transient that is expected in a worst case main steam line break.
4. NRC will randomly select three pieces of mechanical equipment to be audited for environmental qualification review. FP&L will provide the specification criteria, a drawing of the component including materials identification of environmentally sensitive material in each component and the justification for the environmental qualification (vendor info, test reports, etc.).
5. FP&L will provide more specific information on the justification for interim operation and include as much detail as possible to address the five categories of information requested in the SER. This specific information should demonstrate why the equipment may be considered acceptable for interim operation. Test conditions should be clearly specified, test results should be provided to support the conclusions. If this qualification testing information cannot be provided then a failure modes and effects analysis must be performed to demonstrate that the plant can be satisfactorily operated if the equipment were to experience failure.

8211100054 821103
 PDR ADOCK 05000389
 A PDR

OFFICE
SURNAME
DATE

224


- 6. FP&L will make a statement that post accident aging is not used to qualify a component for pre-accident aging conditions for all equipment in a harsh environment.
- 7. FP&L provided a list of TMI equipments for staff review.

Victor Nerses, Project Manager
 Licensing Branch No. 3
 Division of Licensing

Enclosure:
 List of Attendees

cc: See next page

OFFICE	DL:LB#3	DL:LB#3					
SURNAME	VNerses/yt	GWRighton					
DATE	11/2/82	11/3/82					

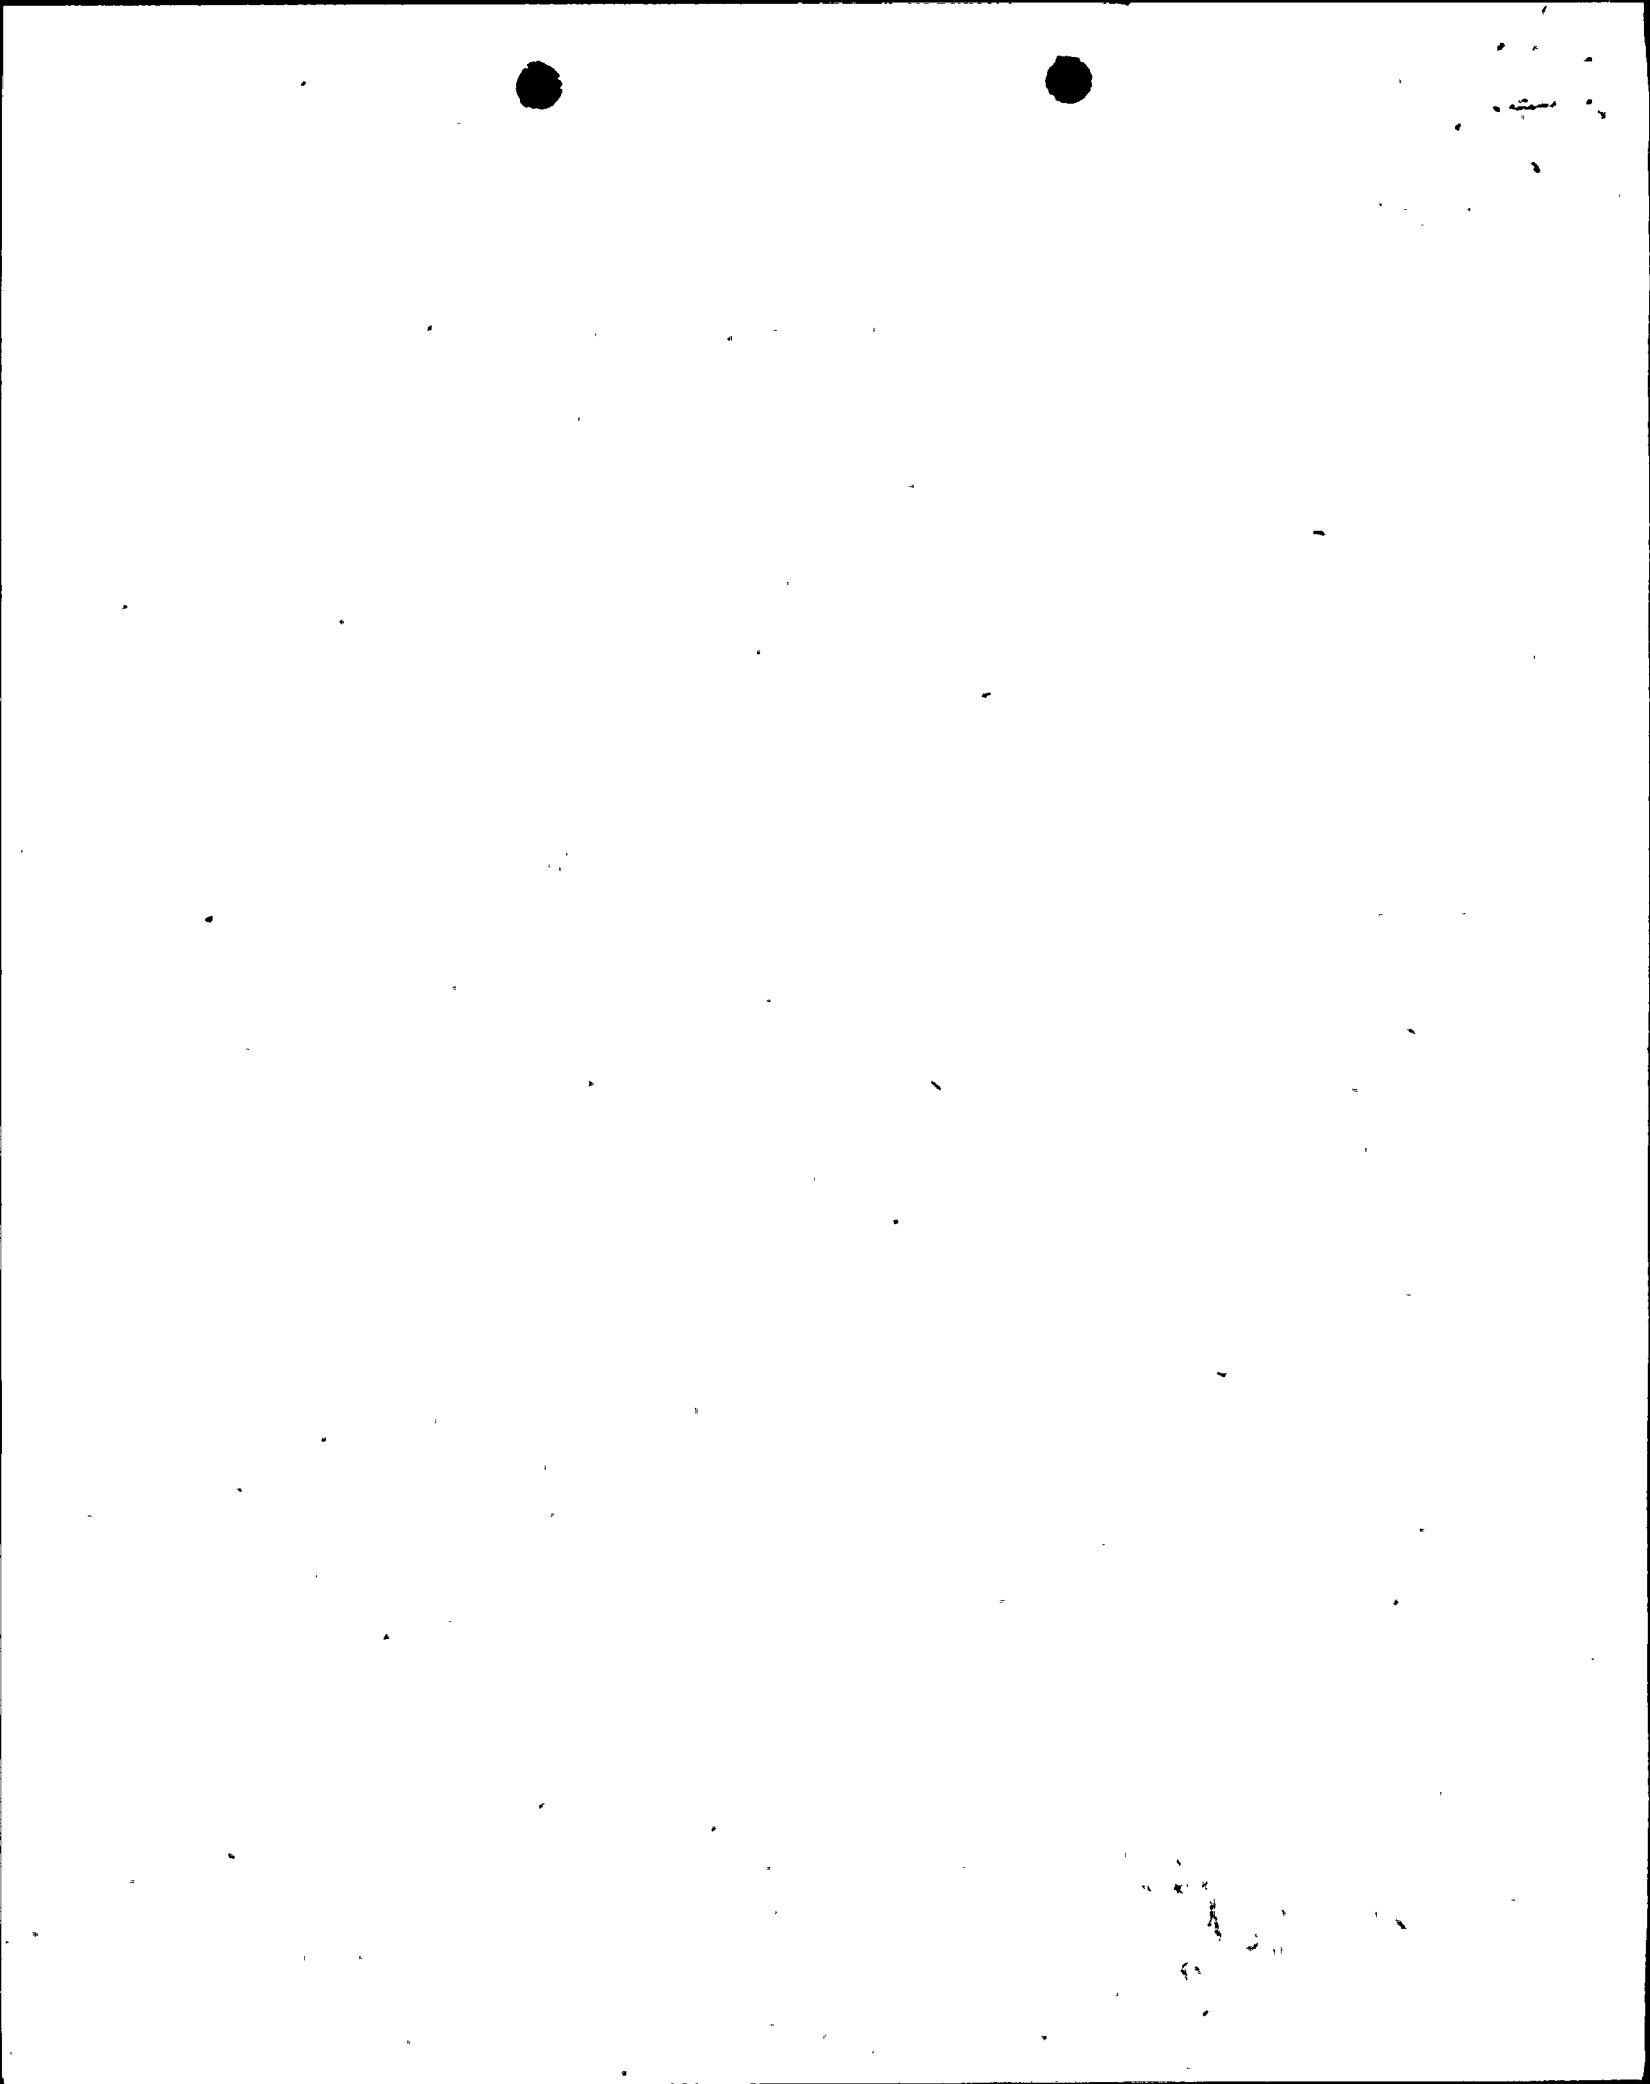

Dr. Robert E. Uhrig, Vice President
Advanced Systems and Technology
Florida Power & Light Company
P. O. Box 5291000
Miami, Florida 33152

Harold F. Reis, Esq.
Lowenstein, Newman, Reis, Axelrad & Toll
1025 Connecticut Avenue, N.W.
Washington, D. C. 20036

Norman A. Coll, Esq.
Steel Hector & Davis
1400 Southeast First National
Bank Building
Miami, Florida 33131

Mr. Martin H. Hodder
1131 N. E. 86th Street
Miami, Florida 33138

Resident Inspector
St. Lucie Nuclear Power Station
c/o U. S. Nuclear Regulatory Commission
7900 South A1A
Jensen Beach, Florida 33457

Regional Administrator - Region II
U. S. Nuclear Regulatory Commission
101 Marietta Street
Suite 3100
Atlanta, Georgia 30303

Attendees
October 29, 1982

NRC Staff

V. Nerses
B. LaGrange
J. Kennedy

Florida Power & Light Company

J. Franklin
J. Sheetz

MEETING SUMMARY

NOV 3 1982

Document Control (50-389)
NRC PDR
L PDR
NSIC
TERA -

LB#3 Reading
J. Lee
G. Knighton
Project Manager VNurses
Attorney, OELD
E. L. Jordon
Regional Administrator, Region II
J. M. Taylor

PARTICIPANTS (NRC):

VNurses
BLaGrange
JKennedy

