

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8302230443 DOC. DATE: 83/02/16 NOTARIZED: YES DOCKET #
 FACIL: 50-335 St. Lucie Plant, Unit 1, Florida Power & Light Co. 05000335
 AUTH. NAME AUTHOR AFFILIATION
 UHRIG, R.E. Florida Power & Light Co.
 RECIP. NAME RECIPIENT AFFILIATION
 EISENHUT, D.G. Division of Licensing

SUBJECT: Application for amend to License DPR-67, revising surveillance requirements of 125-volt dc batteries in conjunction w/mods to sys.

DISTRIBUTION CODE: A015S COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 3+4
 TITLE: OR Submittal: Onsite Emergency Power System

NOTES:


	RECIPIENT ID CODE/NAME		COPIES		RECIPIENT ID CODE/NAME	COPIES	
			LTR	ENCL		LTR	ENCL
	NRR ORB3 BC 01		7	7			
INTERNAL:	NRR/DL/ORAB 12		1	1	NRR/DSI/ICSB 09	1	1
	NRR/DSI/PSB 14		1	1	<u>REG FILE</u> 04	1	1
	RGN2		1	1	RM/DDAMI/MIB 18	1	1
EXTERNAL:	ACRS 16		6	6	INPO, J. STARNES	1	1
	LPDR 03		1	1	NRC PDR 02	1	1
	NSIC 05		1	1	NTIS	1	1

TOTAL NUMBER OF COPIES REQUIRED: LTR 24 ENCL 24

THE DIRECTOR GENERAL OF THE CUSTOMS AND EXCISE DEPARTMENT
 HAS THE HONOUR TO ADVISE THAT THE FOLLOWING LIST OF GOODS
 IS APPROVED FOR EXPORTATION UNDER THE PROVISIONS OF THE
 CUSTOMS ACT, 1912.

THE GOODS ARE TO BE EXPORTED TO THE FOLLOWING COUNTRIES:—
 INDIA, BURMA, CEYLON, SINGAPORE, MALACCA, PENANG, AND
 THE STRAITS SETTLEMENTS.

Sl. No.	Description of Goods	Quantity	Value	Remarks
1	Opium	100	10000	
2	Gold	100	10000	
3	Silver	100	10000	
4	Iron	100	10000	
5	Wool	100	10000	
6	Cotton	100	10000	
7	Wheat	100	10000	
8	Barley	100	10000	
9	Oats	100	10000	
10	Rice	100	10000	

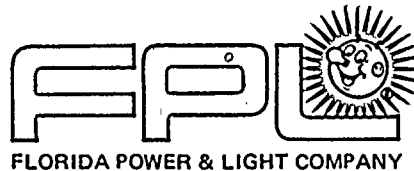

February 16, 1983
L-83-81

Office of Nuclear Reactor Regulation
Attention: Mr. Darrell G. Eisenhut, Director
Division of Licensing
U.S. Nuclear Regulatory Commission
Washington, D. C. 20555

Dear Mr. Eisenhut:

Subject: St. Lucie Unit 1
Docket No. 50-335
Proposed License Amendment
D. C. Distribution

In accordance with 10 CFR 50.90, Florida Power & Light Company submits herewith three signed originals and forty copies of a request to amend Appendix A of Facility Operating License DPR-67.

The proposed amendment is described below and shown on the accompanying Technical Specification pages. The purpose of this amendment is to revise the surveillance requirements of the 125 volt DC batteries in conjunction with modifications to the system. In place of the current two 1800 amp. hr. batteries and three 300 ampere chargers, the new system will consist of two 2160 amp. hr. batteries and five 300 ampere chargers. The revised specifications are needed to accommodate increased D.C. loads, which will be added during the upcoming refueling outage, and to upgrade these specifications to the latest industry testing standards. The surveillance changes will make the Unit 1 surveillance requirements similar to the Unit 2 requirements.

Page 3/4 8-10, 11, 12


The Action Statement and surveillance requirements of Specification 3.8.2.3 are changed to address the system modifications and to make the requirements similar to St. Lucie Unit 2.

In order to support our current installation and test schedule, we would request review and approval of this change by March 1, 1983. We understand that this is an abbreviated schedule, however, we were unable to submit our request earlier because of the need to review the Unit 2 specifications which we have just recently received.

AOIS


We have determined that this is a Class III amendment in accordance with 10 CFR 170.22. A check in the amount of \$4,000 will follow shortly.

8302230443 830216
PDR ADOCK 05000335
PDR



The proposed amendment has been reviewed and approved by the St. Lucie Facility Review Group and the Florida Power & Light Company Nuclear Review Board.

Very truly yours,

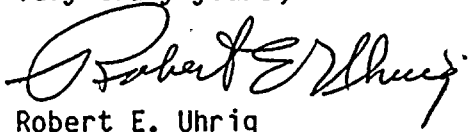

Robert E. Uhrig
Vice President
Advanced Systems & Technology

REU/PLP/js

Enclosure


cc: Mr. J. P. O'Reilly, Region II
Harold F. Reis, Esquire
PNS-LI-83-092-1

STATE OF FLORIDA)
)
) ss.
COUNTY OF DADE)

Robert E. Uhrig, being first duly sworn, deposes and says:


That he is Vice President of Florida Power & Light Company, the licensee herein;

That he has executed the foregoing document; that the statements made in this said document are true and correct to the best of his knowledge, information, and belief, and that he is authorized to execute the document on behalf of said

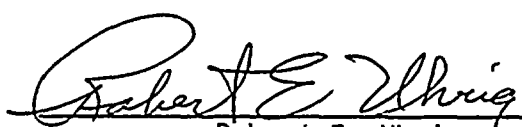

Robert E. Uhrig

Subscribed and sworn to before me this
16th day of February, 1983



Cheryl I. Fredrick
NOTARY PUBLIC in and for the County of Dade,
State of Florida

My commission expires: Notary Public, State of Florida at Largo
My Commission Expires October 30, 1983
Renewed thru Maynard Bonding Agency

