
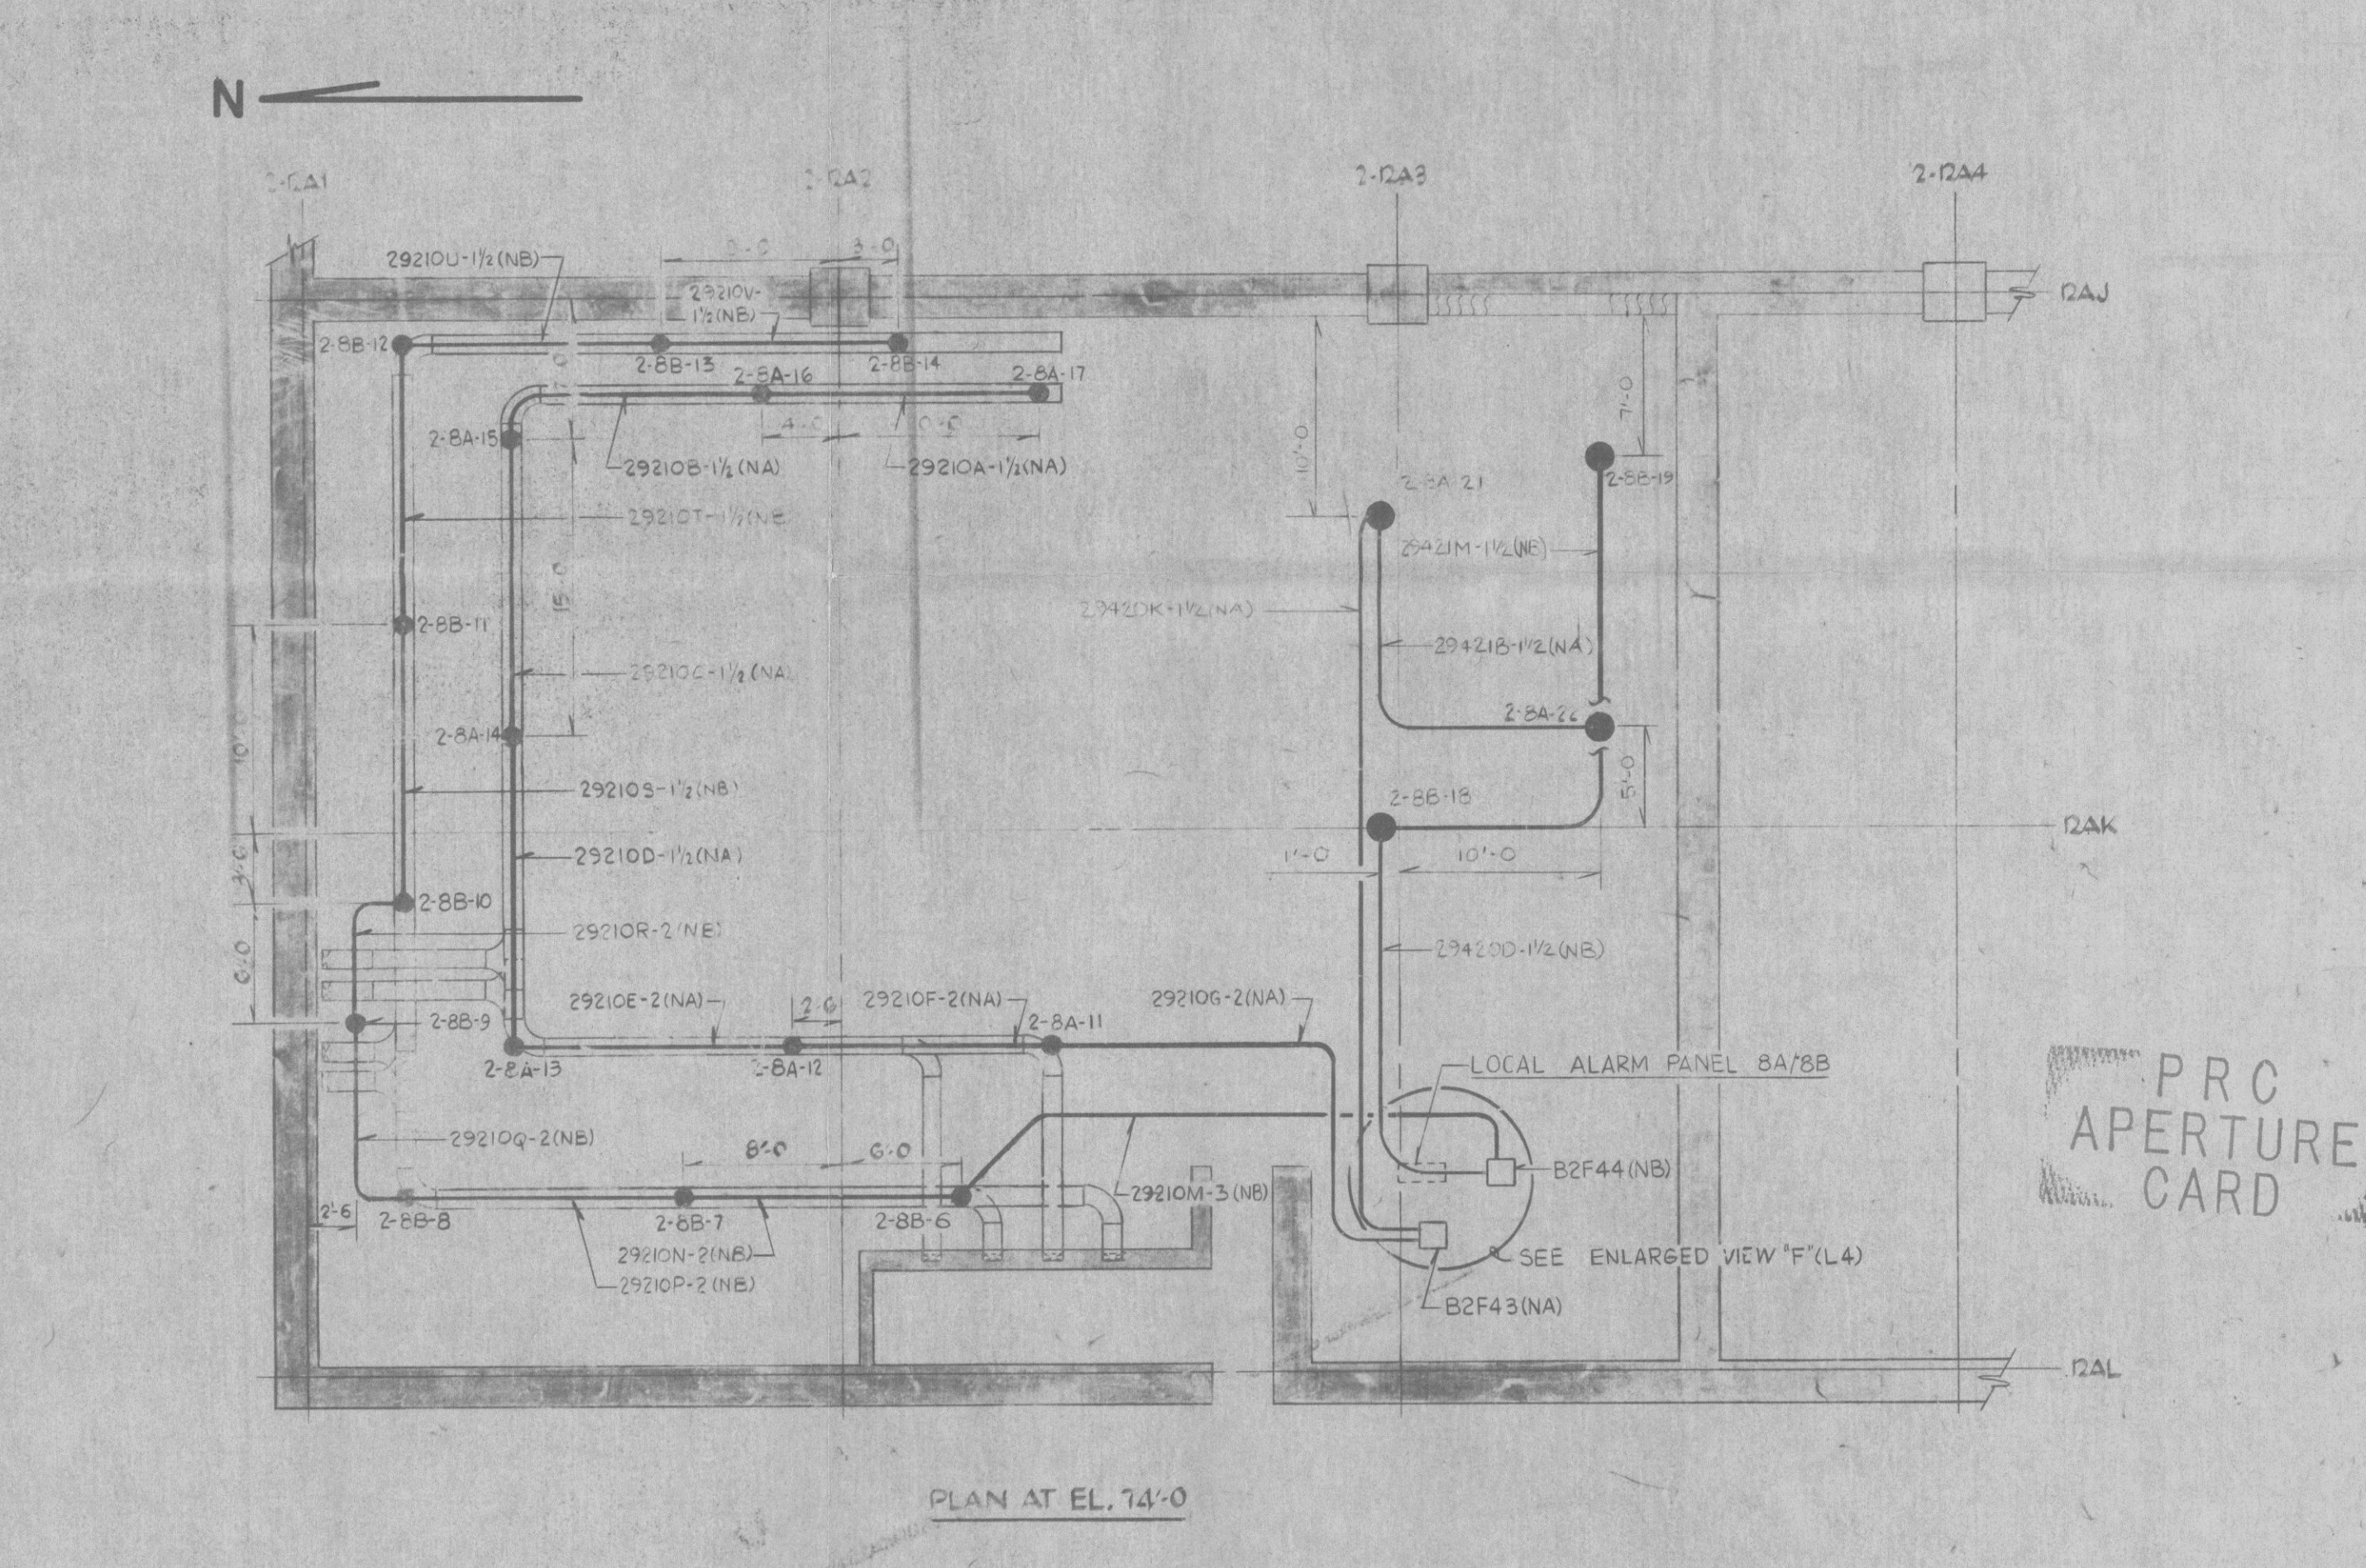


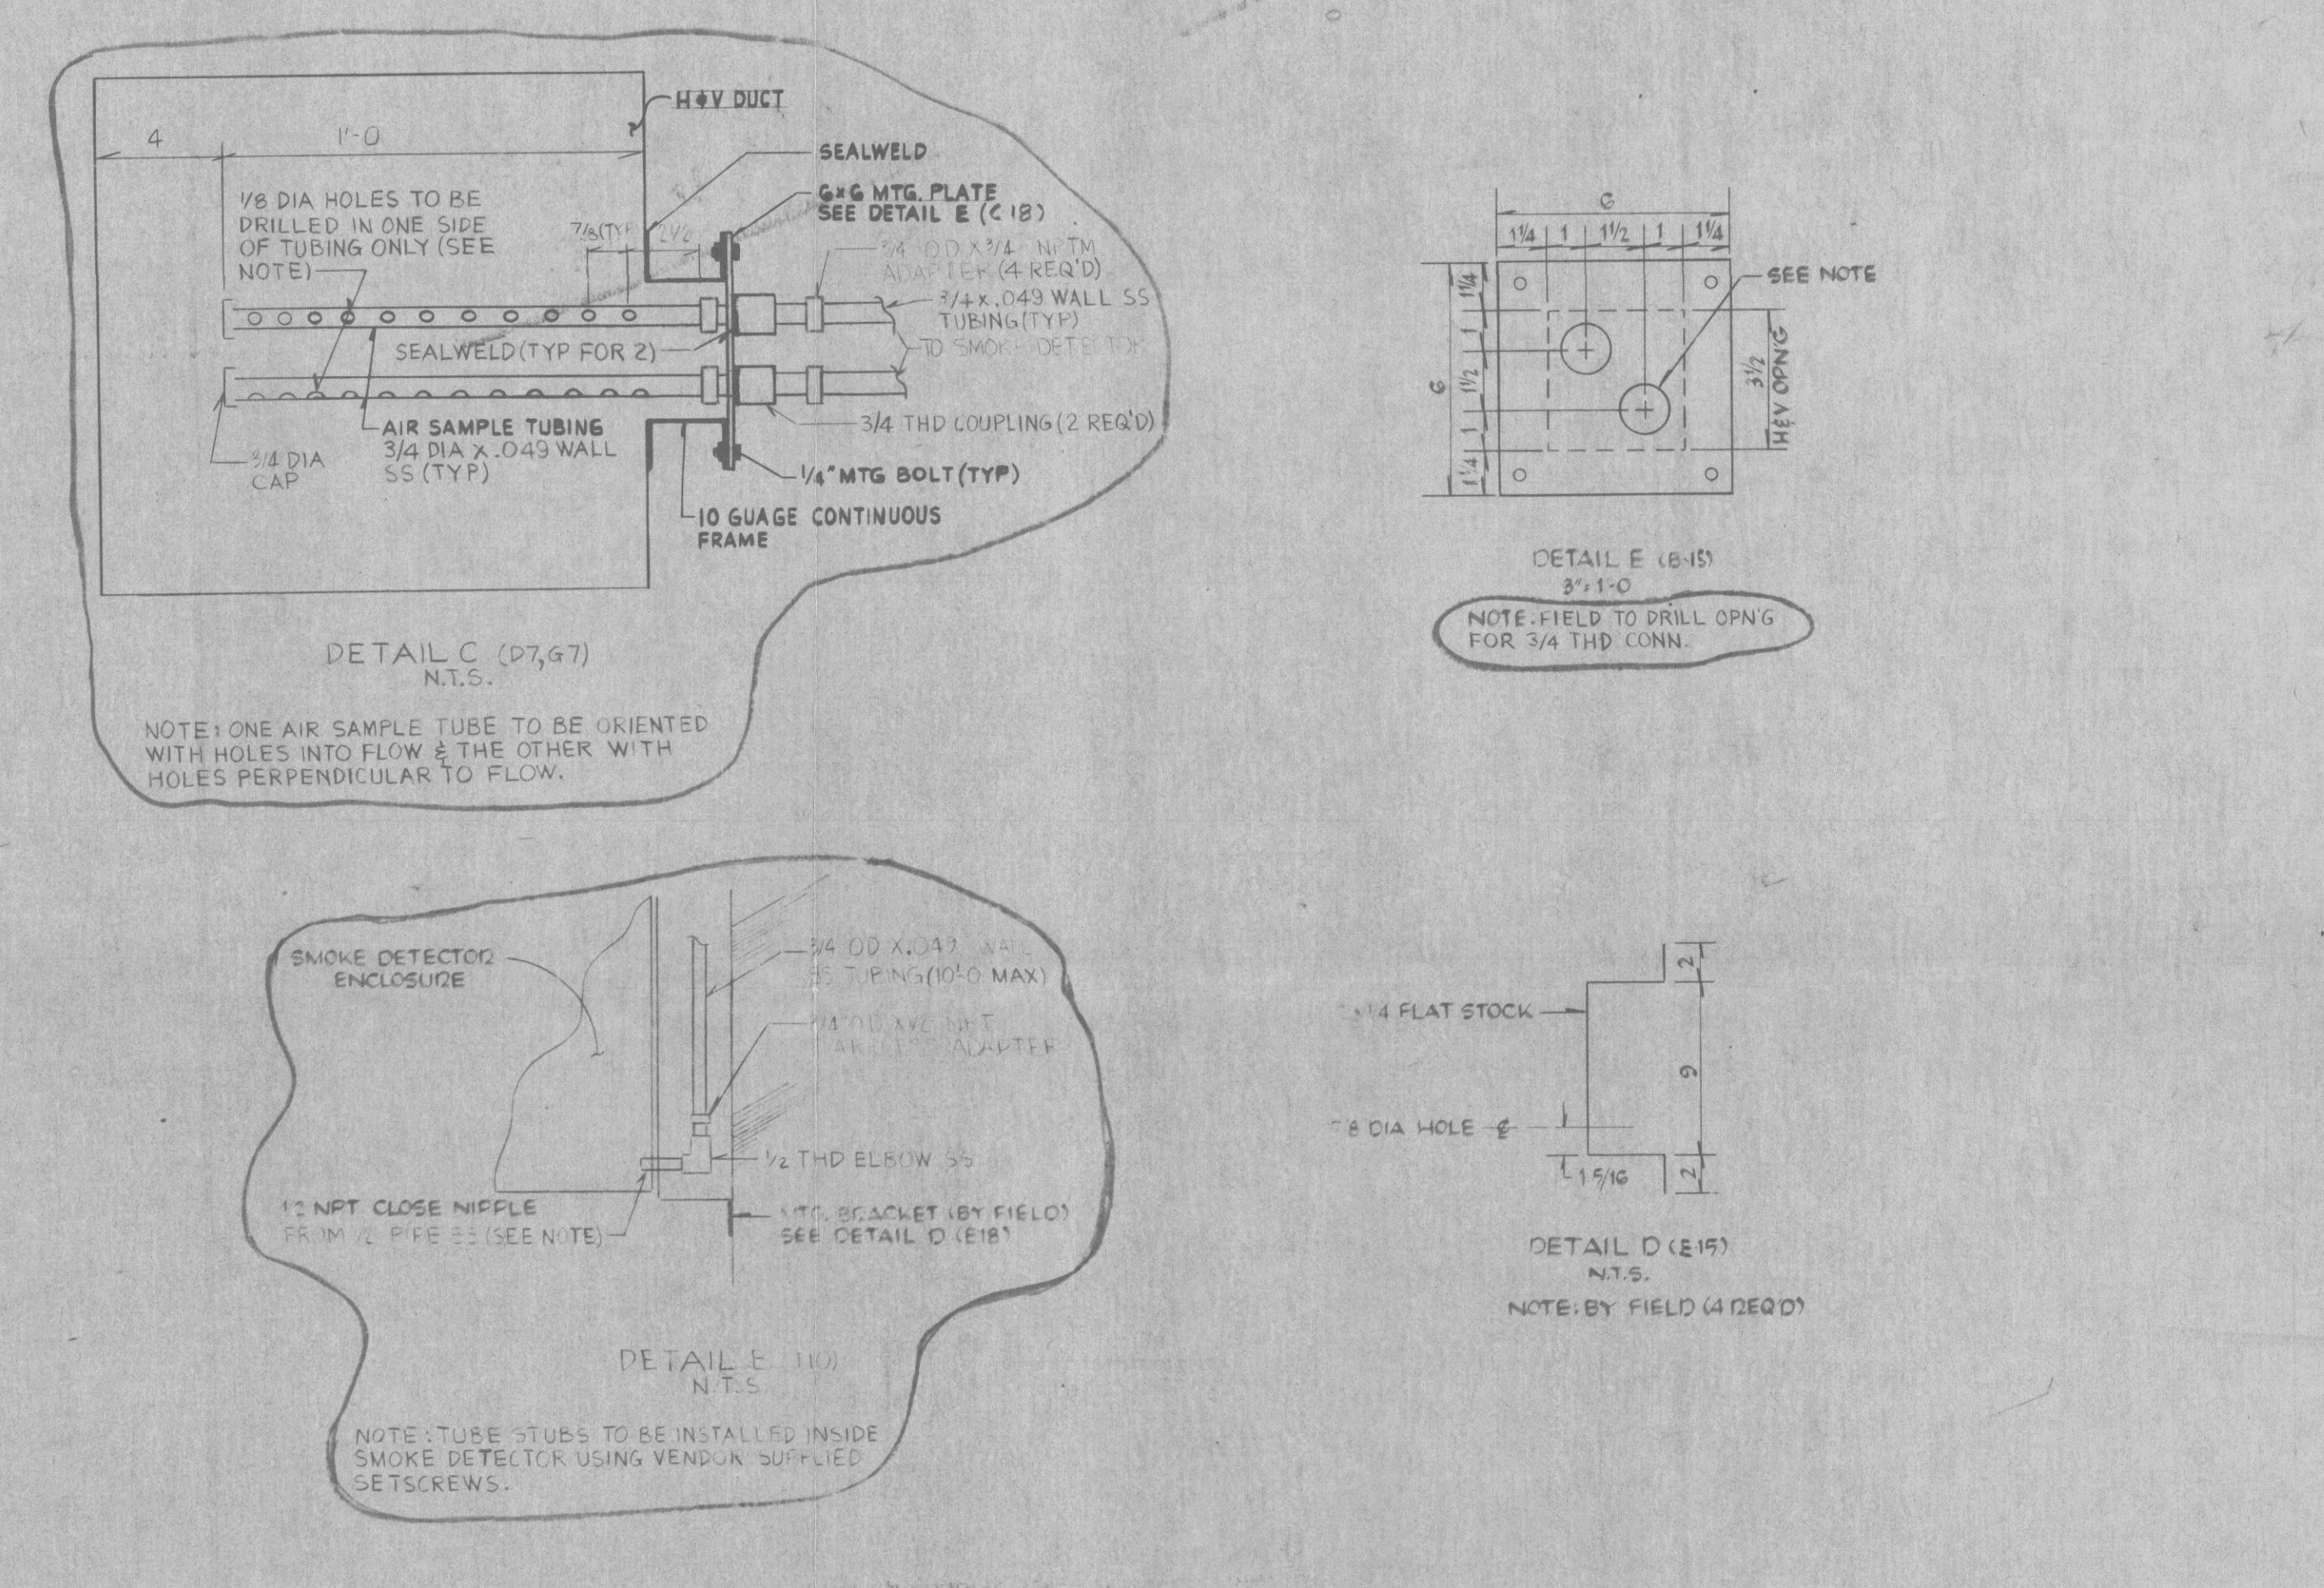

**INFORMATION
ONLY**
VERIFY WITH A CONTROLLED
COPY BEFORE USE

BEST PRINT POSSIBLE

- NOTES:**
- 1) FOR NOTES, SYMBOLS & REFERENCE DWGS, SEE DWG. 2908-C-413 SH.1
 - 2) IN AREAS WITH HUNG CEILING, CONDUITS AND BOXES ARE TO BE LOCATED ABOVE HUNG CEILING.
 - 3) THE DOCUMENTS SUCH AS A3 FCR'S, DCN'S, ETC., WRITTEN AGAINST THIS DWG ARE LISTED ON DWG 2908-B-421, SH 413-7.0

Docket # 50-389
Control # 8401040538
Date 5/3/27 of Document
REGULATORY DOCKET FILE JUL 25 196



THIS DOCUMENT IS THE PROPERTY OF EBASCO SERVICES INCORPORATED. ITS USE IS EXPRESSLY RESTRICTED BY THE TERMS OF THE CONTRACT, DATED AS OF SEPT. 1, 1975 BETWEEN EBASCO SERVICES INCORPORATED AND FLORIDA POWER & LIGHT COMPANY.

FLORIDA POWER & LIGHT COMPANY
ST. LUCIE PLANT
1983-890 MW (e) EXTENSION-UNIT NO. 2
REACTOR AUXILIARY BUILDING
FIRE DETECTION SYSTEM
CONDUIT LAYOUT EL 52'-0"

EBASCO SERVICES INCORPORATED NEW YORK

SCALE 1/8"=1'-0"	<u>APPROVED</u> <i>[Signature]</i>	DATE 4-27-79
------------------	---------------------------------------	--------------

DIV. ELEC. *W. W. Teller* 2998-G-413

DR. <u>W. J. L. DORE</u>				2555 6 115
CH. <u>W. J. L. DORE</u>	<u>W. J. L. DORE</u>	<u>W. J. L. DORE</u>	<u>W. J. L. DORE</u>	SH. 7

18 19

[illegible]