

REGULATOR INFORMATION DISTRIBUTION SYSTEM (RIDS)


ACCESSION NBR: 8412070181 DOC. DATE: 84/11/29 NOTARIZED: NO DOCKET # 05000389
 FACIL: 50-389 St. Lucie Plant, Unit 2, Florida Power & Light Co.
 AUTH. NAME: WILLIAMS, J.W. AUTHOR AFFILIATION: Florida Power & Light Co.
 RECIP. NAME: MILLER, J.R. RECIPIENT AFFILIATION: Operating Reactors Branch 3


SUBJECT: Advises that intake structure pump encl fan housing & condensate storage tank vent hood housing modified, per SSER 2 (NUREG-0843). Reactor auxiliary bldg sliding door satisfies NRC allowable ductility factor.

DISTRIBUTION CODE: A001D COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 1
 TITLE: OR Submittal: General Distribution

NOTES: 05000389
 OL: 04/06/83

RECIPIENT ID CODE/NAME		COPIES LTTR ENCL		RECIPIENT ID CODE/NAME		COPIES LTTR ENCL	
NRR ORB3 BC 01		7					
INTERNAL:	ACRS 09	6	6	ADM/LFMB		1	0
	ELD/HDS2	1	0	NRR/DE/MTEB		1	0
	NRR/DL DIR	1		NRR/DL/ORAB		1	0
	NRR/DSI/METB	1		NRR/DSI/RAB		1	1
	REG FILE 04	1		RGN2		1	1
EXTERNAL:	LPDR 03	1	1	NRC PDR 02		1	1
	NSIC 05	1	1	NTIS		1	1

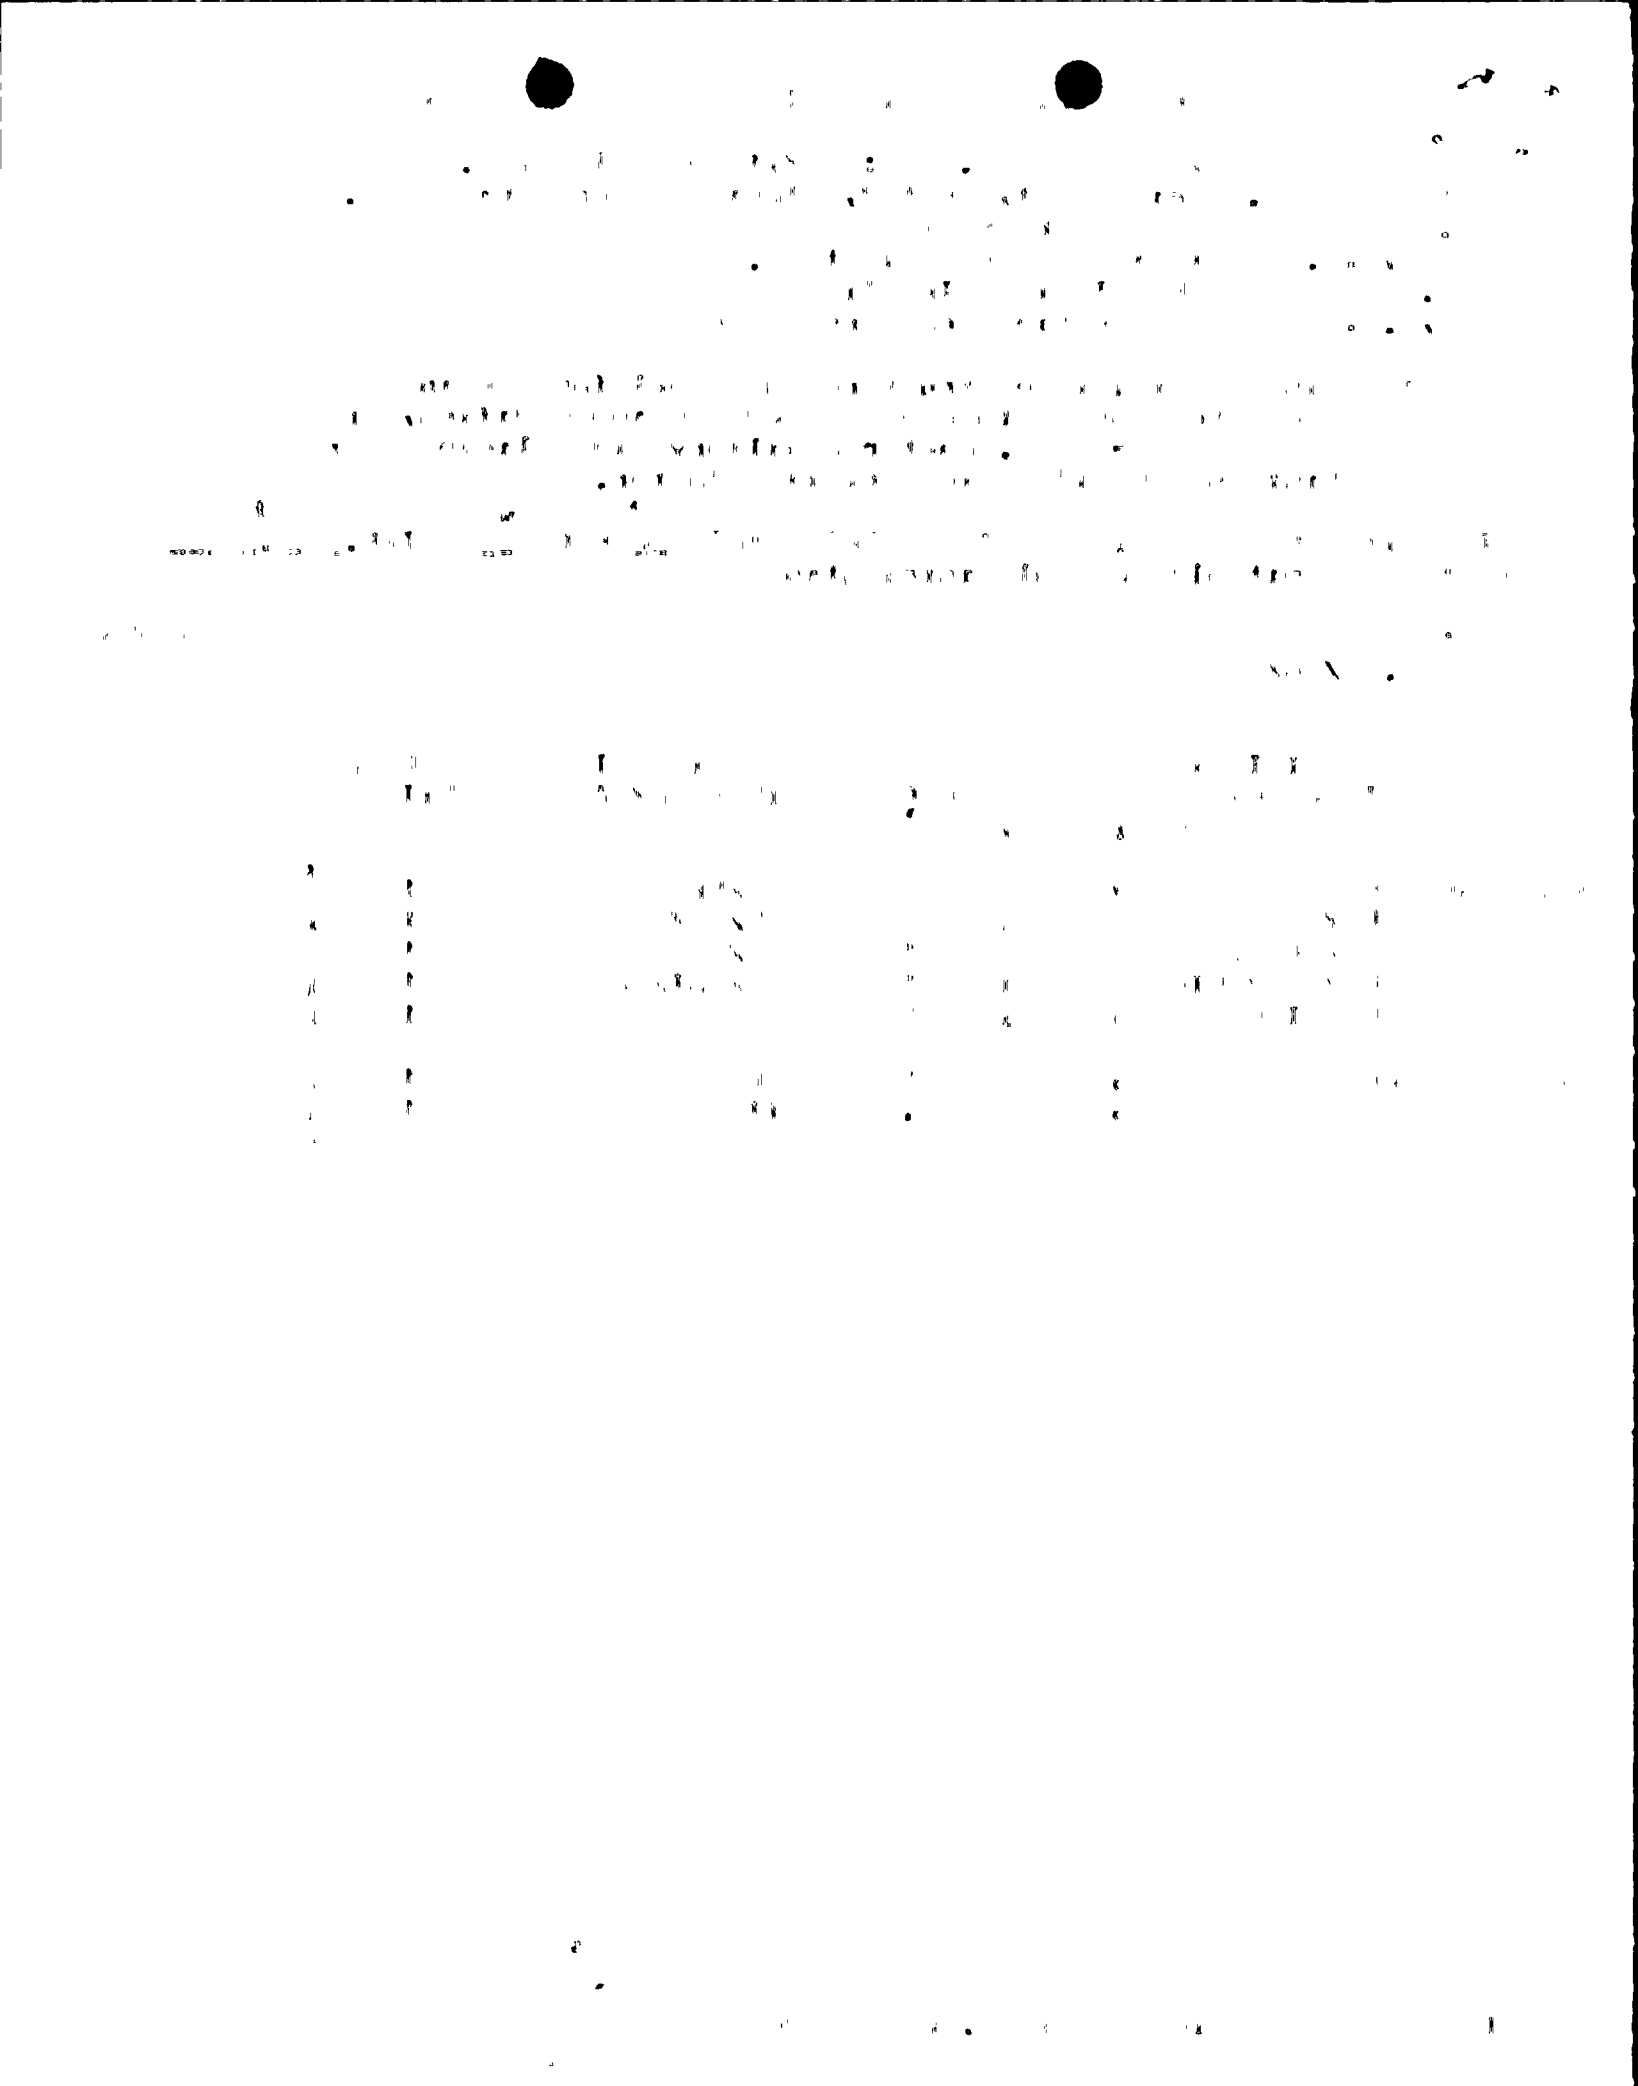

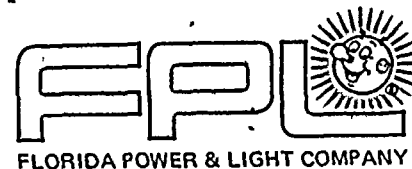

November 29, 1984
L-84-343

Office of Nuclear Reactor Regulation
Attention: Mr. James R. Miller, Chief
Operating Reactors Branch, #3
Division of Licensing
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

Dear Mr. Miller:

Re: St. Lucie Unit No. 2
Docket No. 50-389
Tornado Missile Protection

The St. Lucie Unit 2 Safety Evaluation Report (NUREG-0843) Supplement No. 2, Section 3.5.3 identified three structures requiring strengthening because the design ductility ratio was greater than that allowed by the NRC staff. Two of these structures, the Intake Structure Pump enclosure fan housing and the Condensate Storage Tank vent hood housing, were modified as required. The third structure, the Reactor Auxiliary Building sliding door, was not modified because the certified material test report for the structural member in question specified an actual yield stress of 59 ksi, rather than the 50 ksi assumed in the original design. Therefore, the unmodified structure satisfies the NRC staff's allowable ductility factor, and no modification was necessary.

Very truly yours,

for J. W. Williams, Jr.
J. W. Williams, Jr.
Group Vice President
Nuclear Energy

JWW/RJS/kgn

8412070181 841129
PDR ADDCK 05000389
E PDR

A001
1/0