

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8802010232 DOC. DATE: 88/01/26 NOTARIZED: NO DOCKET #  
 FACIL: 50-335 St. Lucie Plant, Unit 1, Florida Power & Light Co. 05000335  
 50-389 St. Lucie Plant, Unit 2, Florida Power & Light Co. 05000389  
 AUTH. NAME WOODY, C. O. AUTHOR AFFILIATION Florida Power & Light Co.  
 RECIP. NAME RECIPIENT AFFILIATION Document Control Branch (Document Control Desk)

SUBJECT: Forwards W Perkins 880107 ltr to S Lamb re alternate cooling water sys test on 880113, per Section 3.2.2 of util environ protection plans.

DISTRIBUTION CODE: CO01D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 2  
 TITLE: Licensing Submittal: Environmental Rept Amdt & Related Correspondence

NOTES:

	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL		RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	
	PD2-2 LA	1	1	PD2-2 PD	1	1
	TOURIGNY, E	1	1			
INTERNAL:	AEOD/DOA	1	1	AEOD/DSP/TPAB	1	1
	ARM/DAF/LFMB	1	0	NRR/DEST/ADE	1	1
	NRR/DEST/ESGB	1	1	NRR/DREP/RPB	1	1
	DGC/HDS2	1	0	<u>REG FILE</u> 01	1	1
EXTERNAL:	LPDR	1	1	NRC PDR	1	1
	NSIC	1	1			

1. The purpose of this document is to provide a comprehensive overview of the current state of the project and to identify the key challenges that must be addressed in order to ensure its successful completion. The information presented herein is intended for the use of senior management and other stakeholders who are responsible for the overall direction and oversight of the project.

2. The project has made significant progress since its inception, and it is anticipated that the remaining tasks will be completed within the specified timeline. However, there are several areas where the project is currently facing challenges, and these must be carefully monitored and managed to avoid any potential delays or cost overruns.

3. The primary challenge identified is the need for improved communication and coordination between the various teams involved in the project. This is particularly true in the areas of resource allocation and risk management, where a lack of clear communication can lead to confusion and inefficiency.

4. In order to address these challenges, it is recommended that a series of regular meetings be held to discuss the project's progress and to identify any potential issues that may arise. Additionally, it is suggested that a clear communication plan be developed to ensure that all team members are kept up-to-date on the project's status and any changes that may be required.

5. The project team is committed to the successful completion of the project, and it is confident that the challenges identified herein can be overcome through the implementation of the recommended actions. It is hoped that this document will provide a clear and concise summary of the project's current state and that it will be used as a guide for the project's future development.

Item	Description	Status	Priority	Responsible Party
1	Project Planning	Complete	High	John Doe
2	Resource Allocation	In Progress	Medium	Jane Smith
3	Risk Management	Not Started	High	Bob Johnson
4	Communication Plan	In Progress	Medium	Alice Brown
5	Final Review	Not Started	Low	John Doe



JANUARY 26 1988

L-88-34

U. S. Nuclear Regulatory Commission  
Attn: Document Control Desk  
Washington, D. C. 20555

Gentlemen:

Re: St. Lucie Units 1 and 2  
Docket Nos. 50-335 and 50-389  
Environmental Protection Plan Report

In accordance with Section 3.2.2 of the St. Lucie Units 1 and 2 Environmental Protection Plans, attached is one copy of a Florida Power & Light Company letter to the South Florida Water Management District.

Very truly yours,

  
C. O. Woody  
Executive Vice President

COW/GRM/gp


Attachment

cc: Dr. J. Nelson Grace, Regional Administrator,  
Region II, USNRC  
Senior Resident Inspector, USNRC, St. Lucie Plant

8802010232 880126  
PDR ADDCK 05000335  
P PDR

GRM/020.EPP

COO 1  
1/1

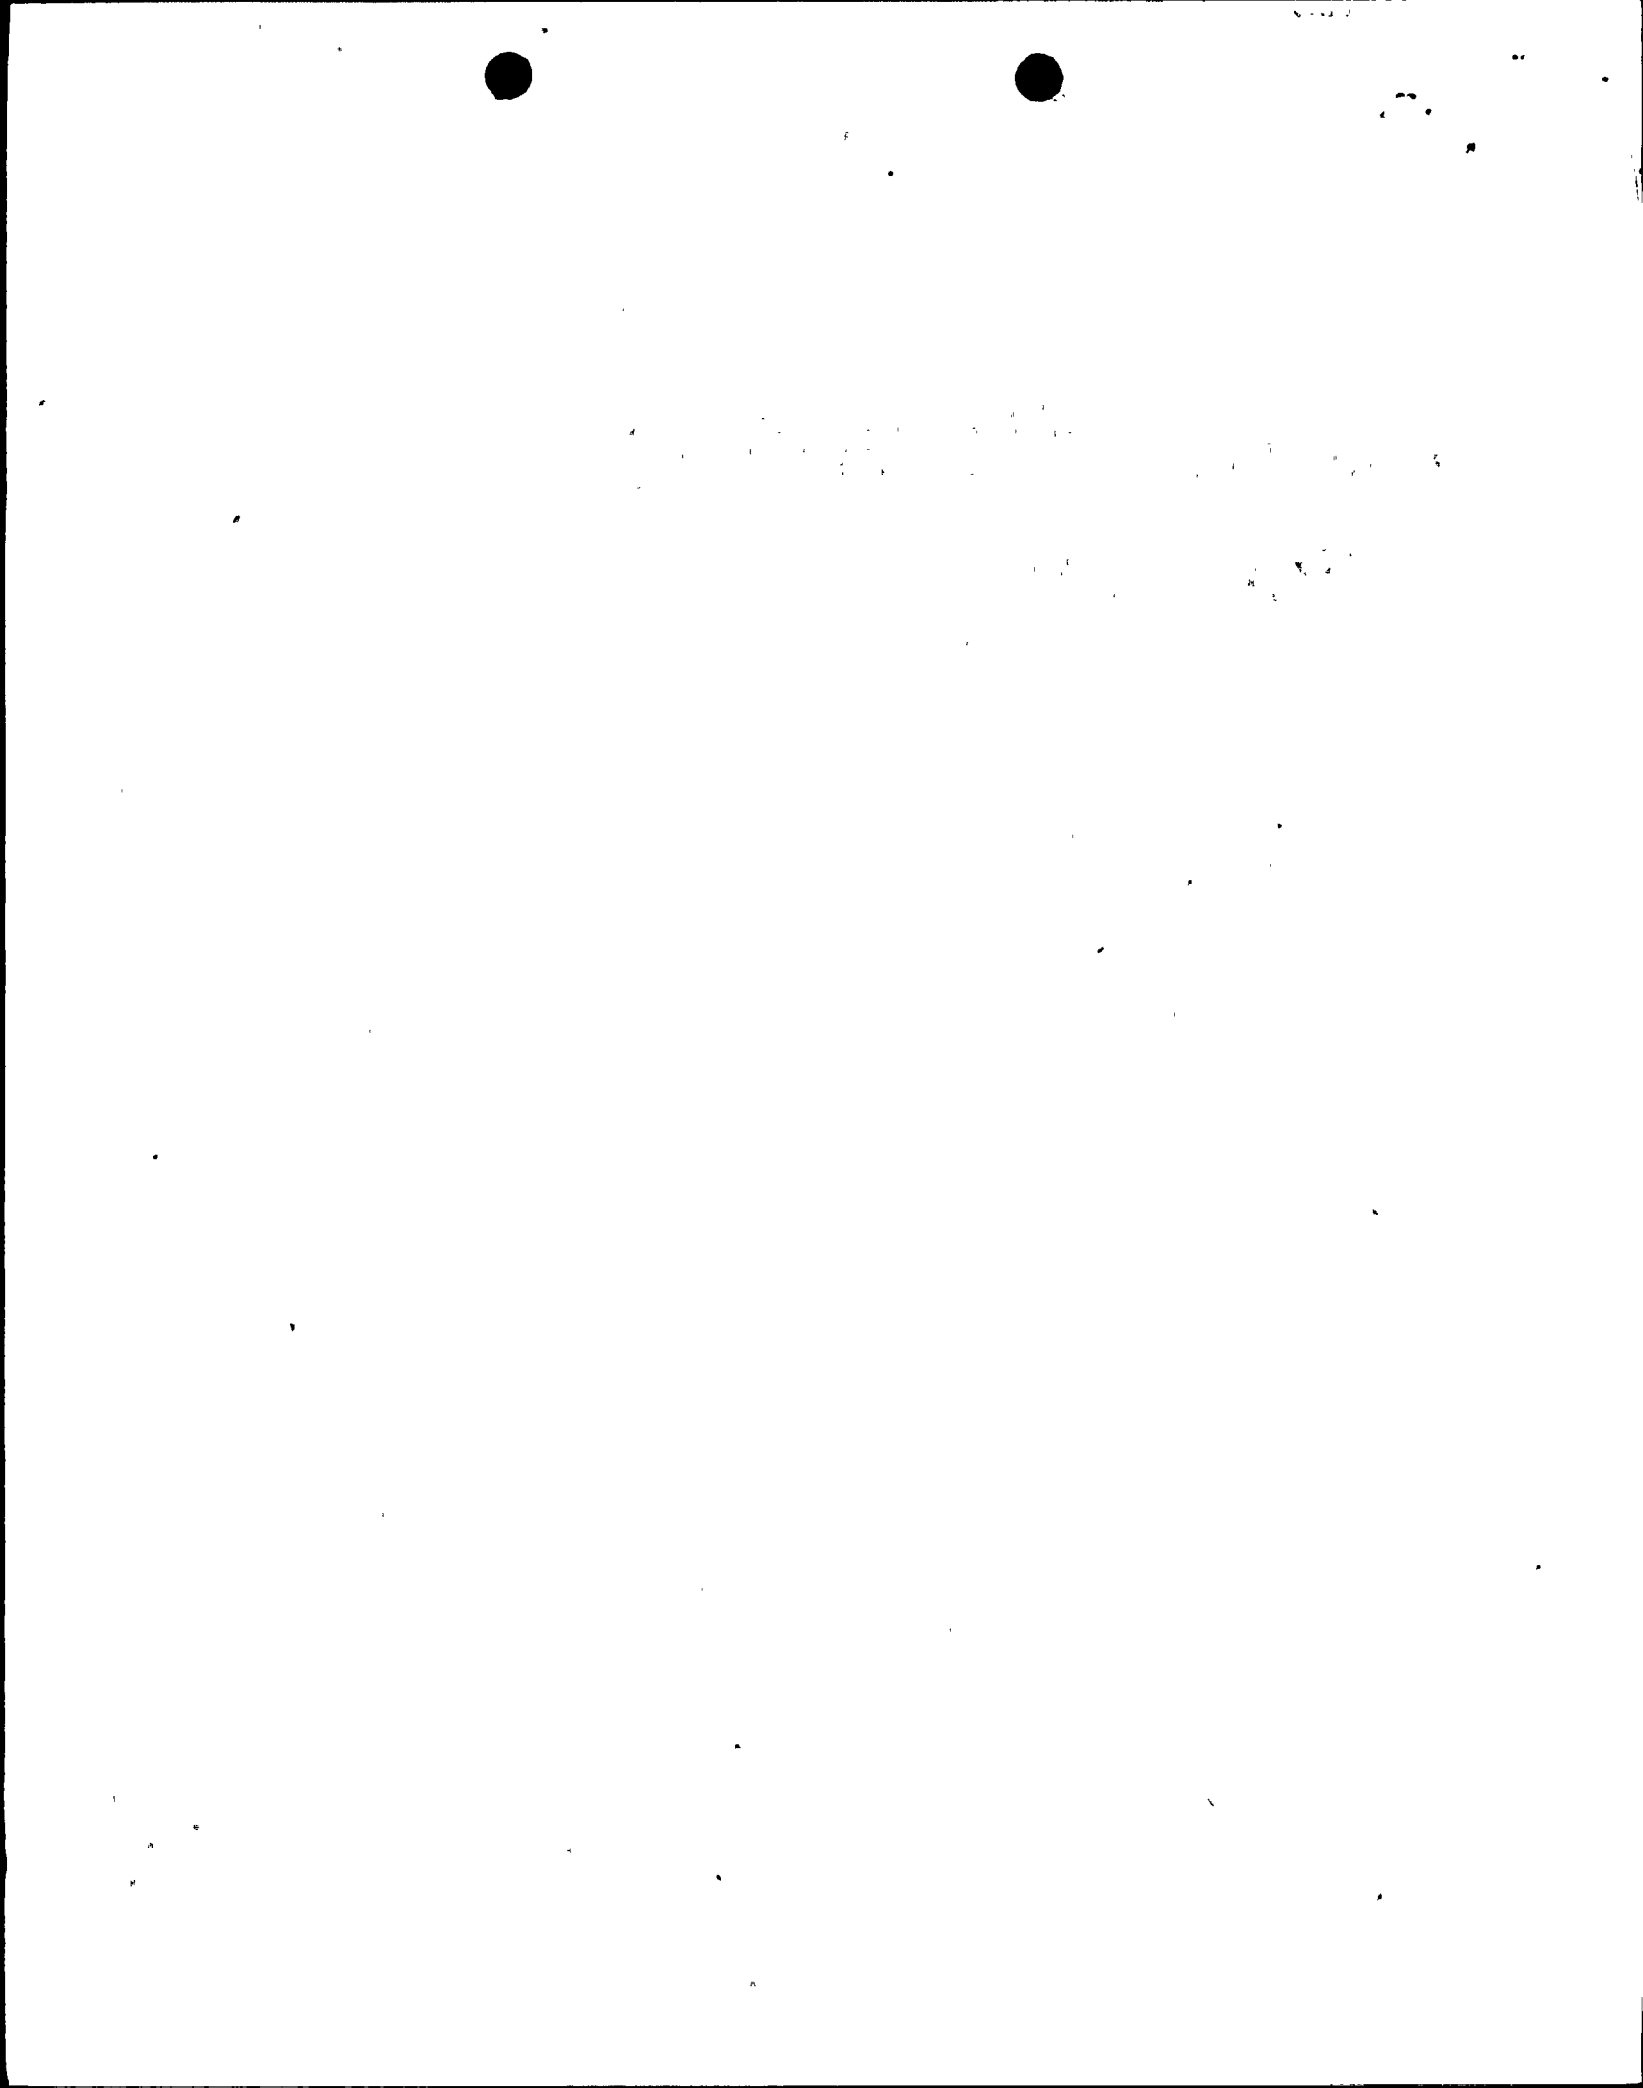

RECEIVED

JAN 08 1988



January 7, 1988

Nuclear Licensing

Mr. Steve Lamb  
Resource Control Department  
South Florida Water Management District  
P.O. BOX 24680  
West Palm Beach, Florida 33416-4680

RE: ALTERNATE COOLING  
WATER SYSTEM TEST

Dear Mr. Lamb:

Please be advised that a routine test of the alternate cooling water system at the St. Lucie Power Plant has been scheduled for approximately 9:00 a. m., Wednesday, January 13, 1988. This test is being conducted to comply with Nuclear Regulatory Commission requirements. The testing of this system is expected to last several minutes.

If you have any questions concerning this test, please feel free to call me at 694-3645.

Sincerely,

*Winifred Perkins*

Winifred Perkins  
Senior Environmental Coordinator

WGP:jm

cc: DER/Port St. Lucie  
S. E. Subdistrict Office/DER

bcc: A. D. Benedict - JEN  
P. C. Cunningham - HBG&S  
T. R. Fair - JEN  
R. Stevens - JNL  
F. War - PSL  
J. R. Wilcox - JEN