

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)


ACCESSION NBR: 8802170091 DOC. DATE: 88/02/12 NOTARIZED: YES DOCKET #  
 FACIL: 50-335 St. Lucie Plant, Unit 1, Florida Power & Light Co. 05000335  
 50-389 St. Lucie Plant, Unit 2, Florida Power & Light Co. 05000389  
 AUTH. NAME: WOODY, C. O. AUTHOR AFFILIATION: Florida Power & Light Co.  
 RECIP. NAME: RECIPIENT AFFILIATION: Document Control Branch (Document Control Desk)


SUBJECT: Responds to Bulletin 87-02 re fastener testing to determined conformance w/applicable matl specs. W/encl.

DISTRIBUTION CODE: IE11D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 156  
 TITLE: Bulletin Response (50 DKT)

NOTES:

	RECIPIENT ID CODE/NAME		COPIES			RECIPIENT ID CODE/NAME		COPIES	
	LTR	ENCL	LTR	ENCL		LTR	ENCL	LTR	ENCL
	PD2-2 LA		1	0		PD2-2 PD		1	1
	TOURIGNY, E		1	1					
INTERNAL:	AEOD/DOA		1	1		AEOD/DSP		1	1
	AEOD/DSP/TPAB		1	1		NRR/DEST/ADE		1	1
	NRR/DEST/ADS		1	1		NRR/DEST/MEB		1	1
	NRR/DOEA/EAB		1	1		NRR/DOEA/GCB		1	1
	NRR/DREP/EPB		1	1		NRR/PMAS/ILRB		1	1
	REG FILE 02		1	1		RES/DE/EIB		1	1
	RGN2 FILE 01		1	1					
EXTERNAL:	LPDR		1	1		NRC PDR		1	1
	NSIC		1	1					

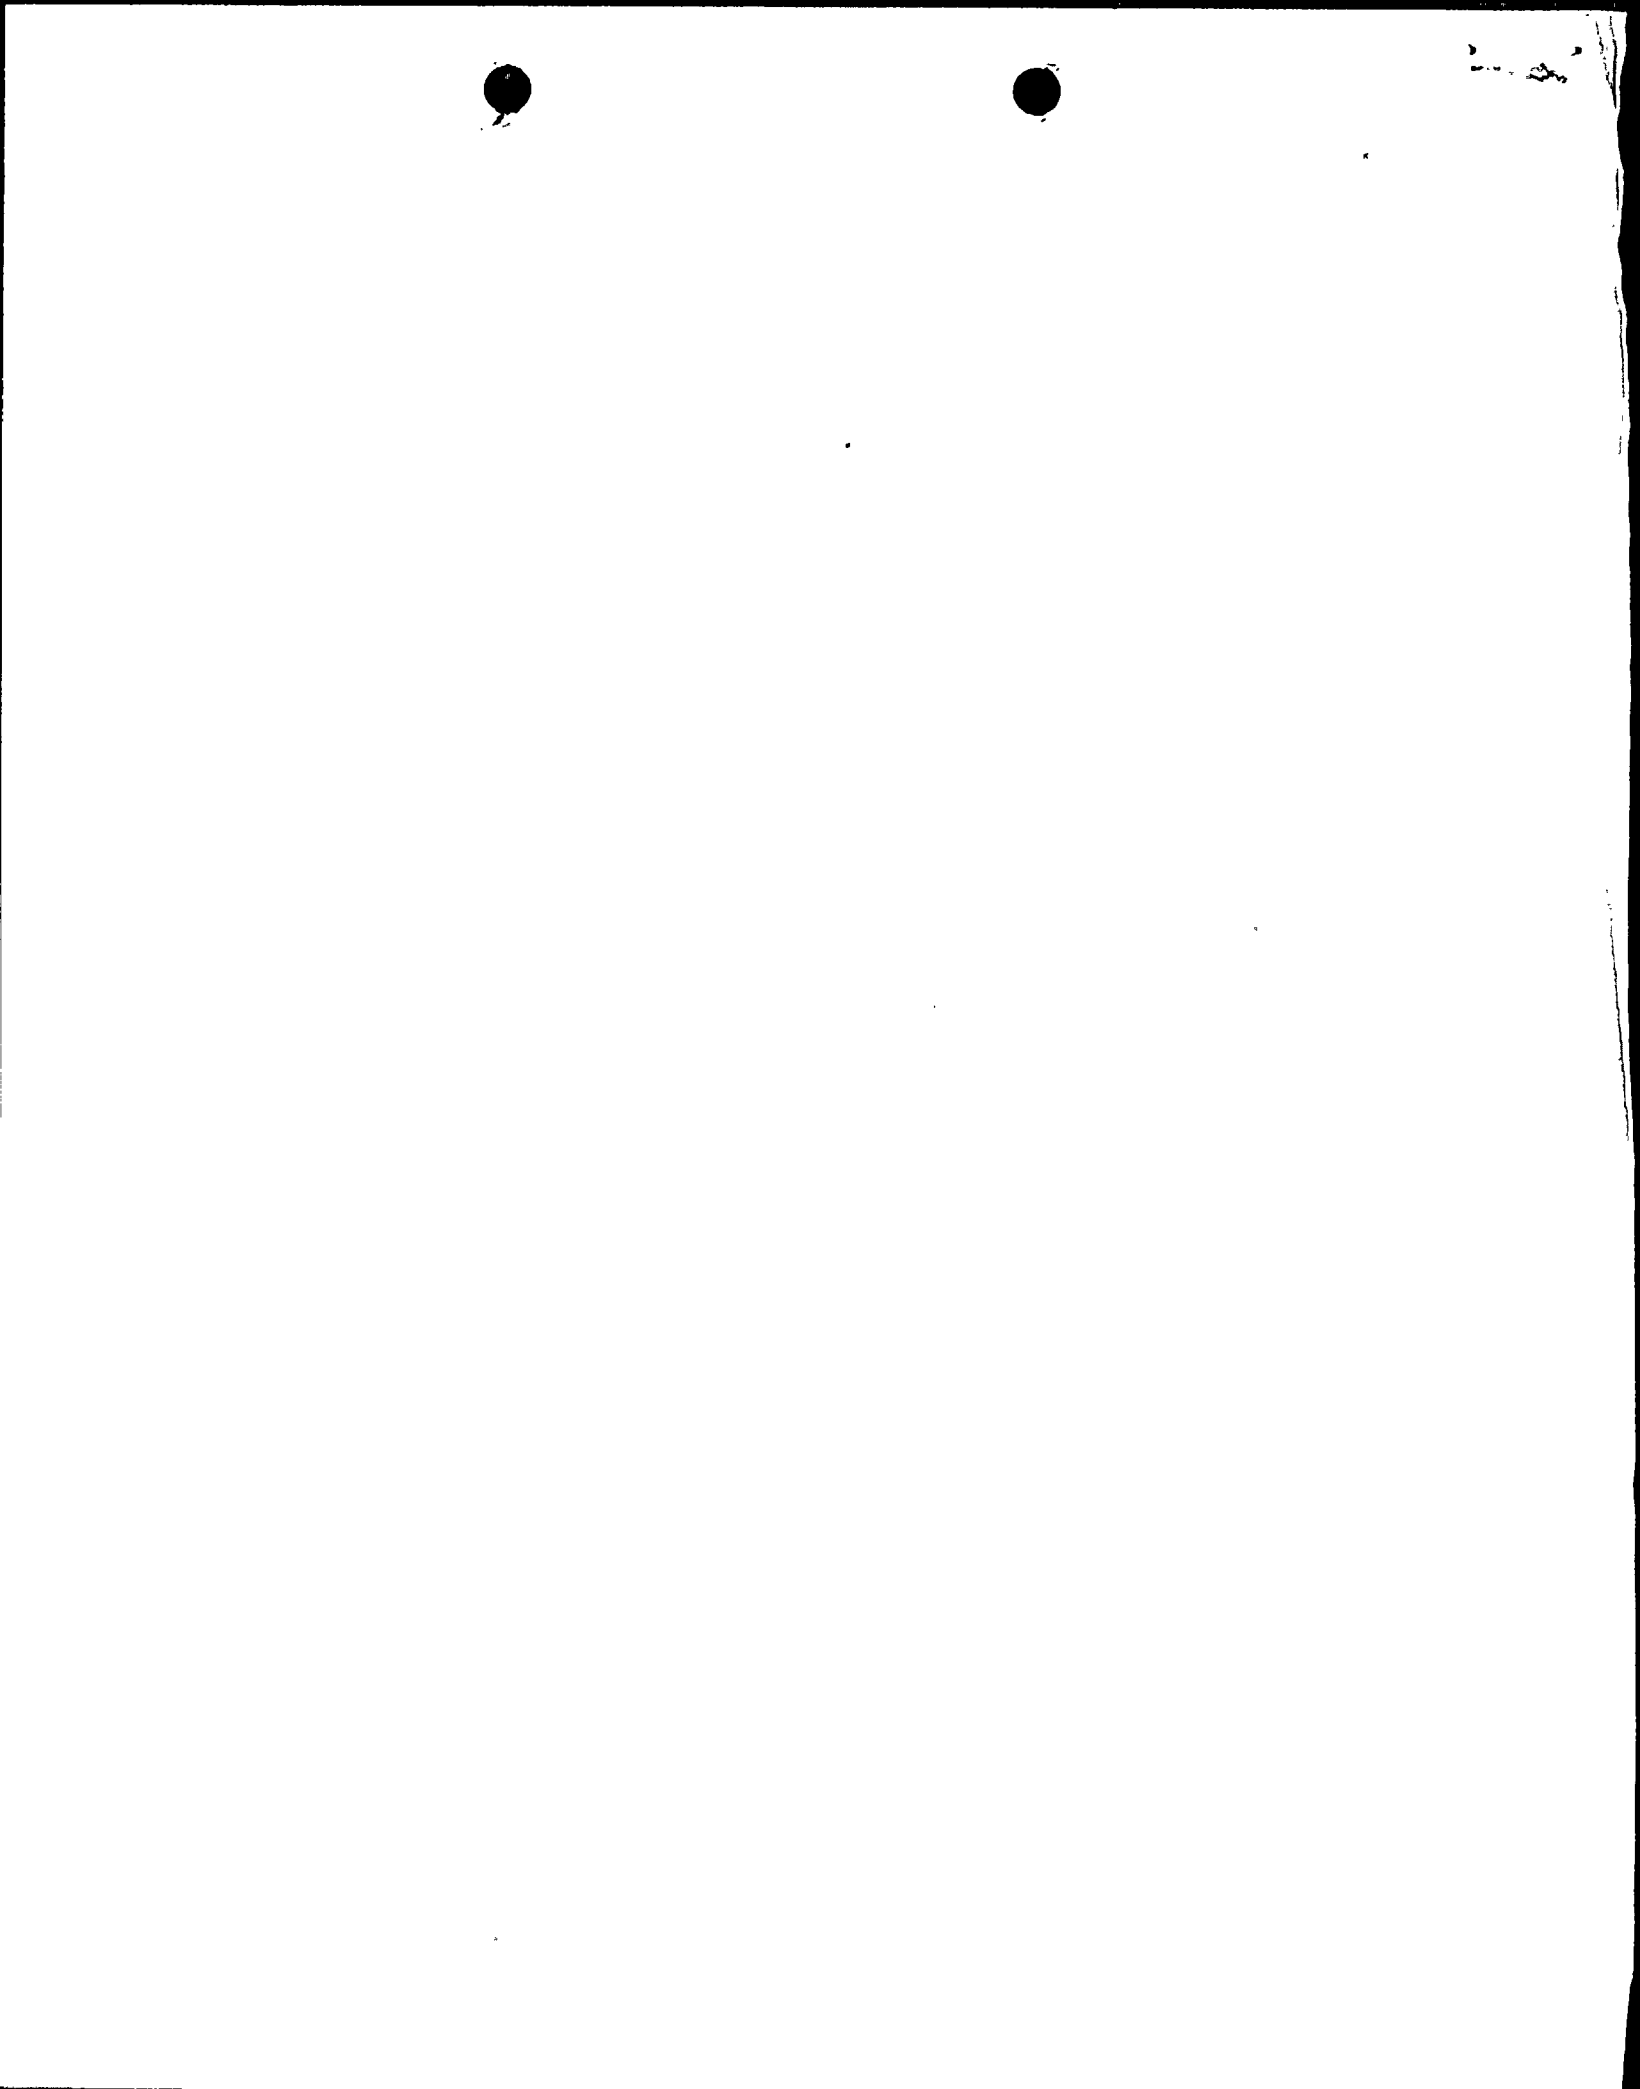

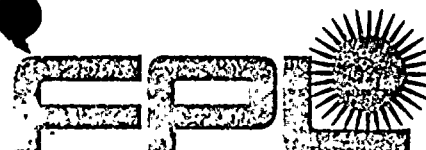

L-88-73

U.S. Nuclear Regulatory Commission  
Attn: Document Control Desk  
Washington, D.C. 20555

FEBRUARY 12 1988

Gentlemen:

Re: St. Lucie Units 1 and 2  
Docket Nos. 50-335 and 50-389  
NRC Bulletin NO. 87-02  
Fastener Testing to Determine Conformance  
with Applicable Material Specifications

By the subject Bulletin, the NRC staff requested licensees 1) review their receipt inspection requirements and internal controls for fasteners and 2) independently determine, through testing, whether fasteners (studs, bolts, cap screws and nuts) in stores at their facilities meet required mechanical and chemical specification requirements. By letter dated January 12, 1988 (L-88-14), FPL provided a schedule to complete the response by February 12, 1988.

The enclosed is a complete response to the Bulletin with results attached as follows:

- Attachment 1 Fastener Testing Data Sheet
- Attachment 2 Mechanical/Chemical Data Summary
- Attachment 3 Definition of Quality Levels
- Attachment 4 Special Quality Assurance Document
- Attachment 5 Evaluations

The attached information is provided pursuant to Section 182a of the Atomic Energy Act of 1954, as amended. If further information is required on this topic, please contact us.

Very truly yours,

*DA Gager*

C. O. Woody  
Executive Vice President

COW/GRM/dh


Enclosure

cc: Dr. J. Nelson Grace, Regional Administrator, Region II,  
USNRC  
Senior Resident Inspector, USNRC, St. Lucie Plant

GRM.FT

8802170091 880212  
PDR ADOCK 05000335  
Q PDR

*IE 11*

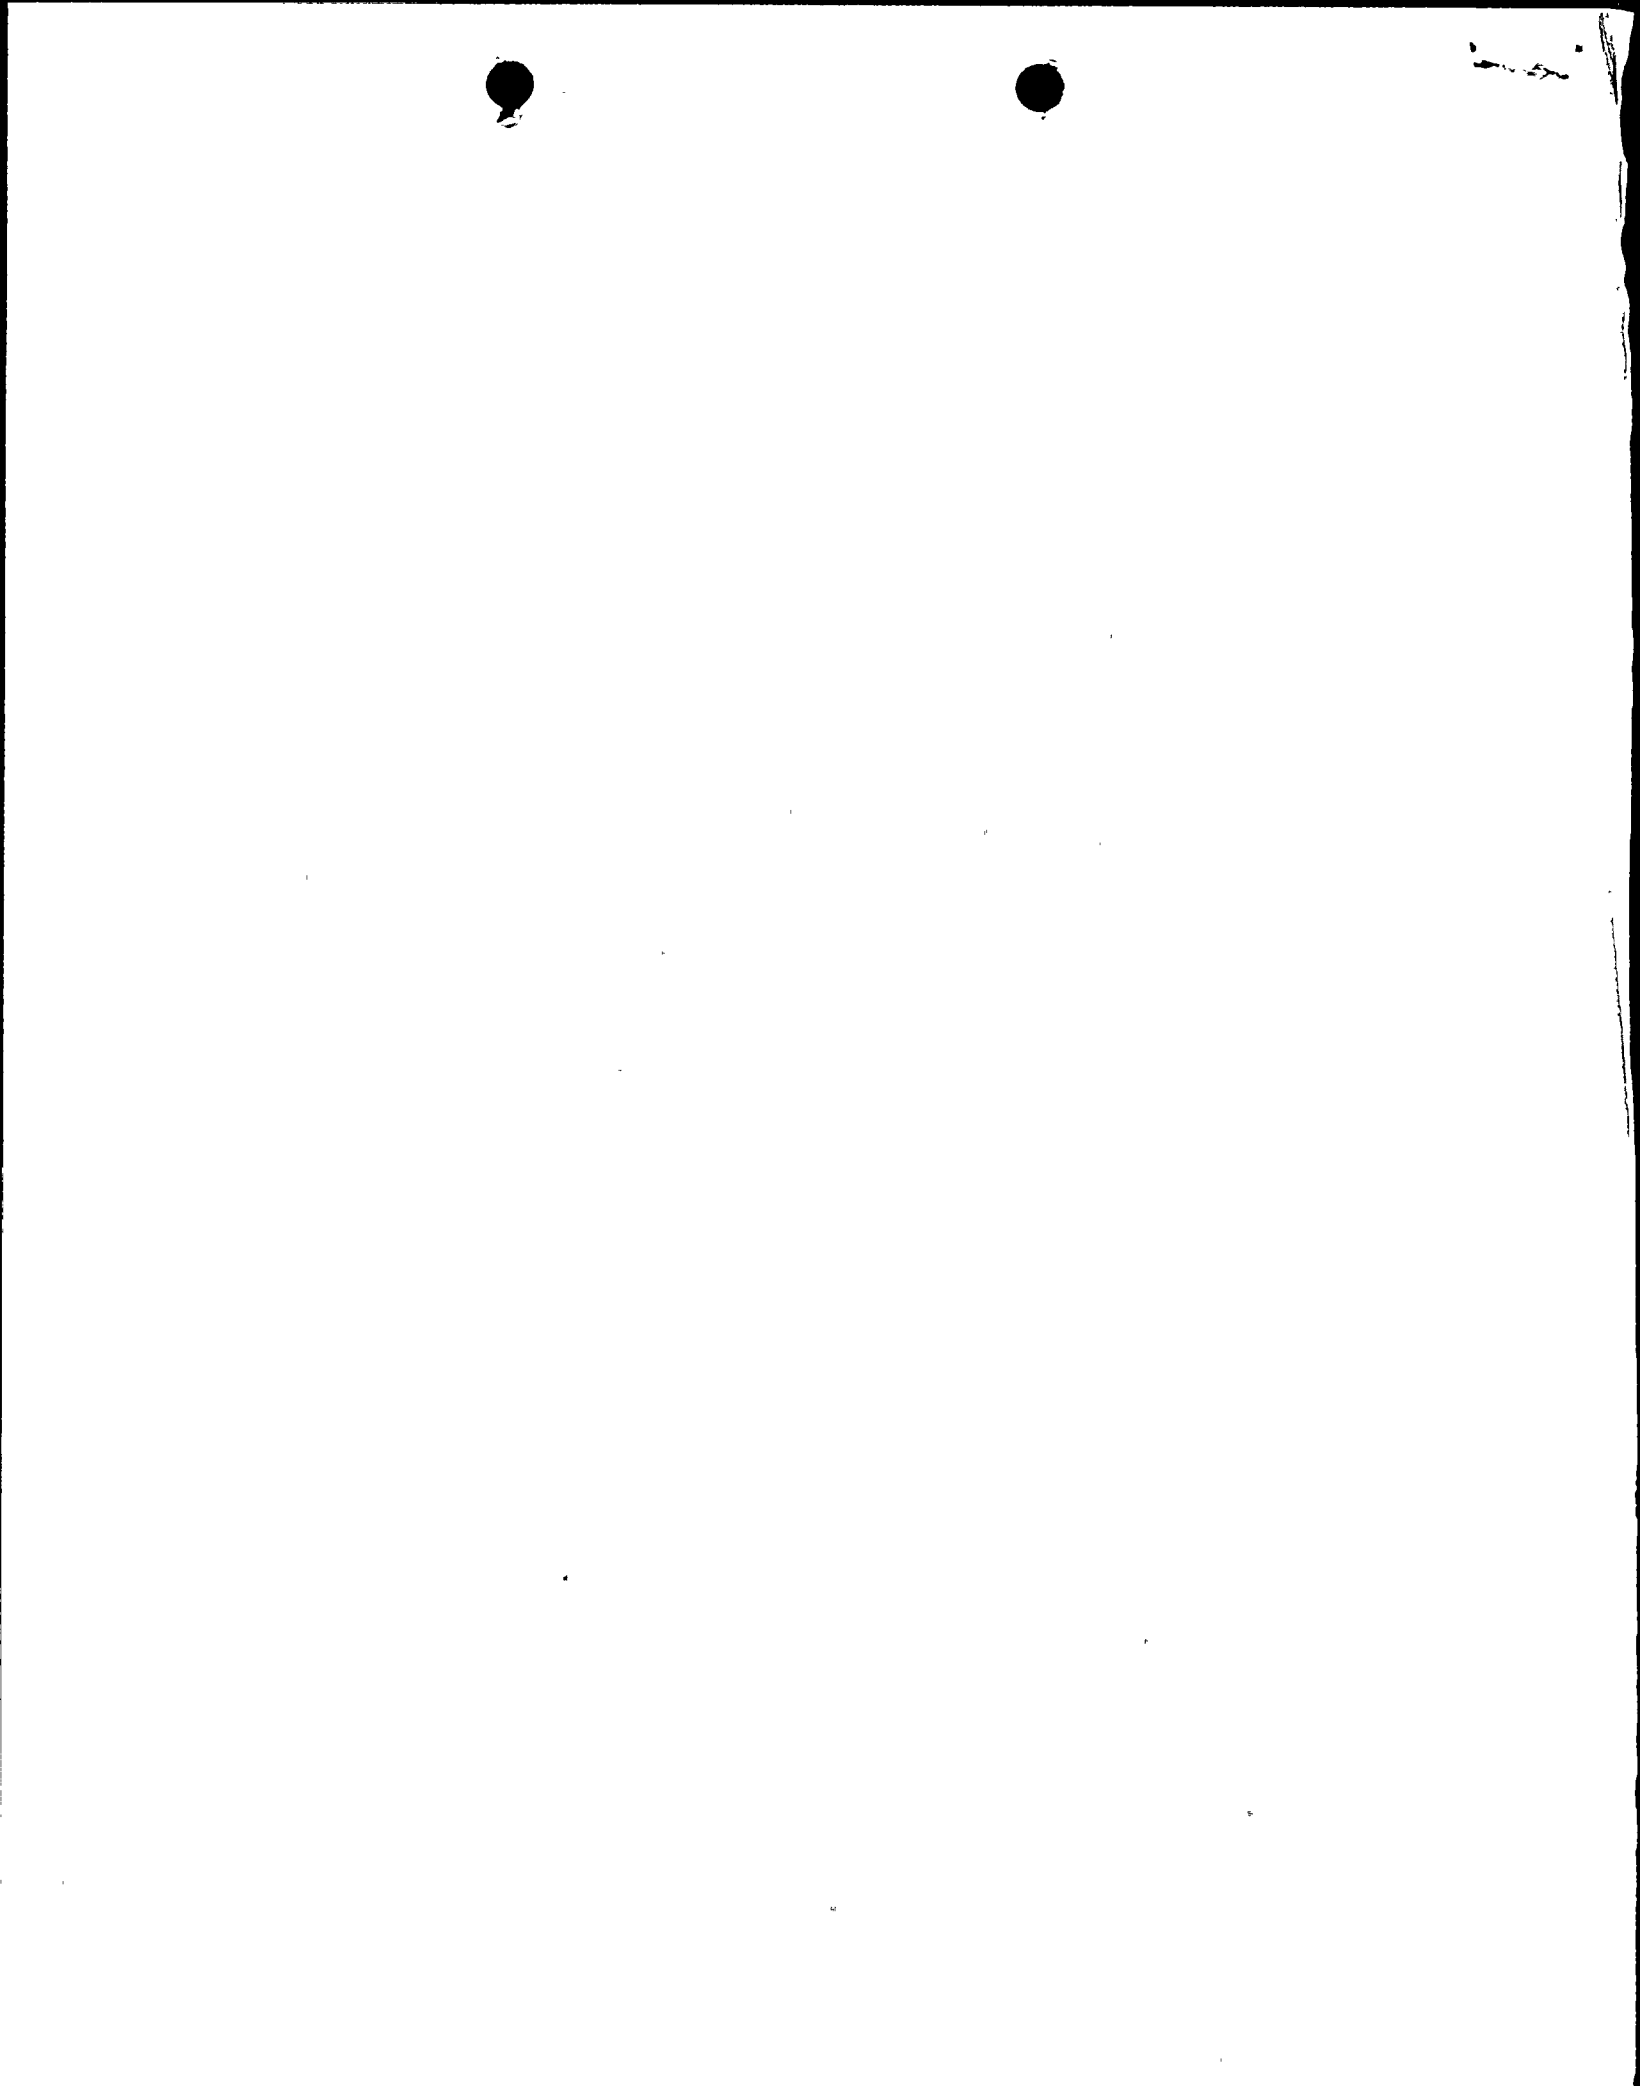

STATE OF FLORIDA            )  
  )  
COUNTY OF PALM BEACH    )   ss.

D. A. Sager being first duly sworn, deposes and says:

That he is Executive Assistant of Florida Power & Light Company, the Licensee herein;

That he has executed the foregoing document; that the statements made in this document are true and correct to the best of his knowledge, information, and belief, and that he is authorized to execute the document on behalf of said Licensee.

*DA Sager*  
\_\_\_\_\_ D. A. Sager

Subscribed and sworn to before me this  
12 day of February, 19 88.

*Bernice M. Delino*  
\_\_\_\_\_

NOTARY PUBLIC, in and for the County of Palm Beach, State of Florida

My Commission expires: \_\_\_\_\_  
NOTARY PUBLIC STATE OF FLORIDA  
BY COMMISSION EXP SEPT 18, 1989  
RENEWED THRU GENERAL INS. UND.

