

# ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

## REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8908020329      DOC. DATE: 89/07/26      NOTARIZED: YES      DOCKET #  
 FACIL: 50-389 St. Lucie Plant, Unit 2, Florida Power & Light Co.      05000389  
 AUTH. NAME      AUTHOR AFFILIATION  
 WOODY, C.O.      Florida Power & Light Co.  
 RECIP. NAME      RECIPIENT AFFILIATION  
                                  Document Control Branch (Document Control Desk)

SUBJECT: Application for amend to License NPF-16, revising ACTION f of Tech Spec 3.8.1.1.

DISTRIBUTION CODE: A001D      COPIES RECEIVED: LTR 1 ENCL 1      SIZE: 2+5  
 TITLE: OR Submittal: General Distribution

NOTES:

	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	
	PD2-2 LA	1 1	PD2-2 PD	1 1	
	NORRIS, J	5 5			
INTERNAL:	ACRS	6 6	NRR/DEST/ADS 7E	1 1	
	NRR/DEST/CEB 8H	1 1	NRR/DEST/ESB 8D	1 1	
	NRR/DEST/ICSB	1 1	NRR/DEST/MTB 9H	1 1	
	NRR/DEST/RSB 8E	1 1	NRR/DOEA/TSB 11	1 1	
	NUDOCS-ABSTRACT	1 1	OC/LFMB	1 0	
	OGC/HDS2	1 0	<u>REG FILE 01</u>	1 1	
	RES/DSIR/EIB	1 1			
EXTERNAL:	LPDR	1 1	NRC PDR	1 1	
	NSIC	1 1			


NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE!      CONTACT THE DOCUMENT CONTROL DESK,  
 ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION  
 LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 28 ENCL 26

R  
I  
D  
S  
/  
A  
D  
D  
S  
  
R  
I  
D  
S  
/  
A  
D  
D  
S

AA2  
gh

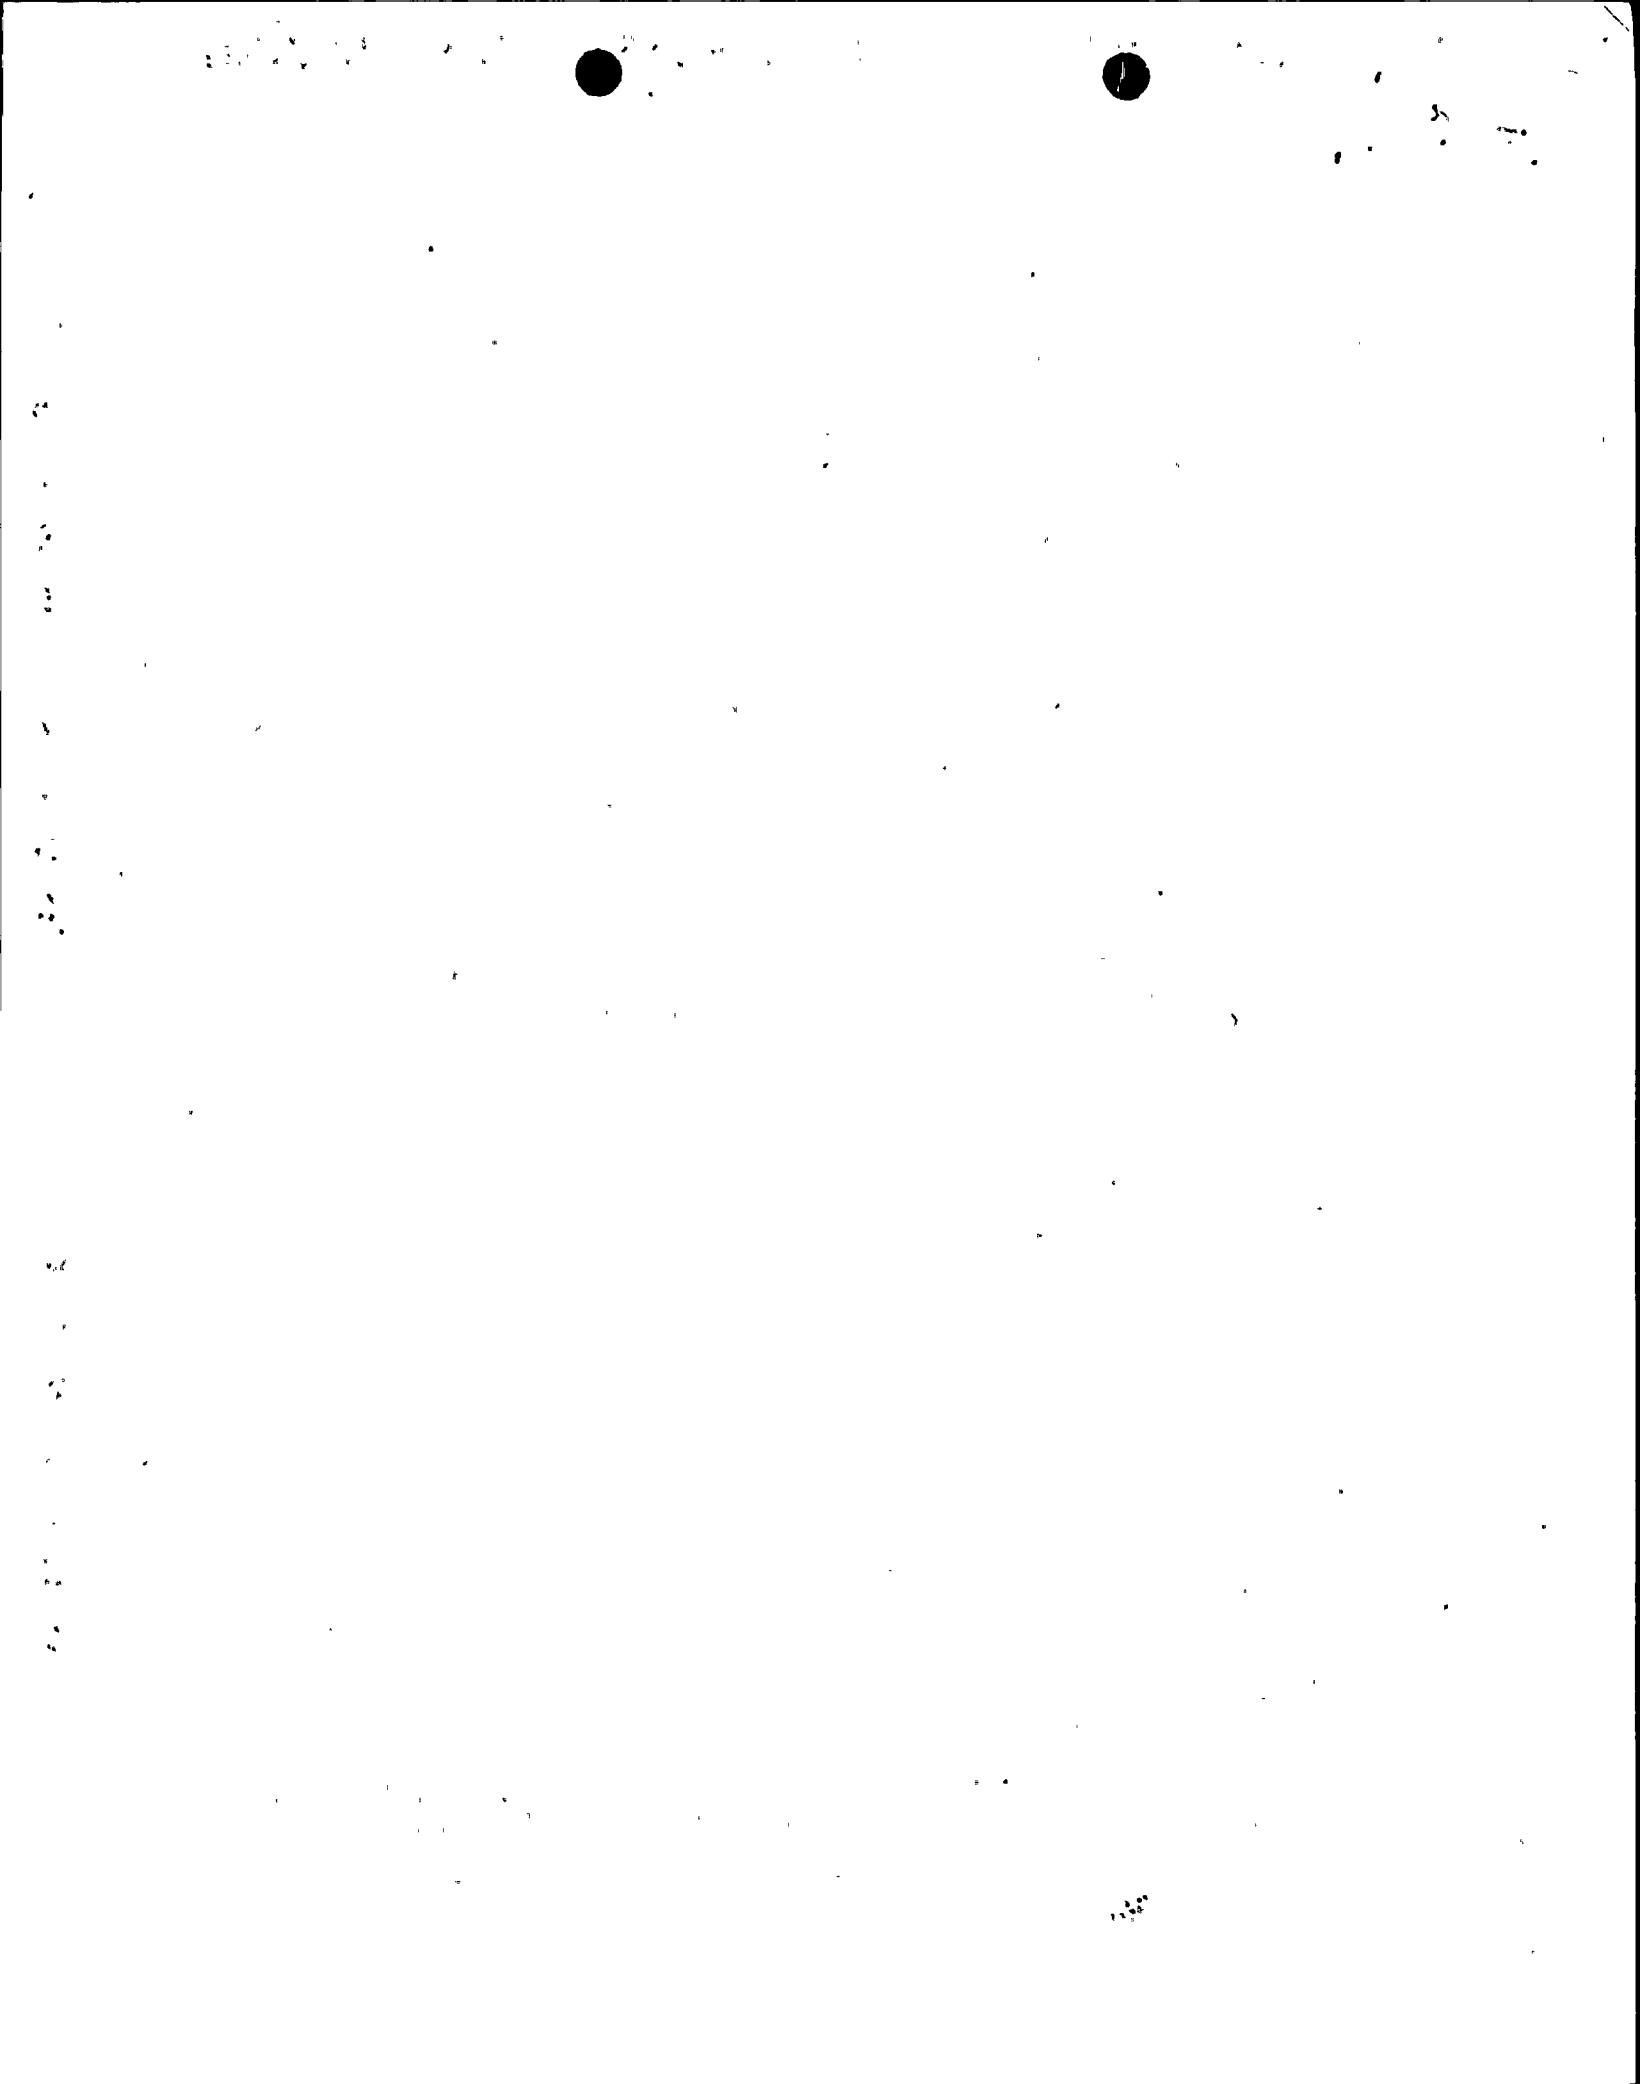



FPL

P.O. Box 14000, Juno Beach, FL 33408-0420

JULY 26 1989

L-89-263  
10 CFR 50.90

U. S. Nuclear Regulatory Commission  
Attn: Document Control Desk  
Washington, D. C. 20555

Gentlemen:

Re: St. Lucie Unit 2  
Docket No. 50-389  
Proposed License Amendment  
Diesel Generators

In accordance with 10 CFR 50.90, Florida Power & Light Company (FPL) submits herewith a request to amend Facility Operating License NPF-16 for St. Lucie Unit 2. This amendment revises ACTION f. of Technical Specification 3.8.1.1. to make it consistent with the Emergency Diesel Generator testing ACTION requirements.


Attachment One is the marked-up Technical Specifications page for St. Lucie Unit 2. Attachment Two is a safety analysis for this change. Attachment Three is a "Determination of No Significant Hazards Considerations".

In accordance with 10 CFR 50.91(b)(1), a copy of this proposed license amendment is being forwarded to the State Designee for the State of Florida.

The proposed amendment has been reviewed by the St. Lucie Facility Review Group and the FPL Company Nuclear Review Board.

Should there be any question, please contact us.

Very truly yours,

  
C. O. Woody  
Acting Senior Vice President - Nuclear

COW/RG/cm

Attachments

cc: Stewart D. Ebnetter, Regional Administrator, Region II, USNRC  
Jacob D. Nash, Florida Department of Health and  
Rehabilitative Services  
Senior Resident Inspector, USNRC, St. Lucie Plant

8908020329 890726  
PDR ADOCK 05000389  
P FDC


*Accl*  
|  
|

STATE OF FLORIDA        )  
                                  ) ss.  
COUNTY OF PALM BEACH )

C. O. Woody being first duly sworn, deposes and says:

That he is Acting Senior Vice President - Nuclear, of Florida Power and Light Company, the Licensee herein;

That he has executed the foregoing document; that the statements made in this document are true and correct to the best of his knowledge, information and belief, and that he is authorized to execute the document on behalf of said Licensee.

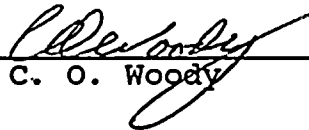  
\_\_\_\_\_  
C. O. Woody

Subscribed and sworn to before me this  
26<sup>th</sup> day of July, 1989.

  
\_\_\_\_\_

NOTARY PUBLIC, in and for the County of  
Palm Beach, State of Florida

My Commission expires \_\_\_\_\_  
NOTARY PUBLIC STATE OF FLORIDA  
MY COMMISSION EXP SEPT 18, 1989  
BONDED THRU GENERAL INS. UND.

