

ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8908220019 DOC. DATE: 89/08/14 NOTARIZED: YES DOCKET #
 FACIL: 50-335 St. Lucie Plant, Unit 1, Florida Power & Light Co. 05000335
 50-389 St. Lucie Plant, Unit 2, Florida Power & Light Co. 05000389

AUTH. NAME AUTHOR AFFILIATION
 WOODY, C.O. Florida Power & Light Co.
 RECIP. NAME RECIPIENT AFFILIATION
 Document Control Branch (Document Control Desk)

SUBJECT: Responds to Generic Ltr 89-06, "TMI Item I.D.2, SPDS."

DISTRIBUTION CODE: A004D COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 2
 TITLE: Safety Parameter Display System (Item 1.D.2) Generic Ltr 89-06 Respon

NOTES:


	RECIPIENT		COPIES			RECIPIENT		COPIES	
ID CODE/NAME	LTR	ENCL	LTR	ENCL	ID CODE/NAME	LTR	ENCL	LTR	ENCL
PD2-2 LA	1	0			PD2-2 PD	7	7		
NORRIS, J	1	1							
INTERNAL: NRR/DLPQ/HFB 10	2	2			NRR/DRSP/PD-3-3	1	1		
NUDOCS-ABSTRACT	1	1			OC/LFMB	1	0		
<u>REG FILE</u> 01	1	1			RES/DSIR/EIB	1	1		
EXTERNAL: LPDR	1	1			NRC PDR	1	1		
NSIC	1	1							

TOTAL NUMBER OF COPIES REQUIRED: LTR 19 ENCL 17

0

R
I
D
S
/
A
D
D
S

R
I
D
S
/
A
D
D
S

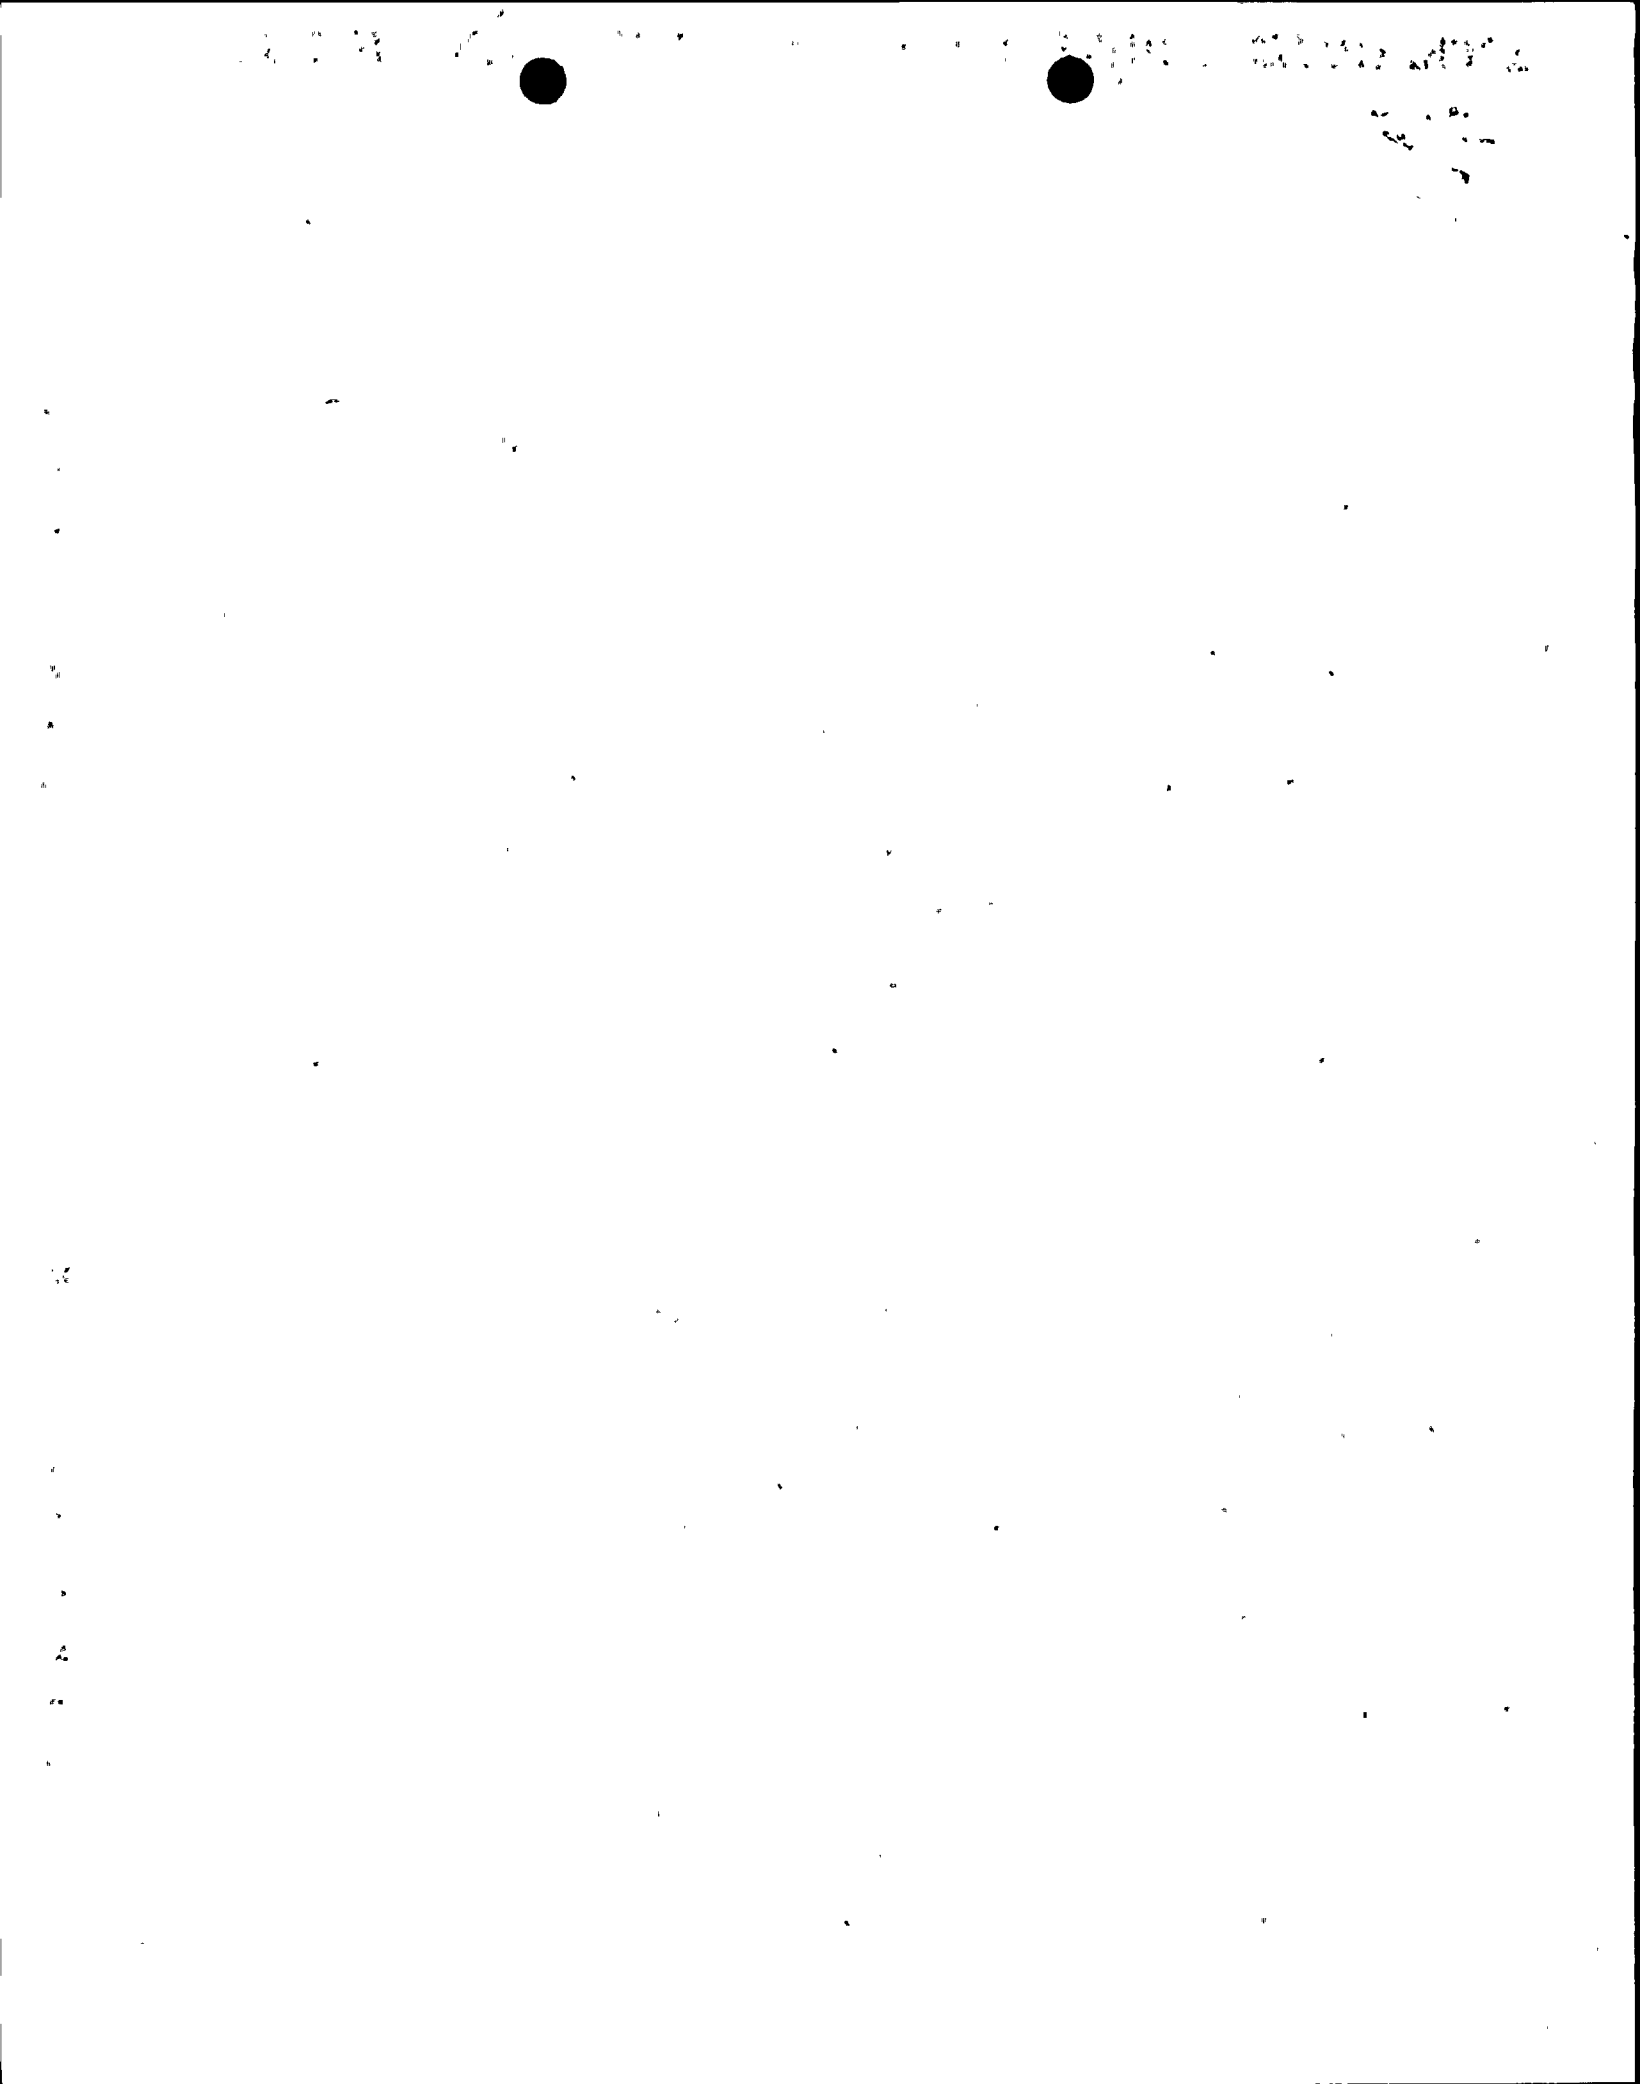



AUGUST 14 1989

L-89-244
10 CFR 50.54(f)

U. S. Nuclear Regulatory Commission
Attn: Document Control Desk
Washington, D. C. 20555

Gentlemen:

Re: St. Lucie Units 1 and 2
Docket Nos. 50-335 and 50-389
Task Action Plan I.D.2 -
Safety Parameter Display System
Generic Letter 89-06

By Generic Letter 89-06 (GL 89-06) dated April 12, 1989, the NRC requested licensees to certify the status of the Safety Parameter Display System (SPDS), TMI item I.D.2, at their facilities.

Florida Power & Light Company (FPL) has reviewed the SPDSs at St. Lucie Units 1 and 2 as requested by GL 89-06. FPL certifies that the St. Lucie Units 1 and 2 SPDSs meet the requirements of NUREG-0737, Supplement 1. Additionally, as requested by the generic letter, FPL has taken into account the information provided in NUREG-1342; however, FPL's certification is limited to meeting NUREG-0737 Supplement 1 requirements.

Generic Letter 89-06 requested that licensees provide their certifications within 90 days of April 12, 1989 (i.e., by July 14, 1989). FPL did not receive this generic letter until May 15, 1989. An extension to the due date for responding to this generic letter was requested by FPL and granted by the NRC Turkey Point Plant Project Manager in the absence of the NRC St. Lucie Plant Project Manager. Accordingly, we are providing this response within 90 days of receipt of GL 89-06.

If there should be any questions regarding this subject, please contact us.

Very truly yours,

C. O. Woody
Acting Senior Vice President - Nuclear

COW/EJW/gp

cc: Stewart D. Ebnetter, Regional Administrator, Region II, USNRC
Senior Resident Inspector, USNRC, St. Lucie Plant

8908220019 890814
PDR ADCK 05000335
P FDC

A004
110

STATE OF FLORIDA)
)
COUNTY OF PALM BEACH)

ss.


R.J. Acosta being first duly sworn, deposes and says:

That he is Acting Vice President, Nuclear Energy, of Florida Power and Light Company, the Licensee herein;

That he has executed the foregoing document; that the statements made in this document are true and correct to the best of his knowledge, information and belief, and that he is authorized to execute the document on behalf of said Licensee.

R.J. Acosta
R.J. Acosta

Subscribed and sworn to before me this
14 day of August, 1989.

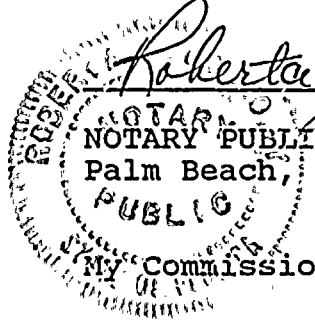

Roberta S. Economy
NOTARY PUBLIC, in and for the County of
Palm Beach, State of Florida
Notary Public, State of Florida
My Commission Expires June 1, 1993
My Commission expires _____
Bonded Thru Troy Fain - Insurance Inc.

11

LIBRARY OF THE
BOSTON PUBLIC LIBRARY
CITY OF BOSTON
MAY 19 1904