

# ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9003080450    DOC. DATE: 90/02/12    NOTARIZED: YES    DOCKET #  
 FACIL: 50-335 St. Lucie Plant, Unit 1, Florida Power & Light Co.    05000335  
       50-389 St. Lucie Plant, Unit 2, Florida Power & Light Co.    05000389  
 AUTH. NAME                    AUTHOR AFFILIATION  
 GOLDBERG, J.H.                Florida Power & Light Co.  
 RECIPIENT NAME                RECIPIENT AFFILIATION  
                                   Document Control Branch (Document Control Desk)

SUBJECT: Application for amends to Licenses DPR-67 & NPF-16, revising Tech Specs re control element assembly operability.

DISTRIBUTION CODE: A001D    COPIES RECEIVED: LTR 1 ENCL 1    SIZE: 449  
 TITLE: OR Submittal: General Distribution

NOTES:


	RECIPIENT ID CODE/NAME	COPIES	LTR	ENCL	RECIPIENT ID CODE/NAME	COPIES	LTR	ENCL
	PD2-2 LA	1	1		PD2-2 PD	1	1	
	NORRIS, J	5		5				
INTERNAL:	ACRS	6	6		NRR/DET/ECMB 9H	1	1	
	NRR/DOEA/OTSB11	1	1		NRR/DST 8E2	1	1	
	NRR/DST/SELB 8D	1	1		NRR/DST/SICB 7E	1	1	
	NRR/DST/SRXB 8E	1	1		NUDOCS-ABSTRACT	1	1	
	OC/LFMB	1	0		OGC/HDS2	1	0	
	<del>REG FILE 01</del>	1	1		RES/DSIR/EIB	1	1	
EXTERNAL:	LPDR	1	1		NRC PDR	1	1	
	NSIC	1	1					

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE!    CONTACT THE DOCUMENT CONTROL DESK,  
 ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION  
 LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 27 ENCL 25

R  
I  
D  
S  
/  
A  
D  
D  
S  
  
R  
I  
D  
S  
/  
A  
D  
D  
S

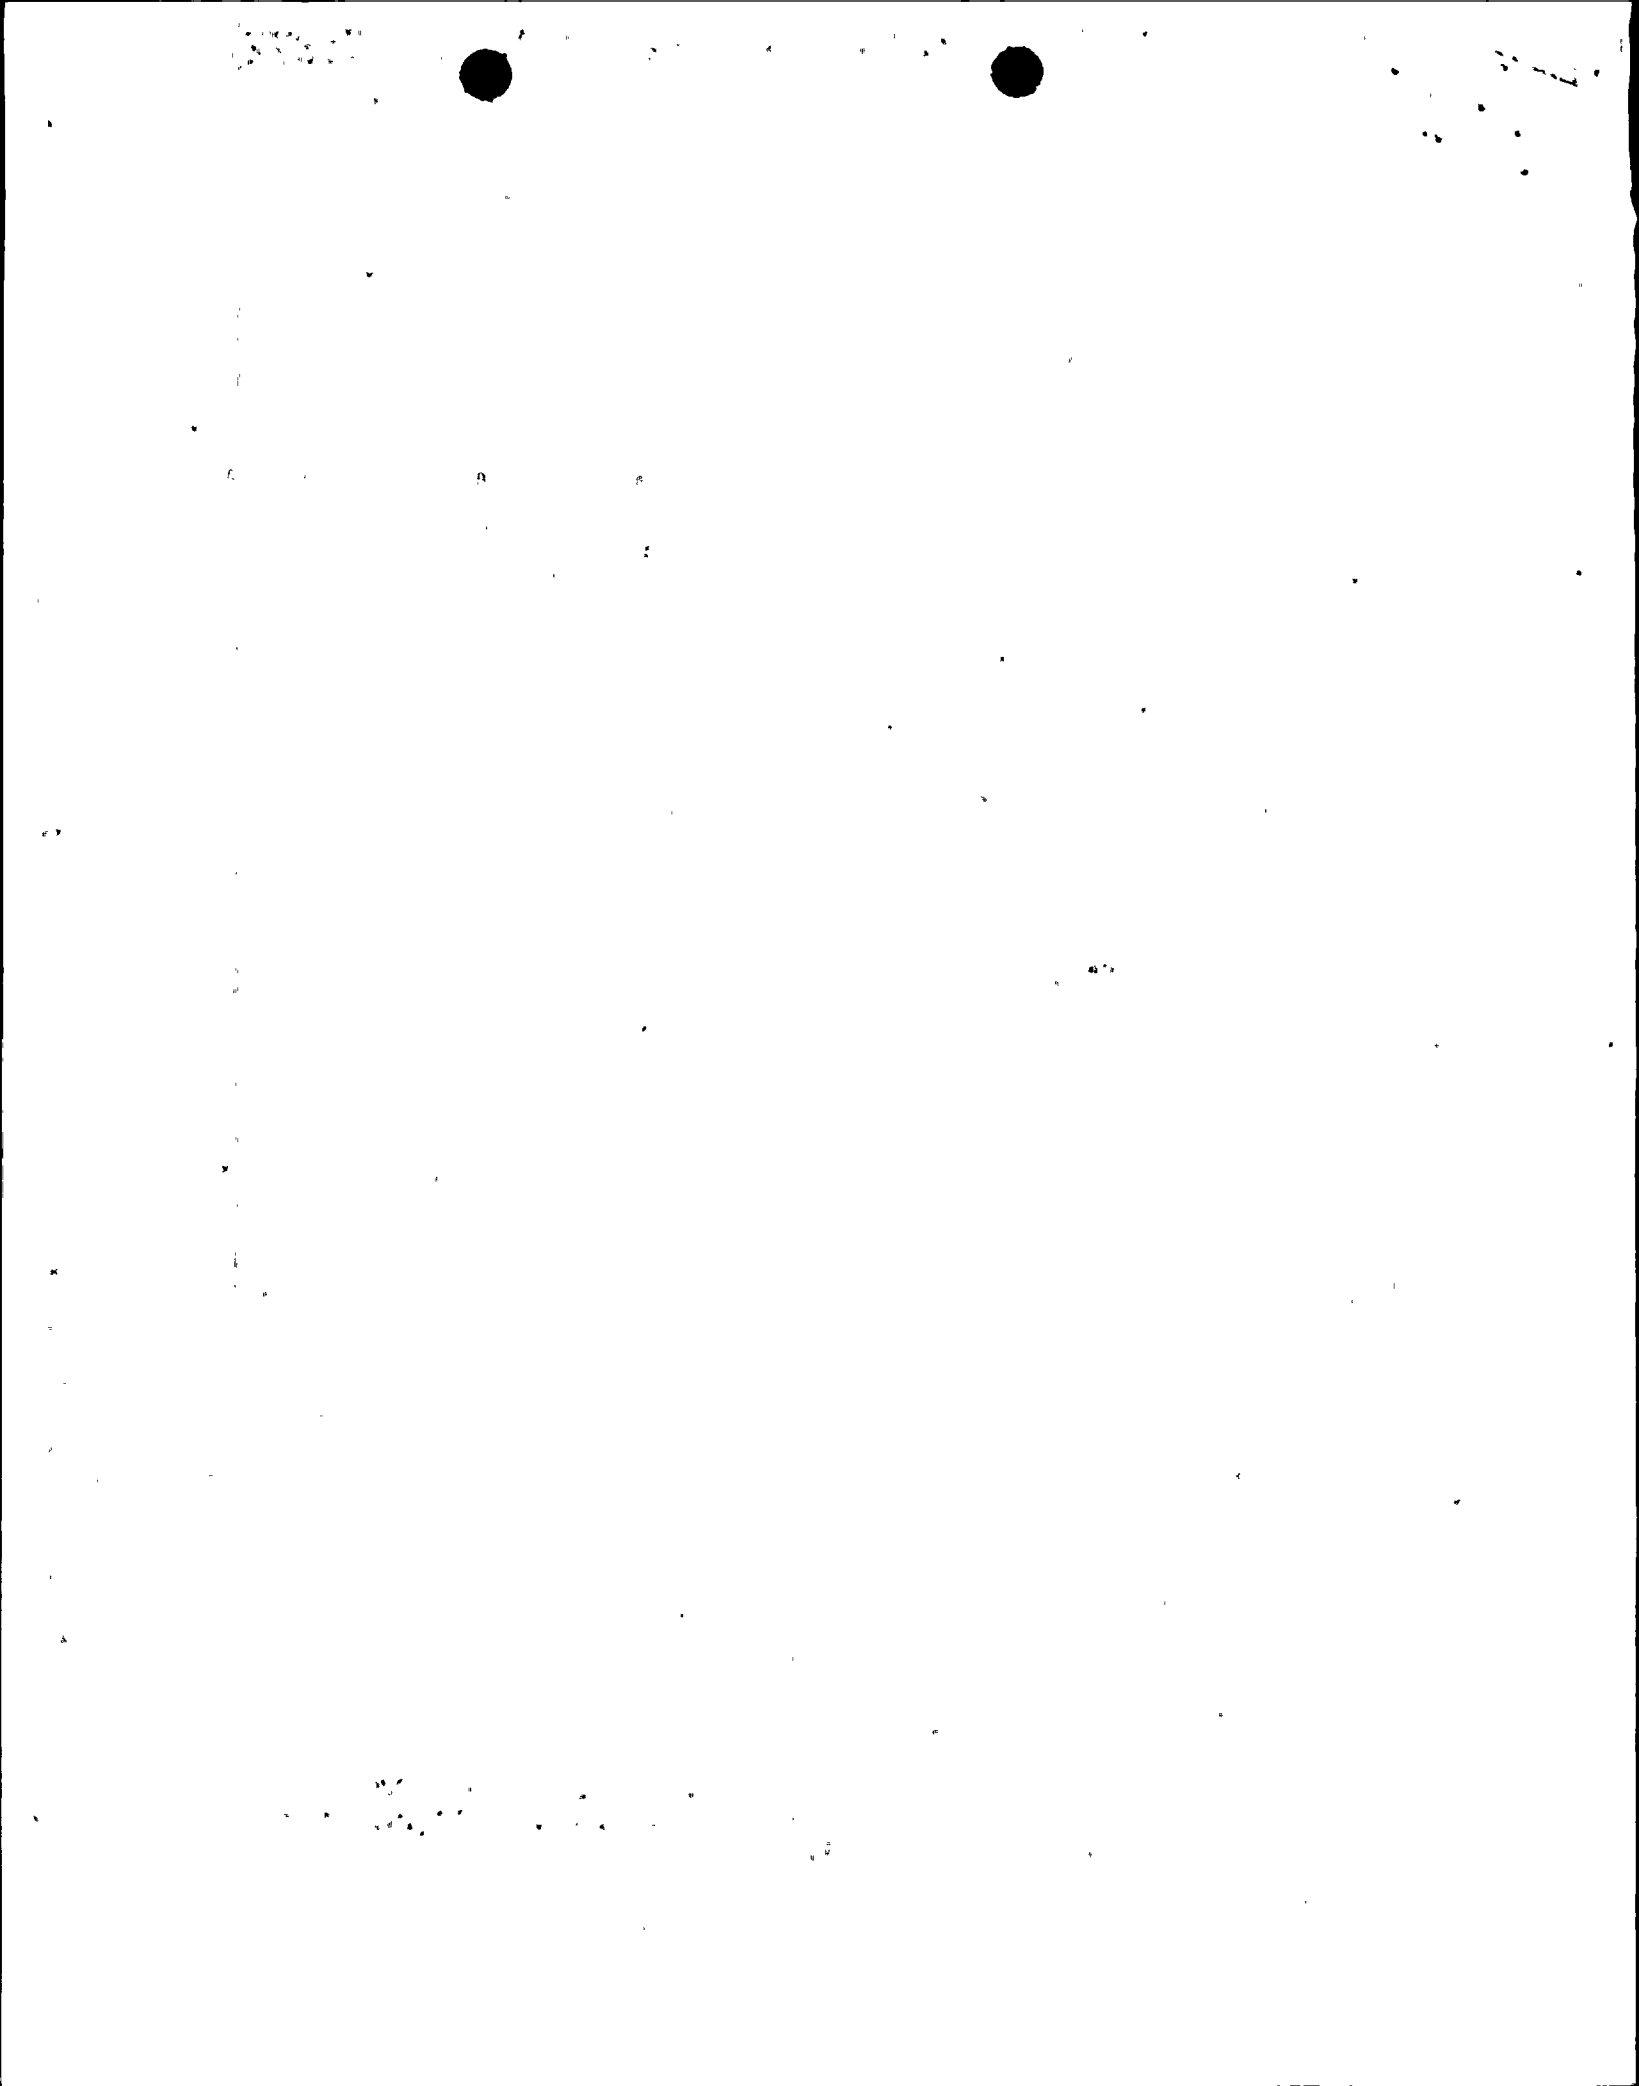



FEBRUARY 12 1990

L-90-47  
10 CFR 50.90

U. S. Nuclear Regulatory Commission  
Attn: Document Control Desk  
Washington, D. C. 20555

Gentlemen:

Re: St. Lucie Units 1 and 2  
Docket Nos. 50-335 and 50-389  
Proposed License Amendments  
Full Length Control Element Assembly Surveillance Testing

In accordance with 10 CFR 50.90, Florida Power & Light Company (FPL) submits herewith a request to amend Facility Operating Licenses DPR-67 and NPF-16.

The proposed amendments to the St. Lucie Units 1 and 2 Technical Specifications revise the requirement to determine control element assembly (CEA) operability at least once per 31 days to once per 92 days. Additionally, it is proposed that the surveillance interval for the performance of the functional test of the CEA block circuit, which is performed as part of the CEA operability test, be performed on a quarterly basis, rather than the existing monthly basis.

Marked up copies of the affected Technical Specification pages are included as Attachment 1. A Safety Analysis in support of the proposed amendments is included as Attachment 2. A "Determination of No Significant Hazards Consideration" is provided as Attachment 3.

The proposed amendments have been reviewed by the St. Lucie Plant Facility Review Group and the FPL Company Nuclear Review Board.

In accordance with 10 CFR 50.91(b)(1), a copy of the proposed amendment is being forwarded to the state designee of the State of Florida.

9003080450 900212  
PDR ADOCK 05000335  
P PNU



*Aool*  
*11*




100-100000

U. S. Nuclear Regulatory Commission  
L-90-47  
Page two

Please contact us if there are any questions regarding this submittal.

Very truly yours,

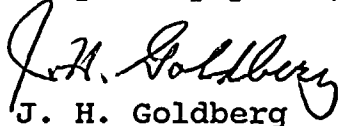

J. H. Goldberg  
Executive Vice President

JHG/MSD/gp

Attachment

cc: Stewart D. Ebnetter, Regional Administrator, Region II, USNRC  
Senior Resident Inspector, USNRC, St. Lucie Plant  
Mr. Jacob D. Nash, Florida Department of Health and  
Rehabilitation Services

STATE OF FLORIDA        )  
                                  ) ss.  
COUNTY OF PALM BEACH )


J. H. Goldberg being first duly sworn, deposes and says:

That he is Executive Vice President, of Florida Power & Light Company, the Licensee herein;

That he has executed the foregoing document; that the statements made in this document are true and correct to the best of his knowledge, information and belief, and that he is authorized to execute the document on behalf of said Licensee.


  
\_\_\_\_\_  
J. H. Goldberg

Subscribed and sworn to before me this  
12 day of February, 1990.

  
\_\_\_\_\_  
NOTARY PUBLIC, in and for the County of  
Palm Beach, State of Florida

Notary Public, State of Florida  
My Commission Expires June 1, 1993  
Bonded Thru Troy Fain - Insurance Inc.

My Commission expires \_\_\_\_\_

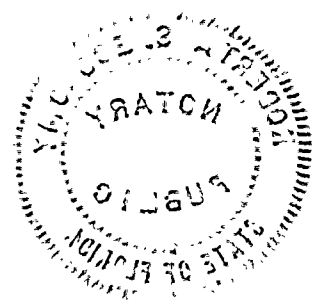

ATTACHMENT 1

MARKED-UP TECHNICAL SPECIFICATION PAGES

St. Lucie Unit 1

3/4 1-22

St. Lucie Unit 2

3/4 1-20





11  
12  
13  
14  
15  
16  
17  
18  
19  
20  
21  
22  
23  
24  
25  
26  
27  
28  
29  
30  
31  
32  
33  
34  
35  
36  
37  
38  
39  
40  
41  
42  
43  
44  
45  
46  
47  
48  
49  
50  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65  
66  
67  
68  
69  
70  
71  
72  
73  
74  
75  
76  
77  
78  
79  
80  
81  
82  
83  
84  
85  
86  
87  
88  
89  
90  
91  
92  
93  
94  
95  
96  
97  
98  
99  
100