

# ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

## REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9007310235      DOC. DATE: 90/07/25      NOTARIZED: NO      DOCKET #  
 FACIL: 50-335 St. Lucie Plant, Unit 1, Florida Power & Light Co.      05000335  
 AUTH. NAME      AUTHOR AFFILIATION  
 SAGER, D.A.      Florida Power & Light Co.  
 RECIP. NAME      RECIPIENT AFFILIATION  
                                  Document Control Branch (Document Control Desk)

SUBJECT: Advises that NIS-1 & NIS-2 forms, as part of inservice insp rept, will be submitted by 900831.

DISTRIBUTION CODE: A047D      COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 1  
 TITLE: OR Submittal: Inservice Inspection/Testing/Relief from ASME Code

NOTES:

|           | RECIPIENT<br>ID CODE/NAME | COPIES<br>LTTR ENCL | RECIPIENT<br>ID CODE/NAME | COPIES<br>LTTR ENCL |
|-----------|---------------------------|---------------------|---------------------------|---------------------|
|           | PD2-2 LA                  | 1 0                 | PD2-2 PD                  | 5 5                 |
|           | NORRIS, J                 | 1 1                 |                           |                     |
| INTERNAL: | ACRS                      | 6 6                 | AEOD/DSP/TPAB             | 1 1                 |
|           | NRR/DET/ECMB 9H           | 1 1                 | NRR/DET/EMEB 9H           | 1 1                 |
|           | NUDOCS-ABSTRACT           | 1 1                 | OC/LFMB                   | 1 0                 |
|           | OGC/HDS2                  | 1 0                 | <u>REG FILE 01</u>        | 1 1                 |
|           | RES/DSIR/EIB              | 1 1                 |                           |                     |
| EXTERNAL: | EG&G BROWN, B             | 1 1                 | EG&G RANSOME, C           | 1 1                 |
|           | LPDR                      | 1 1                 | NRC PDR                   | 1 1                 |
|           | NSIC                      | 1 1                 |                           |                     |


*ama-4*

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,  
 ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION  
 LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 26 ENCL 23 0

R  
I  
D  
S  
/  
A  
D  
D  
S  
/  
A  
D  
D  
S

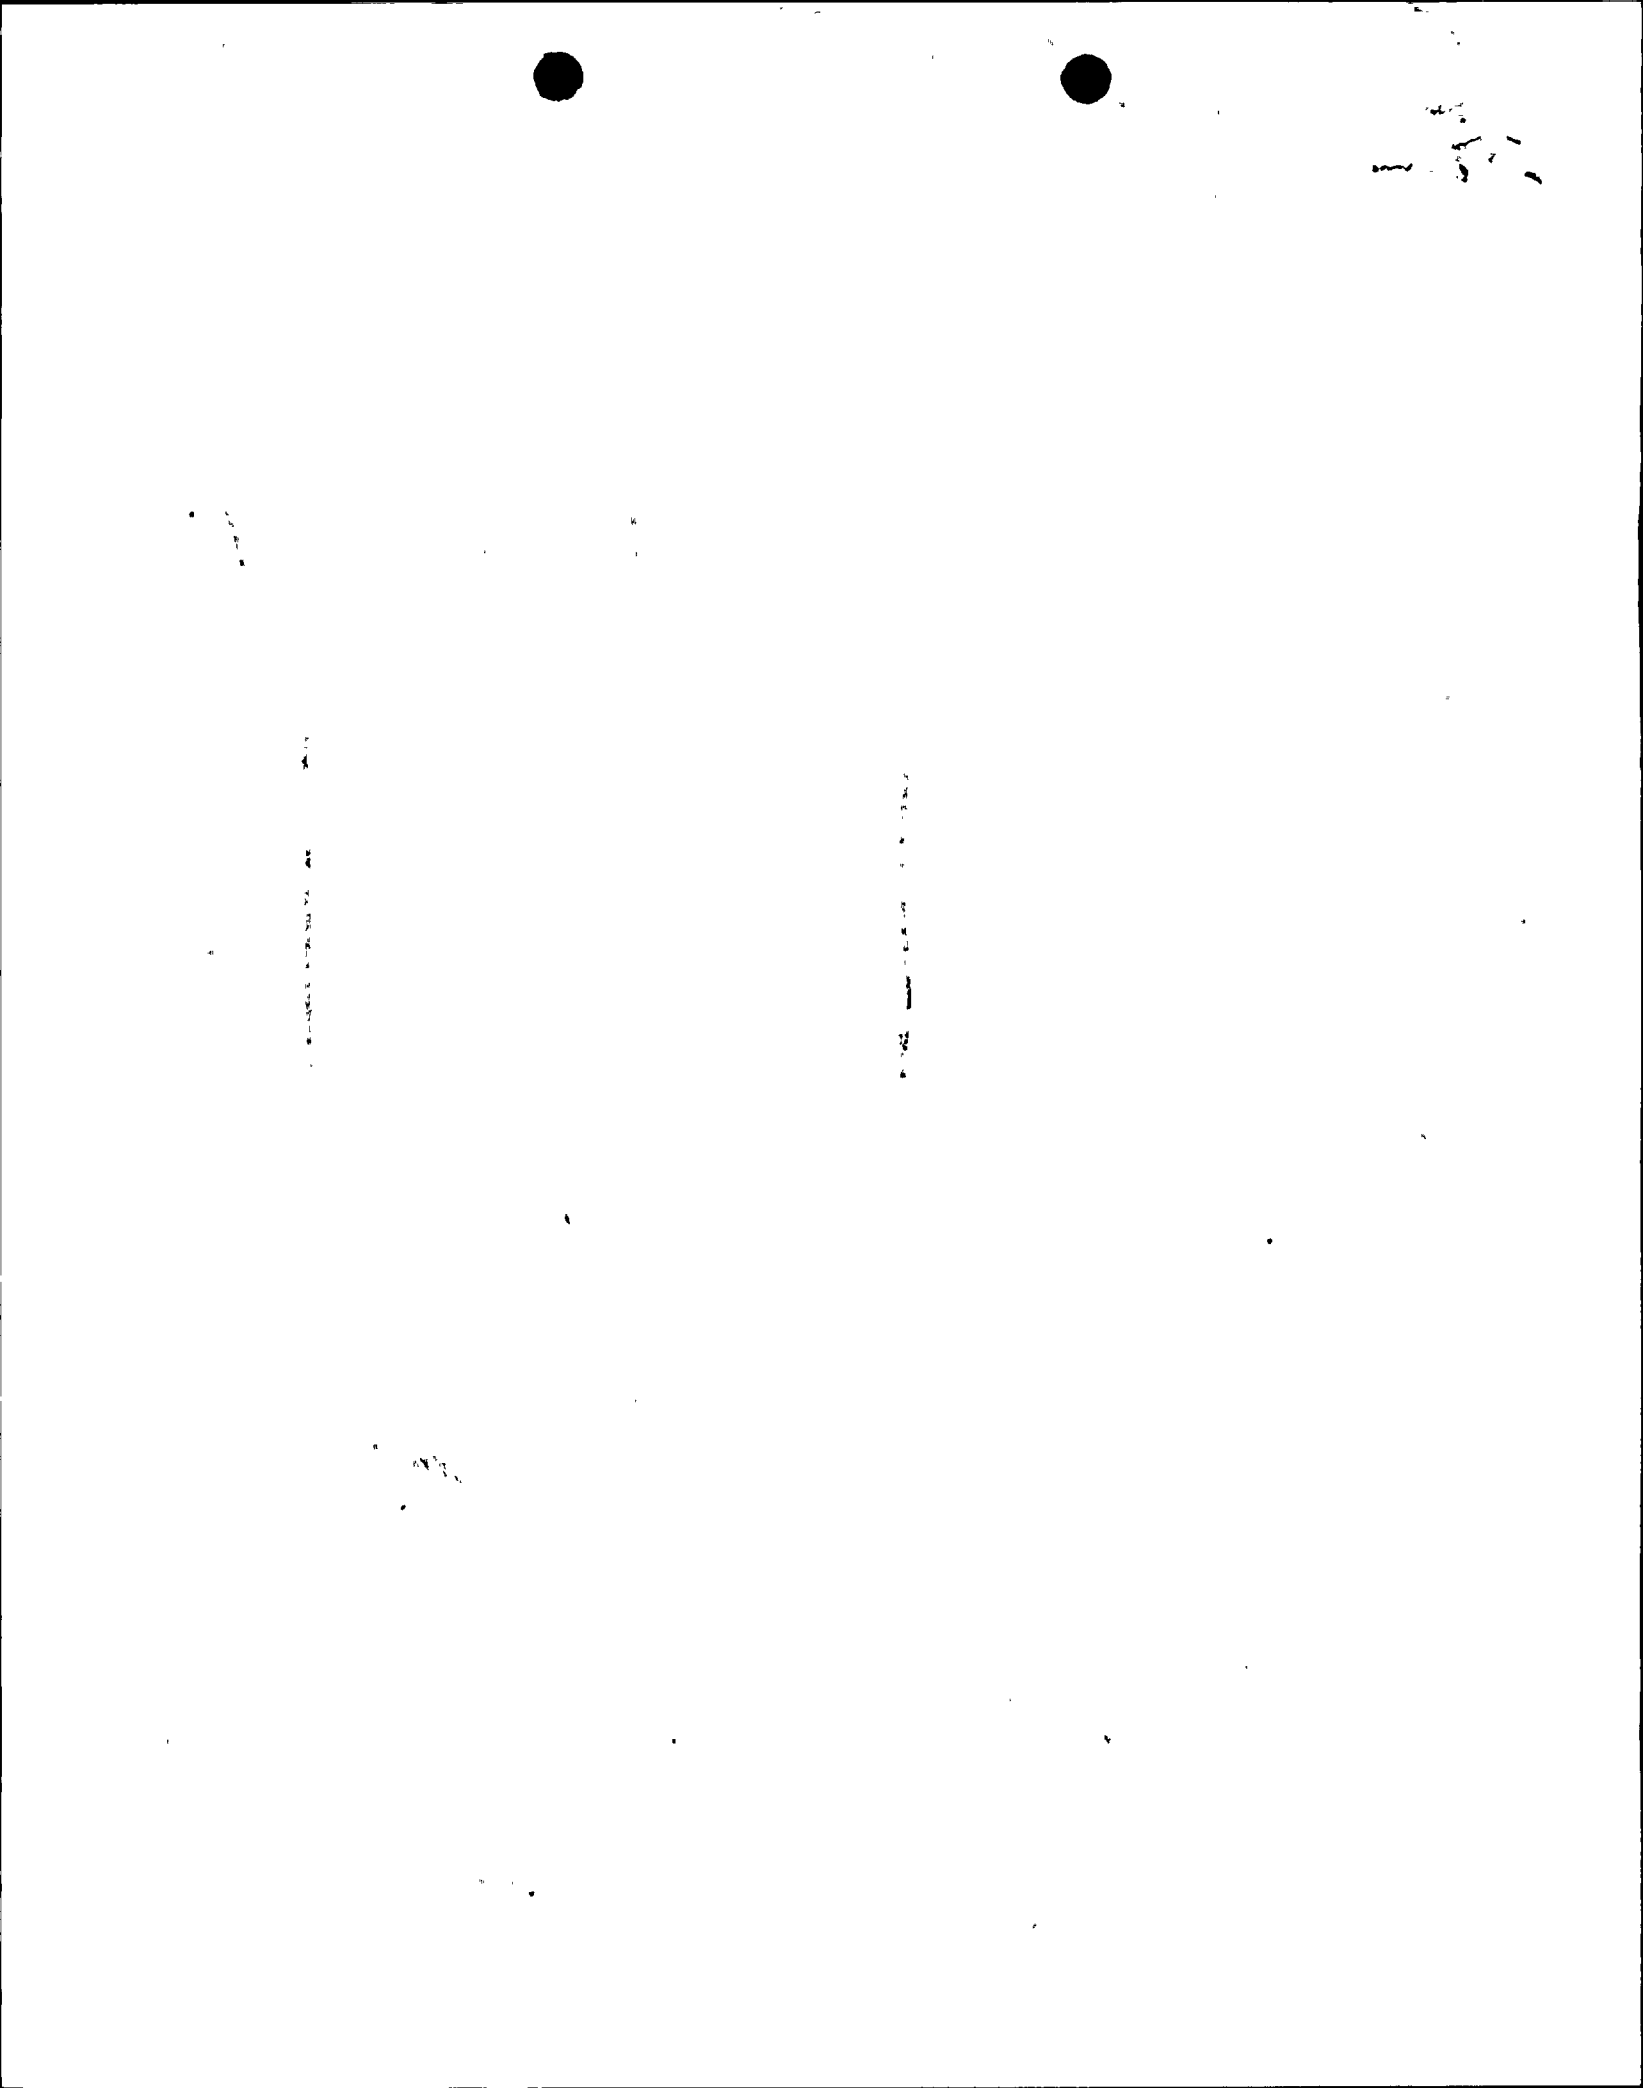



JUL 25 1990

L-90-276  
10 CFR 50.55a

U. S. Nuclear Regulatory Commission  
Attn: Document Control Desk  
Washington, DC 20555

132

Gentlemen:

Re: St. Lucie Unit 1  
Docket 50-335  
Inservice Inspection Report

ASME Code, Section XI, (IWA-6300) requires that Inservice Inspection (ISI) Summary Reports (Forms NIS-1 and NIS-2) be submitted within 90 days after ISI completion. The administrative review of the NIS-2 forms has not been completed, due in part, to the plant ISI manpower required to support the current St. Lucie Unit 1 outage.

The NIS-1 and NIS-2 forms will be submitted by August 31, 1990. This schedule change has been discussed with the NRC Project Manager for St. Lucie.

Very truly yours,

D. A. Sager  
Vice President  
St. Lucie Plant

DAS:LLM:kw

cc: Stewart D. Ebnetter, Regional Administrator, Region II, USNRC  
Senior Resident Inspector, USNRC, St. Lucie Plant

DAS/PSL #220

9007310235 900725  
PDR ADOCK 05000335  
Q PDC

A047  
/0

52