

# ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

## REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9101090117      DOC. DATE: 91/01/02      NOTARIZED: NO      DOCKET #  
 FACIL: 50-335 St. Lucie Plant, Unit 1, Florida Power & Light Co.      05000335  
       50-389 St. Lucie Plant, Unit 2, Florida Power & Light Co.      05000389  
 AUTH. NAME      AUTHOR AFFILIATION  
 BOHLKE, W.H.      Florida Power & Light Co.  
 RECIP. NAME      RECIPIENT AFFILIATION  
                                  Document Control Branch (Document Control Desk)

SUBJECT: Application for amends to Licenses DPR-67 & NPF-16, revising Tech Specs re organizational titles.

DISTRIBUTION CODE: A001D      COPIES RECEIVED: LTR 1 ENCL 1      SIZE: 1+15  
 TITLE: OR Submittal: General Distribution

NOTES:


	RECIPIENT ID CODE/NAME	COPIES LTR	ENCL	RECIPIENT ID CODE/NAME	COPIES LTR	ENCL
	PD2-2 LA	1	1	PD2-2 PD	1	1
	NORRIS, J	2	2			
INTERNAL:	ACRS	6	6	NRR/DET/ECMB 9H	1	1
	NRR/DET/ESGB	1	1	NRR/DOEA/OTSB11	1	1
	NRR/DST 8E2	1	1	NRR/DST/SELB 8D	1	1
	NRR/DST/SICB 7E	1	1	NRR/DST/SRXB 8E	1	1
	NUDOCS-ABSTRACT	1	1	OC/LFMB	1	0
	OGC/HDS2	1	0	<del>REG FEE</del> 01	1	1
	RES/DSIR/EIB	1	1			
EXTERNAL:	NRC PDR	1	1	NSIC	1	1

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,  
 ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION  
 LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 24 ENCL 22

R  
I  
D  
S  
/  
A  
D  
D  
S  
/  
A  
D  
D  
S

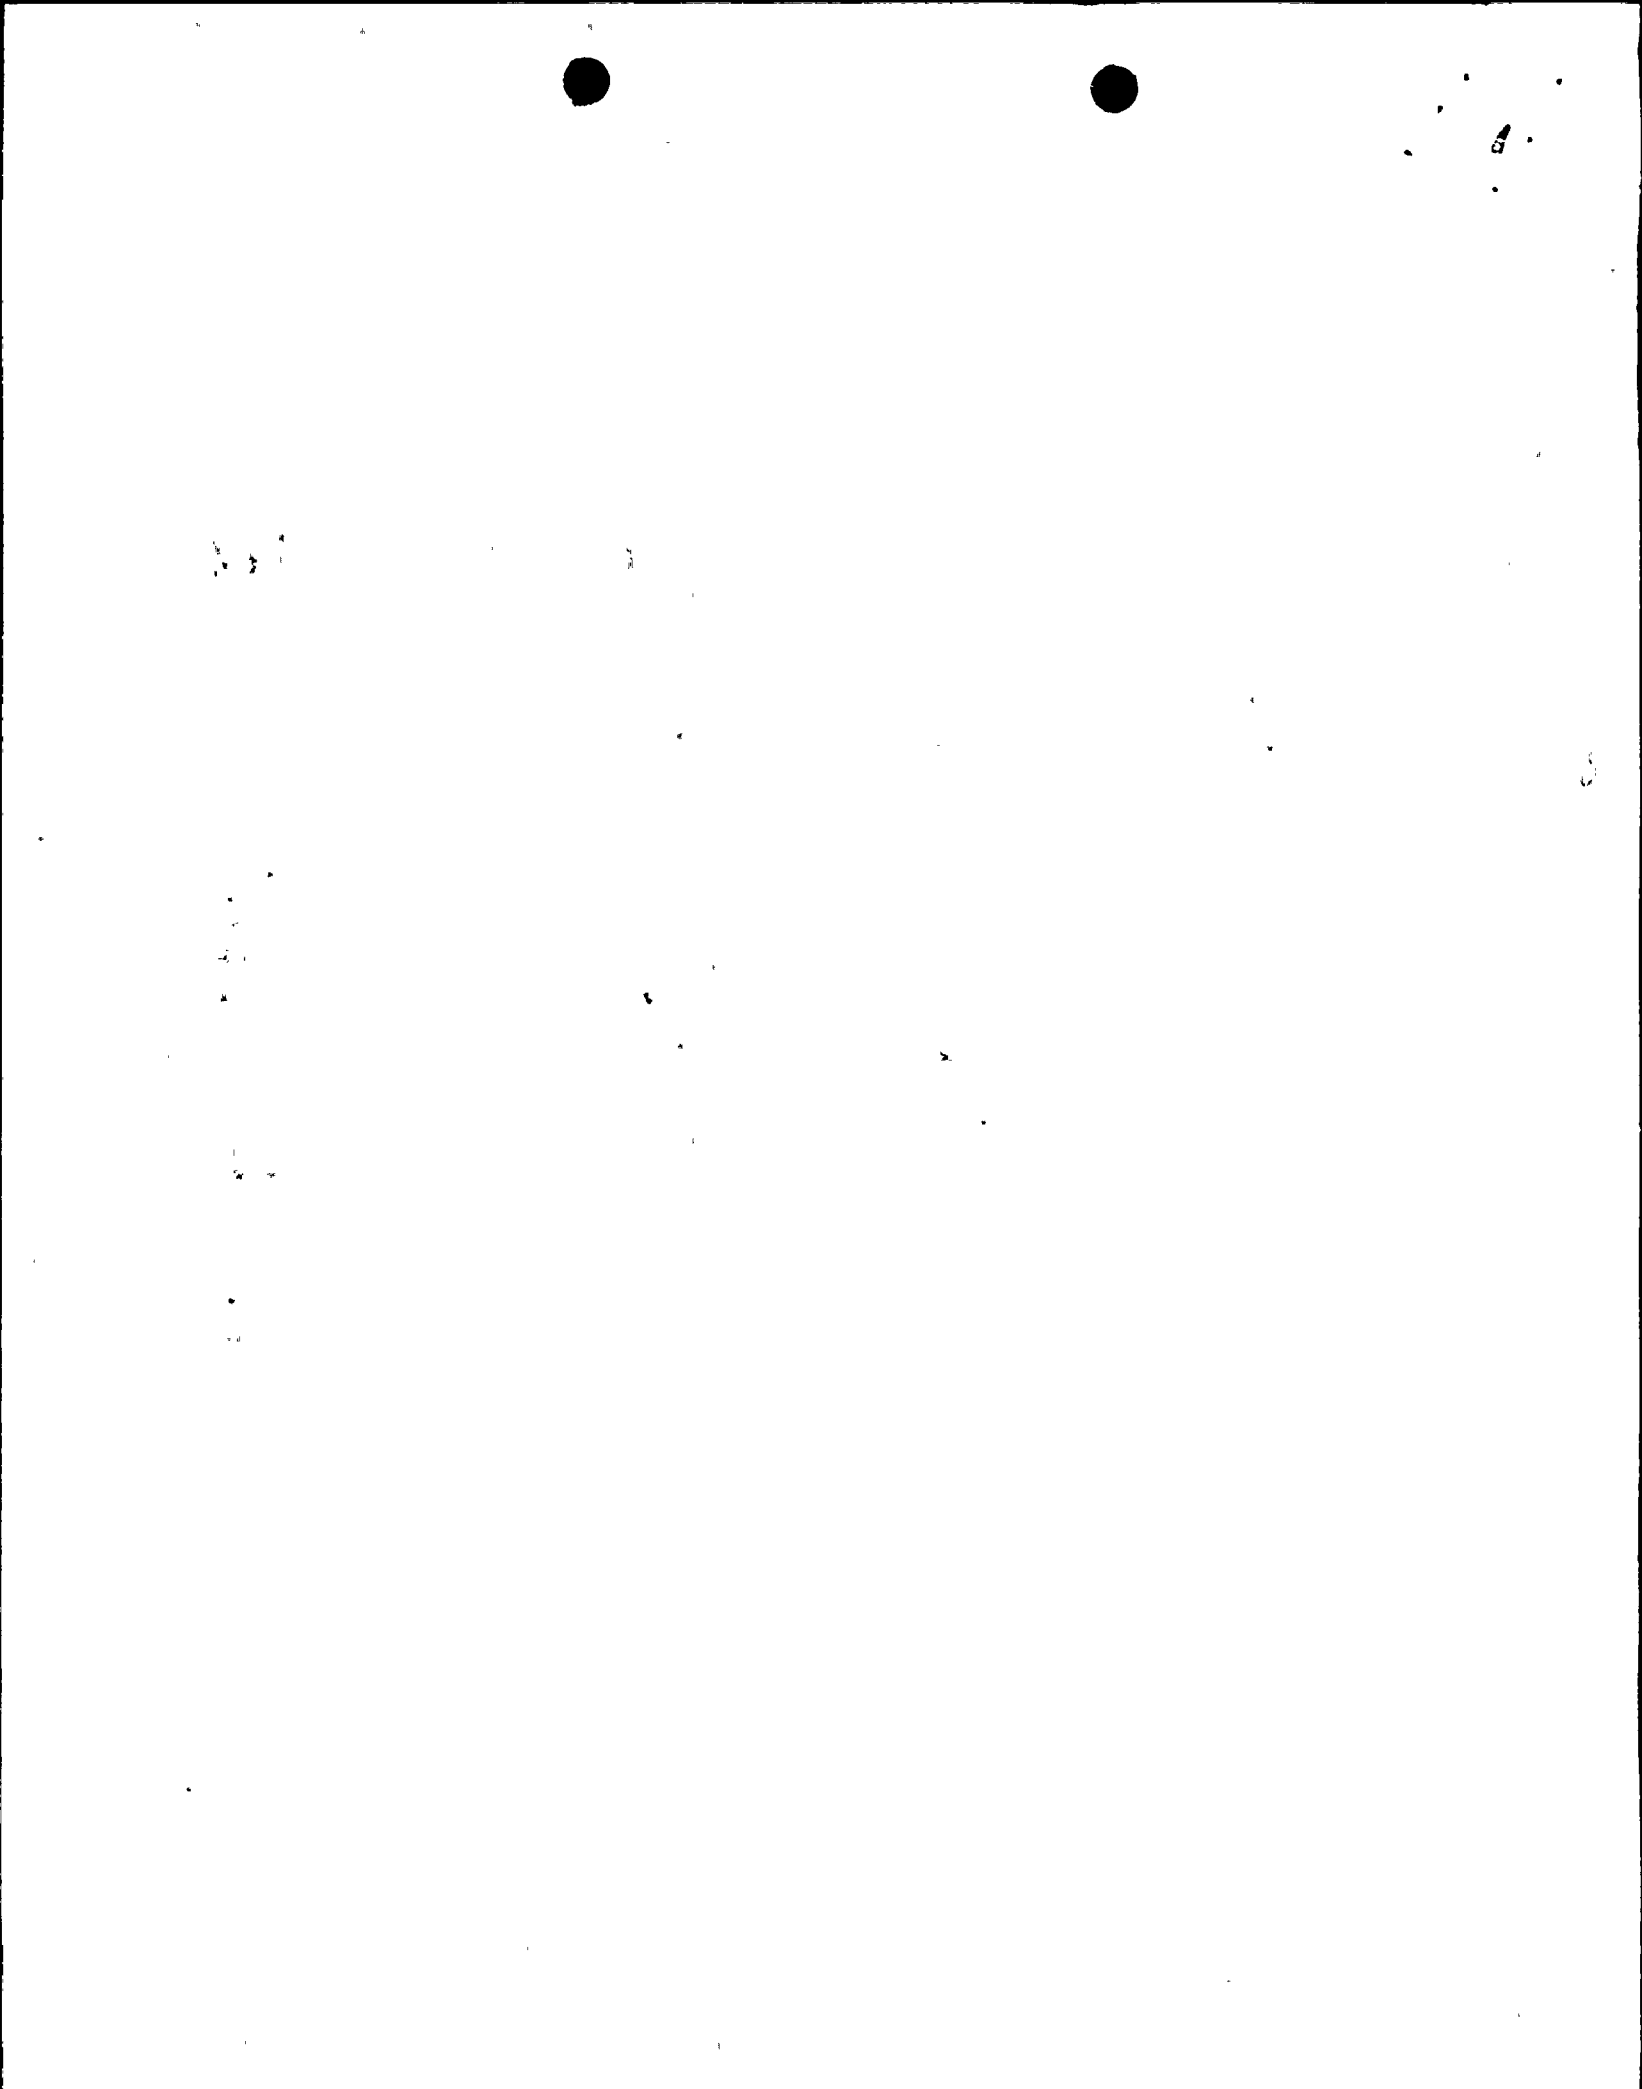



FPL

P.O. Box 14000, Juno Beach, FL 33408-0420

JANUARY 2 1991

L-90-395  
10 CFR 50.90

U. S. Nuclear Regulatory Commission  
Attn: Document Control Desk  
Washington, D. C. 20555

Gentlemen:

Re: St. Lucie Units 1 and 2  
Docket Nos. 50-335 and 50-389  
Proposed License Amendments  
Organizational Titles

By letter L-90-313 (dated August 27, 1990), as amended by letter L-90-351 (dated September 27, 1990), Florida Power & Light Company (FPL) proposed to revise the St. Lucie Units 1 and 2 Facility Operating Licenses. The purpose of these amendments was to revise Technical Specification Section 6.0, Administrative Controls, by adding more general organizational titles to the Technical Specifications of both units and to correct a typographical error in the Technical Specifications of St. Lucie Unit 1.

FPL discussed the proposed amendment with the NRC subsequent to receipt and initial review by the NRC. As a result of the discussions, FPL now proposes to amend its applications to revise the St. Lucie Units 1 and 2 Technical Specifications (Attachments 1 and 2 to this letter).

The changes to the Technical Specifications of Attachments 1 and 2 of this letter are enveloped by the Determination of No Significant Hazards Consideration of L-90-313.

If you have further questions on this topic, please contact us.

W. H. Bohlke  
Vice President  
Nuclear Engineering and Licensing

WHB/lef  
Attachments

cc: Stewart D. Ebnetter, Regional Administrator, Region II, USNRC  
Mr. Jacob D. Nash, Florida Department of Health and  
Rehabilitative Services  
Senior Resident Inspector, USNRC, St. Lucie

080059

an FPL Group company

9101090117 910102  
PDR ADOCK 05000335  
P PDR

A001  
111