

# FORD 1

## REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9110240038    DOC.DATE: 91/10/17    NOTARIZED: YES    DOCKET #  
FACIL: 50-335 St. Lucie Plant, Unit 1, Florida Power & Light Co.    05000335  
50-389 St. Lucie Plant, Unit 2, Florida Power & Light Co.    05000389  
AUTH.NAME    AUTHOR AFFILIATION  
HARRIS, K.N.    Florida Power & Light Co.  
RECIP.NAME    RECIPIENT AFFILIATION  
Document Control Branch (Document Control Desk)

SUBJECT: Application for amends to Licenses DPR-67 & NPF-16, revising fire protection TSs to delete Sections 3/4.3.3.7, 3/4.7.11, 3/4.7.12 & 6.2.2.e & to delete Section 6.5.1.6.n, per Generic Ltrs 86-10 & 88-12.

DISTRIBUTION CODE: A006D    COPIES RECEIVED: LTR 1    ENCL 1    SIZE: 2+57  
TITLE: OR/Licensing Submittal: Fire Protection

NOTES:

	RECIPIENT		COPIES		RECIPIENT		COPIES	
	ID	CODE/NAME	LTTR	ENCL	ID	CODE/NAME	LTTR	ENCL
	PD2-2	LA	1	0	PD2-2	PD	1	1
		NORRIS, J	2	2				
INTERNAL:	ACRS		3	3	NRR	WERMEIL, J	1	0
	NRR/DET/ECMB	9H	2	2	NRR/DST	8E2	1	1
	NRR/DST/SPLB8D1		1	1	NUDOCS-ABSTRACT		1	1
	OC/LFMB		1	0	OGC/HDS3		1	0
	<u>REG FILE</u>	01	1	1				
EXTERNAL:	NRC	PDR	1	1	NSIC		1	1

TOTAL NUMBER OF COPIES REQUIRED: LTR 18    ENCL 14

R  
I  
D  
S  
/  
F  
O  
R  
D  
1  
D  
O  
C  
U  
M  
E  
N  
T



FPL

P.O. Box 14000, Juno Beach, FL 33408-0420

OCT 17 1991

L-91-237  
10 CFR 50.90

U. S. Nuclear Regulatory Commission  
Attn: Document Control Desk  
Washington, DC 20555

Gentlemen:

RE: St. Lucie Units 1 and 2  
Docket Nos. 50-335 and 50-389  
Proposed License Amendment  
Fire Protection Technical Specifications

In accordance with 10 CFR 50.90, Florida Power & Light Company (FPL) submits herewith a request to amend Facility Operating Licenses DPR-67 and NPF-16 for St. Lucie Units 1 and 2. The proposed amendment includes the required updating of the operating licenses with the standard license condition as stated in Generic Letter 86-10, Section F; revises the Unit 1 and Unit 2 Technical Specifications to delete Section 3/4.3.3.7, 3/4.7.11, 3/4.7.12, and 6.2.2.e; and adds Section 6.5.1.6.n. This proposed amendment is in accordance with the guidelines stated in Generic Letter 88-12.

Attachment 1 and 2 are marked up copies of the proposed Unit 1 and Unit 2 Technical Specification changes. Attachments 3 and 4 are Unit 1 and Unit 2 Safety Analyses in support of the proposed license amendments. Attachment 5 is the "Declaration of No Significant Hazards Consideration."

The proposed amendment has been reviewed by the St. Lucie Facility Review Group and the Florida Power & Light Company Nuclear Review Board. In accordance with 10 CFR 50.91 (b) (1), a copy of the proposed amendment is being forwarded to the State Designee, the Department of Health and Rehabilitative Services (DHRS) for the State of Florida.

Please contact us if there are any questions about this material.

Very truly yours,

*K. N. Harris*  
K. N. Harris  
Senior Vice President  
Nuclear Operations

KNH:GRM:kw  
Attachments


cc: Stewart D. Ebnetter, Regional Administrator, Region II, USNRC  
Senior Resident Inspector, USNRC, St. Lucie Plant  
Mr. Jacob D. Nash, State of Florida, DHRS

DAS/PSL 512-91

220100 FPL Group company

9110240038 911017  
PDR ADDCK 05000335  
P PDR

*ADD*

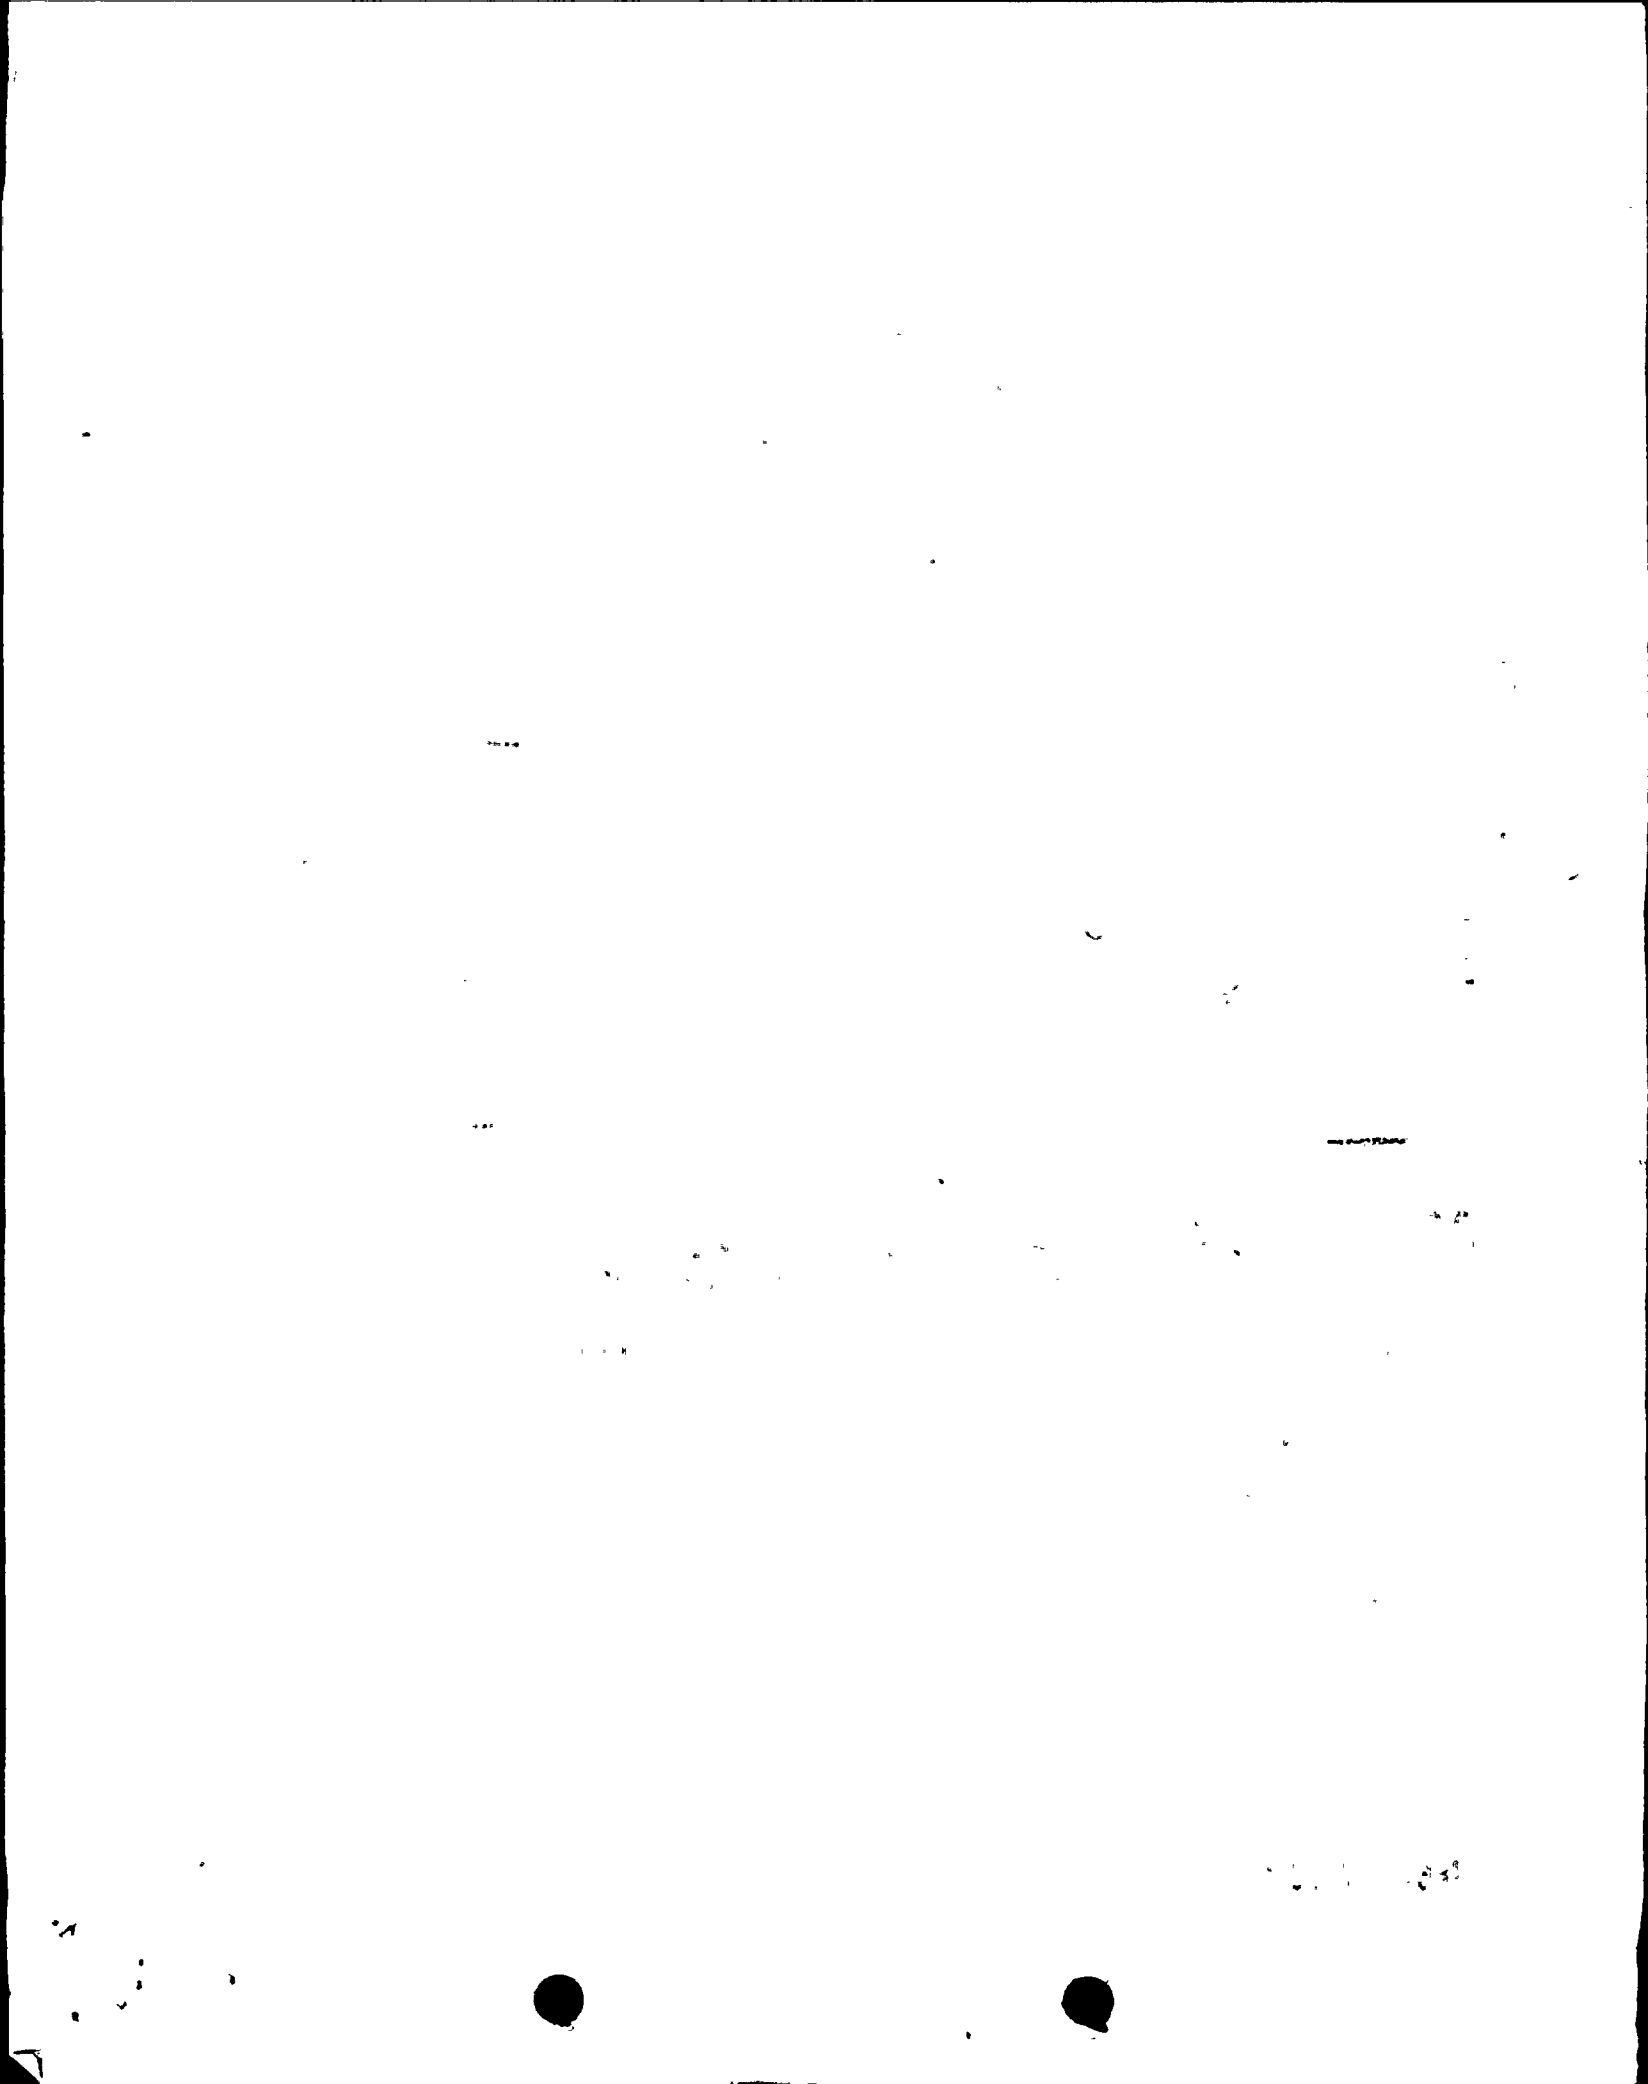

STATE OF FLORIDA            )  
  )  
COUNTY OF PALM BEACH    )            ss.

K. N. Harris being first duly sworn, deposes and says:

That he is Senior Vice President, Nuclear Operations for the Nuclear Division of Florida Power & Light Company, the Licensee herein;

That he has executed the foregoing document; that the statements made in this document are true and correct to the best of his knowledge, information and belief, and that he is authorized to execute the document on behalf of said Licensee.

*K. N. Harris*  
K. N. Harris

Subscribed and sworn to before me this  
17 day of October, 19 91.

*Roberta Economy*

NOTARY PUBLIC, in and for the County of  
Palm Beach, State of Florida

Notary Public, State of Florida  
My Commission Expires June 1, 1993  
Bonded Thru Troy Fain - Insurance Inc.

My Commission expires \_\_\_\_\_