

ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATOR INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9203180137 DOC. DATE: 92/03/13 NOTARIZED: YES DOCKET #
 FACIL: 50-335 St. Lucie Plant, Unit 1, Florida Power & Light Co. 05000335
 AUTH. NAME AUTHOR AFFILIATION
 BOHLKE, W.H. Florida Power & Light Co.
 RECIP. NAME RECIPIENT AFFILIATION
 Document Control Branch (Document Control Desk)

SUBJECT: Application for amend to license DPR-67, revising TSs Design
 Section 5.3.1 re fuel assemblies to delete max weight of U
 in fuel rod & provide alternative requirements.

DISTRIBUTION CODE: A001D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 3+7
 TITLE: OR Submittal: General Distribution

NOTES:

	RECIPIENT		COPIES			RECIPIENT		COPIES	
	ID CODE/NAME		LTR	ENCL		ID CODE/NAME		LTR	ENCL
	PD2-2 LA		1	1		PD2-2 PD		1	1
	NORRIS, J		2	2					
INTERNAL:	ACRS		6	6		NRR/DET/ECMB 7D		1	1
	NRR/DET/ESGB		1	1		NRR/DOEA/OTSB11		1	1
	NRR/DST 8E2		1	1		NRR/DST/SELB 7E		1	1
	NRR/DST/SICB8H7		1	1		NRR/DST/SRXB 8E		1	1
	NUDOCS-ABSTRACT		1	1		OC/LFMB		1	0
	OGC/HDS3		1	0		<u>REG FILE</u> 01		1	1
	RES/DSIR/EIB		1	1					
EXTERNAL:	NRC PDR		1	1		NSIC		1	1

NOTE TO ALL "RIDS" RECIPIENTS:


PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,
 ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION
 LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 24 ENCL 22

AA2

R
I
D
S
/
A
D
D
S

R
I
D
S
/
A
D
D
S





L-92-65
10 CFR 50.90

MAR 13 1992

U. S. Nuclear Regulatory Commission
Attn: Document Control Desk
Washington, D. C. 20555

Gentlemen:

RE: St. Lucie Unit 1
Docket No. 50-335
Proposed License Amendment
Alternative Requirements for Fuel Assemblies
in Design Features Section of Technical Specifications-
Deletion of Maximum Weight of Uranium

Pursuant with 10 CFR 50.90, Florida Power & Light Company (FPL) requests an amendment to Facility Operating License DPR-67 for St. Lucie Unit 1.

The proposed amendment revises Technical Specifications Design Features Section 5.3.1, Fuel Assemblies, to delete the maximum weight of uranium in a fuel rod and provide alternative requirements for fuel assemblies in the design features section.

Attachment 1 is a marked up copy of the proposed Technical Specification change. Attachment 2 is a Safety Analysis in support of the proposed amendment. Attachment 3 is the "Determination of No Significant Hazards Consideration."

The proposed amendment has been reviewed by the St. Lucie Facility Review Group and the Florida Power & Light Company Nuclear Review Board. In accordance with 10 CFR 50.91 (b)(1), a copy of the proposed amendment is being forwarded to the State Designee for the State of Florida.

Please contact us if there are any questions about this submittal.

Very truly yours,

W. H. Bohlke
Vice President
Nuclear Engineering and Licensing

WHB/GRM/kw
DAS/PSL #639-92
Attachments

cc: Stewart D. Ebnetter, Regional Administrator, Region II, USNRC
Senior Resident Inspector, USNRC, St. Lucie Plant
Mr. Jacob D. Nash, Florida Department of Health and
Rehabilitative Services

9203180137 720313
PDR ADDCK 05000335
PDR

ADD 11/1

1981 3 11 AM

St. Lucie Unit 1
Docket No. 50-335
Proposed License Amendment
Alternative Requirements for Fuel Assemblies

STATE OF FLORIDA)
)
COUNTY OF PALM BEACH) ss.

W. H. Bohlke being first duly sworn, deposes and says:


That he is Vice President, Nuclear Engineering and Licensing for the Nuclear Division of Florida Power & Light Company, the Licensee herein;

That he has executed the foregoing document; that the statements made in this document are true and correct to the best of his knowledge, information and belief, and that he is authorized to execute the document on behalf of said Licensee.



W. H. Bohlke

Subscribed and sworn to before me this
13th day of March, 1992.

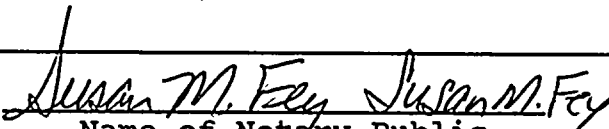

Name of Notary Public

NOTARY PUBLIC, in and for the County of
Palm Beach, State of Florida

Notary Public, State of Florida
My Comm. Exp. Feb. 18, 1995
Bonded thru PICHARD Ins. Agency
Commission No. CC084807

W.H. Bohlke is personally known to me.

St. Lucie Unit 1
Docket No. 50-335
Proposed License Amendment
Alternative Requirements for Fuel Assemblies

ATTACHMENT 1

St. Lucie Unit 1 Marked-up Technical Specification Page