

ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9203270172 DOC. DATE: 92/03/23 NOTARIZED: NO DOCKET # 05000335
 FACIL: 50-335 St. Lucie Plant, Unit 1, Florida Power & Light Co.
 AUTH. NAME: SAGER, D.A. AUTHOR AFFILIATION: Florida Power & Light Co.
 RECIP. NAME: RECIPIENT AFFILIATION: Document Control Branch (Document Control Desk)

See Rpt.

SUBJECT: Forwards "Owners Data Rpt for Inservice Insp (Forms NIS-1 NIS-2) St Lucie Unit 1."

DISTRIBUTION CODE: A047D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 1 + 400
 TITLE: OR Submittal: Inservice Inspection/Testing/Relief from ASME Code

NOTES:

	RECIPIENT		COPIES			
	ID CODE/NAME	LTR	ENCL	LTR		ENCL
	PD2-2 LA	1	0	PD2-2 PD	1	1
	NORRIS, J	2	2			
INTERNAL:	ACRS	0 1	0 1	NRR/DET/ECMB 9H	1	1
	NRR/DET/EMEB 7E	1	1	NUDOCS-ABSTRACT	1	1
	OC/LFMB	1	0	OGC/HDS3	1	0
	REG-FIPE 01	1	1	RES MILLMAN, G	1	1
	RES/DSIR/EIB	1	1			
EXTERNAL:	EG&G BROWN, B	1	1	EG&G RANSOME, C	1	1
	NRC PDR	1	1	NSIC	1	1

NOTE TO ALL "RIDS" RECIPIENTS:


PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK, ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR ~~22~~ ¹⁸ ENCL ~~29~~ ¹³

MA2

R
I
D
S
/
A
D
D
S

R
I
D
S
/
A
D
D
S

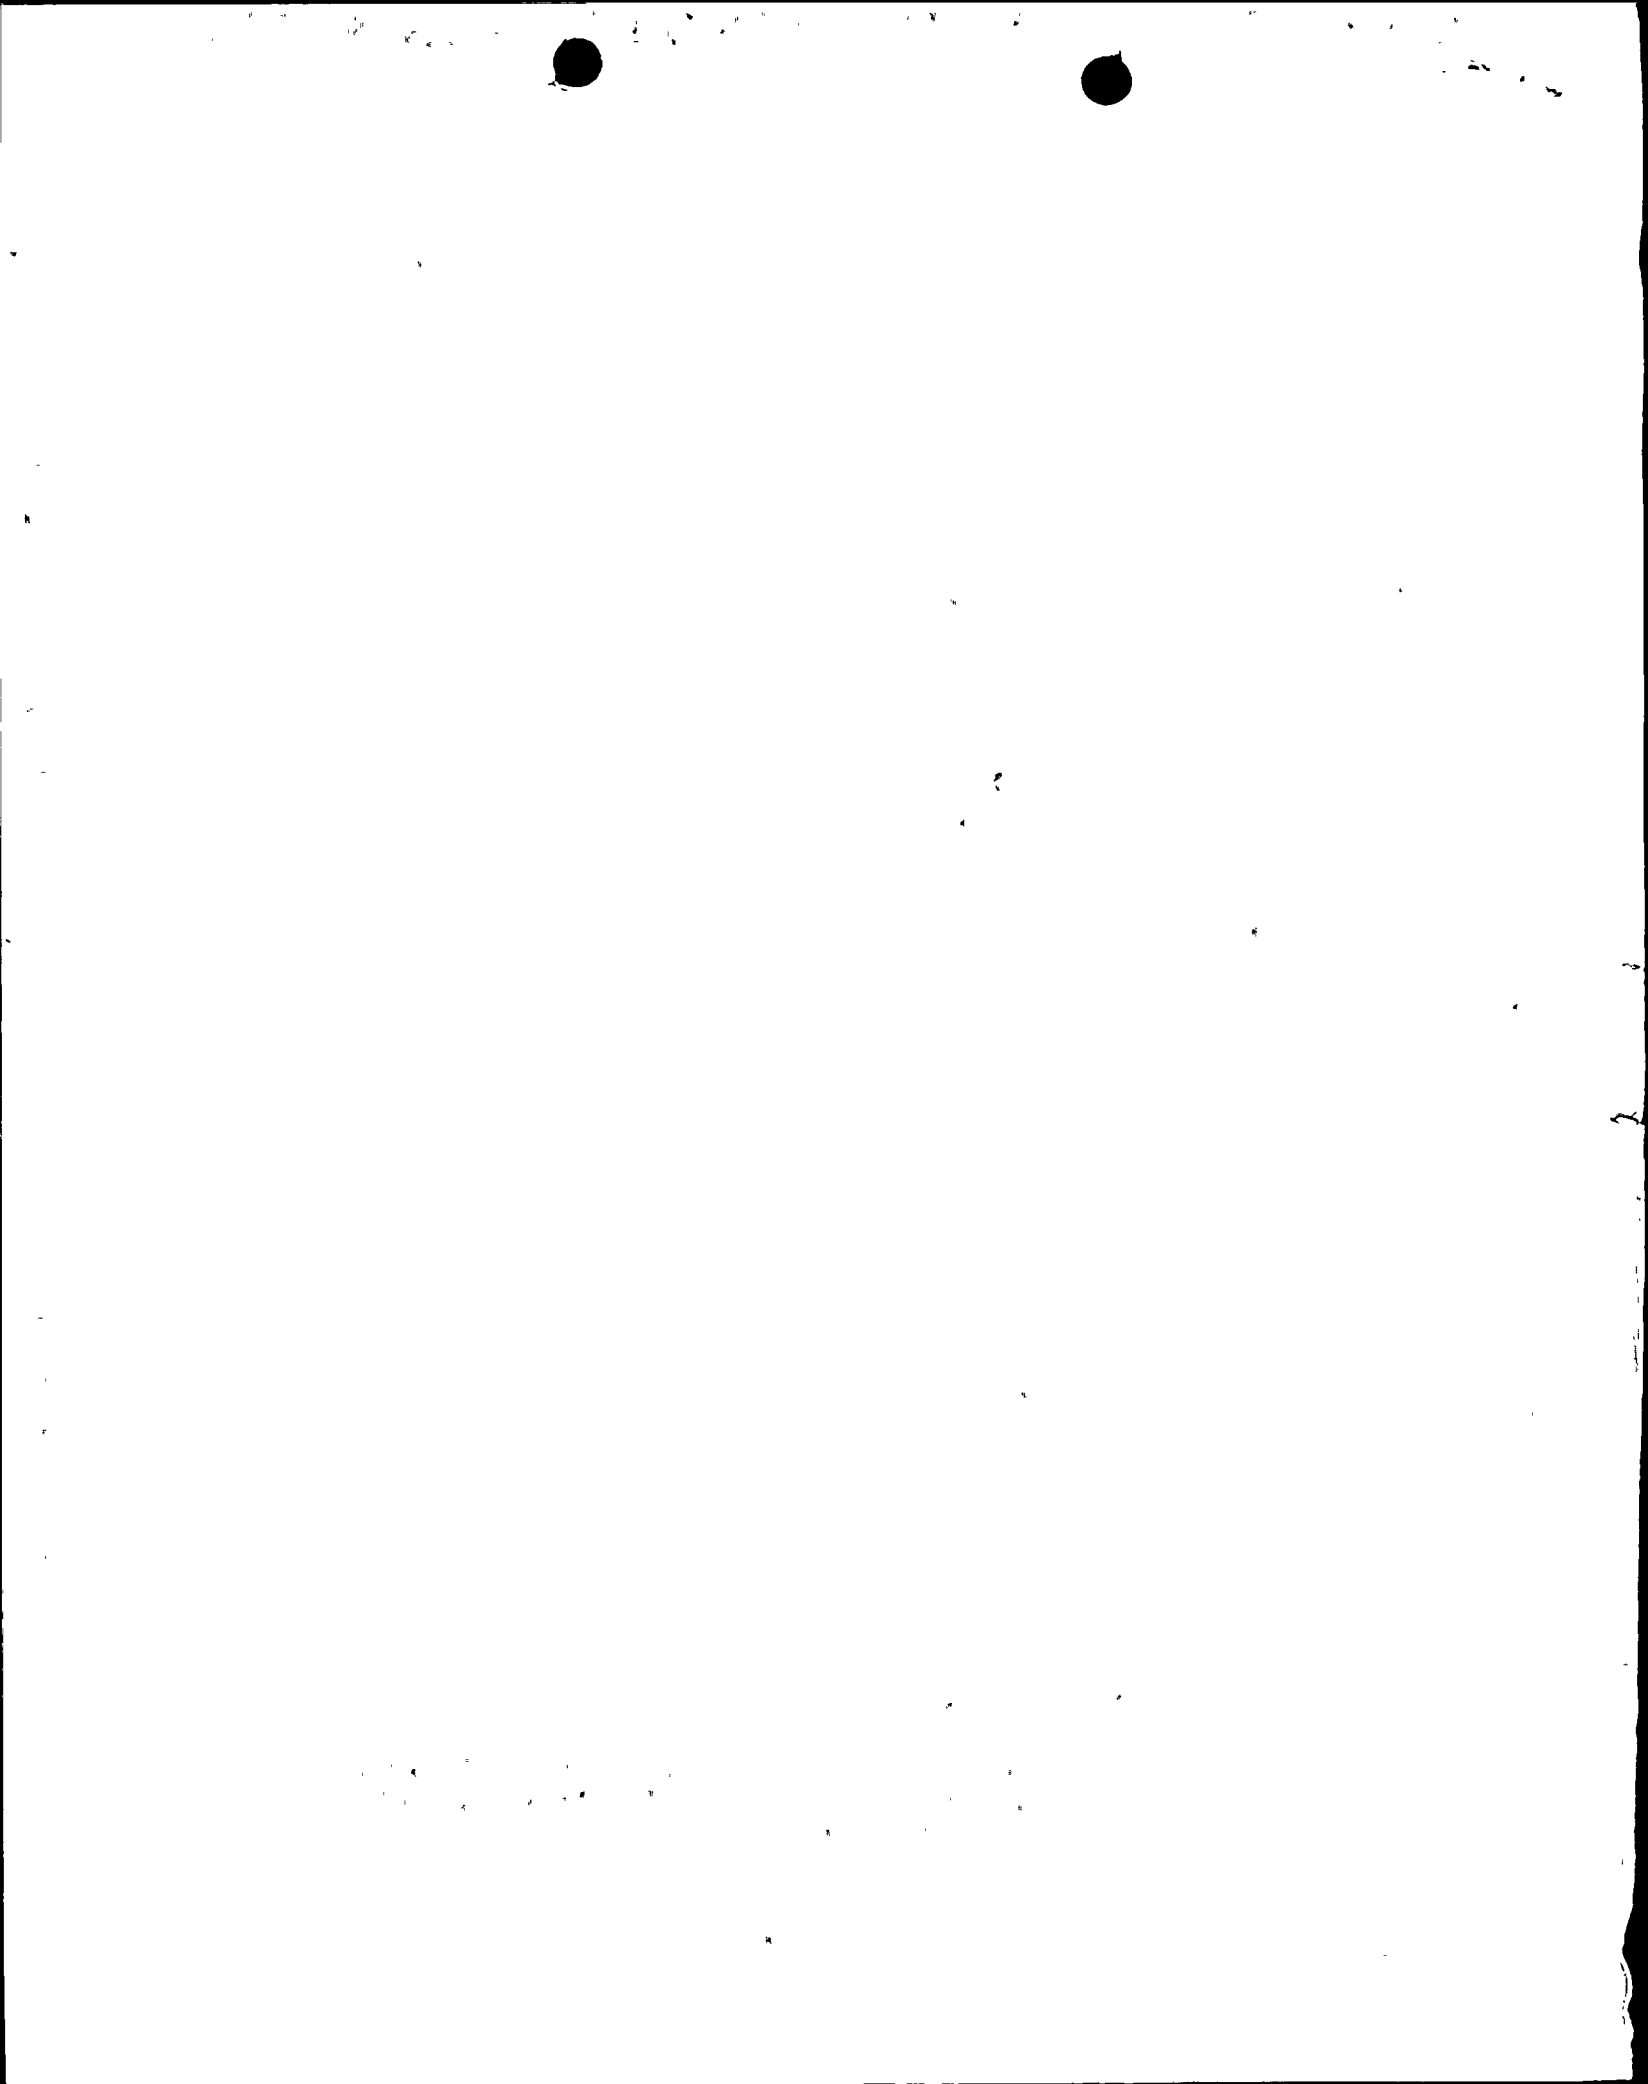



March 23, 1992

L-92-66
10 CFR 50.55a
10 CFR 50.36

U. S. Nuclear Regulatory Commission
Attn: Document Control Desk
Washington, DC 20555

Gentlemen:

Re: St. Lucie Unit 1
Docket 50-335
Inservice Inspection Report

ASME Code, Section XI, (IWA-6230) requires that Inservice Inspection (ISI) Summary Reports (Forms NIS-1 and NIS-2) be submitted within 90 days after completing the ISI conducted during a refueling outage.

Please find attached the Owner's Data Report for Inservice Inspection (Forms NIS-1 and NIS-2) which is submitted in accordance with the provisions of the ASME Code, Section XI, (IWA-6230).

Should you have any questions, please contact us.

Very truly yours,

D. A. Sager,
Vice President
St. Lucie Plant

DAS:JJB:kw

Enclosures

cc: Stewart D. Ebnetter, Regional Administrator, Region II, USNRC
Senior Resident Inspector, USNRC, St. Lucie Plant

DAS/PSL #642-92

270006

A047
11

9203270172 920323
PDR ADDCK 05000335
Q PDR



12