

ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9205050009 DOC. DATE: 92/04/29 NOTARIZED: NO DOCKET #
 FACIL: 50-335 St. Lucie Plant, Unit 1, Florida Power & Light Co. 05000335
 AUTH. NAME AUTHOR AFFILIATION
 GOLDBERG, J.H. Florida Power & Light Co.
 RECIP. NAME RECIPIENT AFFILIATION
 Document Control Branch (Document Control Desk)

SUBJECT: Suppls response to 920413 ltr re violations noted in Insp Rept 50-335/92-04. Corrective actions: crew boxes in plant will be inspected on periodic basis to improve probability that flammable liquids properly stored.

DISTRIBUTION CODE: IE01D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 3
 TITLE: General (50 Dkt)-Insp Rept/Notice of Violation Response

NOTES:

	RECIPIENT ID CODE/NAME	COPIES	LTR	ENCL	RECIPIENT ID CODE/NAME	COPIES	LTR	ENCL
	PD2-2 PD	1	1		NORRIS, J	1	1	
INTERNAL:	ACRS	2	2		AEOD	1	1	
	AEOD/DEIIB	1	1		AEOD/DSP/TPAB	1	1	
	DEDRO	1	1		NRR MORISSEAU, D	1	1	
	NRR/DLPQ/LHFBPT	1	1		NRR/DLPQ/LPEB10	1	1	
	NRR/DOEA/OEAB	1	1		NRR/DREP/PEPB9H	1	1	
	NRR/DST/DIR 8E2	1	1		NRR/PMAS/ILRB12	1	1	
	NUDOCS-ABSTRACT	1	1		OE DIR	1	1	
	OGC/HDS3	1	1		REG. FILE 02	1	1	
	RGN2 FILE 01	1	1					
EXTERNAL:	EG&G/BRYCE, J.H.	1	1		NRC PDR	1	1	
	NSIC	1	1					


NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK, ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 23 ENCL 23

R
I
D
S
/
A
D
D
S

R
I
D
S
/
A
D
D
S

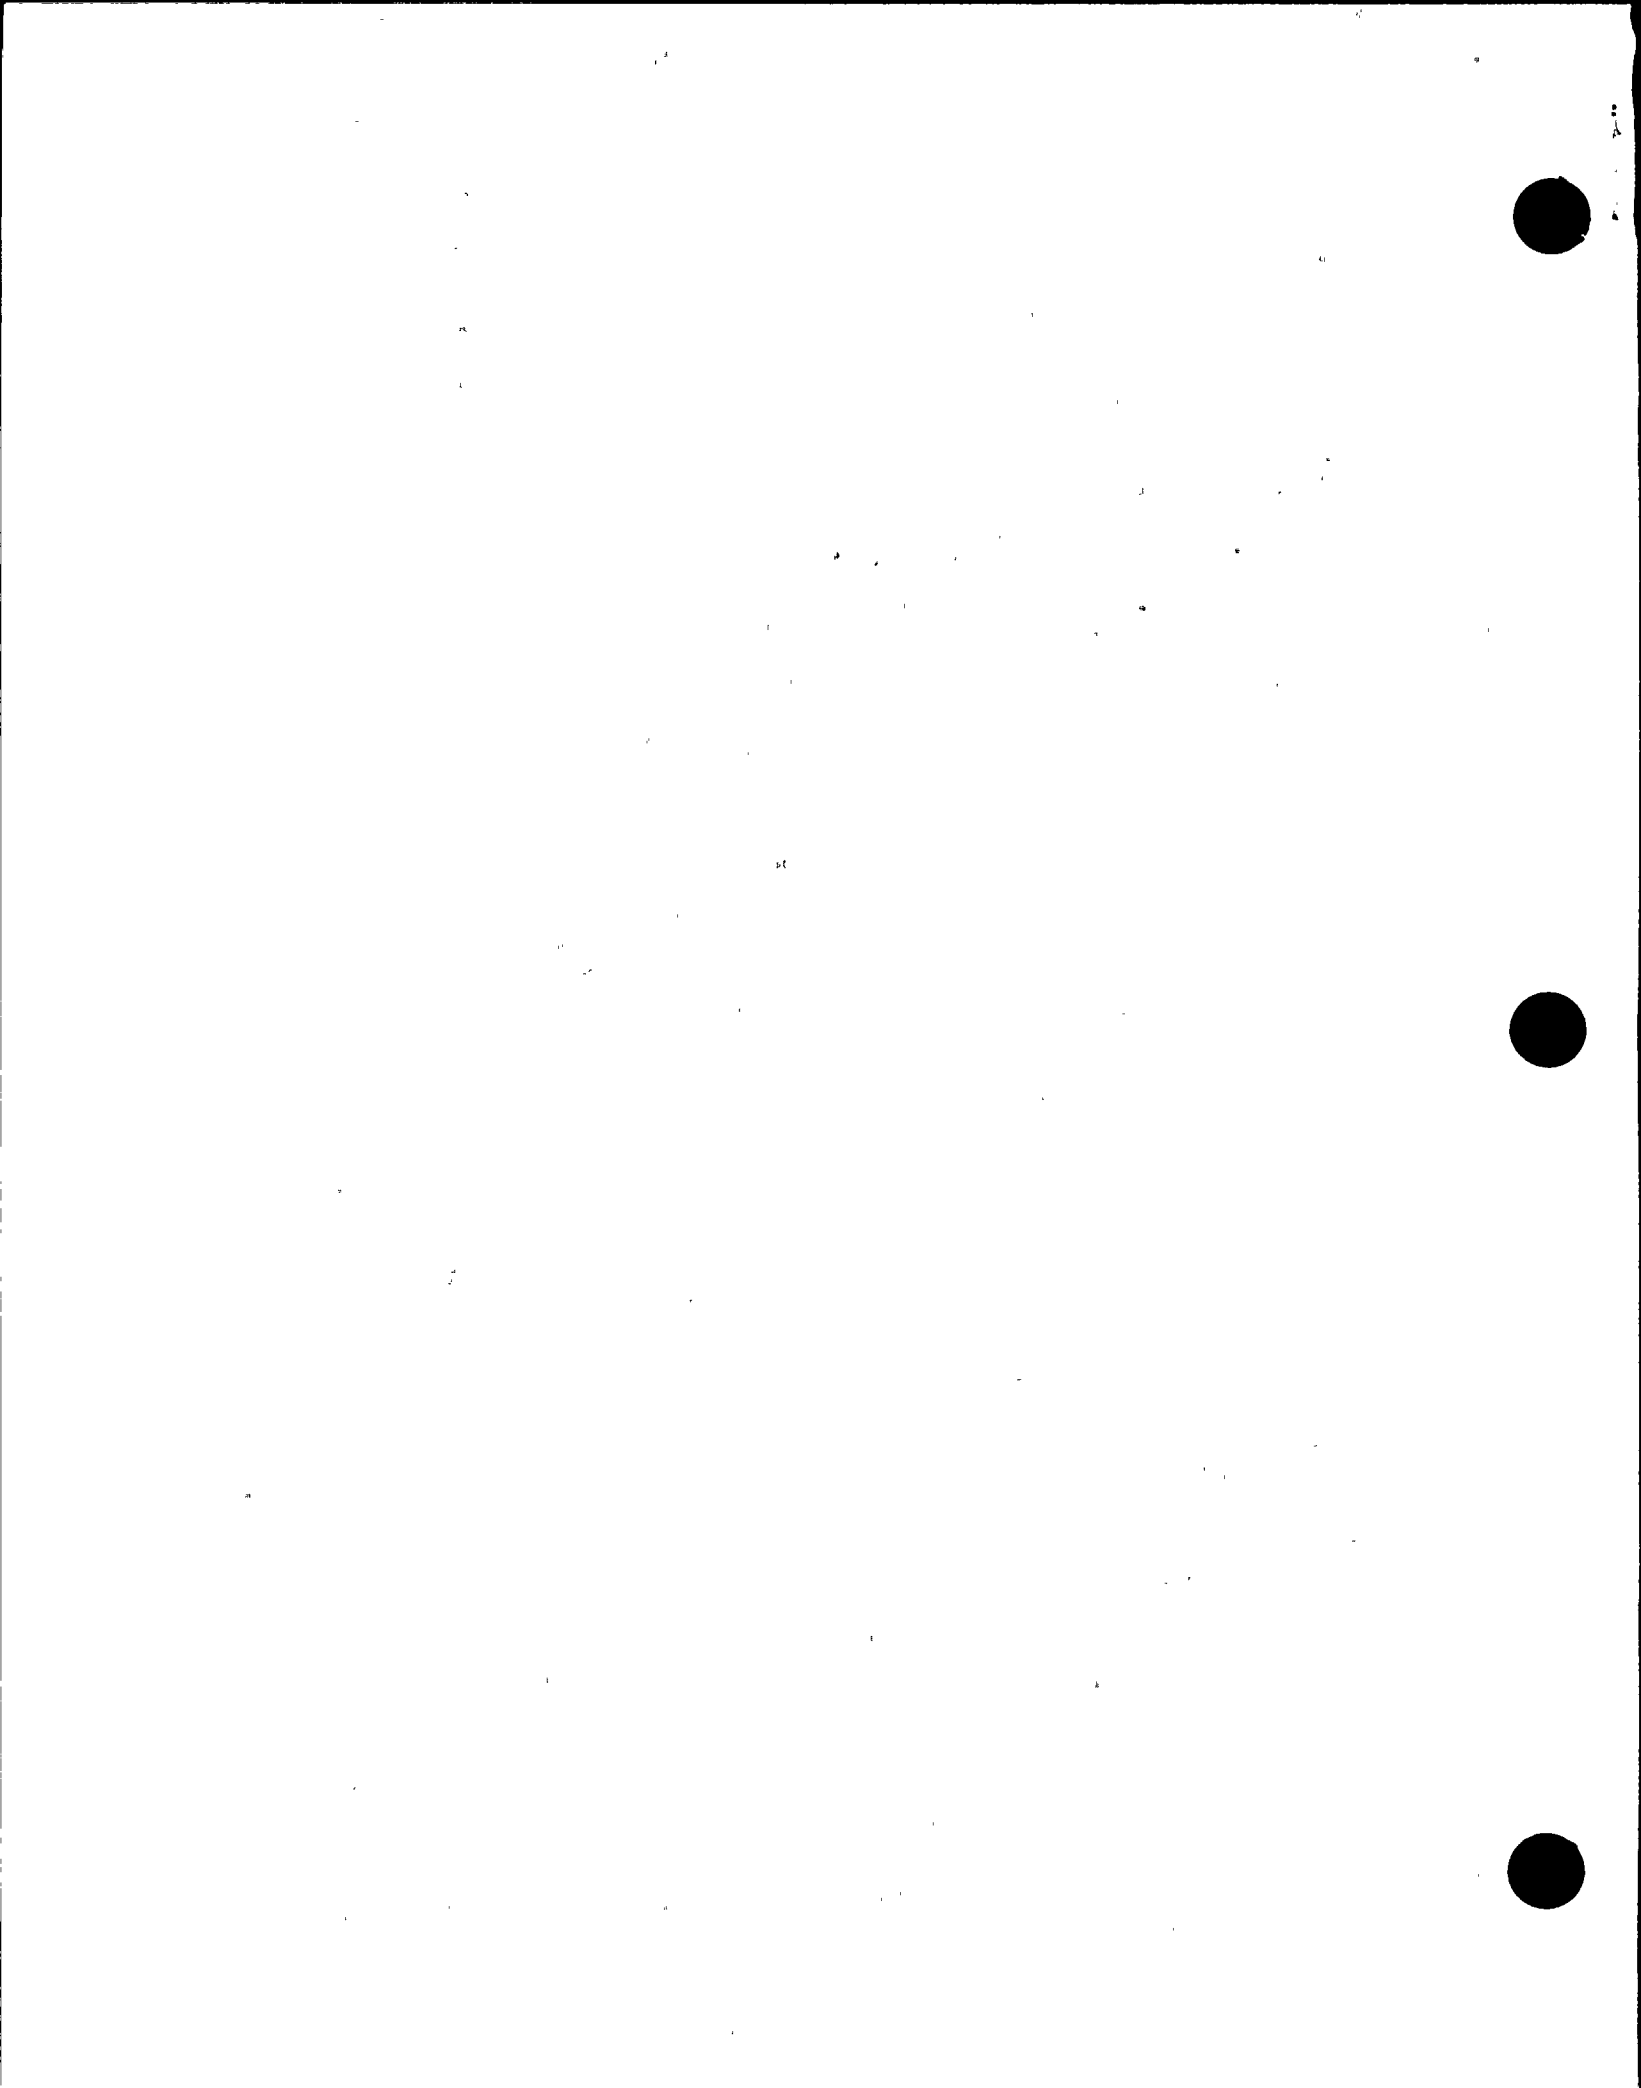



APR 29 1992

L-92-125
10 CFR 2.201

U. S. Nuclear Regulatory Commission
Attn: Document Control Desk
Washington, D. C. 20555

Re: St. Lucie Unit 1
Docket No. 50-335
Reply to Notice of Violation
Inspection Report 92-04 - Revised

Florida Power and Light Company (FPL) has supplemented the response to the subject inspection report submitted by FPL letter L-92-99 on April 13, 1992. The attached replaces the original response to the notice of violation.

Very truly yours,

J. H. Goldberg
President - Nuclear Division

JHG/JWH/kw

Attachment

cc: Stewart D. Ebnetter, Regional Administrator, USNRC Region II
Senior Resident Inspector, USNRC, St. Lucie Plant

DAS/PSL #683-92

9205050009 920429
PDR ADOCK 05000335
Q PDR

IE01

Re: St. Lucie Unit 1
Docket No. 50-335
Reply to Notice of Violation
Inspection Report 92-04 - Revised

VIOLATION:

Unit 1 Technical Specifications (TS) 6.8.1.f requires that written procedures shall be established, implemented, and maintained covering fire protection program implementation. This requirement is implemented in part by administrative procedure AP 0010434, Rev 23, Plant Fire Protection Guidelines. AP 0010434 paragraph 8.2.3 listed the safety-related areas where combustibles may be stored. Storage of combustibles in the cable spreading rooms was not included.

Contrary to the above, on January 28, 1992, two plastic pint spray bottles of 91 percent isopropyl alcohol were observed stored unattended in an open crew box in the Unit 1 cable spreading room. These spray bottles had attached material safety data sheets numbered "1552.500, 1549" stating that the material was flammable and must be transferred to a safety can and stored in a flame-proof cabinet. When notified, the licensee immediately removed the alcohol to a non-safety-related area.

RESPONSE:

1. The reason for the violation was personnel error.
2. Steps taken to correct the non-compliance:
 - a) The flammable material was immediately removed from the cable spreading room, transferred to a safety can, and stored in a flame-proof cabinet.
 - b) All other crew boxes and work areas were inspected to ensure flammable materials were properly stored. This inspection revealed several additional instances of improperly stored flammable material. These materials were removed from the boxes and stored as required.
3. Steps taken to avoid a further violation:
 - a) The Plant Fire Protection Department held a training class at the electrical maintenance foreman/supervisor meeting in February 1992. The training session focussed on the handling and storage of flammable or combustible liquids and the plant chemical control program. A plant wide effort to reach other affected departments was performed by the Fire Protection Department to emphasize the importance of fire protection requirements.



Re: St. Lucie Unit 1
Docket No. 50-335
Reply to Notice of Violation

Inspection Report 92-04 - Revised

- b) This event will be discussed at the next electrical maintenance in-house-events training class. This training is scheduled for the second quarter of 1992.
 - c) Area inspection work descriptions now include a check to ensure that flammable liquids are stored in safety cans and flame-proof cabinets.
 - d) Plant wide emphasis will be placed on chemical control through regularly scheduled safety meetings.
 - e) Crew boxes in the plant will be inspected on a periodic basis to improve the probability that flammable liquids are properly stored.
4. Full compliance was achieved on January 28, 1992.