

# ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

## REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9205180007      DOC. DATE: 92/05/04      NOTARIZED: NO      DOCKET #  
 FACIL: 50-335 St. Lucie Plant, Unit 1, Florida Power & Light Co.      05000335  
 50-389 St. Lucie Plant, Unit 2, Florida Power & Light Co.      05000389  
 AUTH. NAME      AUTHOR AFFILIATION  
 SAGER, D.A.      Florida Power & Light Co.  
 RECIP. NAME      RECIPIENT AFFILIATION  
                          Document Control Branch (Document Control Desk)

SUBJECT: Forwards plant attribute & data point libraries for facilities to support NRC installation onto ERDS computer.

DISTRIBUTION CODE: A026D      COPIES RECEIVED: LTR   6   ENCL   1        SIZE:   122    
 TITLE: Emergency Response Data System (ERDS)

NOTES:

	RECIPIENT		COPIES		RECIPIENT		COPIES	
	ID	CODE/NAME	LTR	ENCL	ID	CODE/NAME	LTR	ENCL
	JOLICOEUR, J	01	2	2	PD2-2	LA	1	1
	NORRIS, J		1	1				
INTERNAL:	ACRS		1	1	AEOD		1	1
	AEOD/DOA/IRB		1	1	NRR ERICKSON, P.		1	1
	NRR HICKMAN, J.		1	0	NRR/DREP/PEPB		1	1
	OC/LFMB		1	0	RGN2    ERC		1	1
	RGN2    FILE		1	1				
EXTERNAL:	NRC PDR		1	1				

*NRR/DREP/PEPB*


*Re-distributed due to incorrect distribution code.*

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK, ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR ~~14~~ <sup>15</sup> ENCL ~~12~~ <sup>13</sup>

R  
I  
D  
S  
/  
A  
D  
D  
S

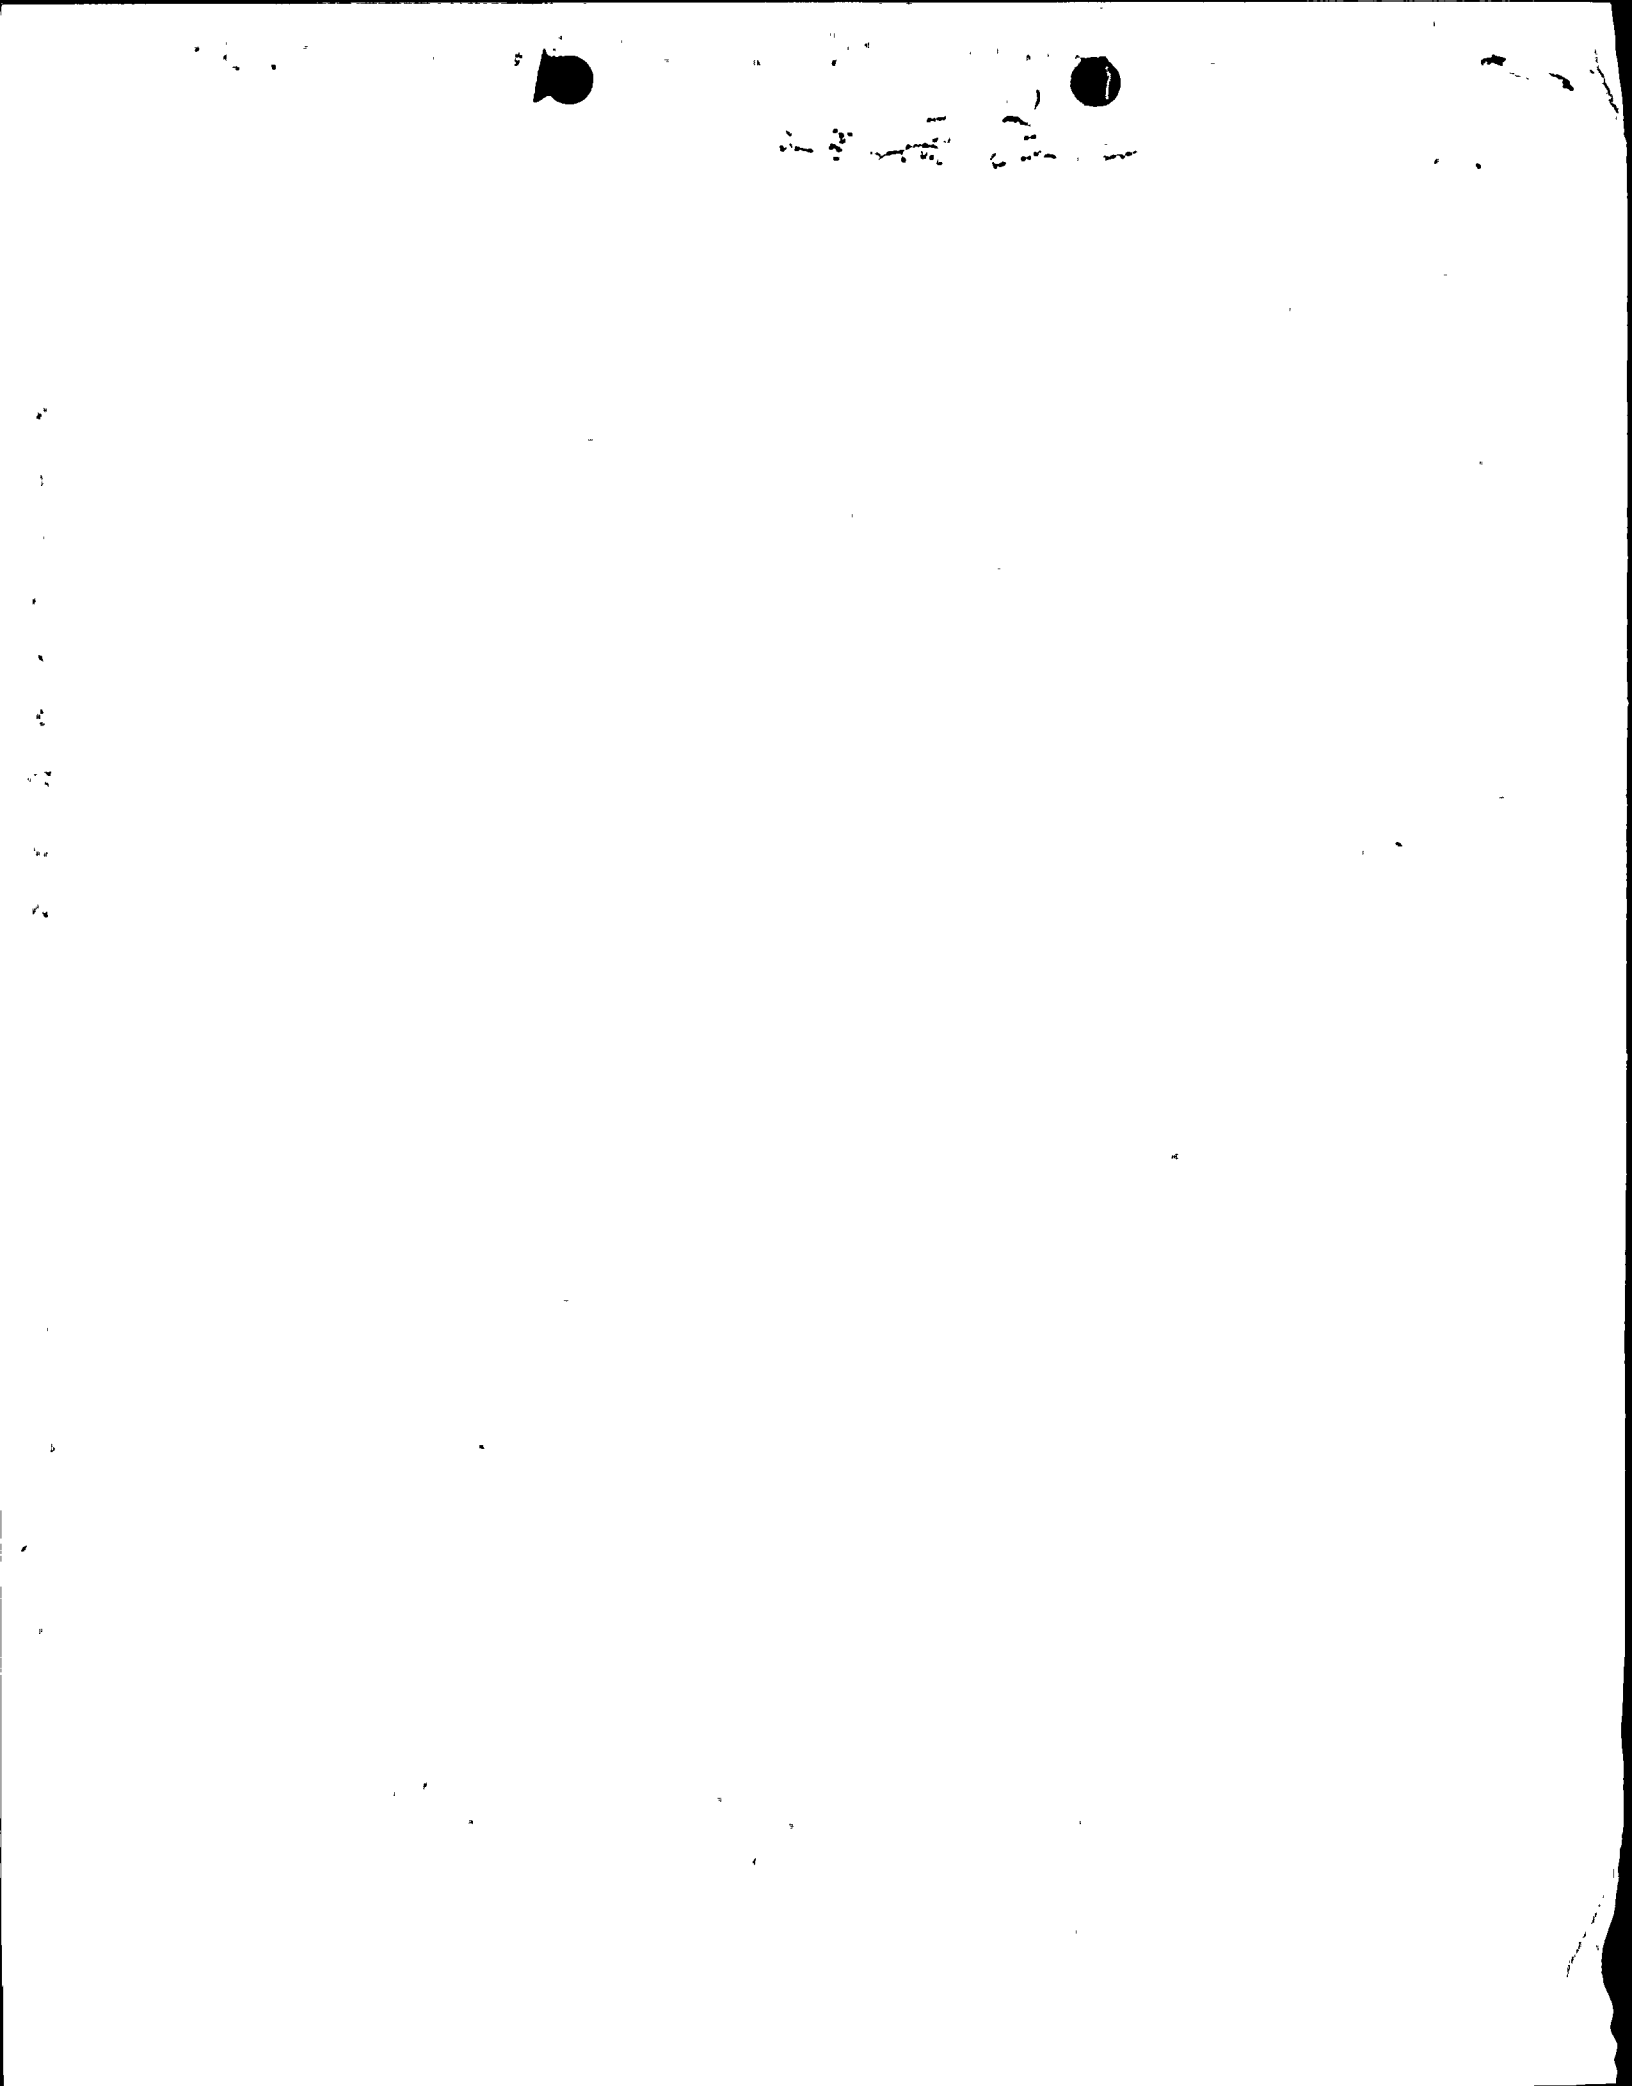



P.O. Box 128, Ft. Pierce, FL 34954-0128

May 4, 1992

L-92-126  
10 CFR 50 Appendix E

U. S. Nuclear Regulatory Commission  
Attn: Document Control Desk  
Washington, DC 20555


Re: St. Lucie Units 1 and 2  
Docket Nos. 50-335 and 50-389  
Emergency Response Data System

Florida Power and Light submits the attached Plant Attribute and Data Point Libraries (attachments A1, A2, B1, and B2) for St. Lucie Plant.

This information is provided to support installation by the NRC onto the Emergency Response Data System computer.

If you have any questions on the enclosed, please contact us.

Very truly yours,

  
D. A. Sager  
Vice President  
St. Lucie Plant

DAS:kw

DAS/PSL #680-92  
Attachments

cc: Stewart D. Ebnetor, Regional Administrator, Region II, USNRC  
Senior Resident Inspector, USNRC, St. Lucie Plant

9205180007 920504  
PDR ADOCK 05000335  
F PDR  
14000  
an FPL Group company

*ADDL*  
*ADD: NRR/DREP/PEPS*  
*11*



Faint, illegible markings or text at the top center.

Faint, illegible markings or text at the bottom left corner.

Faint, illegible markings or text at the bottom right corner.