

ACCELERATED DOCUMENT DISTRIBUTION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9305070064 DOC. DATE: 93/04/29 NOTARIZED: NO DOCKET # 05000335
 FACIL: 50-335 St. Lucie Plant, Unit 1, Florida Power & Light Co.
 AUTH. NAME: SAGER, D.A. AUTHOR AFFILIATION: Florida Power & Light Co.
 RECIP. NAME: RECIPIENT AFFILIATION: Document Control Branch (Document Control Desk)

SUBJECT: Submits listed SG tubes plugging rept for Spring 1993 refueling outage.

DISTRIBUTION CODE: A001D COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 1
 TITLE: OR Submittal: General Distribution

NOTES:


	RECIPIENT		COPIES		
	ID CODE/NAME	LTR	ENCL		
	PD2-2 LA	1	1		
	NORRIS, J	2	2		
INTERNAL:	ACRS	6	6		
	NRR/DORS/OTSB	1	1		
	NRR/DSSA/SCSB	1	0		
	NRR/DSSA/SRXB	1	1		
	OC/LEMB	1	0		
	<u>REG FILE</u> 01	1	1		
EXTERNAL:	NRC PDR	1	1		
	PD2-2 PD	1	1		
	NRR/DE/EELB	1	1		
	NRR/DRCH/HICB	1	1		
	NRR/DSSA/SPLB	1	1		
	NUDOCS-ABSTRACT	1	1		
	OGC/HDS3	1	0		
	NSIC	1	1		

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK, ROOM P1-37 (EXT. 504-2065) TO ELIMINATE YOUR NAME FROM DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 22 ENCL 19 0

MA-4
dlp

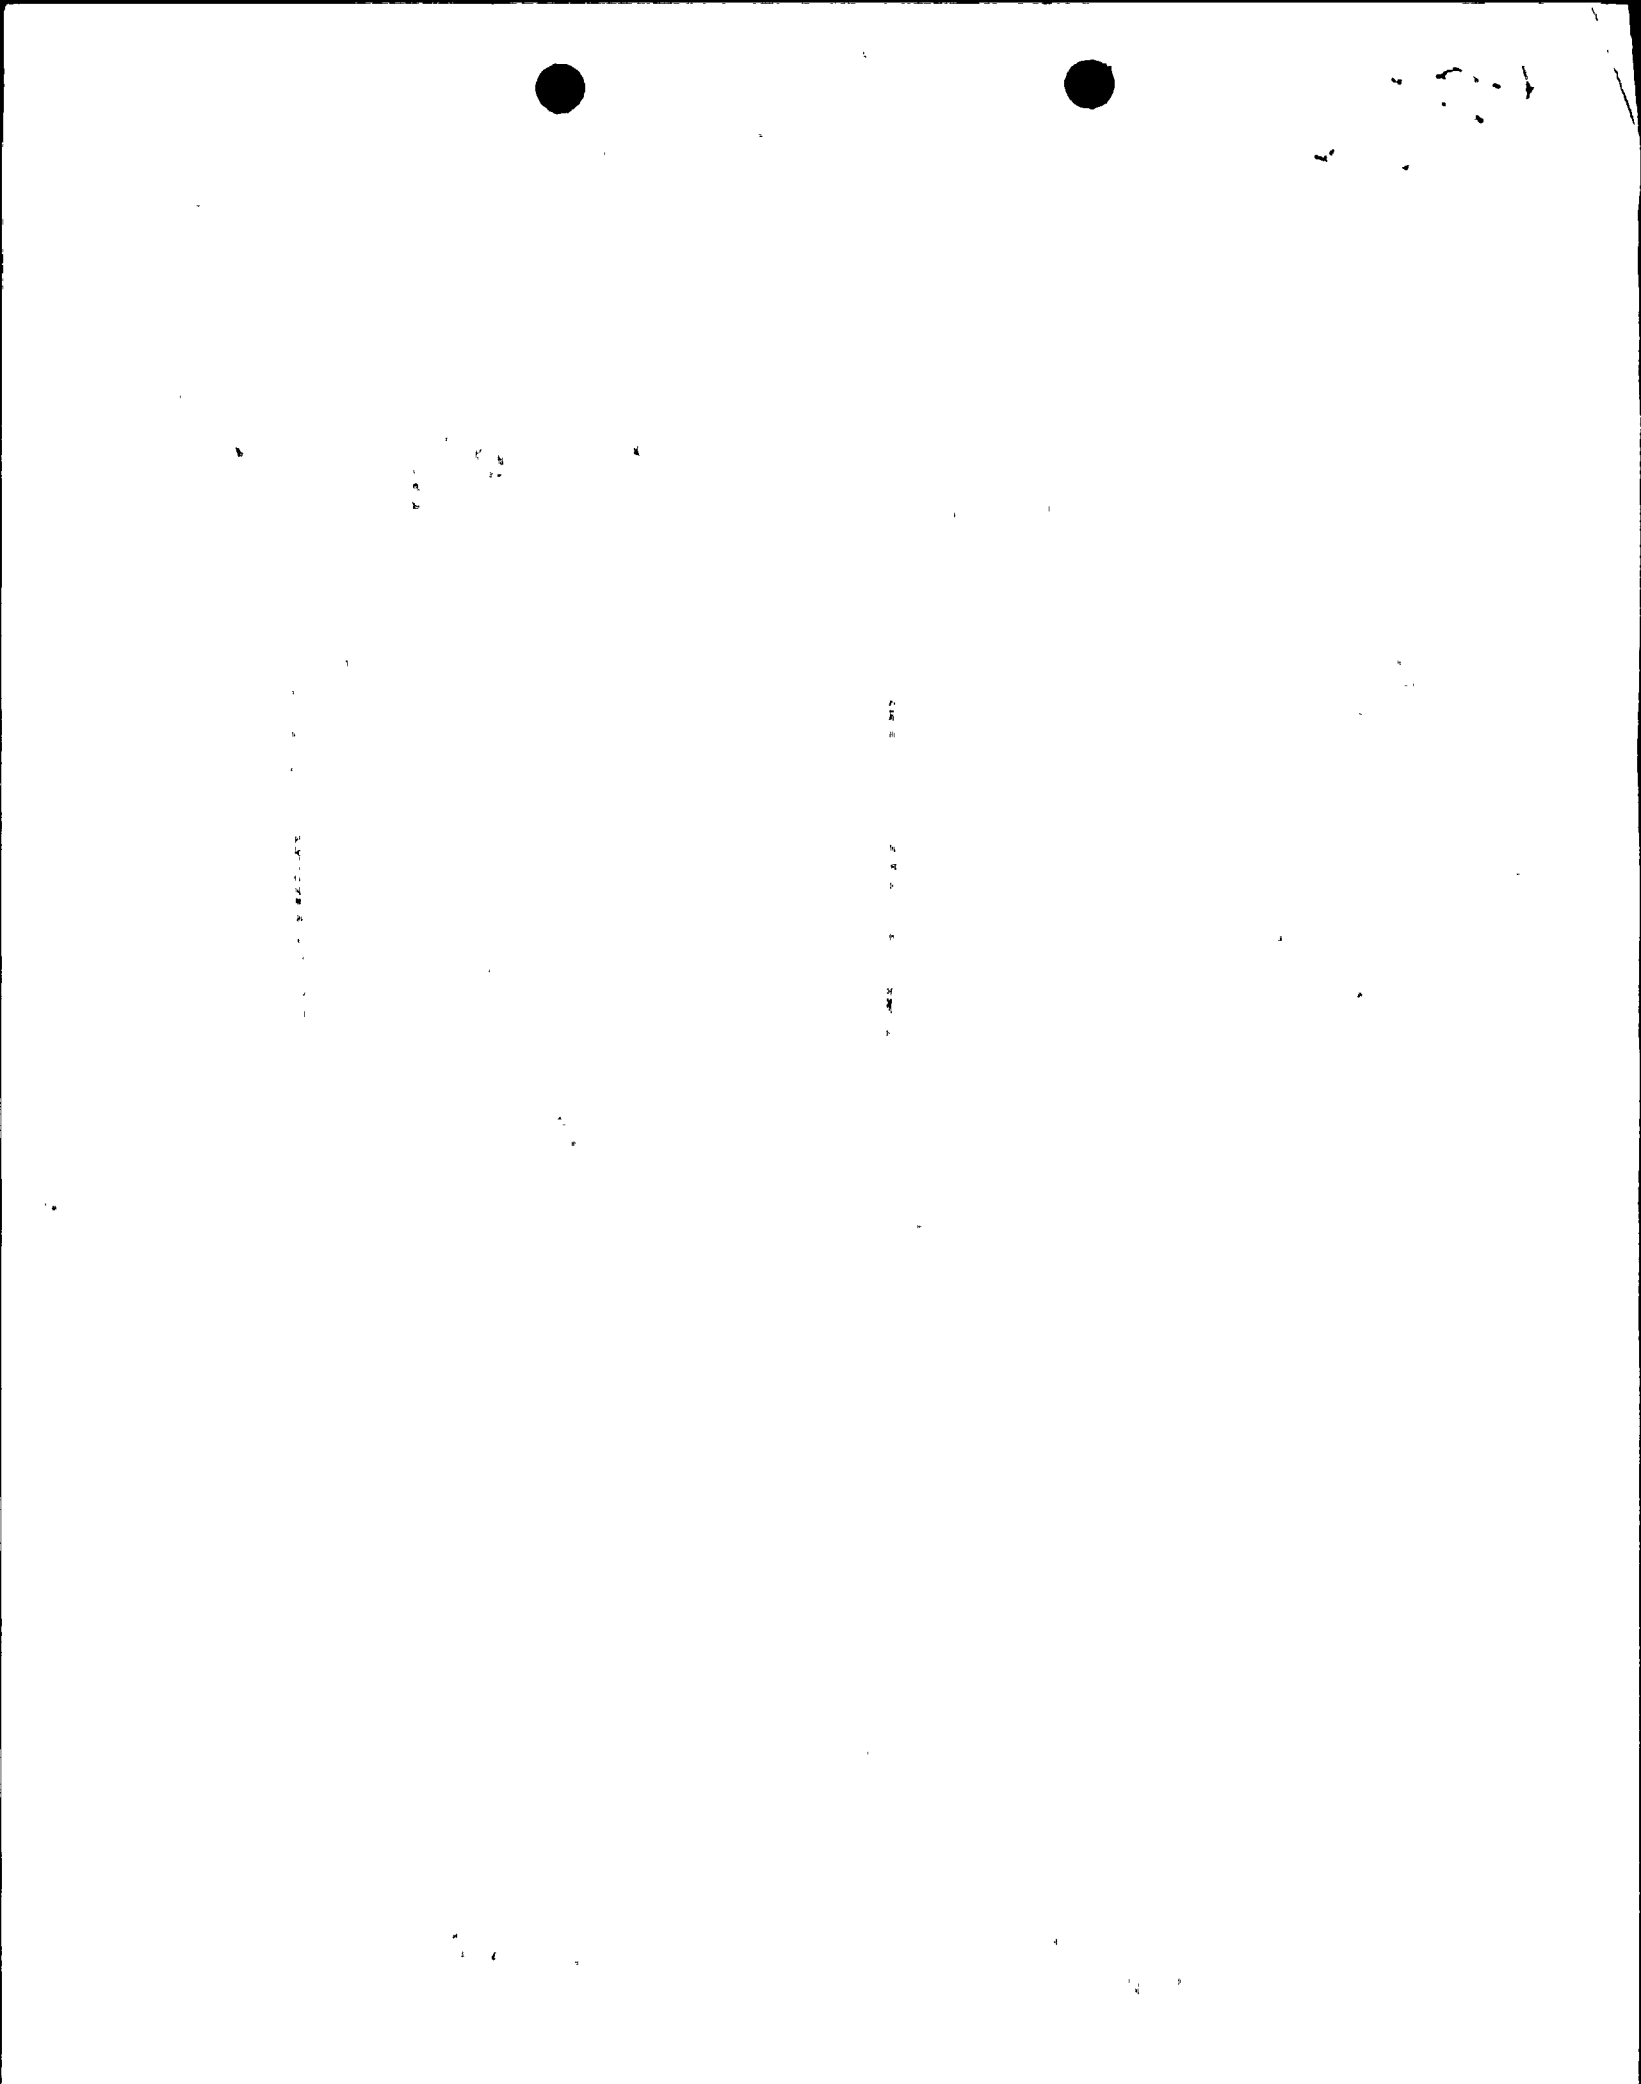



April 29, 1993

L-93-120
10 CFR 50.36
10 CFR 50.4

U. S. Nuclear Regulatory Commission
Attn: Document Control Desk
Washington, DC 20555

Gentlemen:

Re: St. Lucie Unit 1
Docket No. 50-335
Special Report
Steam Generator Tube Plugging Report

This letter is being sent pursuant to St. Lucie Unit 1 Technical Specification 4.4.5.5.a. The following number of tubes were plugged during the Spring 1993 Unit 1 refueling outage:

Steam Generator 1A	69
Steam Generator 1B	61

Should you have any questions on this information, please contact us.

Very truly yours,
D.A. SAGER
By H.F. Bussay
D. A. Sager
Vice President
St. Lucie Plant

DAS/JWH/kw

cc: Stewart D. Ebnetter, Regional Administrator, Region II, USNRC
Senior Resident Inspector, USNRC, St. Lucie Plant

DAS/PSL #912-93

