

# ACCELERATED DOCUMENT DISTRIBUTION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9305070064      DOC. DATE: 93/04/29      NOTARIZED: NO      DOCKET #  
 FACIL: 50-335 St. Lucie Plant, Unit 1, Florida Power & Light Co.      05000335  
 AUTH. NAME      AUTHOR AFFILIATION  
 SAGER, D.A.      Florida Power & Light Co.  
 RECIP. NAME      RECIPIENT AFFILIATION  
                                  Document Control Branch (Document Control Desk)

SUBJECT: Submits listed SG tubes plugging rept for Spring 1993 refueling outage.

DISTRIBUTION CODE: A001D      COPIES RECEIVED: LTR 1 ENCL 0      SIZE: 1  
 TITLE: OR Submittal: General Distribution

NOTES:


	RECIPIENT ID CODE/NAME	COPIES	L	T	E	N	C	L	R
	PD2-2 LA	1	1						
	NORRIS, J	2	2						
INTERNAL:	ACRS	6	6						
	NRR/DORS/OTSB	1	1						
	NRR/DSSA/SCSB	1	0						
	NRR/DSSA/SRXB	1	1						
	OC/LEMB	1	0						
	<u>REG FILE</u> 01	1	1						
EXTERNAL:	NRC PDR	1	1						
	PD2-2 PD	1	1						
	NRR/DE/EELB	1	1						
	NRR/DRCH/HICB	1	1						
	NRR/DSSA/SPLB	1	1						
	NUDOCS-ABSTRACT	1	1						
	OGC/HDS3	1	0						
	NSIC	1	1						

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,  
 ROOM P1-37 (EXT. 504-2065) TO ELIMINATE YOUR NAME FROM DISTRIBUTION  
 LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 22 ENCL 19 0

MA-4  
dlp

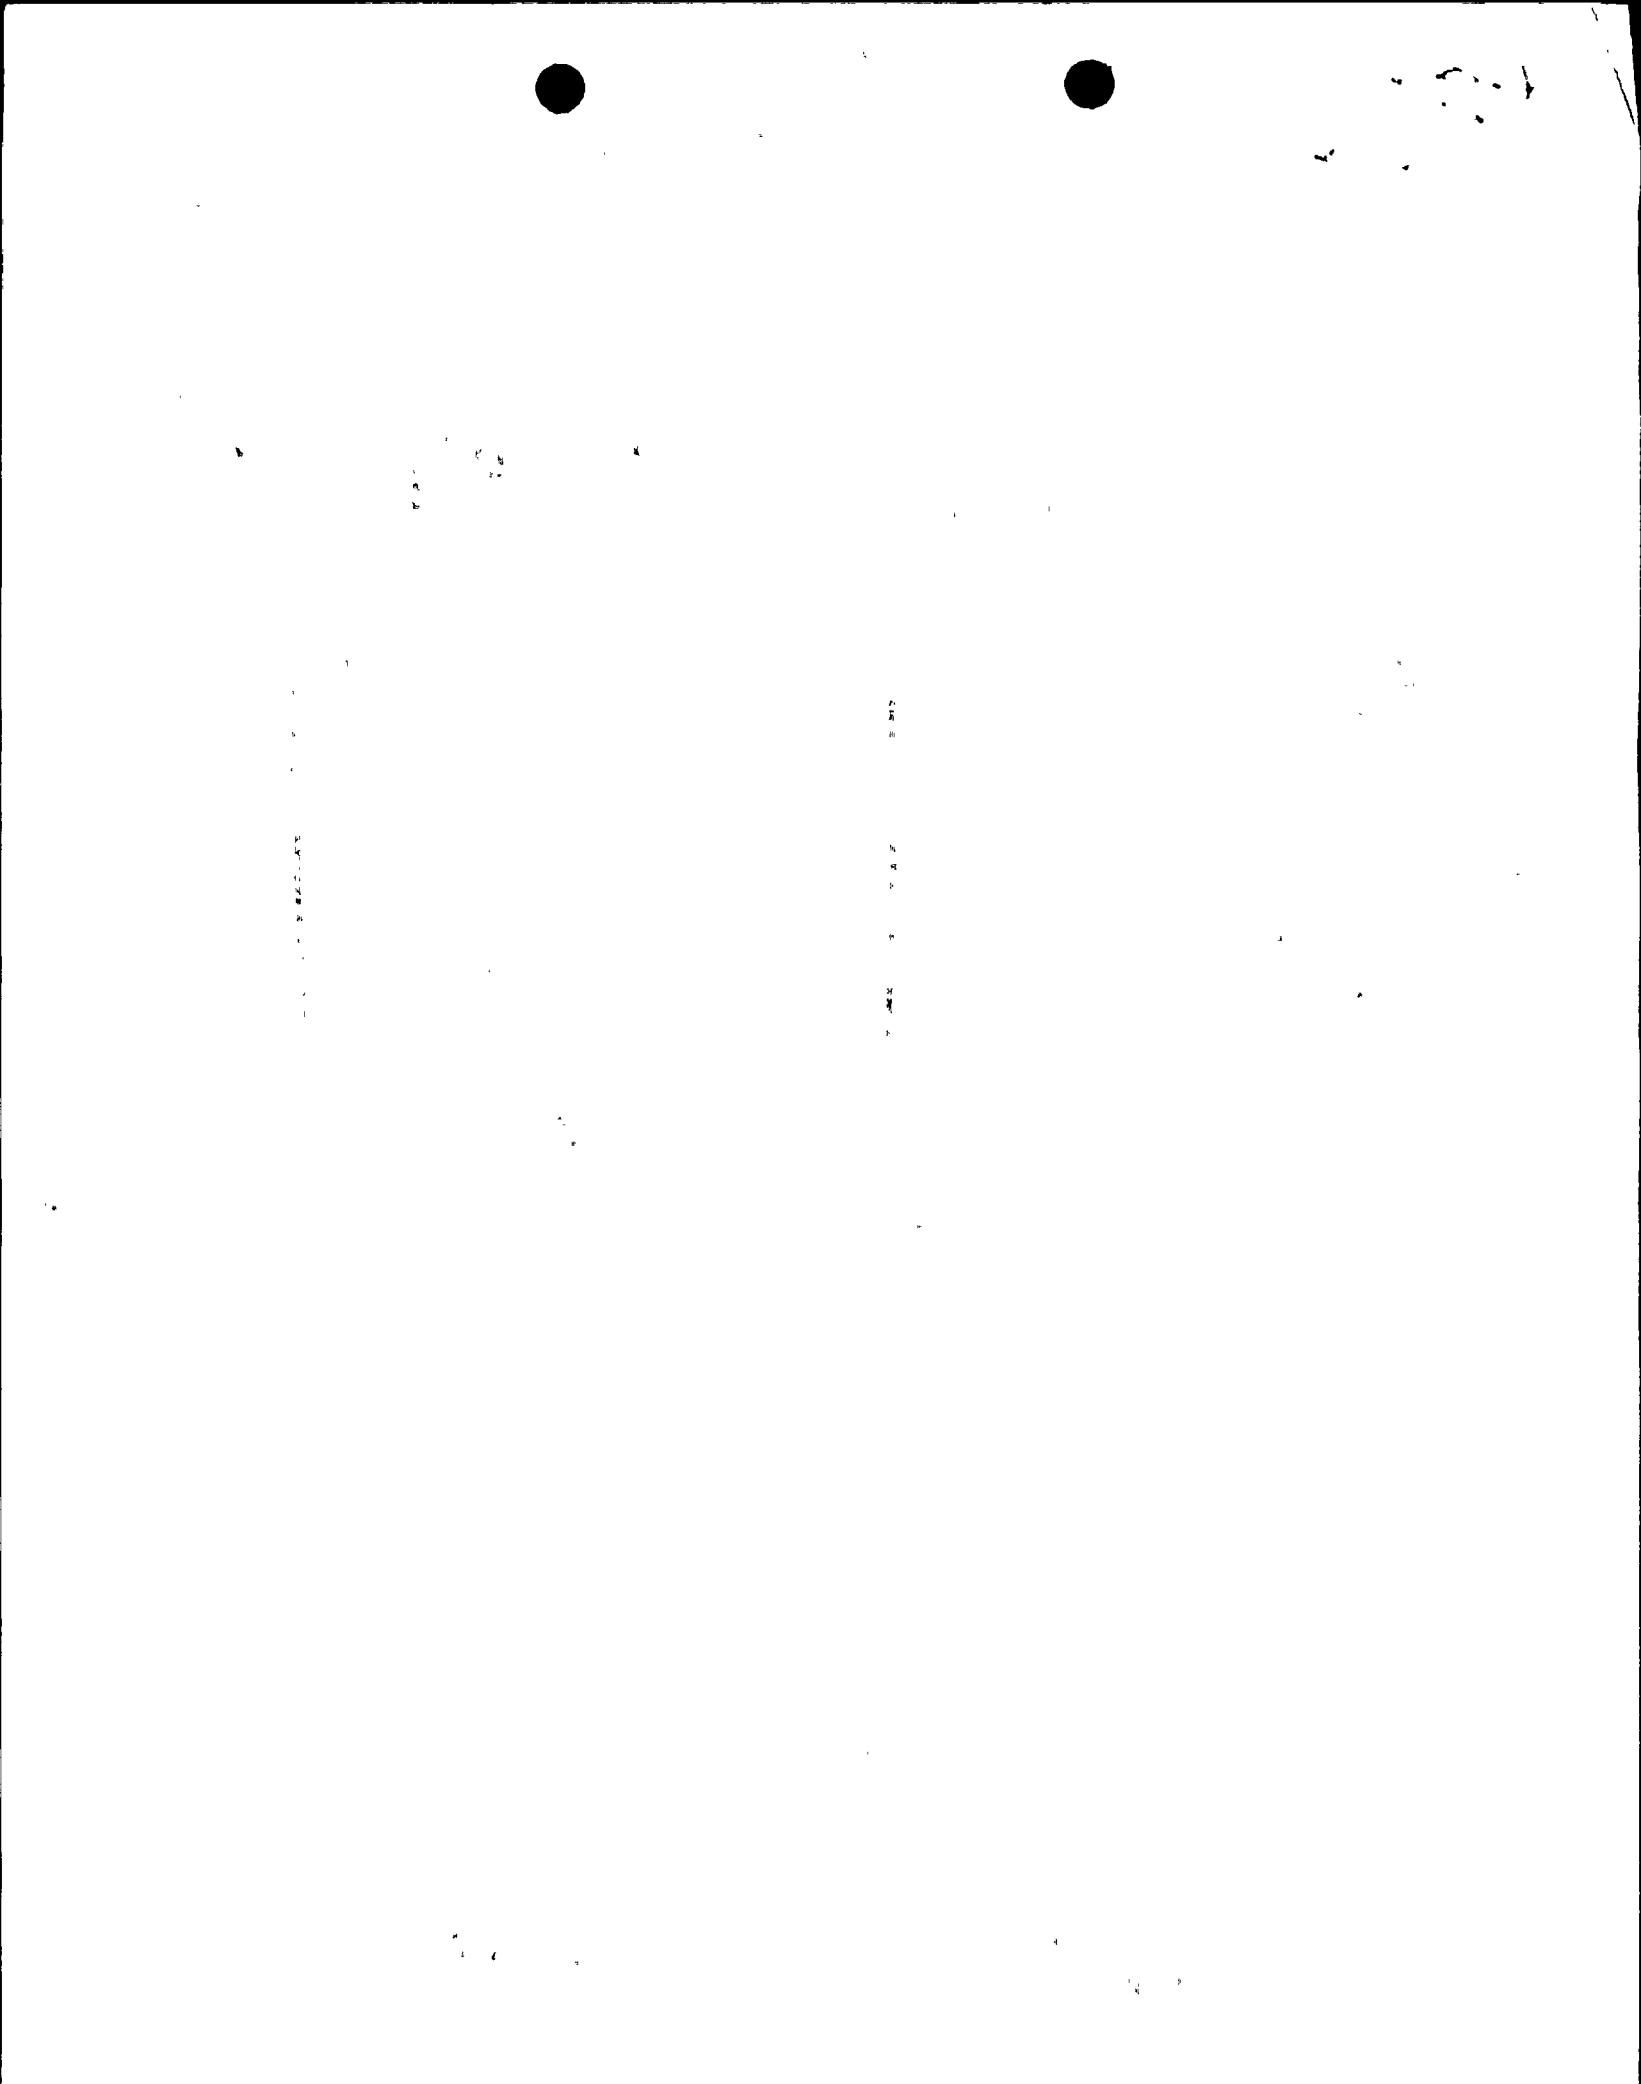



April 29, 1993

L-93-120  
10 CFR 50.36  
10 CFR 50.4

U. S. Nuclear Regulatory Commission  
Attn: Document Control Desk  
Washington, DC 20555

Gentlemen:

Re: St. Lucie Unit 1  
Docket No. 50-335  
Special Report  
Steam Generator Tube Plugging Report

This letter is being sent pursuant to St. Lucie Unit 1 Technical Specification 4.4.5.5.a. The following number of tubes were plugged during the Spring 1993 Unit 1 refueling outage:

Steam Generator 1A	69
Steam Generator 1B	61


Should you have any questions on this information, please contact us.

Very truly yours,  
*D.A. SAGER*  
*By H.F. Bussay*  
D. A. Sager  
Vice President  
St. Lucie Plant

DAS/JWH/kw

cc: Stewart D. Ebnetter, Regional Administrator, Region II, USNRC  
Senior Resident Inspector, USNRC, St. Lucie Plant

DAS/PSL #912-93

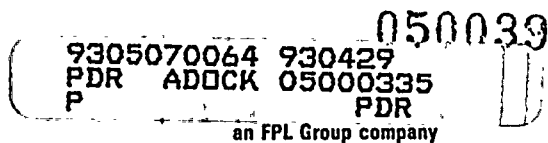

*Food*  
*11/10*