

ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9403080387 DOC. DATE: 94/02/28 NOTARIZED: YES DOCKET #
 FACIL: 50-335 St. Lucie Plant, Unit 1, Florida Power & Light Co. 05000335
 50-389 St. Lucie Plant, Unit 2, Florida Power & Light Co. 05000389
 AUTH. NAME AUTHOR AFFILIATION
 SAGER, D.A. Florida Power & Light Co.
 RECIPIENT NAME RECIPIENT AFFILIATION
 Document Control Branch (Document Control Desk)

SUBJECT: Application for amends to licenses DPR-67 & NPF-16,
 relocating audit min frequency criteria from TS 6.5.2.8 &
 6.8.4 to FPL Topical QA Rept, per NUREG-1432.

DISTRIBUTION CODE: A001D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 3417
 TITLE: OR Submittal: General Distribution

NOTES:

	RECIPIENT		COPIES			RECIPIENT		COPIES	
	ID CODE/NAME		LTTR	ENCL		ID CODE/NAME		LTTR	ENCL
	PD2-2 LA		1	1		PD2-2 PD		1	1
	NORRIS, J		2	2					
INTERNAL:	ACRS		6	6		NRR/DE/EELB		1	1
	NRR/DORS/OTSB		1	1		NRR/DRCH/HICB		1	1
	NRR/DRPW		1	1		NRR/DSSA/SPLB		1	1
	NRR/DSSA/SRXB		1	1		NUDOCS-ABSTRACT		1	1
	OC/LEDGB		1	0		OGC/HDS3		1	0
	<u>REG FILE</u>	01	1	1					
EXTERNAL:	NRC PDR		1	1		NSIC		1	1


NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,
 ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION
 LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTTR 22 ENCL 20

R
I
D
S
/
A
D
D
S

AA-2





February 28, 1994

L-94-018
10 CFR 50.90

U. S. Nuclear Regulatory Commission
Attn: Document Control Desk
Washington, D. C. 20555

RE: St. Lucie Unit 1 and Unit 2
Docket Nos. 50-335 and 50-389
Proposed License Amendments
Relocation of Audit Minimum
Frequency Criteria to FPLTOAR

Pursuant to 10 CFR 50.90, Florida Power & Light Company (FPL) requests to amend Facility Operating Licenses DPR-67 and NPF-16 for St. Lucie Unit 1 and Unit 2, respectively. The proposed amendments will delete the minimum frequency criteria prescribed for quality assurance audits from Administrative Controls sections 6.5.2.8 and 6.8.4 of the Technical Specifications (TS). Audit periodicity will thereby be controlled by the program described in the FPL Topical Quality Assurance Report (FPLTQAR). FPL considers the proposed amendment to be a line-item improvement that is consistent with NUREG-1432, Standard Technical Specifications for Combustion Engineering Plants. Approval is requested by December 31, 1994.

Attachments 1 and 2 contain copies of the appropriate TS pages marked-up to show the proposed changes. Attachment 3 is an evaluation of the proposed TS changes. Attachment 4 is the "Determination of No Significant Hazards Consideration."

The proposed amendments have been reviewed by the St. Lucie Facility Review Group and the Florida Power & Light Company Nuclear Review Board. In accordance with 10 CFR 50.91 (b) (1), copies of the proposed amendments are being forwarded to the State Designee for the State of Florida.

Please contact us if there are any questions about this submittal.

Very truly yours,

D. A. Sager
Vice President
St. Lucie Plant

DAS/RLD/kw
DAS/PSL #1071-94

Attachments

070032

9403080387 940228
PDR ADDCK 05000335
P PDR



304057

St. Lucie Unit 1 and Unit 2
Docket Nos. 50-335 and 50-389
Proposed License Amendments
Relocation of Audit Minimum
Frequency Criteria to FPL/TOAR

cc: Stewart D. Ebnetter, Regional Administrator, Region II, USNRC.

Senior Resident Inspector, USNRC, St. Lucie Plant.

Mr. W.A. Passetti, Florida Department of Health and
Rehabilitative Services.


St. Lucie Unit 1 and Unit 2
Docket Nos. 50-335 and 50-389
Proposed License Amendments
Relocation of Audit Minimum
Frequency Criteria to FPLTOAR

STATE OF FLORIDA)
)
COUNTY OF ST. LUCIE) ss.

D. A. Sager being first duly sworn, deposes and says:

That he is Vice President, St. Lucie Plant for the Nuclear Division of Florida Power & Light Company, the Licensee herein;


That he has executed the foregoing document; that the statements made in this document are true and correct to the best of his knowledge, information and belief, and that he is authorized to execute the document on behalf of said Licensee.



D. A. Sager

STATE OF FLORIDA
COUNTY OF St. Lucie


The foregoing instrument was acknowledged before me this 28th day of February, 19 94 by D.A. Sager, who is personally known to me and who did take an oath.



KAREN WEST
Name of Notary Public

My Commission expires 4-18-94

Commission No. CC003229

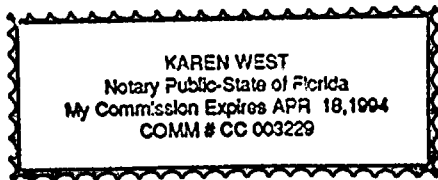

COMMERCIAL
W. C. W. CO. INC.
EXHIBIT
NO. 10
KAY TAY