

ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9404210119 DOC. DATE: 94/04/15 NOTARIZED: NO DOCKET #
 FACIL: 50-335 St. Lucie Plant, Unit 1, Florida Power & Light Co. 05000335
 50-389 St. Lucie Plant, Unit 2, Florida Power & Light Co. 05000389
 AUTH. NAME AUTHOR AFFILIATION
 GOLDBERG, J.H. Florida Power & Light Co.
 RECIPIENT AFFILIATION
 Document Control Branch (Document Control Desk)

SUBJECT: Advises that State of FL DOT scheduled repairs for EF Lyons & E Crary bridges during summer of 1994. Bridges located in St Lucie emergency planning zone approx ten miles south of plant.

DISTRIBUTION CODE: A001D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 3
 TITLE: OR Submittal: General Distribution

NOTES:

	RECIPIENT ID CODE/NAME		COPIES		RECIPIENT ID CODE/NAME		COPIES	
			LTTR	ENCL			LTTR	ENCL
	PD2-2 LA		1	1	PD2-2 PD		1	1
	NORRIS, J		2	2				
INTERNAL:	ACRS		6	6	NRR/DE/EELB		1	1
	NRR/DORS/OTSB		1	1	NRR/DRCH/HICB		1	1
	NRR/DRPW		1	1	NRR/DSSA/SPLB		1	1
	NRR/DSSA/SRXB		1	1	NUDOCS-ABSTRACT		1	1
	OC/LEDCB		1	0	OGC/HDS3		1	0
	<u>REG FILE</u> 01		1	1				
EXTERNAL:	NRC PDR		1	1	NSIC		1	1

NRR/DRSS/PEPB

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK, ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTTR ~~22~~ ENCL ~~20~~
23 21

R
I
D
S
/
A
D
D
S

R
I
D
S
/
A
D
D
S

ACRS

2



1



L-94-96

APR 15 1994

U. S. Nuclear Regulatory Commission
Attn: Document Control Desk
Washington, D. C. 20555

Subject: St. Lucie Units 1 and 2
Docket Nos. 50-335 and 50-389
Bridge Closures associated with Hutchinson Island

The purpose of this letter is to advise you that the State of Florida Department of Transportation (DOT) has scheduled repairs for the E. F. Lyons and Evans Crary Bridges during the summer of 1994. These bridges are located in the St. Lucie Emergency Planning Zone approximately ten miles south of the plant (see attachment 1 for map). The bridges are one of three accessing South Hutchinson Island. The E. F. Lyons Bridge connects South Hutchinson Island to Sewall's Pt. and the Evans Crary Bridge connects Sewall's Pt. to the mainland in Stuart. Based on the information provided by the State DOT in the April 11 public meeting, the scheduled periods of closure are four days for the Evans Crary Bridge (June 7-11) and twenty six days for the E. F. Lyons Bridge (August 8 - September 9). The North Sewall's Pt. Road exiting Sewall's Pt will remain open throughout the repairs.

Florida Power & Light Company has worked with Martin County Department of Public Safety since September, 1993 to ensure that the appropriate compensatory measures are put in place to deal with a radiological emergency, should one occur, during the bridge repairs. Those compensatory measures involve actions to be taken by the bridge repair contractor, Martin County Department of Public Safety and Florida Power & Light Company. The State DOT has specified that the bridge repair contractor will make one lane of the bridge available to traffic within two hours of any declared emergency. In determining the appropriate time to order a protective evacuation associated with the unlikely occurrence of a radiological emergency at the St. Lucie Power Plant, Martin County will consider plant conditions (emergency classification), the bridges available for use and the timeframe associated with implementing the evacuation of the South Hutchinson Island/Sewall's Pt. area. Martin County could order evacuation of this area earlier than otherwise necessary per our existing emergency plan based on the particular circumstances (bridge status and plant conditions).

210046

9404210119 940415
PDR ADCK 05000335
F PDR

an FPL Group company

Pool
Add: NRR/PRSS/PEPB *41 Encl*
11 *11*

1954

1954

1954

Page Two
L-94-96

Florida Power & Light Company has reviewed the impact of the bridge closure on onsite emergency planning and response activities. Site evacuation, offsite fire support, medical support service, and transient notification require no significant change to our normal operation. Emergency staff augmentation time could be impacted. St. Lucie Plant is assessing the impact on travel time associated with emergency staff augmentation. If the results of this assessment shows a potential problem, compensatory measures will be undertaken during the period of impact.

Due to the nature of any construction project, the dates and times may change. As we are made aware of changes, we will relay them to the regional emergency preparedness section. If you should have any questions regarding this matter, please contact Mr. R. D. Mothena at 407-694-4218.

Sincerely,




J. H. Goldberg
President
Nuclear Division

Attachment

cc: Stewart D. Ebnetter, Regional Administrator, Region II,
USNRC
USNRC Senior Resident Inspector, St. Lucie Plant

Attachment 1
St. Lucie Emergency Planning Zone Map
including South Hutchinson Island and Sewall's Pt.

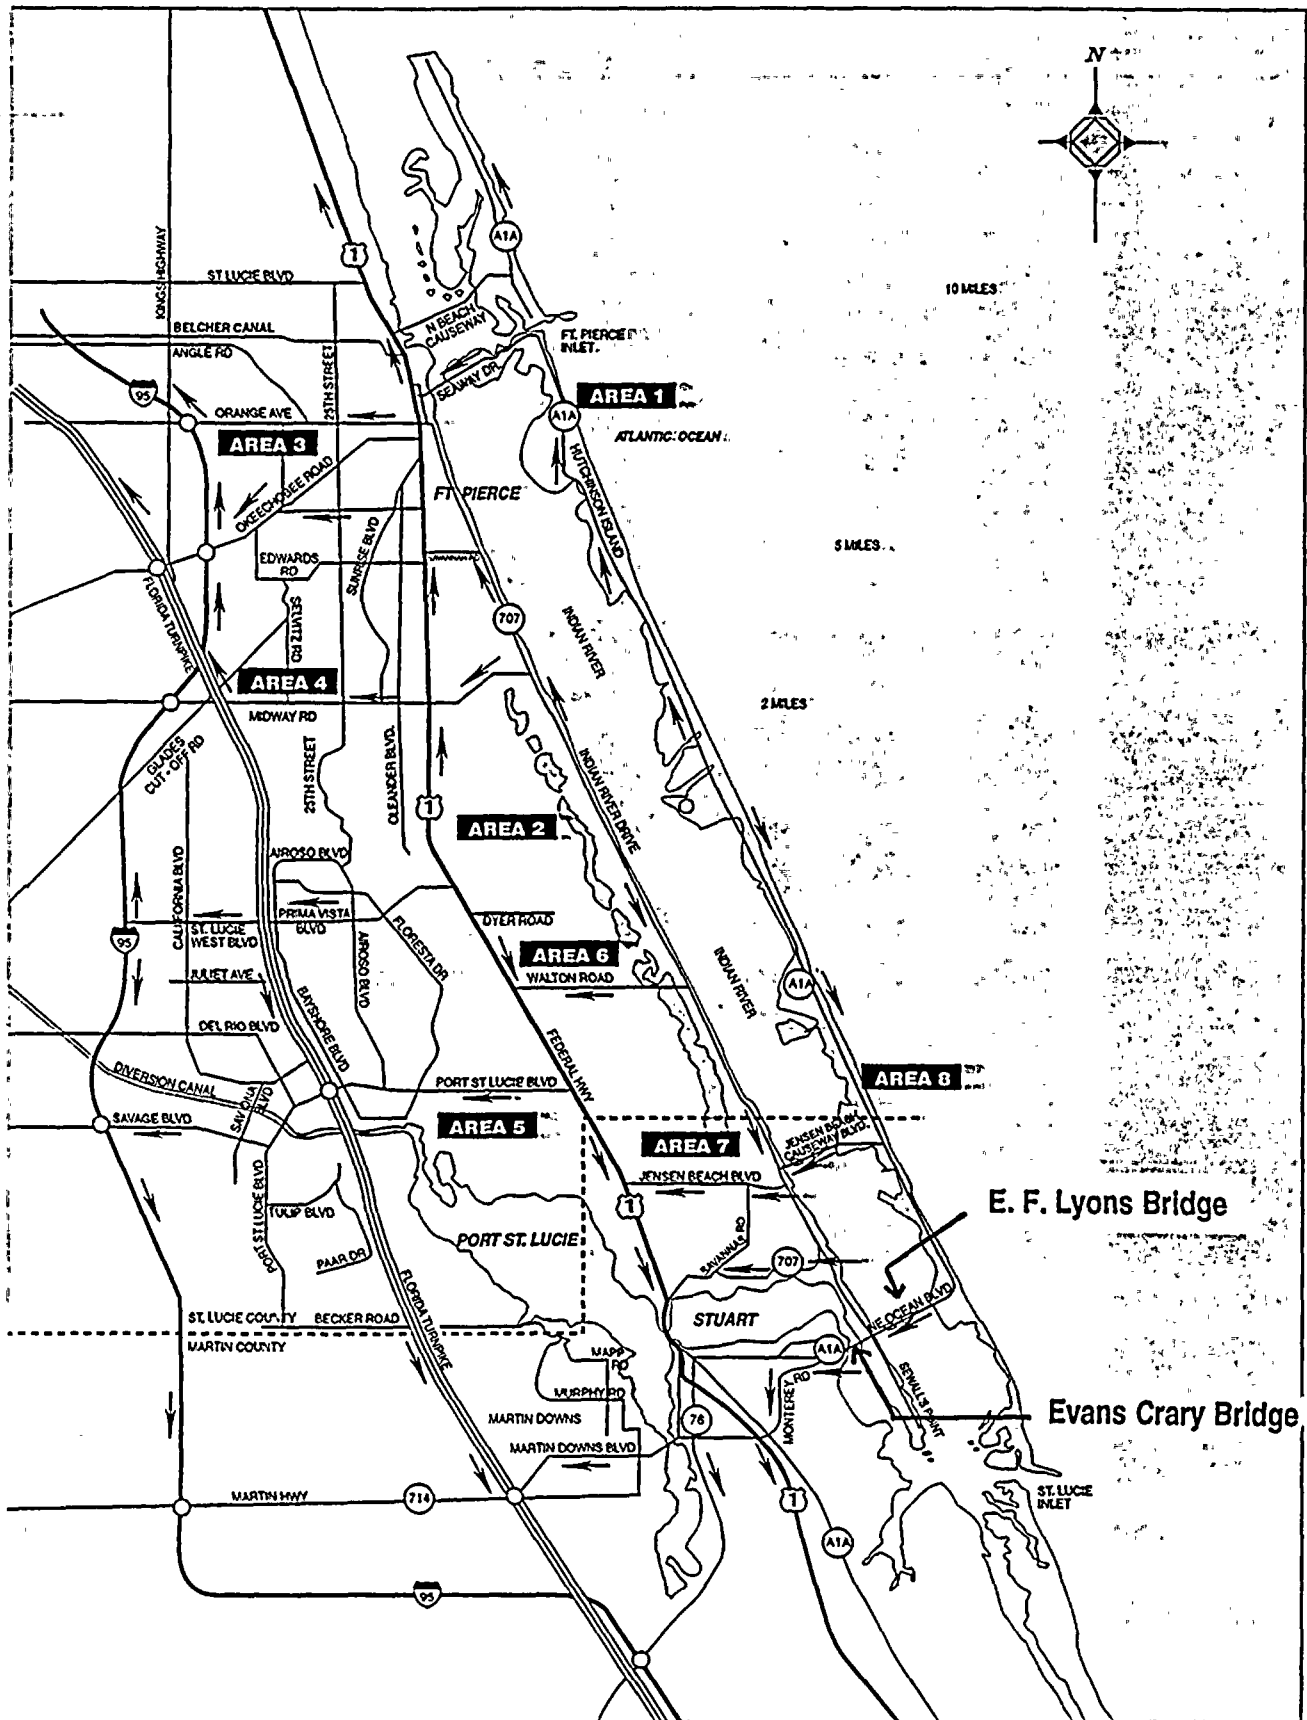



November 10, 1993

DOCKET NO(S). 50-335

DISTRIBUTION:
 (Docket file w/o encl.
 PD II-2 r/f
 ETana

SEE ATTACHED LIST

SUBJECT: ST. LUCIE, UNIT 1

The following documents concerning our review of the subject facility are transmitted for your information.

✓	DESCRIPTION OF DOCUMENT	DATED
	Notice of Receipt of Application	
	Draft/Final Environmental Statement	
	Notice of Availability of Draft/Final Environmental Statement	
	Safety Evaluation Report, or Supplement No. _____	
	Environmental Assessment and Finding of No Significant Impact	
	Notice of Issuance of Environmental Assessment	
	Notice of Consideration of Issuance of Facility Operating License or Amendment to Facility Operating License	
	Biweekly Notice; Applications and Amendments to Operating Licenses Involving No Significant Hazards Conditions See Page(s) _____	
	Exemption	
	Construction Permit No. CPPR- _____, Amendment No. _____	
	Facility Operating License No. _____, Amendment No. _____	
	Order	
	Monthly Operating Report for _____ transmitted by Letter	
	Annual/Semi-Annual Report: _____ transmitted by Letter	
X	Other <u>NPDES noncompliance notification</u>	11/1/93

Office of Nuclear Reactor Regulation

Enclosures:
As Stated

cc: See next page

OFFICE▶	NRR/PD.II-2						
SURNAME▶	ETana. <i>ET</i>						
DATE▶	11/10/93						

MRS
dy



.....

.....

.....

.....

.....

.....

.....

.....

St. Lucie 1 and 2

cc: Chief
Division of Habitat Conservation
U.S. Fish & Wildlife Service
U.S. Department of the Interior
Washington, DC 20240

Regional Radiation Representative
U.S. Environmental Protection Agency
Region IV Office
345 Cortland Street, NE
Atlanta, GA 30365

Dr. William Cunningham
FDA Research Chemist
National Institute of Standards
and Technology
Reactor Building 235, Room B-108
Gaithersburg, MD 20899



o

u

.

July 23, 1993

DOCKET NO(S). 50-335

DISTRIBUTION:
Docket file w/o encl.
PD II-2 r/f
ETana

SEE ATTACHED LIST

SUBJECT: ST. LUCIE, UNIT 1

The following documents concerning our review of the subject facility are transmitted for your information.

✓	DESCRIPTION OF DOCUMENT	DATED
	Notice of Receipt of Application	
	Draft/Final Environmental Statement	
	Notice of Availability of Draft/Final Environmental Statement	
	Safety Evaluation Report, or Supplement No. _____	
	Environmental Assessment and Finding of No Significant Impact	
	Notice of Issuance of Environmental Assessment	
	Notice of Consideration of Issuance of Facility Operating License or Amendment to Facility Operating License	
	Biweekly Notice; Applications and Amendments to Operating Licenses Involving No Significant Hazards Conditions See Page(s) _____	
	Exemption	
	Construction Permit No. CPPR- _____, Amendment No. _____	
	Facility Operating License No. _____, Amendment No. _____	
	Order	
	Monthly Operating Report for _____ transmitted by Letter	
	Annual/Semi-Annual Report: _____ transmitted by Letter	
X	Other <u>NPDES noncompliance notification</u>	7/6/93

Office of Nuclear Reactor Regulation

Enclosures:
As Stated

cc: See next page

OFFICE▶	NRR/PD II-2						
SURNAME▶	ETana <i>ETT</i>						
DATE▶	7/23/93						

ACRS
dbp

1950

1950

1950

1950

1950

1950

1950

1950

1950

St. Lucie 1 and 2

cc: Chief
Division of Habitat Conservation
U.S. Fish & Wildlife Service
U.S. Department of the Interior
Washington, DC 20240

Regional Radiation Representative
U.S. Environmental Protection Agency
Region IV Office
345 Cortland Street, NE
Atlanta, GA 30365

April 22, 1993

DOCKET NO(S). 50-335 and
50-389

DISTRIBUTION:
(Docket file w/o encl.)
PD II-2 Rdg
ETana

SEE ATTACHED LIST

SUBJECT: ST. LUCIE, UNITS 1 and 2

The following documents concerning our review of the subject facility are transmitted for your information.

✓	DESCRIPTION OF DOCUMENT	DATED
	Notice of Receipt of Application	
	Draft/Final Environmental Statement	
	Notice of Availability of Draft/Final Environmental Statement	
	Safety Evaluation Report, or Supplement No. _____	
	Environmental Assessment and Finding of No Significant Impact	
	Notice of Issuance of Environmental Assessment	
	Notice of Consideration of Issuance of Facility Operating License or Amendment to Facility Operating License	
	Biweekly Notice; Applications and Amendments to Operating Licenses Involving No Significant Hazards Conditions See Page(s) _____	
	Exemption	
	Construction Permit No. CPPR- _____, Amendment No. _____	
	Facility Operating License No. _____, Amendment No. _____	
	Order	
	Monthly Operating Report for _____ transmitted by Letter	
	Annual/Semi-Annual Report: _____ transmitted by Letter	
XX	Other <u>NPDES noncompliance notification</u>	4/14/93

Office of Nuclear Reactor Regulation

Enclosures:
As Stated

cc: See next page

OFFICE▶	NRR/PDII-2						
SURNAME▶	ETana <i>EP</i>						
DATE▶	4/22/93						

ACRS-1
dhp

1942

1942

1942

1942

1942

1942

1942

1942

1942

1942

1942

St. Lucie 1 and 2

cc: Chief
Division of Habitat Conservation
U.S. Fish & Wildlife Service
U.S. Department of the Interior
Washington, DC 20240

Regional Radiation Representative
U.S. Environmental Protection Agency
Region IV Office
345 Cortland Street, NE
Atlanta, GA 30365

March 17, 1993

DISTRIBUTION:
 Docket file w/o encl.
 PD II-2 Rdg
 ETana

DOCKET NO(S). 50-335
 and 50-389

SEE ATTACHED LIST

SUBJECT: St. Lucie, Units 1 and 2

The following documents concerning our review of the subject facility are transmitted for your information.

✓	DESCRIPTION OF DOCUMENT	DATED
	Notice of Receipt of Application	
	Draft/Final Environmental Statement	
	Notice of Availability of Draft/Final Environmental Statement	
	Safety Evaluation Report, or Supplement No. _____	
	Environmental Assessment and Finding of No Significant Impact	
	Notice of Issuance of Environmental Assessment	
	Notice of Consideration of Issuance of Facility Operating License or Amendment to Facility Operating License	
	Biweekly Notice; Applications and Amendments to Operating Licenses Involving No Significant Hazards Conditions See Page(s) _____	
	Exemption	
	Construction Permit No. CPPR- _____, Amendment No. _____	
	Facility Operating License No. _____, Amendment No. _____	
	Order	
	Monthly Operating Report for _____ transmitted by Letter	
	Annual/Semi-Annual Report: _____ transmitted by Letter	
XX	Other NPDES noncompliance notification _____	3/5/93

Office of Nuclear Reactor Regulation

Enclosures:
 As Stated

cc: See next page

OFFICE▶	NRR/PD II-2					
SURNAME▶	ETana <i>ET</i>					
DATE▶	3/17/93					



1944
1945
1946
1947
1948
1949
1950
1951
1952
1953
1954
1955
1956
1957
1958
1959
1960
1961
1962
1963
1964
1965
1966
1967
1968
1969
1970
1971
1972
1973
1974
1975
1976
1977
1978
1979
1980
1981
1982
1983
1984
1985
1986
1987
1988
1989
1990
1991
1992
1993
1994
1995
1996
1997
1998
1999
2000
2001
2002
2003
2004
2005
2006
2007
2008
2009
2010
2011
2012
2013
2014
2015
2016
2017
2018
2019
2020
2021
2022
2023
2024
2025

1944

1945

1946

1947

1948

1949

1950
1951
1952
1953
1954
1955
1956
1957
1958
1959
1960
1961
1962
1963
1964
1965
1966
1967
1968
1969
1970
1971
1972
1973
1974
1975
1976
1977
1978
1979
1980
1981
1982
1983
1984
1985
1986
1987
1988
1989
1990
1991
1992
1993
1994
1995
1996
1997
1998
1999
2000
2001
2002
2003
2004
2005
2006
2007
2008
2009
2010
2011
2012
2013
2014
2015
2016
2017
2018
2019
2020
2021
2022
2023
2024
2025

November 5, 1992

DOCKET NO(S). 50-335

DISTRIBUTION:
Docket File w/o encl. ✓
PD II-2 Rdg
ETana

SEE ATTACHED LIST

SUBJECT: St. Lucie, Unit 1

The following documents concerning our review of the subject facility are transmitted for your information.

✓	DESCRIPTION OF DOCUMENT	DATED
	Notice of Receipt of Application	
	Draft/Final Environmental Statement	
	Notice of Availability of Draft/Final Environmental Statement	
	Safety Evaluation Report, or Supplement No. _____	
	Environmental Assessment and Finding of No Significant Impact	
	Notice of Issuance of Environmental Assessment	
	Notice of Consideration of Issuance of Facility Operating License or Amendment to Facility Operating License	
	Biweekly Notice; Applications and Amendments to Operating Licenses Involving No Significant Hazards Conditions See Page(s) _____	
	Exemption	
	Construction Permit No. CPPR— _____, Amendment No. _____	
	Facility Operating License No. _____, Amendment No. _____	
	Order	
	Monthly Operating Report for _____ transmitted by Letter	
	Annual/Semi-Annual Report: _____ transmitted by Letter	
XX	Other <u>NPDES noncompliance notification</u>	

Office of Nuclear Reactor Regulation

Enclosures:
As Stated

cc: See next page

OFFICE▶	PDII-2/NRR					
SURNAME▶	ETana					
DATE▶	11/5/92					

ACRS-1
2/4

1954

1954

1954

1954

1954

St. Lucie 1&2

cc: Chief
Division of Ecological Services
Bureau of Sport Fisheries & Wildlife
U. S. Department of the Interior
Washington, DC 20240

Dr. William Cunningham
FDA Research Chemist
National Bureau of Standards
Reactor Building 235, Room B-108
Gaithersburg, MD 20899

EIS Review Coordinator
EPA Region IV
345 Courtland Street, NE
Atlanta, GA 30365

Director, Criteria and Standards
(ANR-460)
Office of Radiation Programs
U.S. Environmental Protection
Agency
Washington, DC 20460

DISTRIBUTION:
 Docket File w/o enclosure
 PD22 Reading File
 DMiller
 JNorris

July 24, 1992

DOCKET NO(S). 50-335 and 50-389

SEE ATTACHED LIST

SUBJECT: ST. LUCIE PLANT UNITS 1 AND 2: FLORIDA POWER & LIGHT COMPANY

The following documents concerning our review of the subject facility are transmitted for your information.

✓	DESCRIPTION OF DOCUMENT	DATED
	Notice of Receipt of Application	
	Draft/Final Environmental Statement	
	Notice of Availability of Draft/Final Environmental Statement	
	Safety Evaluation Report, or Supplement No. _____	
	Environmental Assessment and Finding of No Significant Impact	
	Notice of Issuance of Environmental Assessment	
	Notice of Consideration of Issuance of Facility Operating License or Amendment to Facility Operating License	
	Biweekly Notice; Applications and Amendments to Operating Licenses Involving No Significant Hazards Conditions See Page(s) _____	
	Exemption	
	Construction Permit No. CPPR- _____, Amendment No. _____	
	Facility Operating License No. _____, Amendment No. _____	
	Order	
X	Monthly Operating Report for April 1992 _____ transmitted by Letter	04/30/92
	Annual/Semi-Annual Report: _____ transmitted by Letter	
	Other _____	

Division of Reactor Projects - I/II
 Office of Nuclear Reactor Regulation

Enclosures:
 As Stated

cc: See next page

ACRS 1

OFFICE▶	LA:RDA-3						
SURNAME▶	D Miller						
DATE▶	07/24/92						



1948

1949

1950

DISTRIBUTION:
 Docket File w/o enclosure
 PD22 Reading File
 DMiller
 JNorris

July 24, 1992

DOCKET NO(S). 50-335 and 50-389

SEE ATTACHED LIST

SUBJECT: ST. LUCIE PLANT, UNITS 1 AND 2: FLORIDA POWER & LIGHT COMPANY

The following documents concerning our review of the subject facility are transmitted for your information.

✓	DESCRIPTION OF DOCUMENT	DATED
	Notice of Receipt of Application	
	Draft/Final Environmental Statement	
	Notice of Availability of Draft/Final Environmental Statement	
	Safety Evaluation Report, or Supplement No. _____	
	Environmental Assessment and Finding of No Significant Impact	
	Notice of Issuance of Environmental Assessment	
	Notice of Consideration of Issuance of Facility Operating License or Amendment to Facility Operating License:	
	Biweekly Notice; Applications and Amendments to Operating Licenses Involving No Significant Hazards Conditions. See Page(s) _____	
	Exemption	
	Construction Permit No. CPPR- _____, Amendment No. _____	
	Facility Operating License No. _____, Amendment No. _____	
	Order	
X	Monthly Operating Report for <u>June 1992</u> transmitted by Letter	06/30/92
	Annual/Semi-Annual Report: _____ transmitted by Letter	
	Other _____	

Division of Reactor Projects - I/II
 Office of Nuclear Reactor Regulation

Enclosures:
 As Stated

cc: See next page

ACRS-1

OFFICE▶	I/A/P/2						
SURNAME▶	D Miller						
DATE▶	07.24.92						



1952

1952

1952

DISTRIBUTION:
 Docket File w/o enclosure
 PD22 Reading File
 DMiller
 JNorris

July 24, 1992

DOCKET NO(S). 50-335 and 50-389

SEE ATTACHED LIST

SUBJECT: ST. LUCIE PLANT UNITS 1 AND 2: FLORIDA POWER & LIGHT COMPANY

The following documents concerning our review of the subject facility are transmitted for your information.

	DESCRIPTION OF DOCUMENT	DATED
	Notice of Receipt of Application	
	Draft/Final Environmental Statement	
	Notice of Availability of Draft/Final Environmental Statement	
	Safety Evaluation Report, or Supplement No. _____	
	Environmental Assessment and Finding of No Significant Impact	
	Notice of Issuance of Environmental Assessment	
	Notice of Consideration of Issuance of Facility Operating License or Amendment to Facility Operating License	
	Biweekly Notice; Applications and Amendments to Operating Licenses Involving No Significant Hazards Conditions See Page(s) _____	
	Exemption	
	Construction Permit No. CPPR- _____, Amendment No. _____	
	Facility Operating License No. _____, Amendment No. _____	
	Order	
X	Monthly Operating Report for <u>May 1992</u> transmitted by Letter	05/31/92
	Annual/Semi-Annual Report: _____ transmitted by Letter	
	Other _____	


Division of Reactor Projects - I/II
 Office of Nuclear Reactor Regulation

Enclosures:
 As Stated

cc: See next page

ACRS-1

OFFICE▶	IA-PD2-2						
SURNAME▶	<i>[Signature]</i>						
DATE▶	07/24/92						

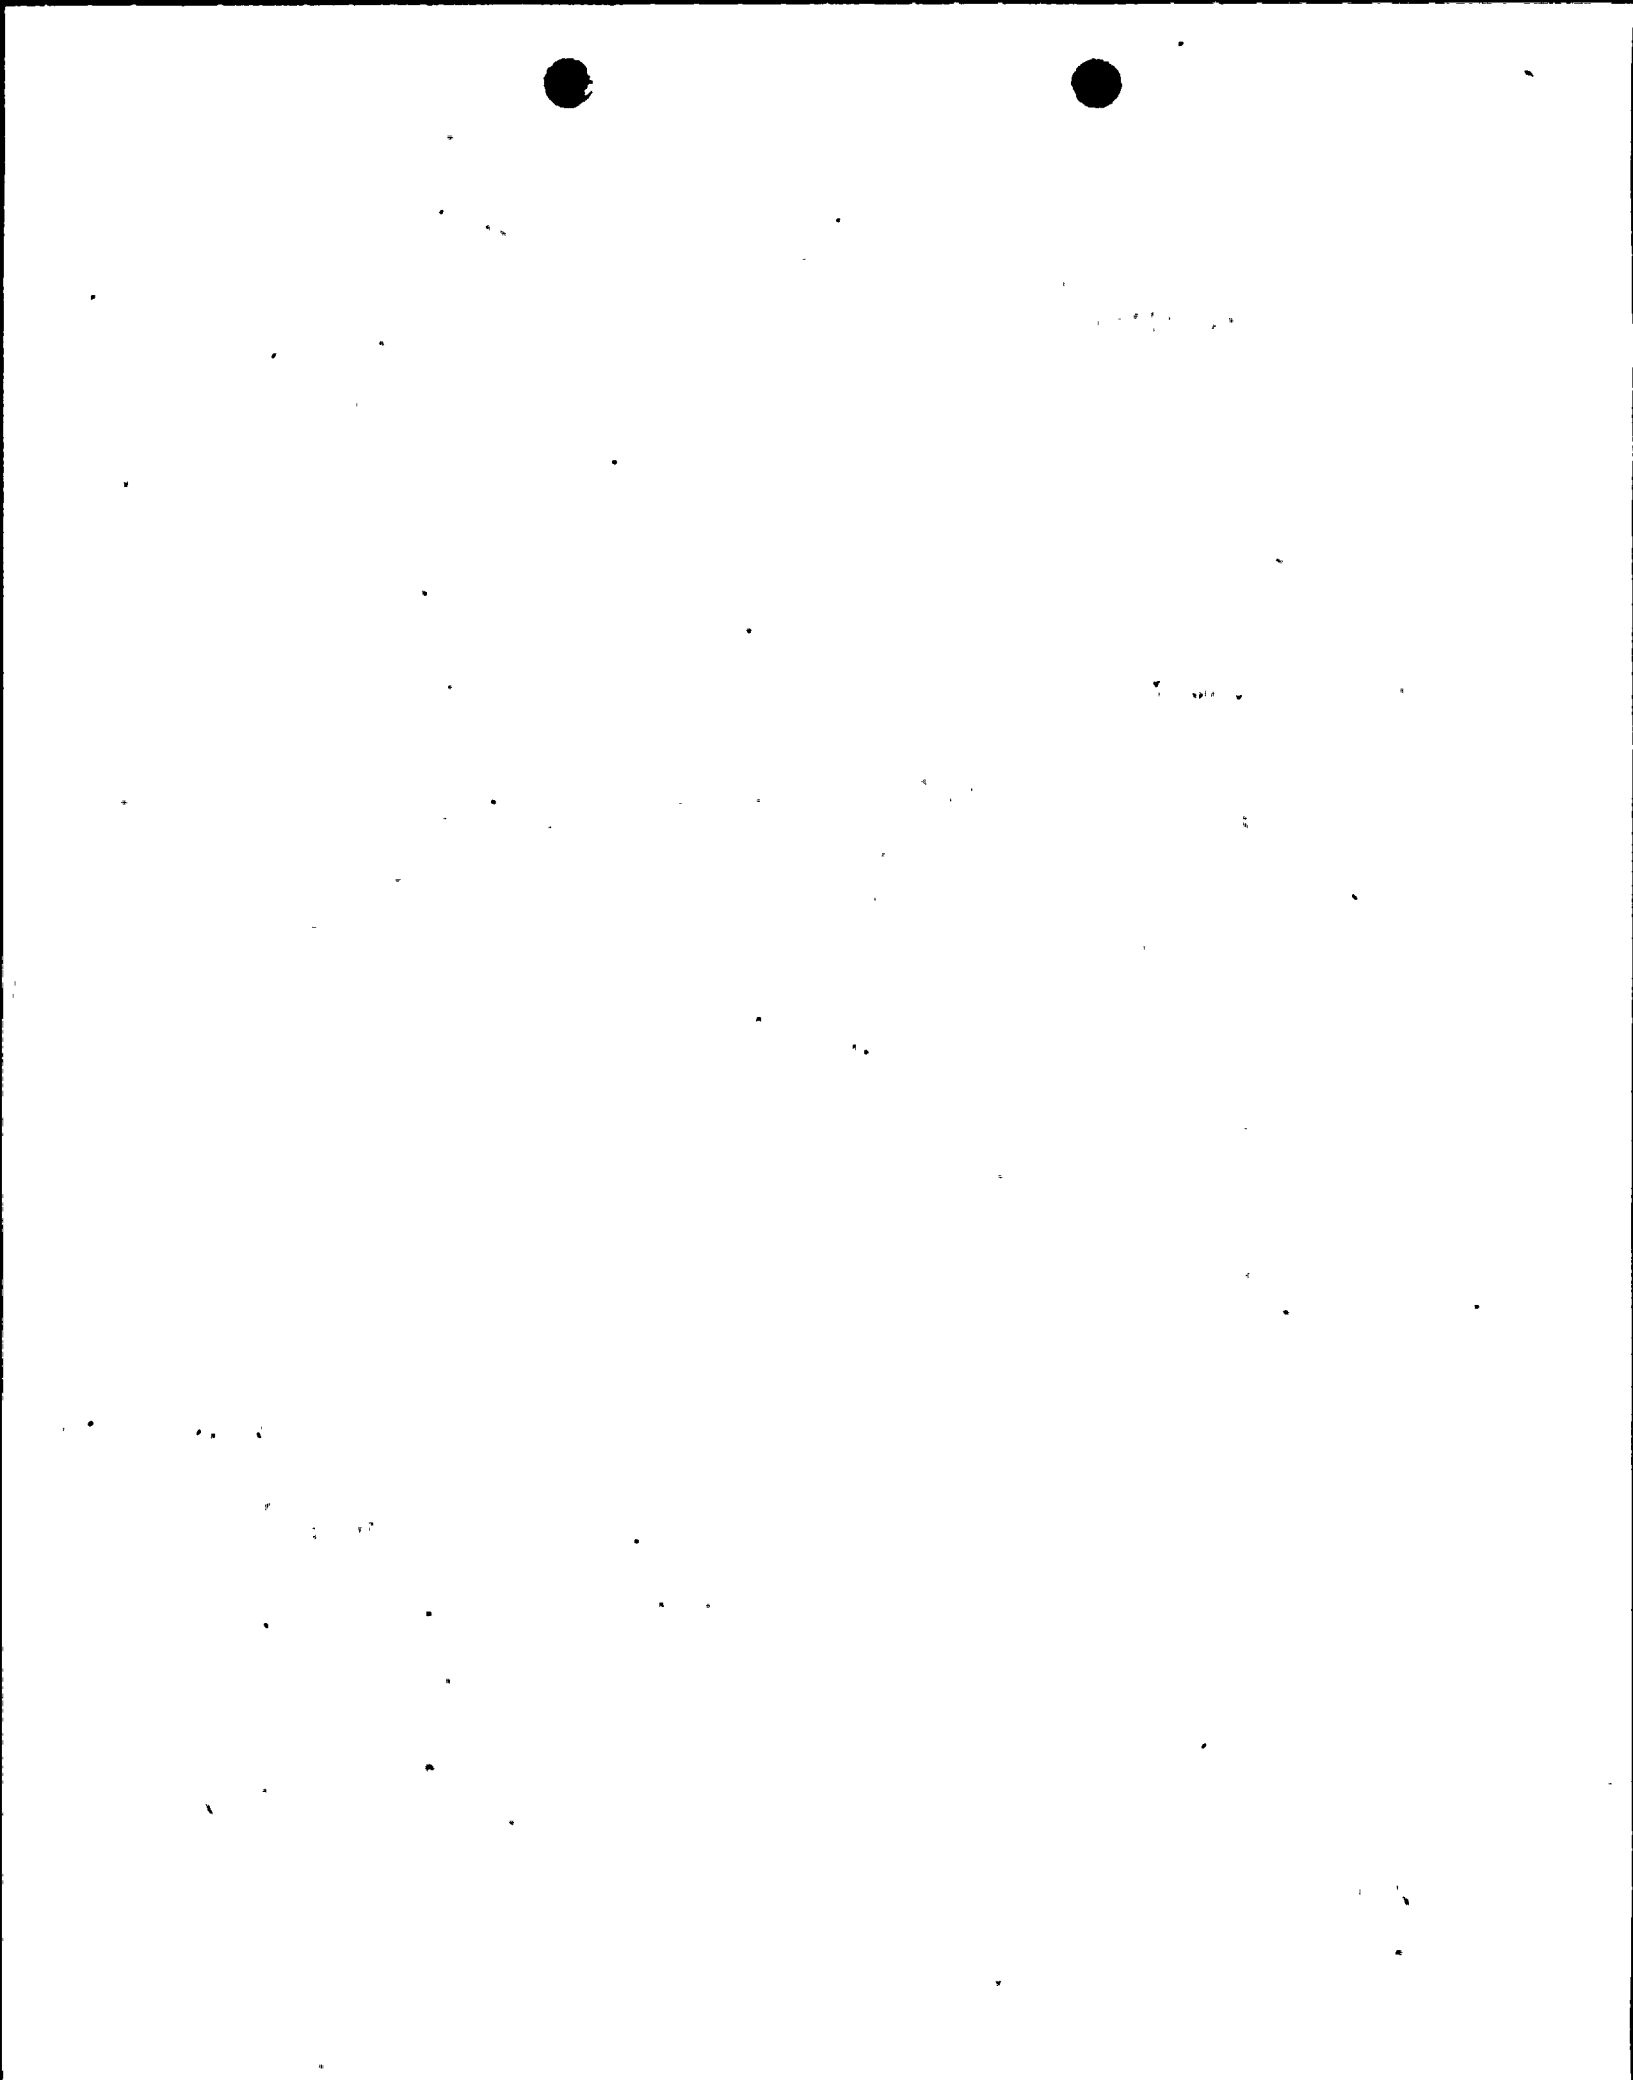

June 16, 1992

DISTRIBUTION
Docket File
PD22 Rdg
DMiller

DOCKET NO(S). 50-335/50-389

SEE ATTACHED LIST

SUBJECT: FLORIDA POWER AND LIGHT COMPANY, ST. LUCIE UNITS 1 AND 2

The following documents concerning our review of the subject facility are transmitted for your information.

✓	DESCRIPTION OF DOCUMENT	DATED
	Notice of Receipt of Application	
	Draft/Final Environmental Statement	
	Notice of Availability of Draft/Final Environmental Statement	
	Safety Evaluation Report, or Supplement No. _____	
	Environmental Assessment and Finding of No Significant Impact	
	Notice of Issuance of Environmental Assessment	
	Notice of Consideration of Issuance of Facility Operating License or Amendment to Facility Operating License	
	Biweekly Notice; Applications and Amendments to Operating Licenses Involving No Significant Hazards Conditions See Page(s) _____	
	Exemption	
	Construction Permit No. CPPR- _____, Amendment No. _____	
	Facility Operating License No. _____, Amendment No. _____	
	Order	
	Monthly Operating Report for _____ transmitted by Letter	
	Annual/Semi-Annual Report: _____ transmitted by Letter	
XX	Other NPDES noncompliance notification	

Office of Nuclear Reactor Regulation

Enclosures:
As Stated

cc: See next page

ACRS-1

OFFICE▶	LA: PD22						
SURNAME▶	D. Miller						
DATE▶	6/16/92						



1000

1000

1000

1000

1000

1000

1000

cc: Chief
Division of Ecological Services
Bureau of Sport Fisheries & Wildlife
U.S. Department of the Interior
Washington, DC 20240

Dr. William Cunningham
FDA Research Chemist
National Institute of Standards
and Technology
Reactor Building 235, Room B-108
Gaithersburg, MD 20899

U.S. Environmental Protection Agency
Region IV Office
ATTN: Regional Radiation Representative
345 Courtland Street, NE
Atlanta, GA 30365

Director, Criteria and Standards
(ANR-460)
Office of Radiation Programs
U.S. Environmental Protection
Agency
Washington, DC 20460