

PRIORITY 1
ACCELERATED RIDS PROCESSING

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR:9502150075 DOC.DATE: 95/02/08 NOTARIZED: NO DOCKET #
 FACIL:50-335 St. Lucie Plant, Unit 1, Florida Power & Light Co. 05000335
 AUTH.NAME AUTHOR AFFILIATION
 SAGER,D.A. Florida Power & Light Co.
 RECIP.NAME RECIPIENT AFFILIATION
 Document Control Branch (Document Control Desk) *See Reports*

SUBJECT: Forwards "Second 10-Yr ISI Interval IST Program for Pumps & Valves St Lucie Nuclear Power Plant Unit 1," rev 5.

DISTRIBUTION CODE: A047D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 2+150
 TITLE: OR Submittal: Inservice/Testing/Relief from ASME Code - GL-89-04

NOTES:

	RECIPIENT ID CODE/NAME	COPIES LTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTR ENCL
	PD2-2 LA NORRIS,J	1 1 1 1	PD2-2 PD	1 1
INTERNAL:	ACRS FILE CENTER 01	6 6 1 1	AEOD/SPD/RAB NRR/DE/EMCB	1 1 1 1
	NRR/DE/EMEB OGC/HDS3	1 1 1 0	NUDOCS-ABSTRACT RES/DSIR/EIB	1 1 1 1
EXTERNAL:	LITCO BROWN,B NOAC	1 1 1 1	LITCO RANSOME,C NRC PDR	1 1 1 1

NOTE TO ALL "RIDS" RECIPIENTS:


PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL
 DESK, ROOM P1-37 (EXT. 504-2083) TO ELIMINATE YOUR NAME FROM
 DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 20 ENCL 19

P
R
I
O
R
I
T
Y

1

D
O
C
U
M
E
N
T

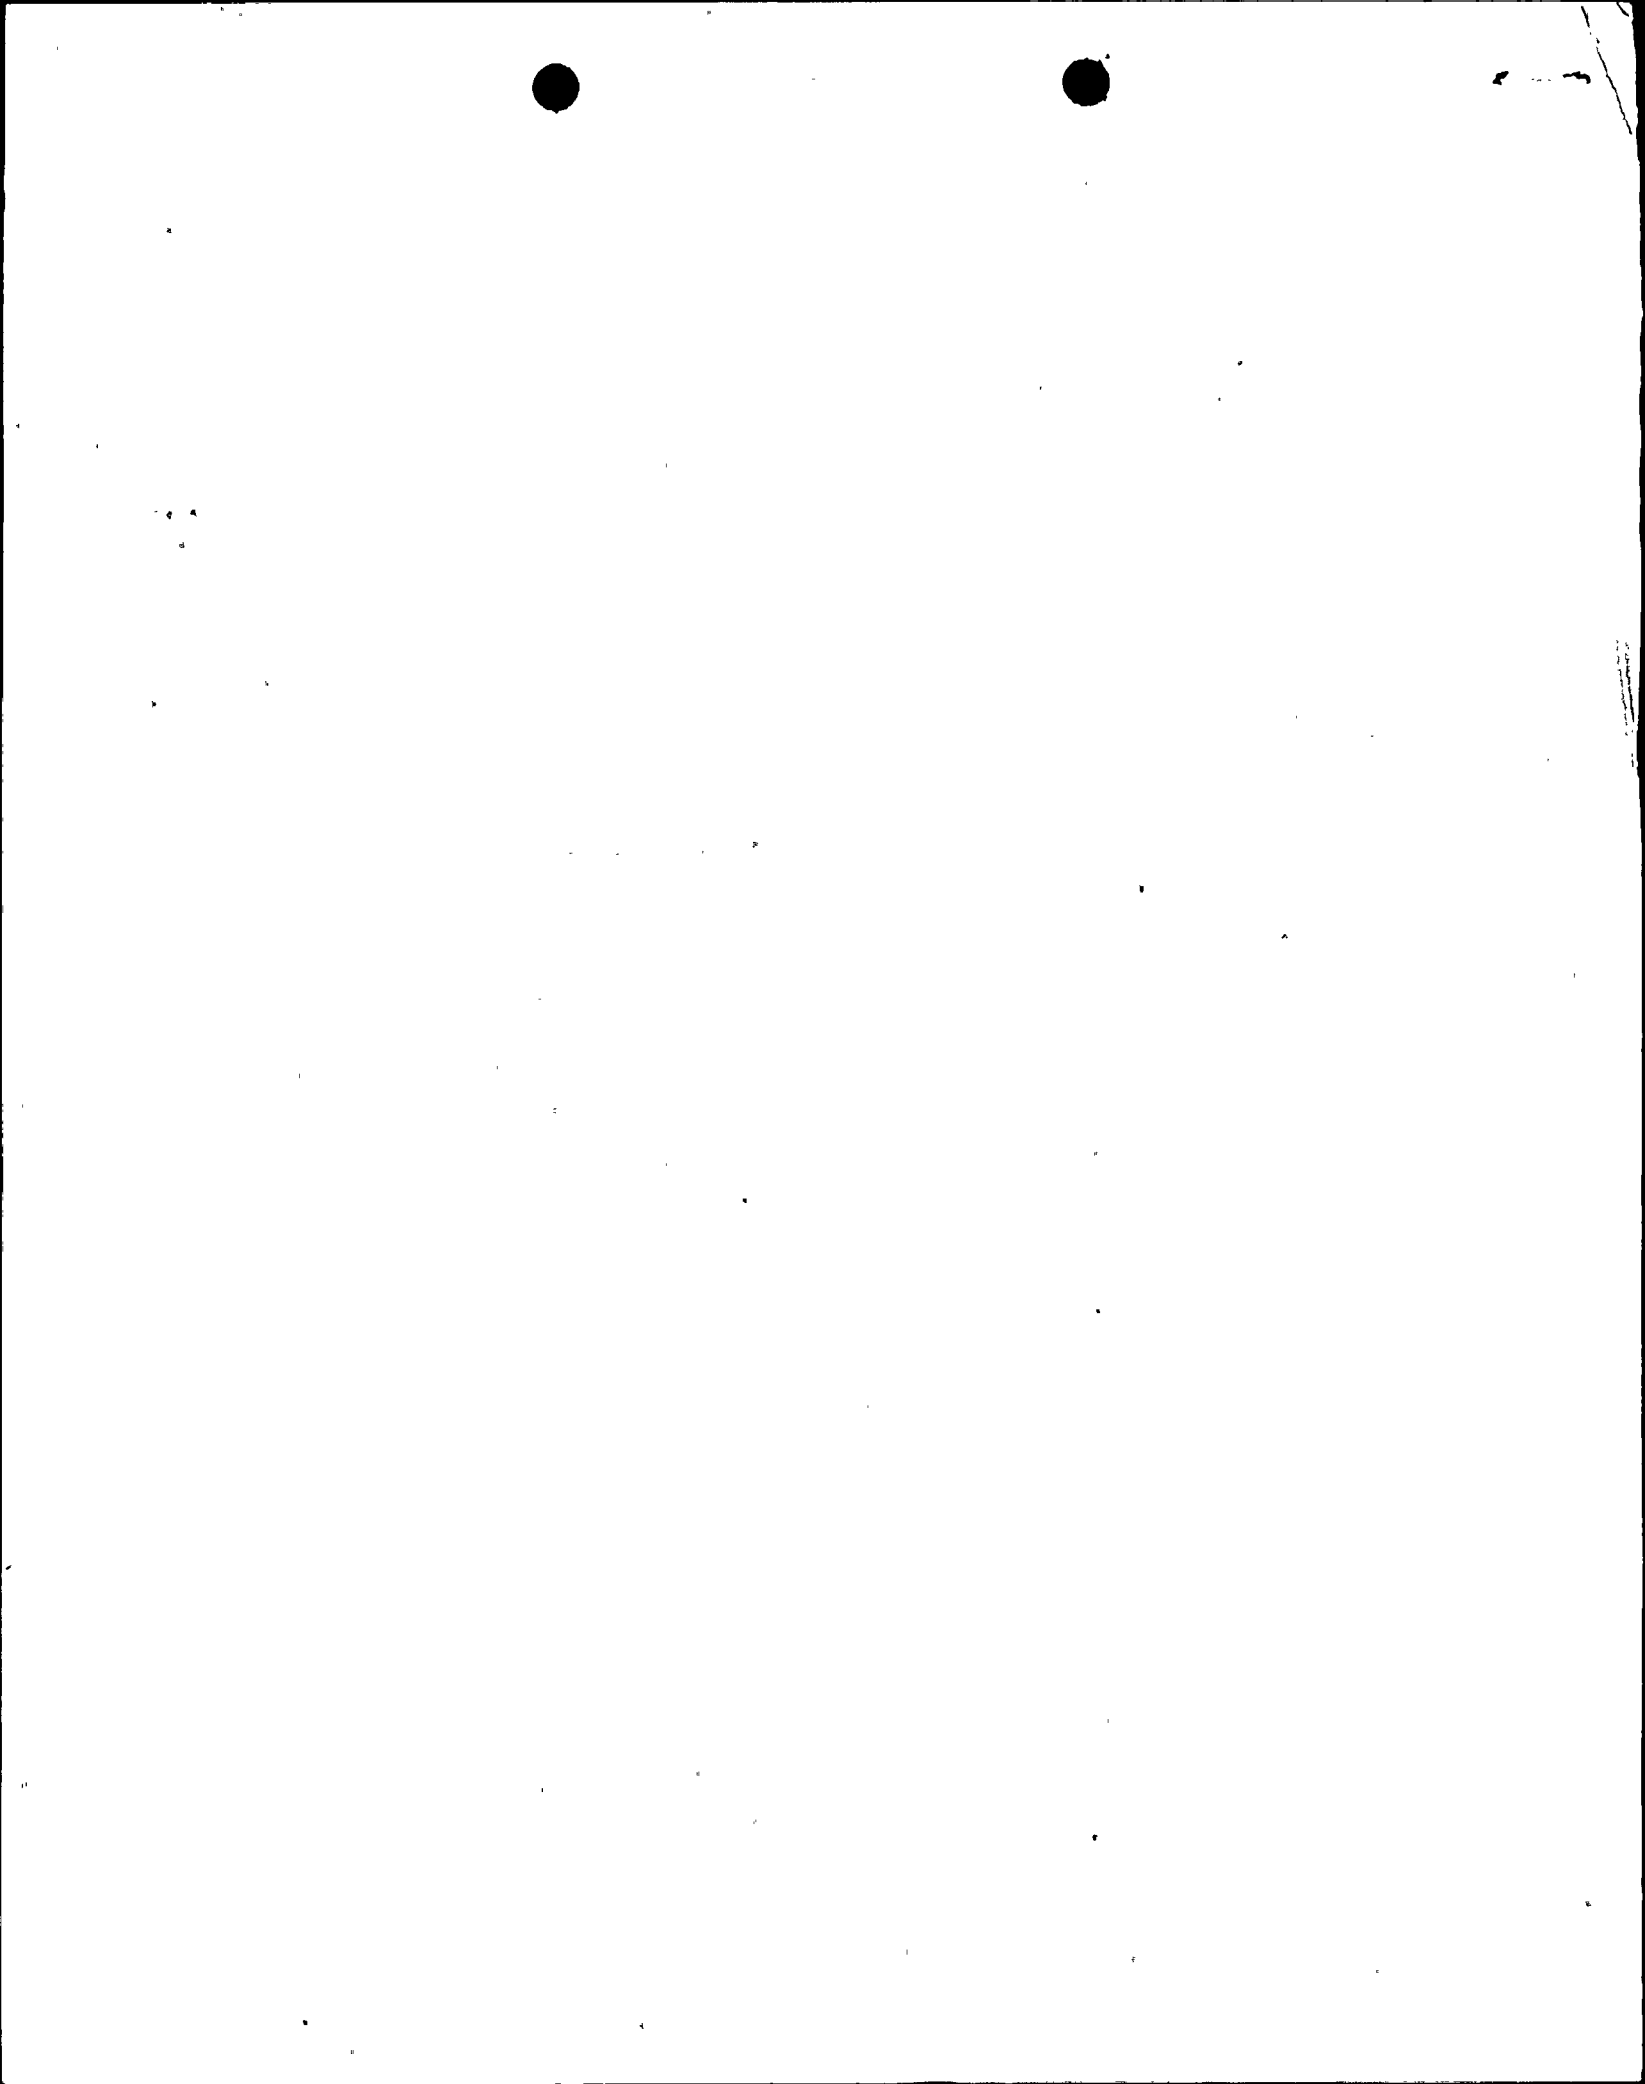



FPL

Florida Power & Light Company, P.O. Box 128, Fort Pierce, FL 34954-0128

February 8, 1995

L-95-48
10 CFR 50.4

U. S. Nuclear Regulatory Commission
Attn: Document Control Desk
Washington, D. C. 20555

RE: St. Lucie Unit 1
Docket No. 50-335
Second Ten Year In Service Inspection Interval
In Service Test Program Revision 5

Enclosed for your information is the St. Lucie Unit 1, Second Ten Year In Service Inspection Interval, In Service Test Program, Revision 5. This revision incorporates changes based on the NRC Safety Evaluation dated September 27, 1994.

Attachment 1 is a summary of the changes incorporated into this revision.

Please contact us if there are any questions about this submittal.

Very truly yours,

D. A. Sager
Vice President
St. Lucie Plant


DAS/GRM

cc: Stewart D. Ebnetter, Regional Administrator, Region II, USNRC
Senior Resident Inspector, USNRC, St. Lucie Plant

140098

9502150075 950208
PDR ADOCK 05000335
P PDR

an FPL Group company

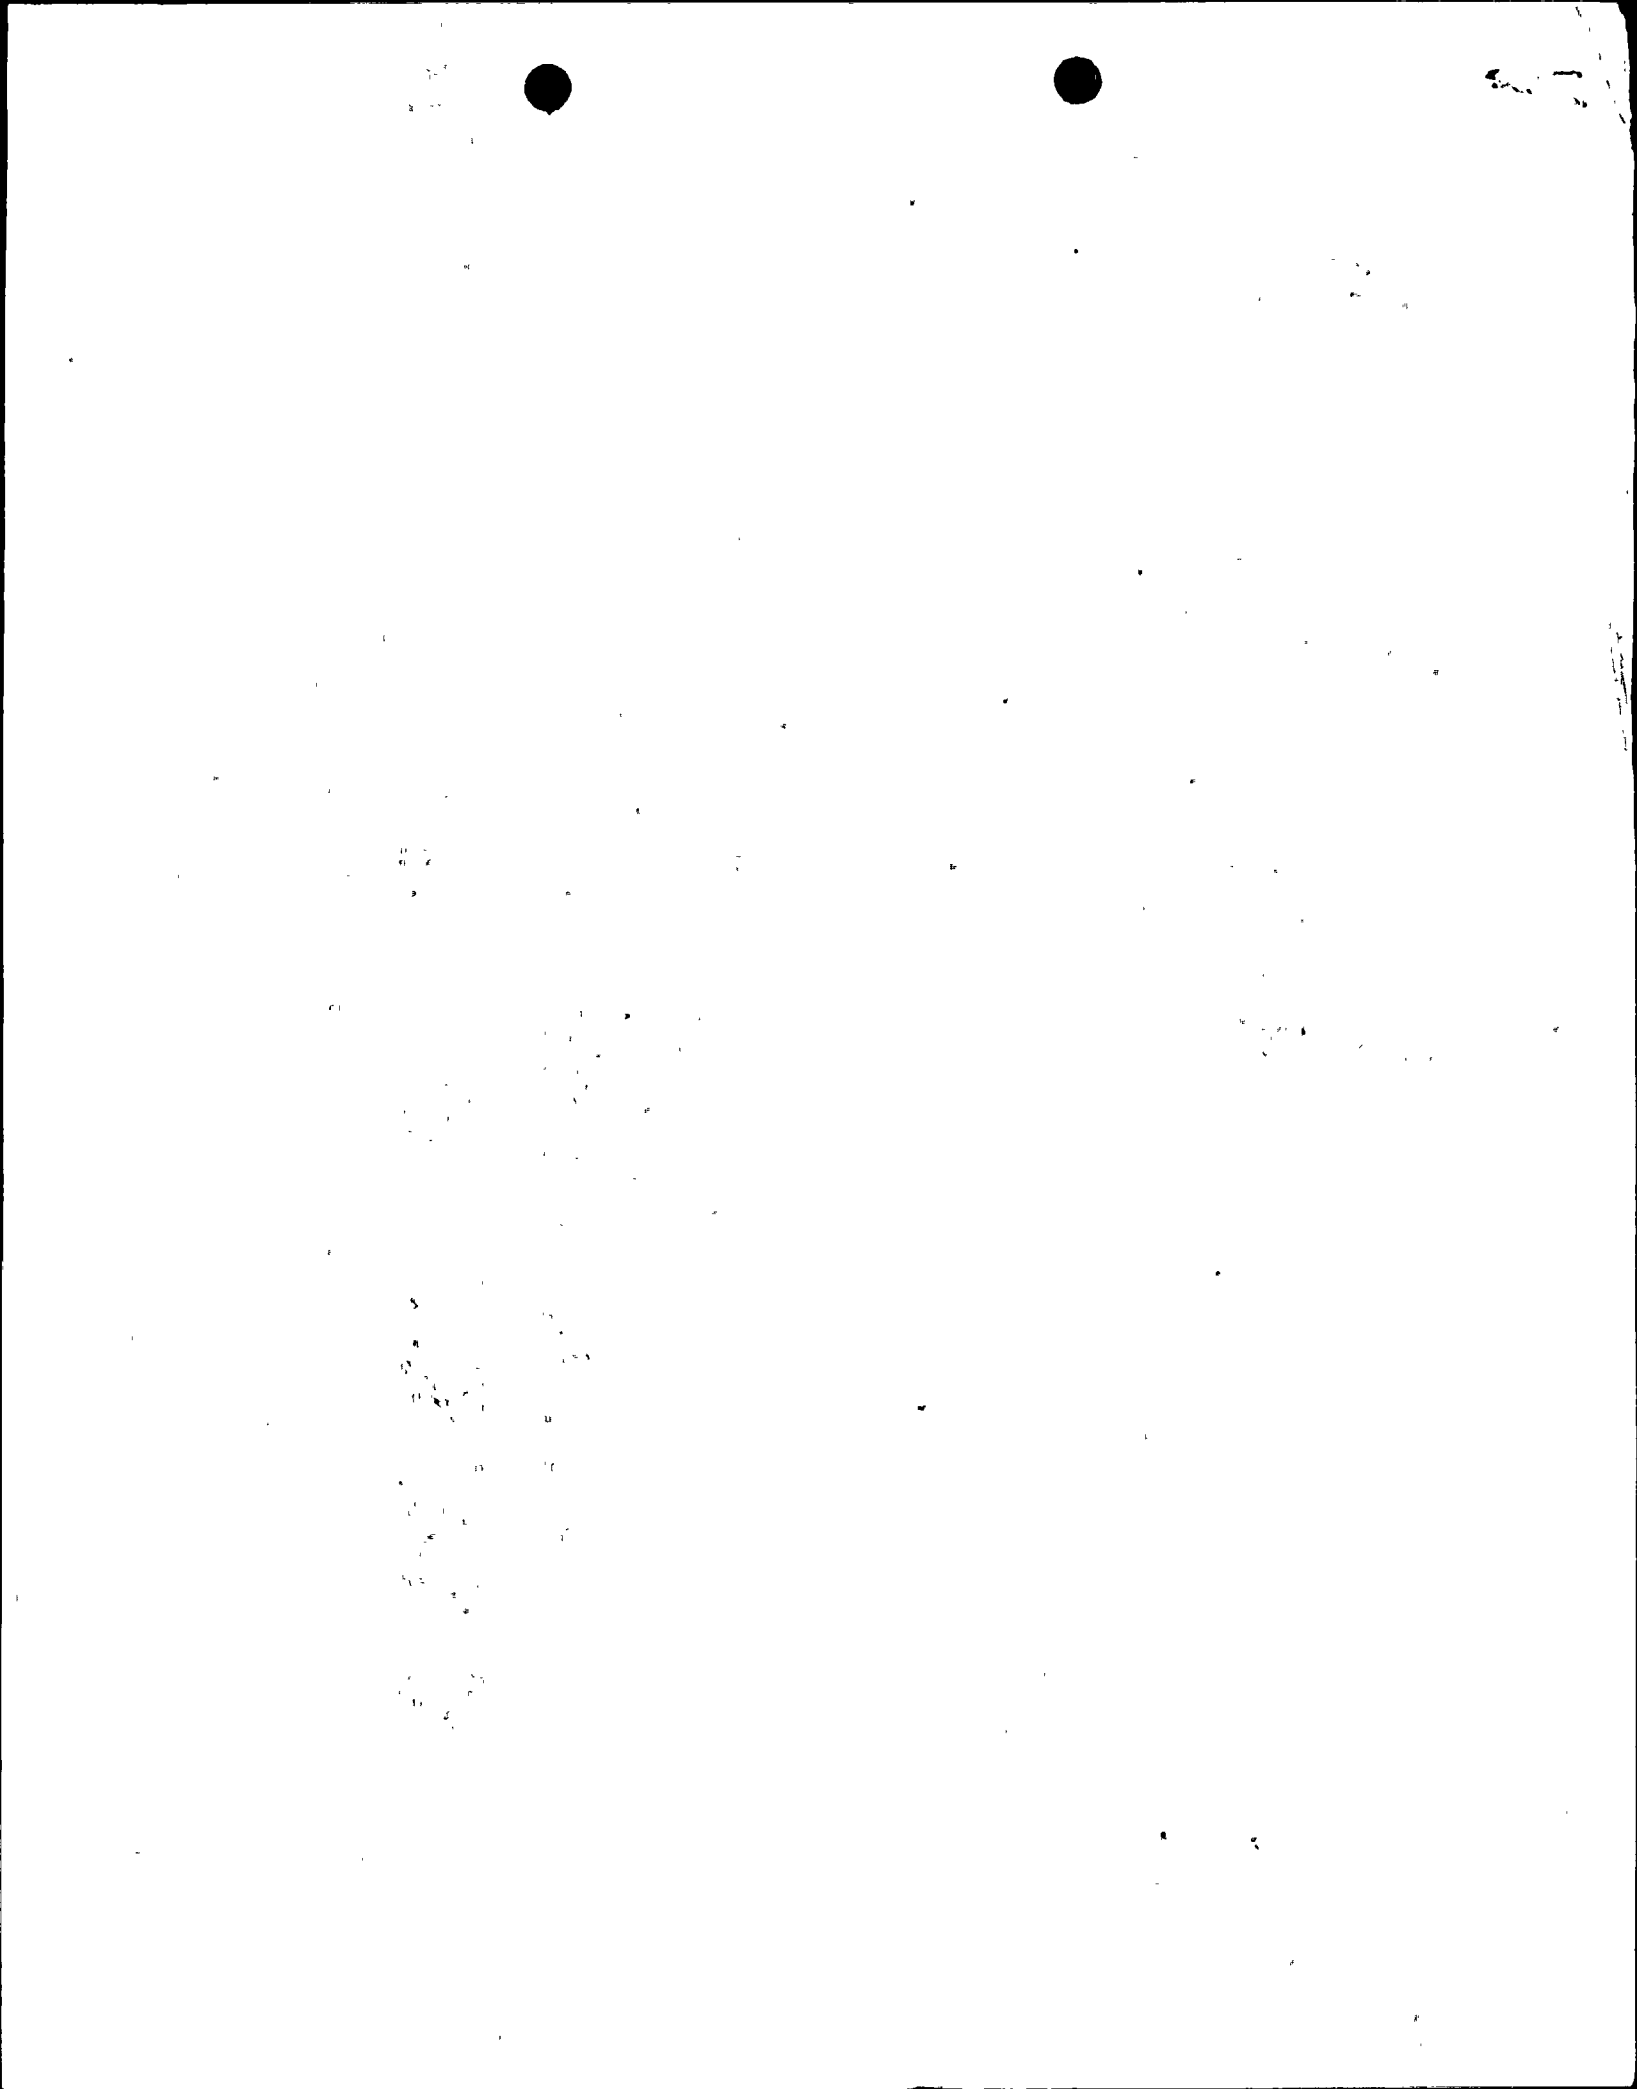

St. Lucie Unit 1
Docket No. 50-335
Second Ten Year In Service Inspection Interval
In Service Test Program Revision 5

Summary of Changes for St. Lucie Unit 1
In Service Testing Program Revision 5

The introduction has been revised to reference the NRC approval to the use of ASME/ANSI OM-1987, Part 1 requirements as an alternative to ASME Section XI, 1983 Edition, Subsection IWV-3510 requirements for testing of safety and relief valves. The approval is included in the NRC Safety Evaluation of St. Lucie Unit 1 In Service Testing Program Relief Requests dated September 27, 1994.

Revised relief request PR-12, which was approved by NRC Safety Evaluation dated August 5, 1994 has been incorporated into this revision.

The approval sections of relief requests PR-5, VR-29, VR-30, VR-39, VR-40, and VR-41, have been revised to incorporate approval of these relief requests which was documented in NRC Safety Evaluation dated September 27, 1994.

Relief requests VR-12 and VR-13 have been revised to denote that full stroke verification of the check valves be performed utilizing non-intrusive test methods in accordance with Generic Letter 89-04.

