

PRIORITY 1
ACCELERATED RIDS PROCESSING

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9505030201 DOC. DATE: 95/04/27 NOTARIZED: NO DOCKET # 05000335
 FACIL: 50-335 St. Lucie Plant, Unit 1, Florida Power & Light Co.
 AUTH. NAME: SAGER, D.A. AUTHORITY AFFILIATION: Florida Power & Light Co.
 RECIP. NAME: RECIPIENT AFFILIATION: Document Control Branch (Document Control Desk) *see RIFTS*

SUBJECT: Forwards Rev 0 to PSL-100-AOA-95-1, "St Lucie Unit 1 Second ISI Interval Request for Authorization of Alternative Exam."

DISTRIBUTION CODE: A047D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 1+38
 TITLE: OR Submittal: Inservice/Testing/Relief from ASME Code - GL-89-04

NOTES:

	RECIPIENT ID CODE/NAME	COPIES LTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTR ENCL
	PD2-1 LA	1 1	PD2-1 PD	1 1
	NORRIS, J	1 1		
INTERNAL:	ACRS	6 6	AEOD/SPD/RAB	1 1
	<u>FILE CENTER - OJS</u>	1 1	NRR/DE/EMCB	1 1
	NRR/DE/EMEB	1 1	NUDOCS-ABSTRACT	1 1
	OGC/HDS3	1 0	RES/DSIR/EIB	1 1
EXTERNAL:	LITCO BROWN, B	1 1	LITCO RANSOME, C	1 1
	NOAC	1 1	NRC PDR	1 1

P
R
I
O
R
I
T
Y


1

D
O
C
U
M
E
N
T

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK, ROOM P1-37 (EXT. 504-2083) TO ELIMINATE YOUR NAME FROM DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 20 ENCL 19

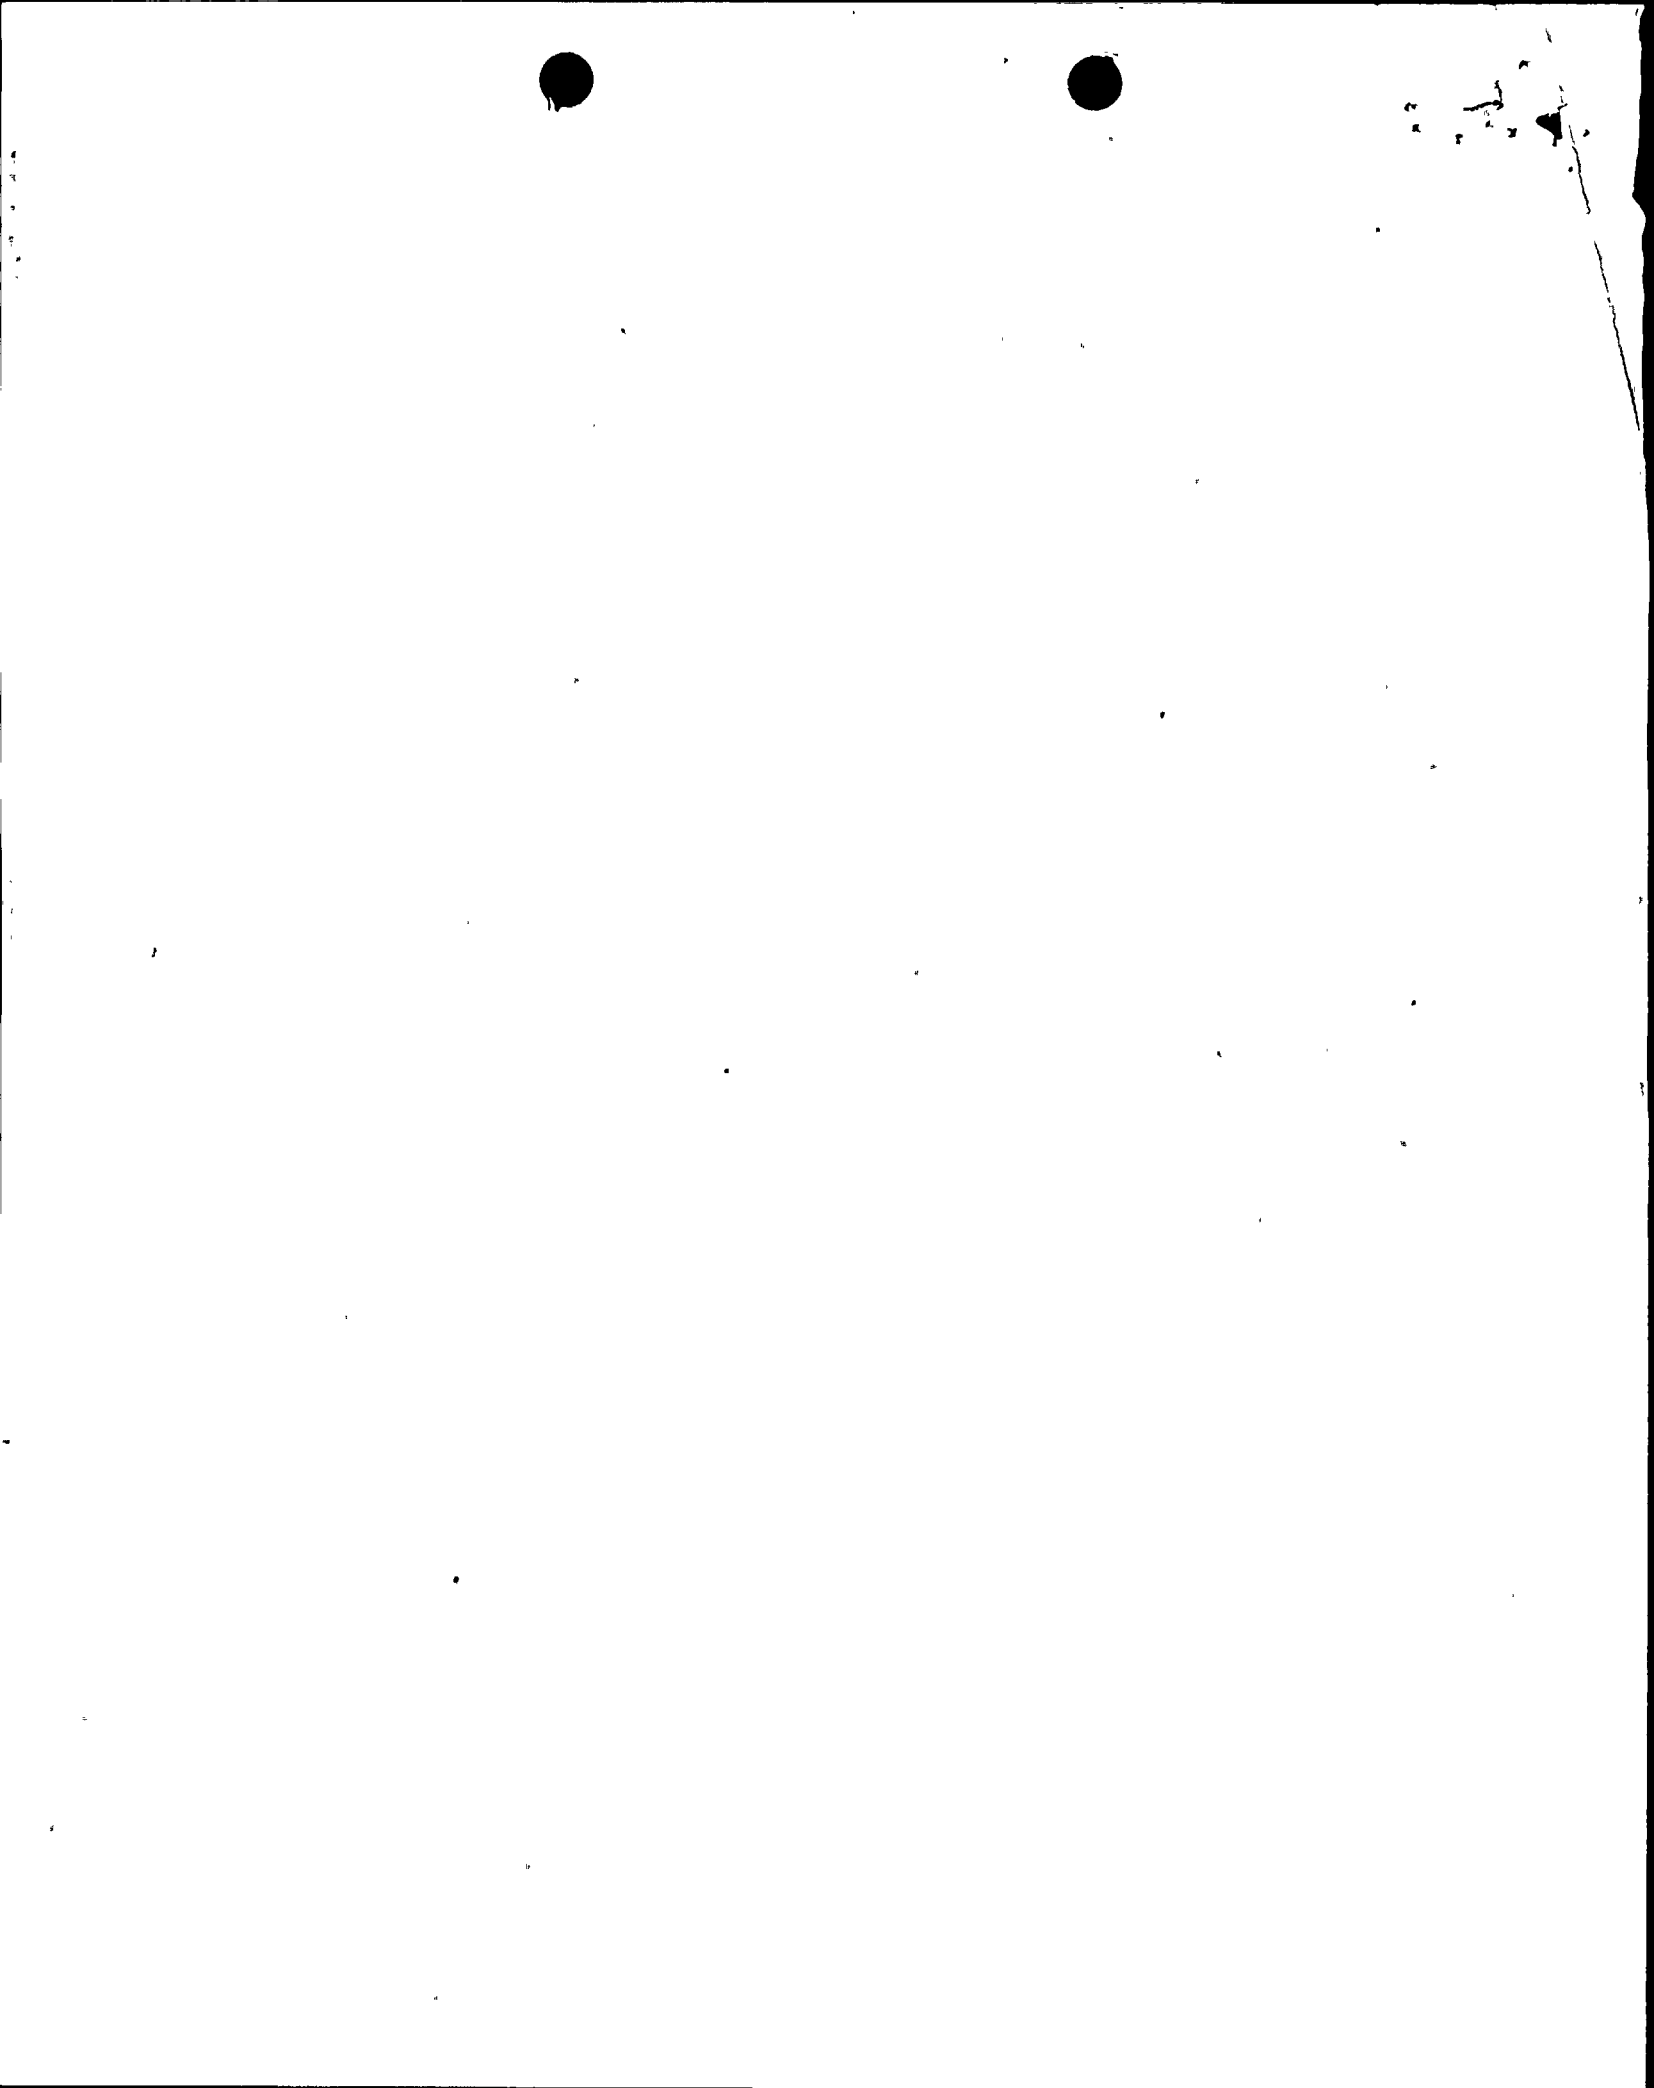



April 27, 1995

L-95-123
10 CFR 50.4
10 CFR 50.55a

U. S. Nuclear Regulatory Commission
Attn: Document Control Desk
Washington, D. C. 20555

RE: St. Lucie Unit 1
Docket No. 50-335
In-Service-Inspection Plan
Second Ten-Year Interval
Request for Authorization of Alternative
Examination of Reactor Vessel Welds

Pursuant to 10 CFR 50.55a(g)(6)(ii)(A)(5), Florida Power and Light Company (FPL) requests approval of alternative examination requirements for the augmented reactor vessel weld inspection required by 10CFR55a(g)(6)(ii)(A). FPL has determined that the proposed alternatives would provide an acceptable level of quality and safety. The request for authorization of alternative examination requirements including the justification is attached.

NRC review is requested by January 15, 1996, to support planning for the next St. Lucie Unit 1 refueling outage which is currently scheduled to begin April 8, 1996.

Please contact us if there are any questions about this submittal.

Very truly yours,

D. A. Sager
Vice President
St. Lucie Plant

DAS/GRM

cc: Stewart D. Ebnetter, Regional Administrator, Region II, USNRC
Senior Resident Inspector, USNRC, St. Lucie Plant

9505030201 950427
PDR ADOCK 05000335
PDR

A047
11