

# PRIORITY 1

(ACCELERATED RIDS PROCESSING)

## REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9510240268      DOC. DATE: 95/10/11      NOTARIZED: YES      DOCKET # .05000335 P  
FACIL: 50-335 St. Lucie Plant, Unit 1, Florida Power & Light Co.      05000389  
50-389 St. Lucie Plant, Unit 2, Florida Power & Light Co.  
AUTH. NAME      AUTHOR AFFILIATION  
SAGER, D.A.      Florida Power & Light Co.  
RECIP. NAME      RECIPIENT AFFILIATION  
Document Control Branch (Document Control Desk)

SUBJECT: Provides initial response to GL 95-07, "Pressure Locking & Thermal Binding Of Safety-Related Power-Operated Gate Valves."

DISTRIBUTION CODE: A056D      COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 2  
TITLE: Generic Ltr 95-07 - Pressure Locking & Thermal Binding of Safety Rela


### NOTES:

	RECIPIENT		COPIES		RECIPIENT		COPIES	
	ID CODE/NAME		LTR	ENCL	ID CODE/NAME	LTR	ENCL	
	NRR/DRPE/PD1-1		1	1	PD2-1 PD	1	1	
	NORRIS, J		1	1				
INTERNAL:	<u>FILE CENTER</u>	01	1	1	NRR/EMEB/B	1	1	
EXTERNAL:	NOAC		1	1	NRC PDR	1	1	
	NUDOCS ABSTRACT		1	1				

### NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK, ROOM OWFN 5D8 (415-2083) TO ELIMINATE YOUR NAME FROM DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 8 ENCL 8

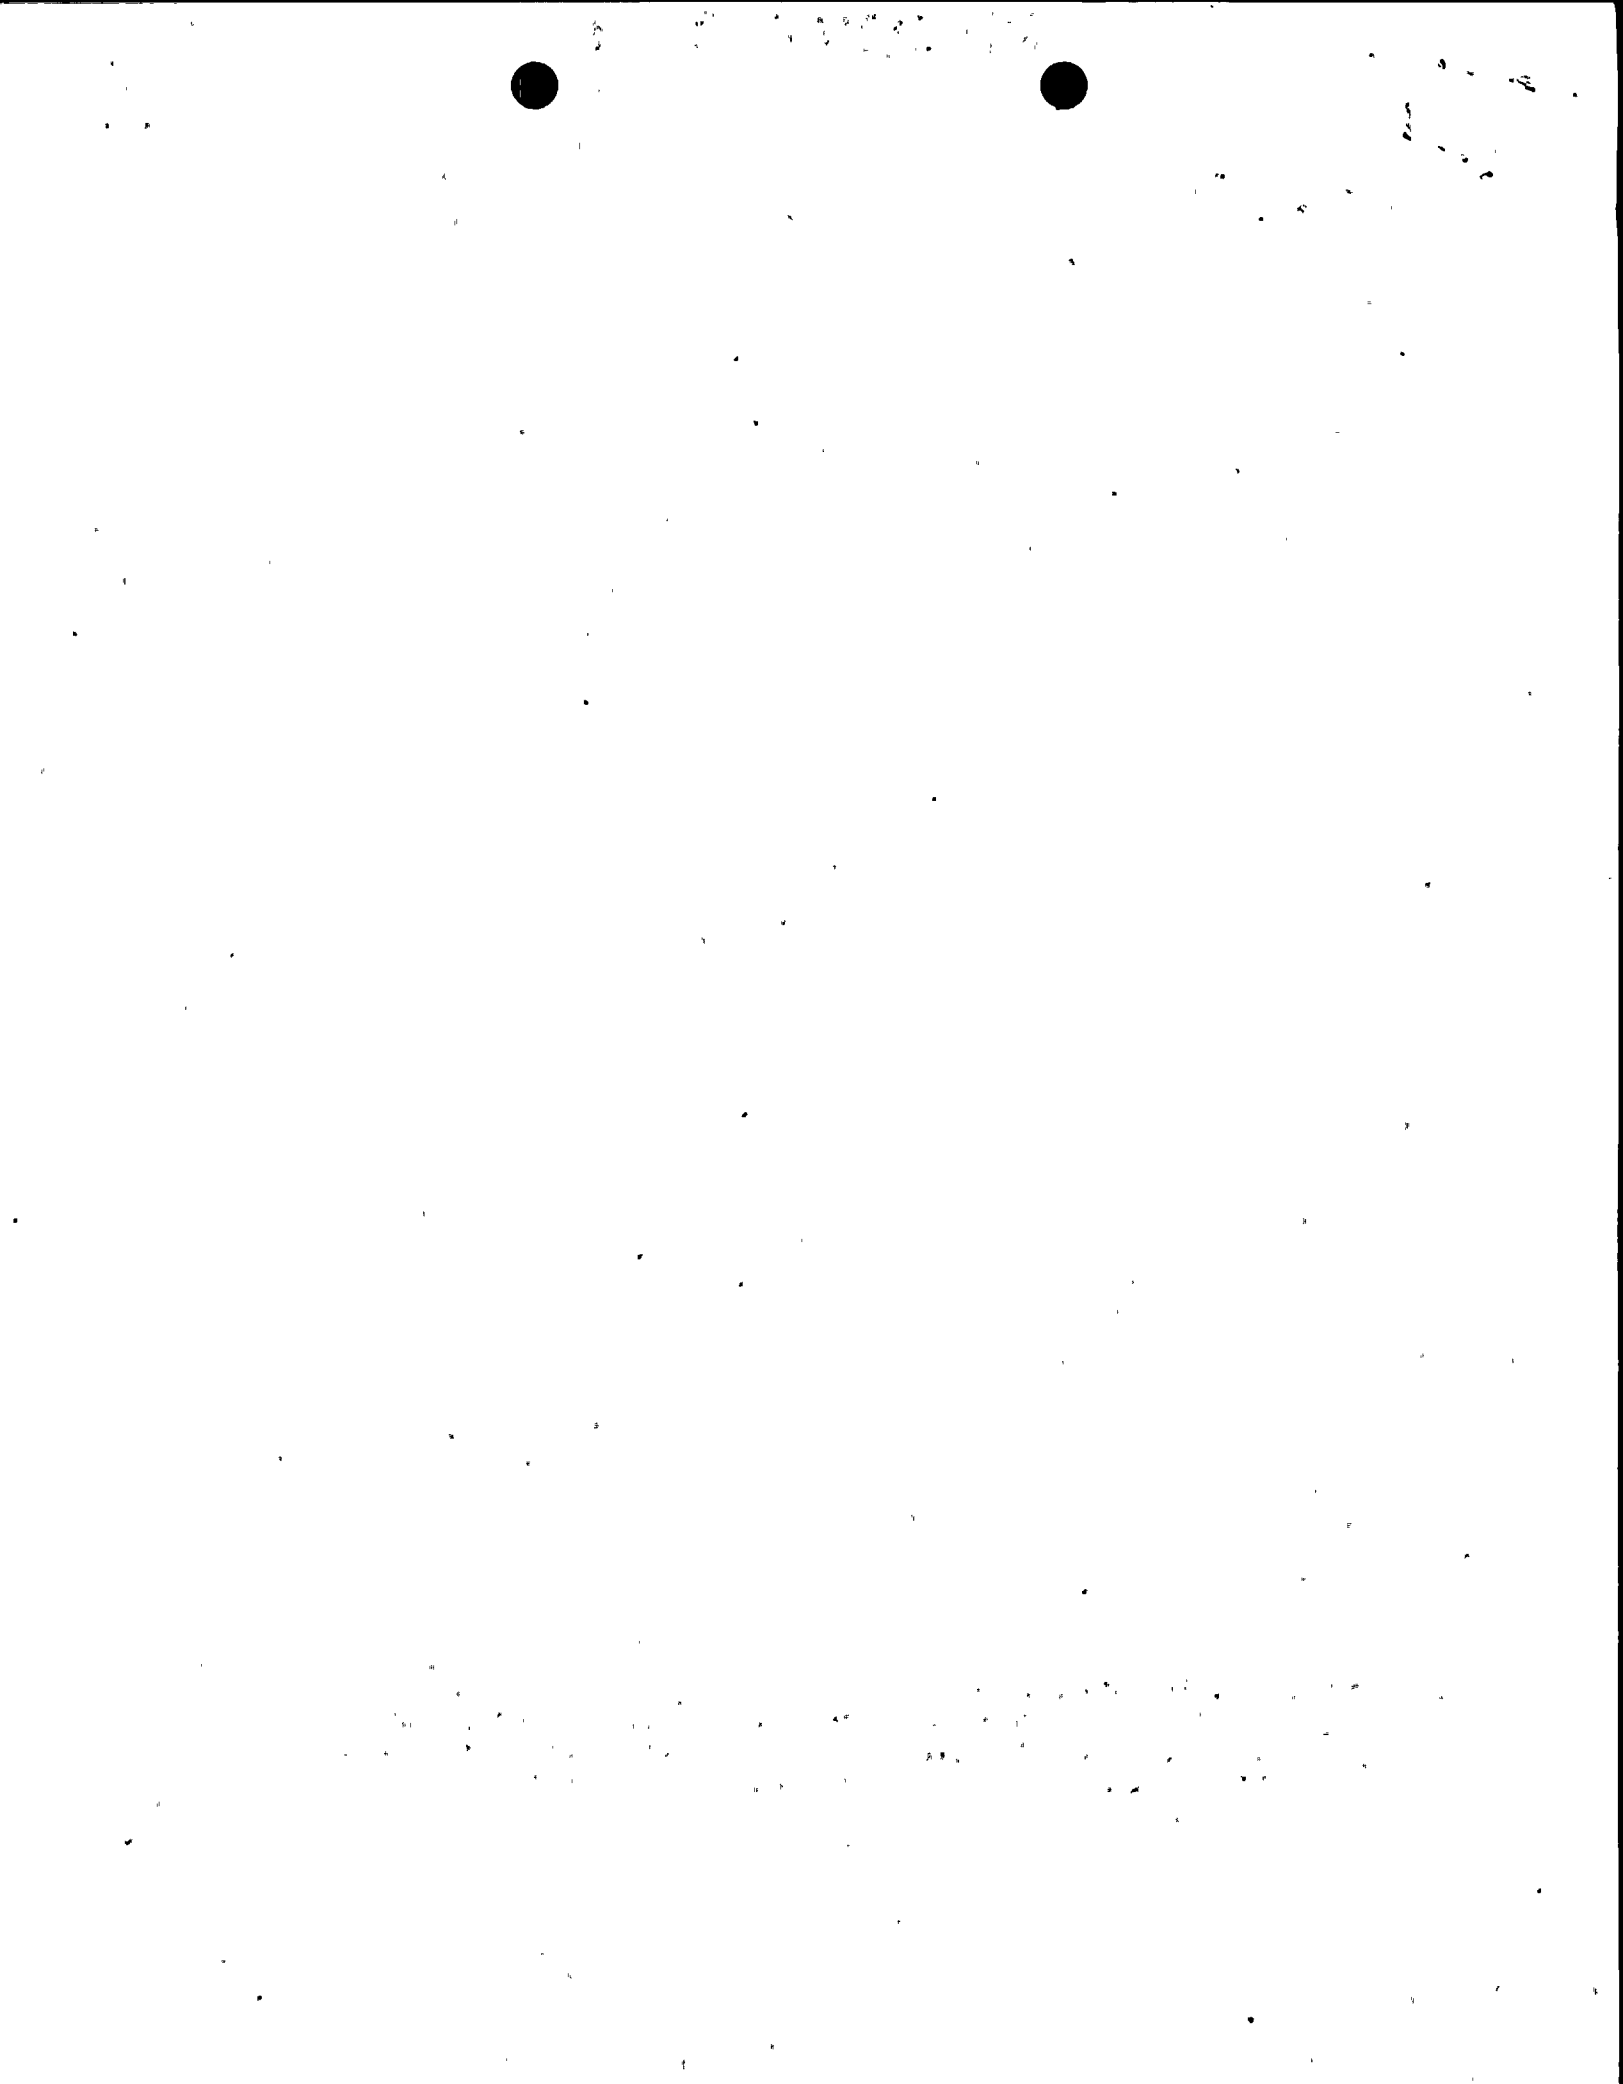



October 11, 1995

L-95-282  
10 CFR 50.4  
10 CFR 50.54(f)

U. S. Nuclear Regulatory Commission  
Attn: Document Control Desk  
Washington, D. C. 20555

RE: St. Lucie Units 1 and 2  
Docket No. 50-335 and 50-389  
Generic Letter 95-07 - Initial Response

The letter provides the Florida Power and Light Company (FPL) initial response to Generic Letter (GL) 95-07 "Pressure Locking and Thermal Binding of Safety Related Power Operated Gate Valves" for St. Lucie Units 1 and 2. The GL requested a written response within sixty days of August 17, 1995, indicating FPL's intentions to implement the actions requested in the GL and a schedule for completion.

FPL plans to implement the actions proposed in the GL. The information requested will be provided on or before February 13, 1996. Should our evaluations determine that modifications are required that cannot be completed by this date, FPL will provide a schedule along with the necessary justification in the February 1996 submittal.

This response is provided pursuant to the requirements of Section 182a of the Atomic Energy Act of 1954, as amended, and 10 CFR 50.54(f).

Please contact us if there are any questions about this submittal.

Very truly yours,

D. A. Sager  
Vice President  
St. Lucie Plant

DAS/GRM

Attachments

cc: Stewart D. Ebnetter, Regional Administrator, Region II, USNRC  
Senior Resident Inspector, USNRC, St. Lucie Plant

240008

AD56 11



1-2

1964

St. Lucie Units 1 and 2  
Docket No. 50-335 and 50-389  
Generic Letter 95-07 - Initial Response

STATE OF FLORIDA        )  
                                  )  
COUNTY OF ST. LUCIE    )        ss.

D. A. Sager being first duly sworn, deposes and says:

That he is Vice President, St. Lucie Plant for the Nuclear Division of Florida Power & Light Company, the Licensee herein;

That he has executed the foregoing document; that the statements made in this document are true and correct to the best of his knowledge, information and belief, and that he is authorized to execute the document on behalf of said Licensee.

DA Sager  
D. A. Sager

STATE OF FLORIDA  
COUNTY OF ST. Lucie

The foregoing instrument was acknowledged before me this 11<sup>th</sup> day of October, 19 95 by D. A. Sager, who is personally known to me and who did take an oath.

Karen West  
KAREN WEST  
Name of Notary Public

My Commission expires 4-18-98  
Commission No. CC359926

 KAREN WEST  
MY COMMISSION # CC359926 EXPIRES  
April 18, 1998  
BONDED THRU TROY FAH INSURANCE, INC.

Handwritten scribble or mark in the top right corner.

WESTERN  
NORTHWEST  
AT THE  
OFFICE OF THE  
DIRECTOR