

# CATEGORY 1

## REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9607250292      DOC. DATE: 96/07/25      NOTARIZED: NO      DOCKET #  
 FACIL: 50-335 St. Lucie Plant, Unit 1, Florida Power & Light Co.      05000335  
 AUTH. NAME:      AUTHOR AFFILIATION:  
 STALL, J.A.      Florida Power & Light Co.  
 RECIP. NAME:      RECIPIENT AFFILIATION:  
                                  Document Control Branch (Document Control Desk)

SUBJECT: Submits cumulative total of steam generator tubes plugged during spring 1996 outage & previous outages. W/o encl.

DISTRIBUTION CODE: A001D      COPIES RECEIVED: LTR 1 ENCL 0      SIZE: 1  
 TITLE: OR Submittal: General Distribution


NOTES:

	RECIPIENT		COPIES			RECIPIENT		COPIES		
	ID CODE/NAME		LTR	ENCL		ID CODE/NAME		LTR	ENCL	
	PD2-3 LA		1	1		PD2-3 PD		1	1	
	WIENS, L.		1	1						
INTERNAL:	ACRS		1	1		<del>ELLE CENTER</del> 01		1	1	
	NRR/DE/EMCB		1	1		NRR/DRCH/HICB		1	1	
	NRR/DSSA/SPLB		1	1		NRR/DSSA/SRXB		1	1	
	NUDOCS-ABSTRACT		1	1		OGC/HDS3		1	1	
EXTERNAL:	NOAC		1	1		NRC PDR		1	1	

NOTE TO ALL "RIDS" RECIPIENTS:  
 PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,  
 ROOM OWFN 5D-5 (EXT. 415-2083) TO ELIMINATE YOUR NAME FROM  
 DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 13 ENCL 2

C  
A  
T  
E  
G  
O  
R  
Y  
  
D  
O  
C  
U  
M  
E  
N  
T

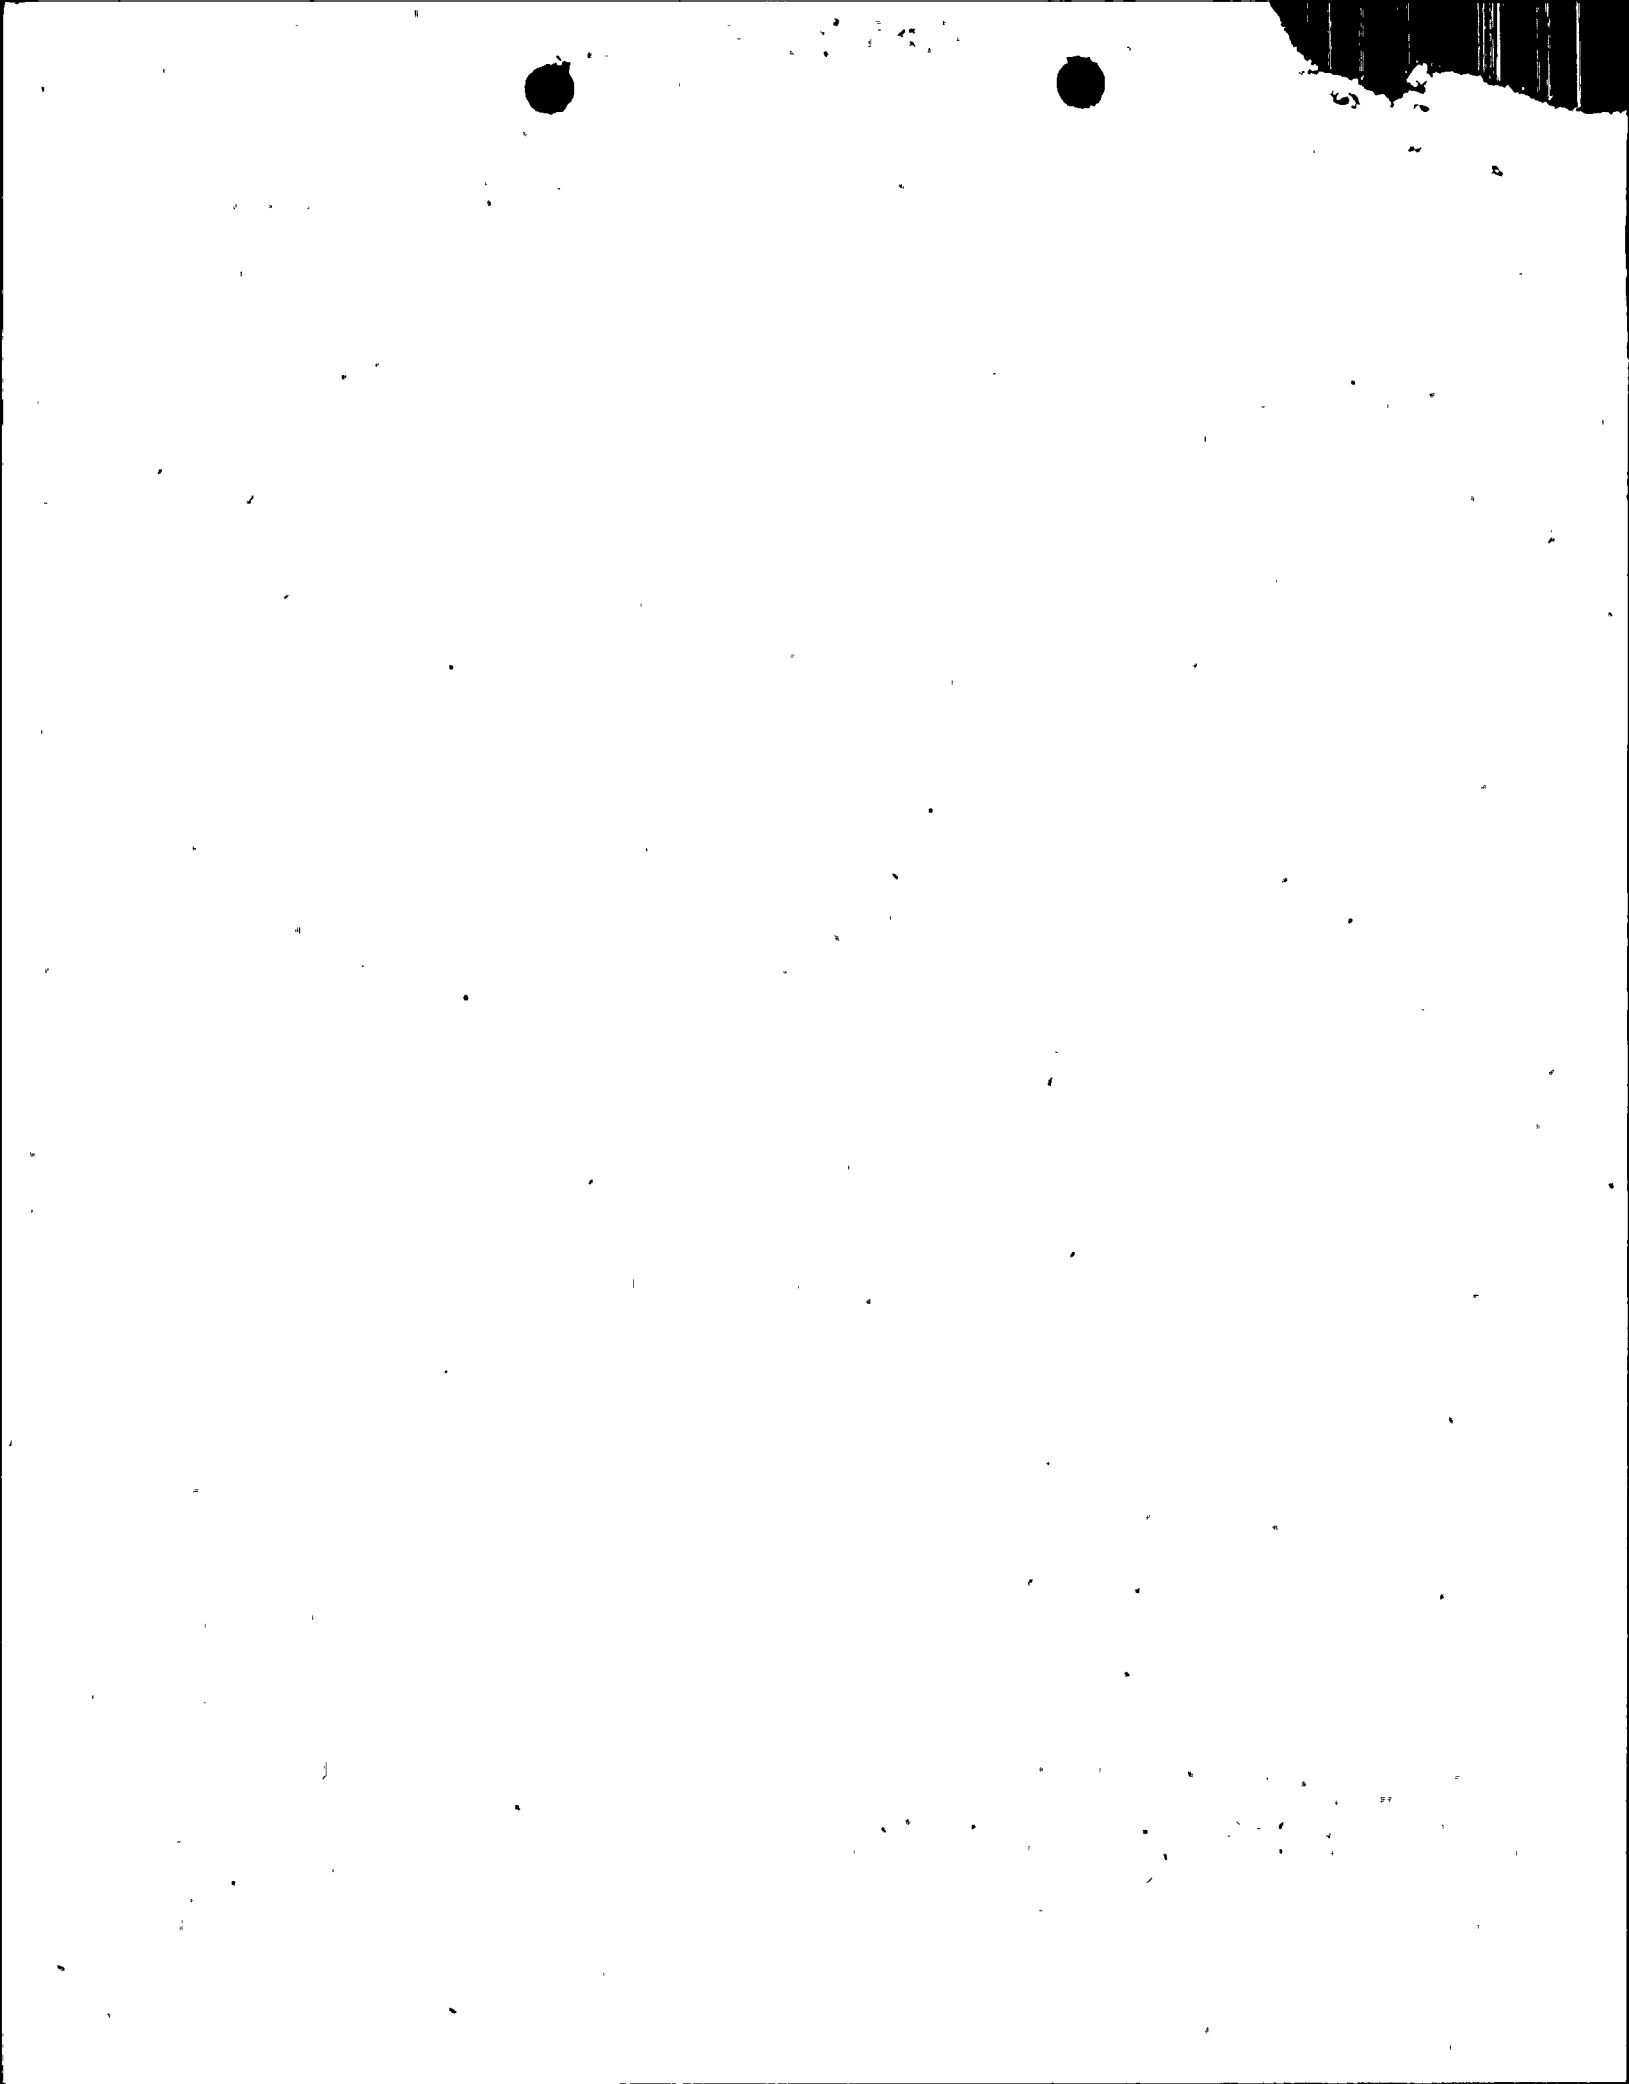



FPL

L-96-189  
10 CFR 50.36  
10 CFR 50.4

U.S. Nuclear Regulatory Commission  
Attn: Document Control Desk  
Washington, DC 20555

Gentlemen:

Re: St. Lucie Unit 1  
Docket No. 50-335  
Special Report  
Steam Generator Tube Plugging Report

This letter is being sent pursuant to St. Lucie Unit 1 Technical Specification 4.4.5.5.a. The following number of tubes were plugged during the Spring 1996 Unit 1 refueling outage (SL1-14):

Steam Generator 1A - 1021  
Steam Generator 1B - 1060

Cumulative total tubes plugged during this outage and previous outages:

Steam Generator 1A - 2159  
Steam Generator 1B - 1834

Should you have any questions on this information, please contact us.

Very truly yours,

J. A. Stall  
Vice President  
St. Lucie Plant

JAS/GRM

cc: Stewart D. Ebnetter, Regional Administrator, Region II, USNRC  
Senior Resident Inspector, USNRC, St. Lucie Plant

9607250292 960725  
PDR ADOCK 05000335  
P PDR

ADO1  
1/0

