

CATEGORY 1

REGULATOR INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9708140033 DOC. DATE: 97/08/06 NOTARIZED: NO DOCKET #
FACIL: 50-389 St. Lucie Plant, Unit 2, Florida Power & Light Co. 05000389
AUTH. NAME AUTHOR AFFILIATION
STALL, J.A. Florida Power & Light Co.
RECIP. NAME RECIPIENT AFFILIATION
Document Control Branch (Document Control Desk)

SUBJECT: Forwards "SG Tube ISI Special Rept" required by sections 4.4.5.5.b & 6.9.2 of plant Unit 2 TS for Spring 1997 refueling outage.

DISTRIBUTION CODE: A047D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 1+17
TITLE: OR Submittal: Inservice/Testing/Relief from ASME Code - GL-89-04

NOTES:

	RECIPIENT		COPIES		RECIPIENT	COPIES	
	ID CODE/NAME	LTR	ENCL	ID CODE/NAME		LTR	ENCL
	PD2-3 LA	1	1	PD2-3 PD	1	1	
	WIENS, L.	1	1				
INTERNAL:	ACRS	1	1	AEOD/SPD/RAB	1	1	
	FILE CENTER 02	1	1	NRR/DE/EMEB	1	1	
	NUDGS ABSTRACT	1	1	OGC/HDS3	1	0	
	RES/DET/EIB	1	1	RES/DET/EMEB	1	1	
EXTERNAL:	LITCO ANDERSON	1	1	NOAC	1	1	
	NRC PDR	1	1				


NOTE TO ALL "RIDS" RECIPIENTS:
PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,
ROOM OWFN 5D-5 (EXT. 415-2083) TO ELIMINATE YOUR NAME FROM
DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 14 ENCL 13

C
A
T
E
G
O
R
Y

1

D
O
C
U
M
E
N
T

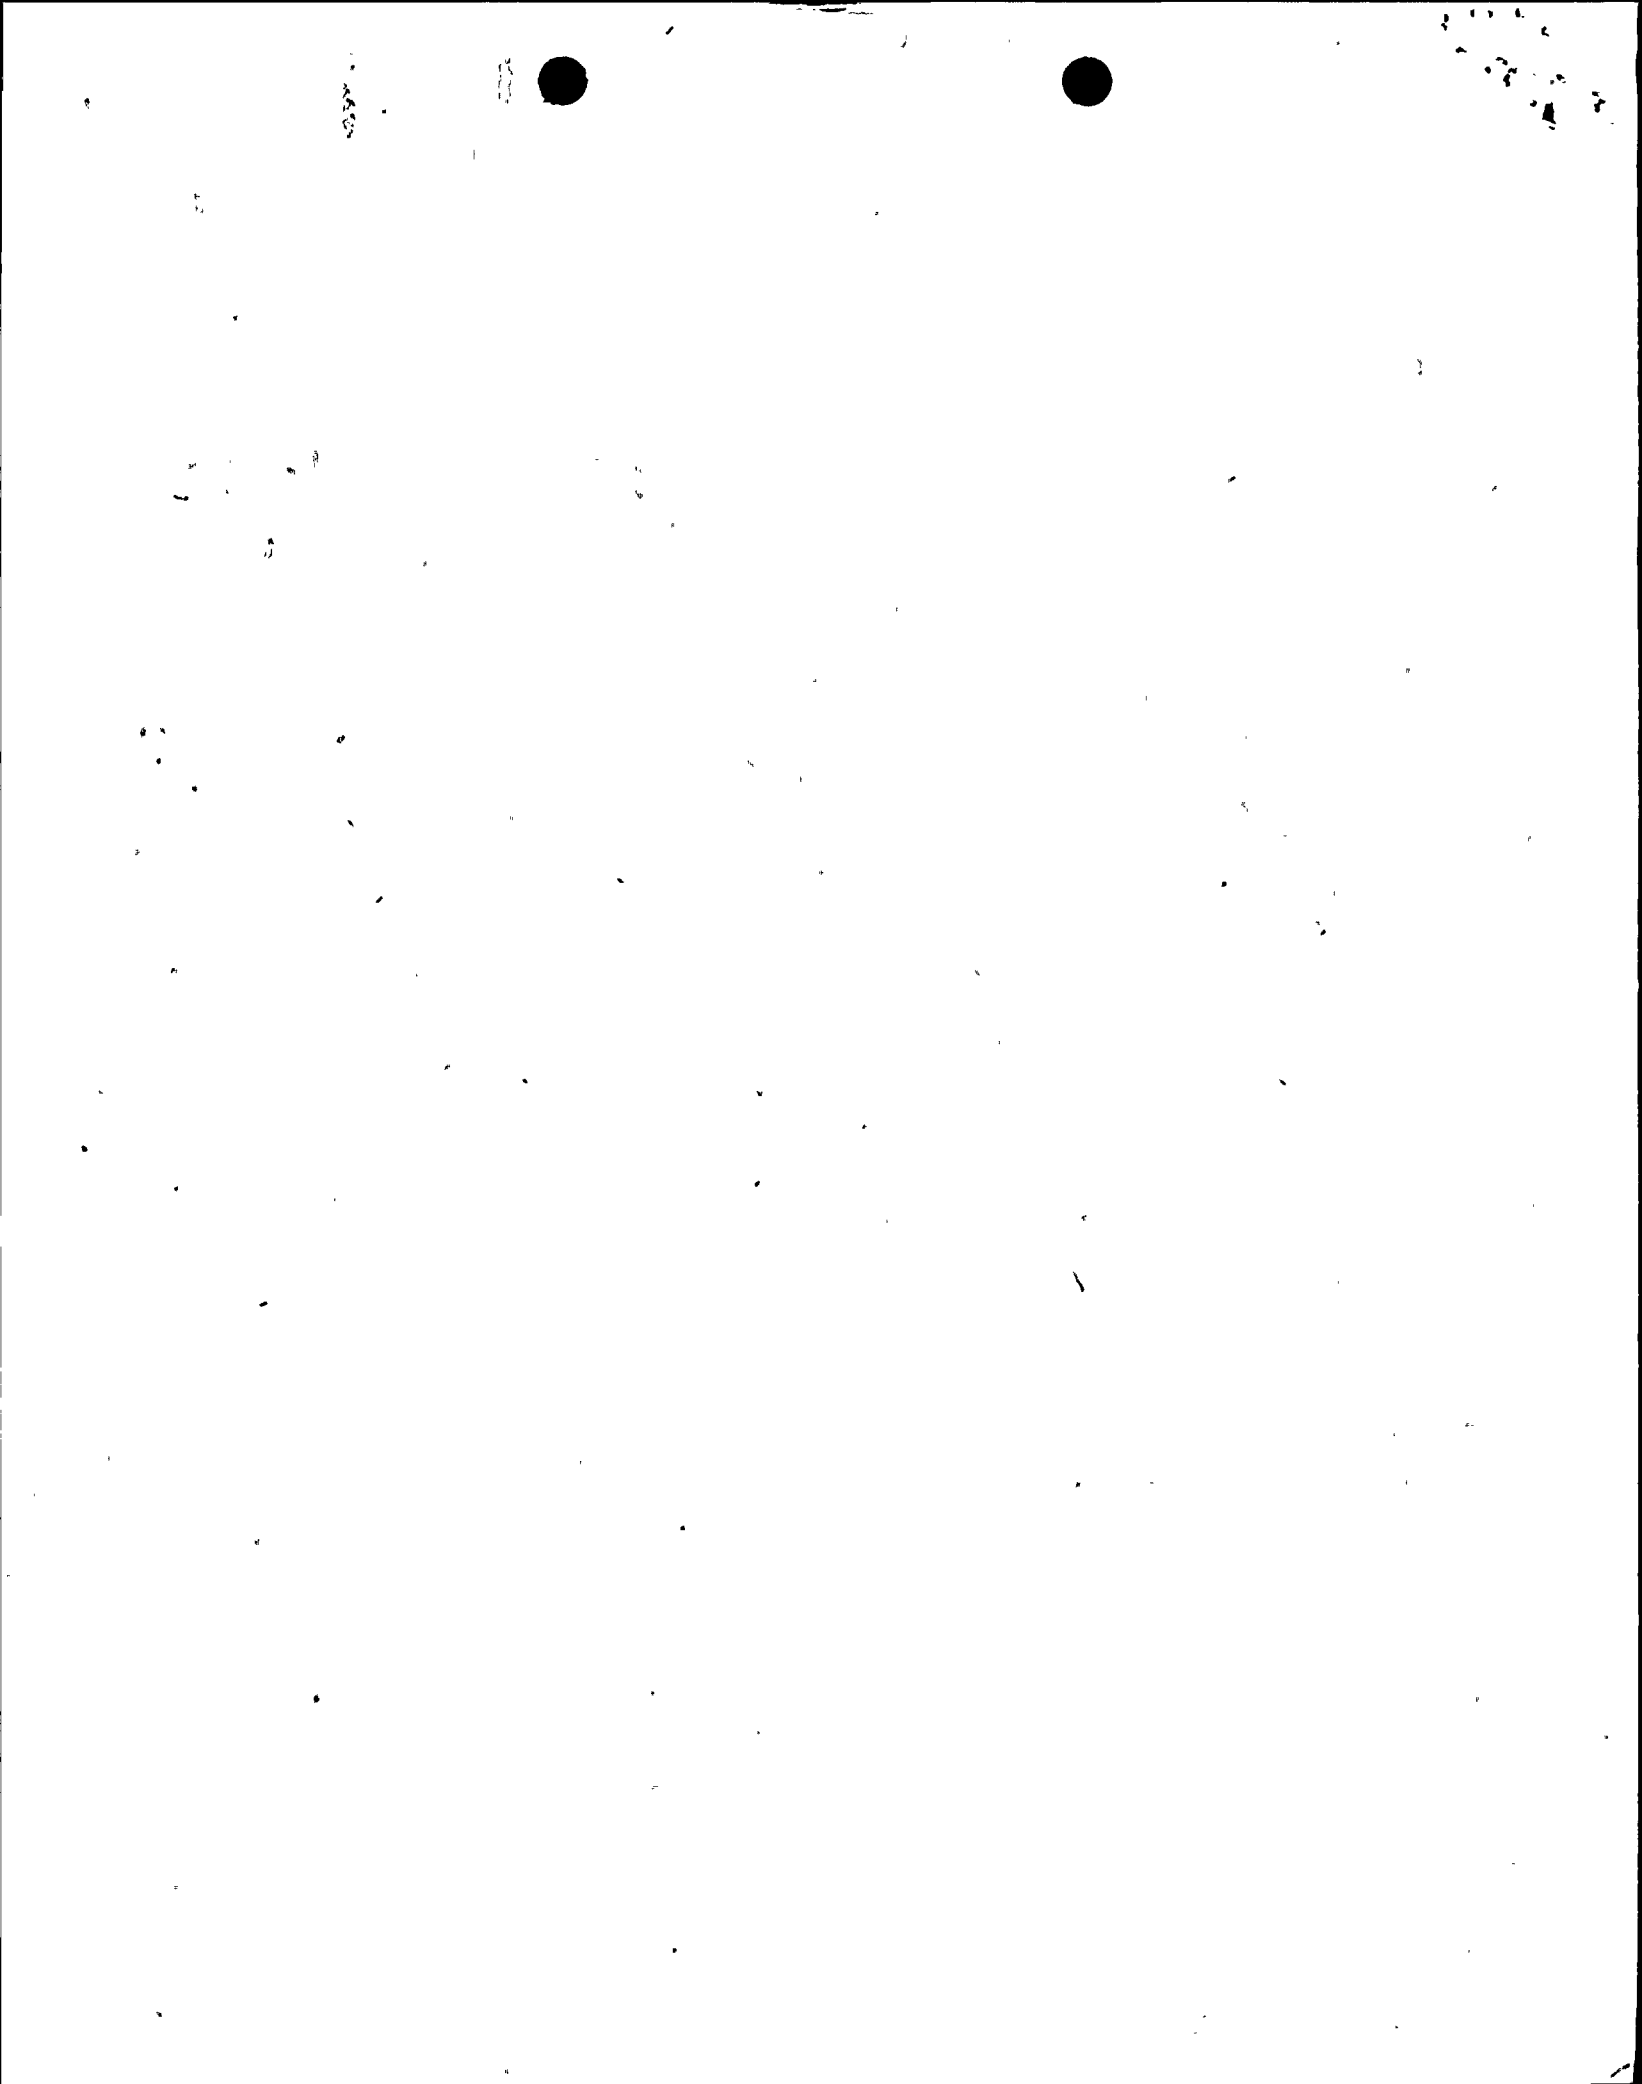



August 6, 1997

L-97-198
10 CFR 50.36

U. S. Nuclear Regulatory Commission
Attn: Document Control Desk
Washington, DC 20555

Re: St. Lucie Unit 2
Docket No. 50-389
1997 Steam Generator Tube
Inservice Inspection Special Report

Attached is the Steam Generator Tube Inservice Inspection Special Report required by sections 4.4.5.5.b and 6.9.2 of the St. Lucie Unit 2 Technical Specifications for the Spring 1997 refueling outage (SL2-10). The report is to be submitted within one year of completing the refueling outage steam generator inservice inspection.

Should there be any questions, please contact us.

Very truly yours,

J. A. Stall
Vice President
St. Lucie Plant

JAS:GRM

Attachment

cc: Regional Administrator, Region II, USNRC
Senior Resident Inspector, USNRC, St. Lucie Plant

A047
/ /

120040

9708140033 970806
PDR ADOCK 05000389
G PDR



