

# CATEGORY 1

## REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9711120270    DOC.DATE: 97/11/05    NOTARIZED: NO    DOCKET #  
 FACIL: 50-335 St. Lucie Plant, Unit 1, Florida Power & Light Co.    05000335  
 50-389 St. Lucie Plant, Unit 2, Florida Power & Light Co.    05000389  
 AUTH.NAME    AUTHOR AFFILIATION  
 STALL, J.A.    Florida Power & Light Co.  
 RECIP.NAME    RECIPIENT AFFILIATION  
                  Document Control Branch (Document Control Desk)

SUBJECT: Forwards corrected FFD program performance data for periods 960630, 961231 & 970630. Computer sys used to rack employment classification of individuals tested grouped personnel into incorrect categories. New regulatory commitments listed.

DISTRIBUTION CODE: A021D    COPIES RECEIVED: LTR 1 ENCL 1    SIZE: 7  
 TITLE: "Semiannual Fitness for Duty Program Performance Rept/Data" 10CFR26.7


### NOTES:

	RECIPIENT ID CODE/NAME	COPIES LTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTR ENCL
	PD2-3 PD	1 1	WIENS, L.	1 1
INTERNAL:	ACRS	1 1	<u>FILE CENTER 01</u>	1 1
	NRR/DRCH/HOLB	1 1	NRR/DRPM/PSGB	1 1
	NUDOCS-ABSTRACT	1 1	RGN2	1 1
EXTERNAL:	NOAC	1 1	NRC PDR	1 1

NOTE TO ALL "RIDS" RECIPIENTS:  
 PLEASE HELP US TO REDUCE WASTE. TO HAVE YOUR NAME OR ORGANIZATION REMOVED FROM DISTRIBUTION LISTS OR REDUCE THE NUMBER OF COPIES RECEIVED BY YOU OR YOUR ORGANIZATION, CONTACT THE DOCUMENT CONTROL DESK (DCD) ON EXTENSION 415-2083

TOTAL NUMBER OF COPIES REQUIRED: LTR 10 ENCL 10

C  
A  
T  
E  
G  
O  
R  
Y  
1  
D  
O  
C  
U  
M  
E  
N  
T

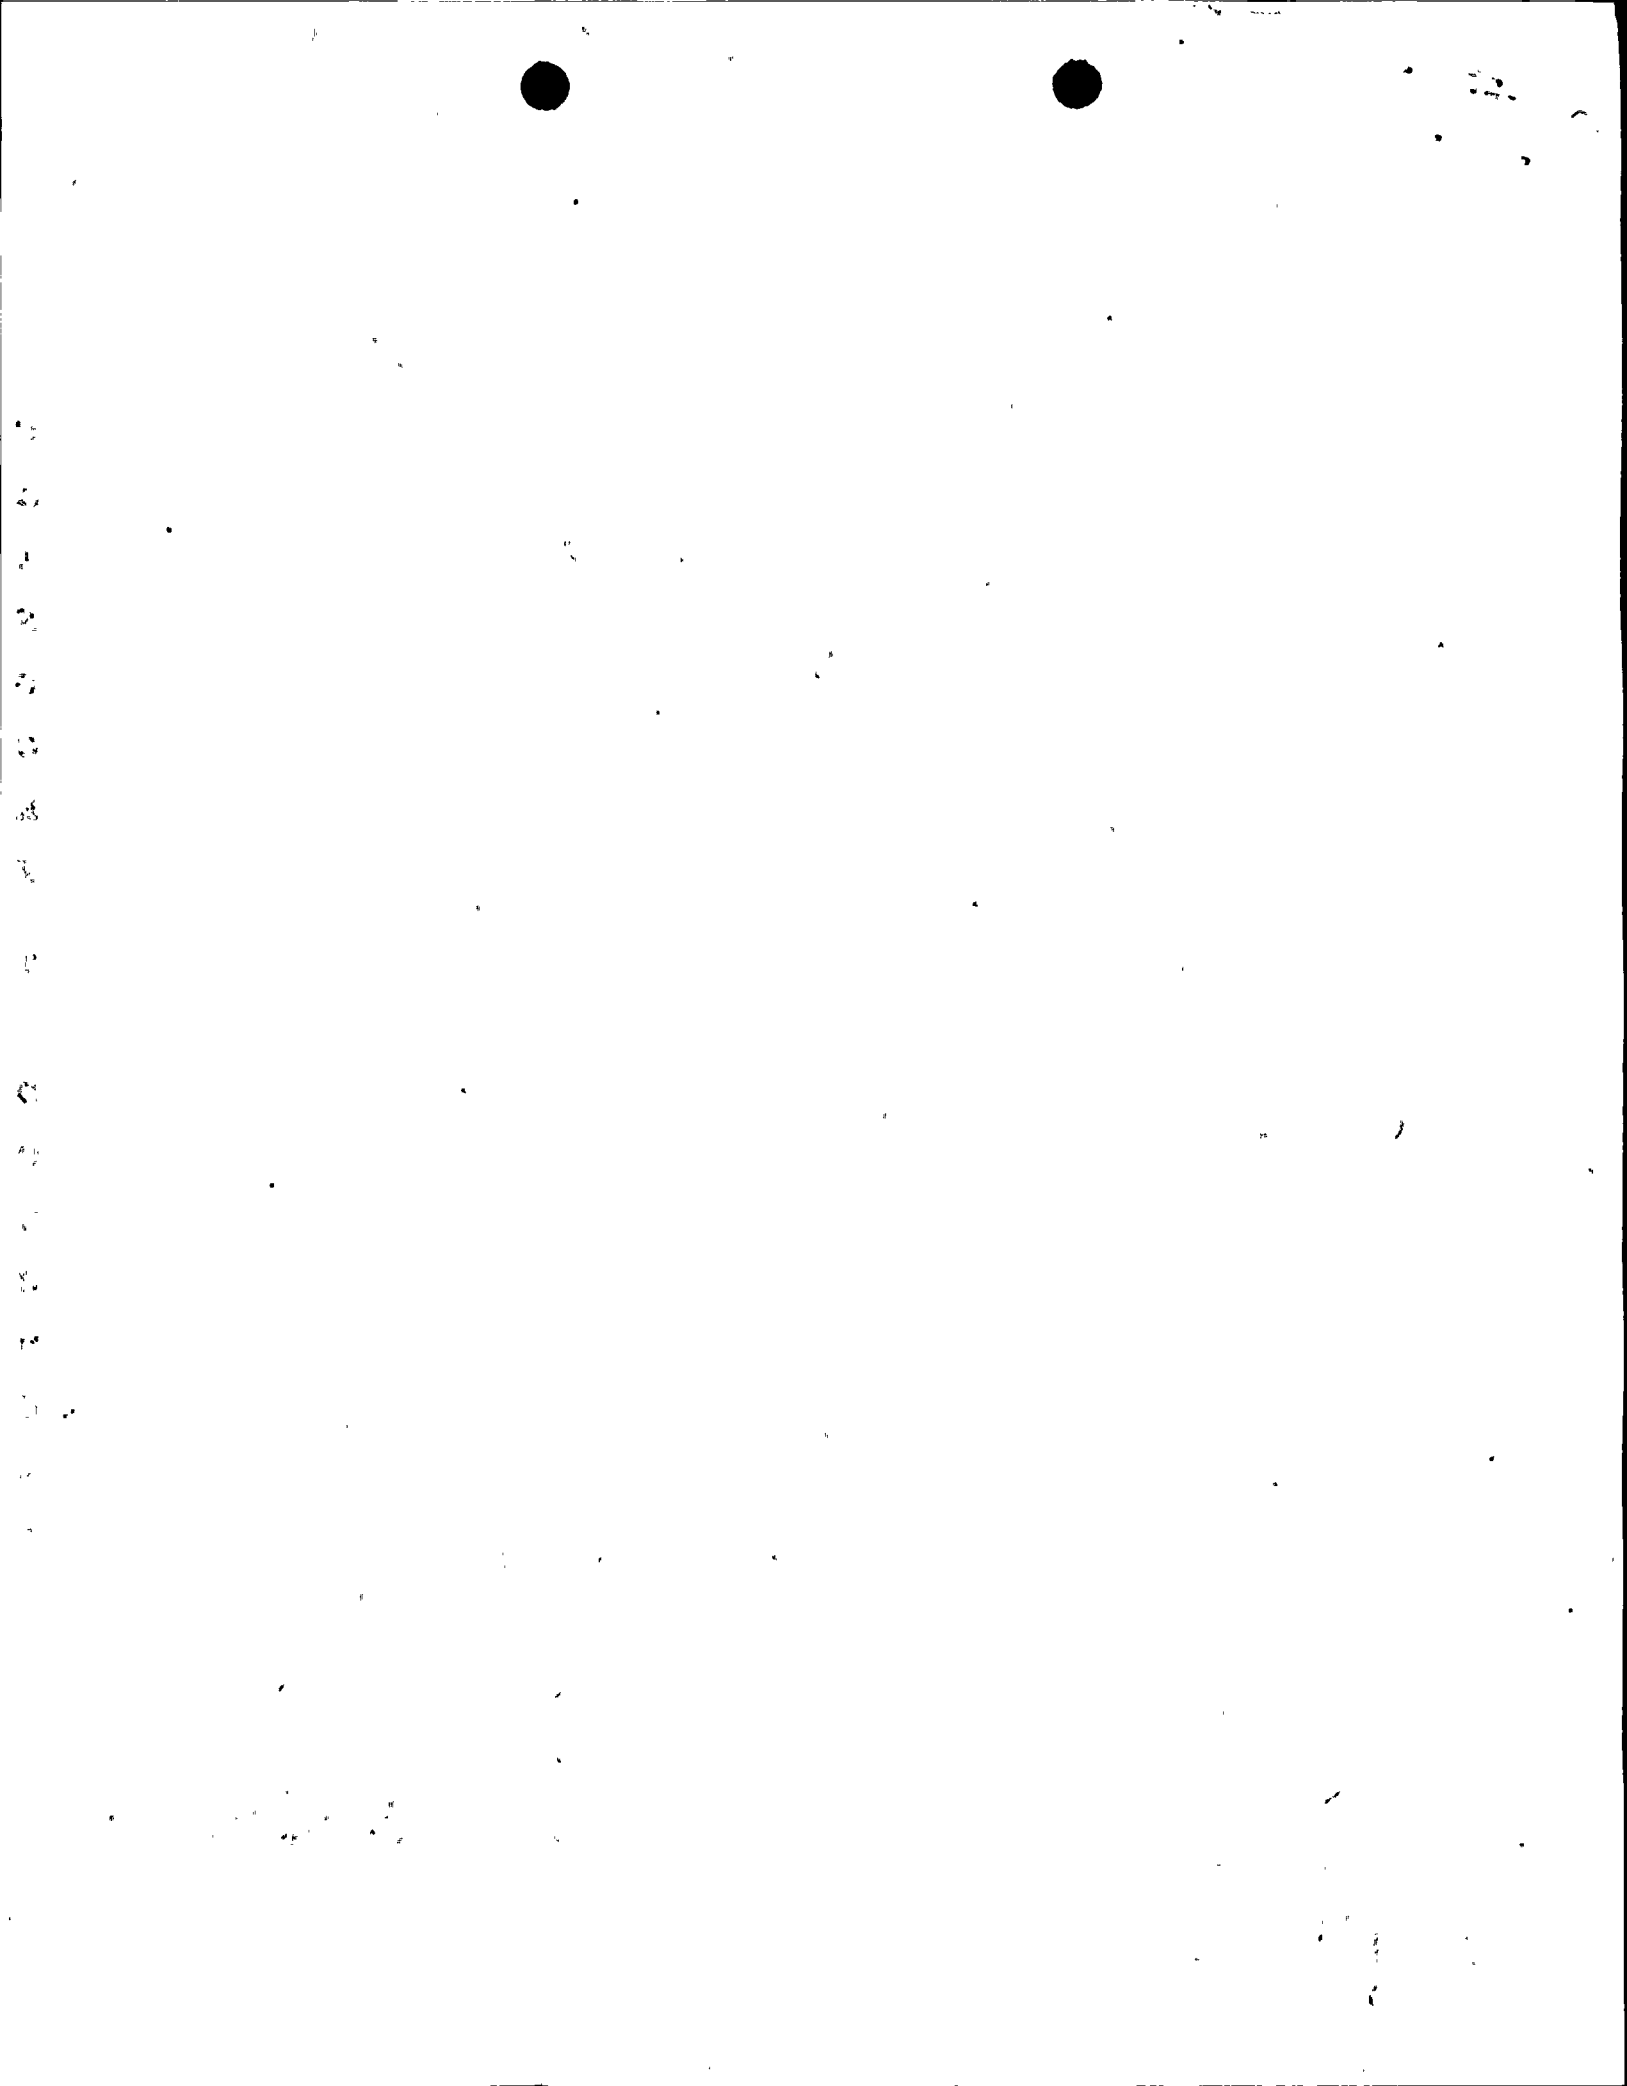



FPL

Florida Power & Light Company, 6351 S. Ocean Drive, Jensen Beach, FL 34957

November 5, 1997

L-97-282  
10 CFR 50.4  
10 CFR 26.71

U. S. Nuclear Regulatory Commission  
Attn: Document Control Desk  
Washington, D. C. 20555

RE: St. Lucie Units 1 and 2  
Docket Nos. 50-335 and 50-389  
Corrected Semi-Annual Fitness-For-Duty  
Program Performance Data Reports

Florida Power & Light Company (FPL) has identified an administrative error in the information used to prepare the semi-annual fitness for duty (FFD) data reports required by 10 CFR 26.71(d). The computer system used to track the employment classification of individuals tested grouped personnel into incorrect categories. Long term corrective actions to correct the coding for the permanent reports are scheduled to be complete by March 15, 1998. Until the coding error is corrected, FPL will have interim corrective actions in place to assure the accuracy of the semi-annual reports.

As part of the corrective actions, FPL produced ad hoc reports to validate and correct the classification data and evaluated the results against the FFD data reports for the periods ending June 30, 1996, December 31, 1996, and June 30, 1997. The FFD reports for these periods were previously submitted by FPL letters L-96-213, dated August 23, 1996, L-97-36, dated February 18, 1997, and L-97-197, dated August 6, 1997.

Attached are the corrected FFD program performance data reports for the periods ending June 30, 1996, December 31, 1996, and June 30, 1997.

This letter contains two new regulatory commitments. The first is to complete the coding modifications to the permanent reports by March 15, 1998. The second is to have interim controls in place until the computer coding modification is completed. Please contact us if there are any questions about this submittal.

Very truly yours,

J. A. Stall  
Vice President  
St. Lucie Plant

*A021/1*

120058

JAS/GRM

cc: Regional Administrator, Region II, USNRC  
Senior Resident Inspector, USNRC, St. Lucie Plant

9711120270 971105  
PDR ADOCK 05000335  
R PDR

an FPL Group company



**Fitness for Duty Program  
Performance Data  
Personnel Subject to 10CFR Part 26**

<b><u>Florida Power &amp; Light</u></b>	<b><u>JUNE 30, 1996</u></b>				
Company	6 Months Ending				
<b><u>St. Lucie Plant</u></b>					
Location					
<b><u>Arthur R. Cummings</u></b>	<b><u>(561) 467-7008</u></b>				
Contact Name	Phone (Include Area Code)				
Cutoffs: Screen/Confirmation (ng/ml) <span style="float:right;"><input type="checkbox"/> Appendix A to 10 CFR Part 26</span>					
Marijuana	50/10	Amphetamines	1000/500	_____	/
Cocaine	300/150	Phencyclidine	25/25	_____	/
Opiates	300/300	Alcohol (%BAC)	.04%	_____	/

TESTING RESULTS		LICENSEE EMPLOYEES		LONG-TERM CONTRACTOR PERSONNEL		SHORT-TERM CONTRACTOR PERSONNEL	
		1495		207		468	
Average Number with Unescorted Access		1495		207		468	
CATEGORIES		# TESTED	# POSITIVE	# TESTED	# POSITIVE	# TESTED	# POSITIVE
Pre-Access		151	0	0	0	941	13
For Cause	Post Accident	0	0	0	0	0	0
	Observed Behavior	1	0	1	1	3	1
Random		390	2	63	0	125	1
Follow-up		21	0	4	0	9	1
Other		0	0	0	0	0	0
<b>TOTAL</b>		<b>563</b>	<b>2</b>	<b>68</b>	<b>1</b>	<b>1078</b>	<b>16</b>



**Breakdown of Confirmed Positive Tests for Specific Substances \*\***


	Marijuana	Cocaine	Opiates	Amphetamines	Phencyclidine	Alcohol	Refusal to Test	1	2	3	4	5	
Licensee Employees		1					1						
Long-Term Contractors						1							
Short-Term Contractors	7	3				3	3						A
<b>PSL TOTALS</b>	<b>7</b>	<b>4</b>				<b>4</b>	<b>4</b>						<b>19</b>

**\*\* All of the positive drug tests listed above exceeded the DHHS/NRC cutoff levels.**

**Fitness for Duty Program  
Performance Data  
Personnel Subject to 10CFR Part 26**

<b><u>Florida Power &amp; Light</u></b>		<b><u>DECEMBER 31, 1996</u></b>		
Company		6 Months Ending		
<b><u>St. Lucie Plant</u></b>				
Location				
<b><u>Arthur R. Cummings</u></b>		<b><u>(561) 467-7008</u></b>		
Contact Name		Phone (Include Area Code)		
Cutoffs: Screen/Confirmation (ng/ml)		<input type="checkbox"/> Appendix A to 10 CFR Part 26		
Marijuana	50/10	Amphetamines	1000/500	_____ /
Cocaine	300/150	Phencyclidine	25/25	_____ /
Opiates	300/300	Alcohol (%BAC)	.04%	_____ /

TESTING RESULTS	LICENSEE EMPLOYEES		LONG-TERM CONTRACTOR PERSONNEL		SHORT-TERM CONTRACTOR PERSONNEL	
	# TESTED	# POSITIVE	# TESTED	# POSITIVE	# TESTED	# POSITIVE
Average Number with Unescorted Access	1151		147		177	
Pre-Access	65	1	0	0	278	2
For Cause	Post Accident	0	0	0	0	0
	Observed Behavior	0	0	0	0	1
Random	300	1	41	0	40	0
Follow-up	34	0	4	0	0	0
Other	0	0	0	0	0	0
<b>TOTAL</b>	<b>399</b>	<b>2</b>	<b>45</b>	<b>0</b>	<b>319</b>	<b>3</b>

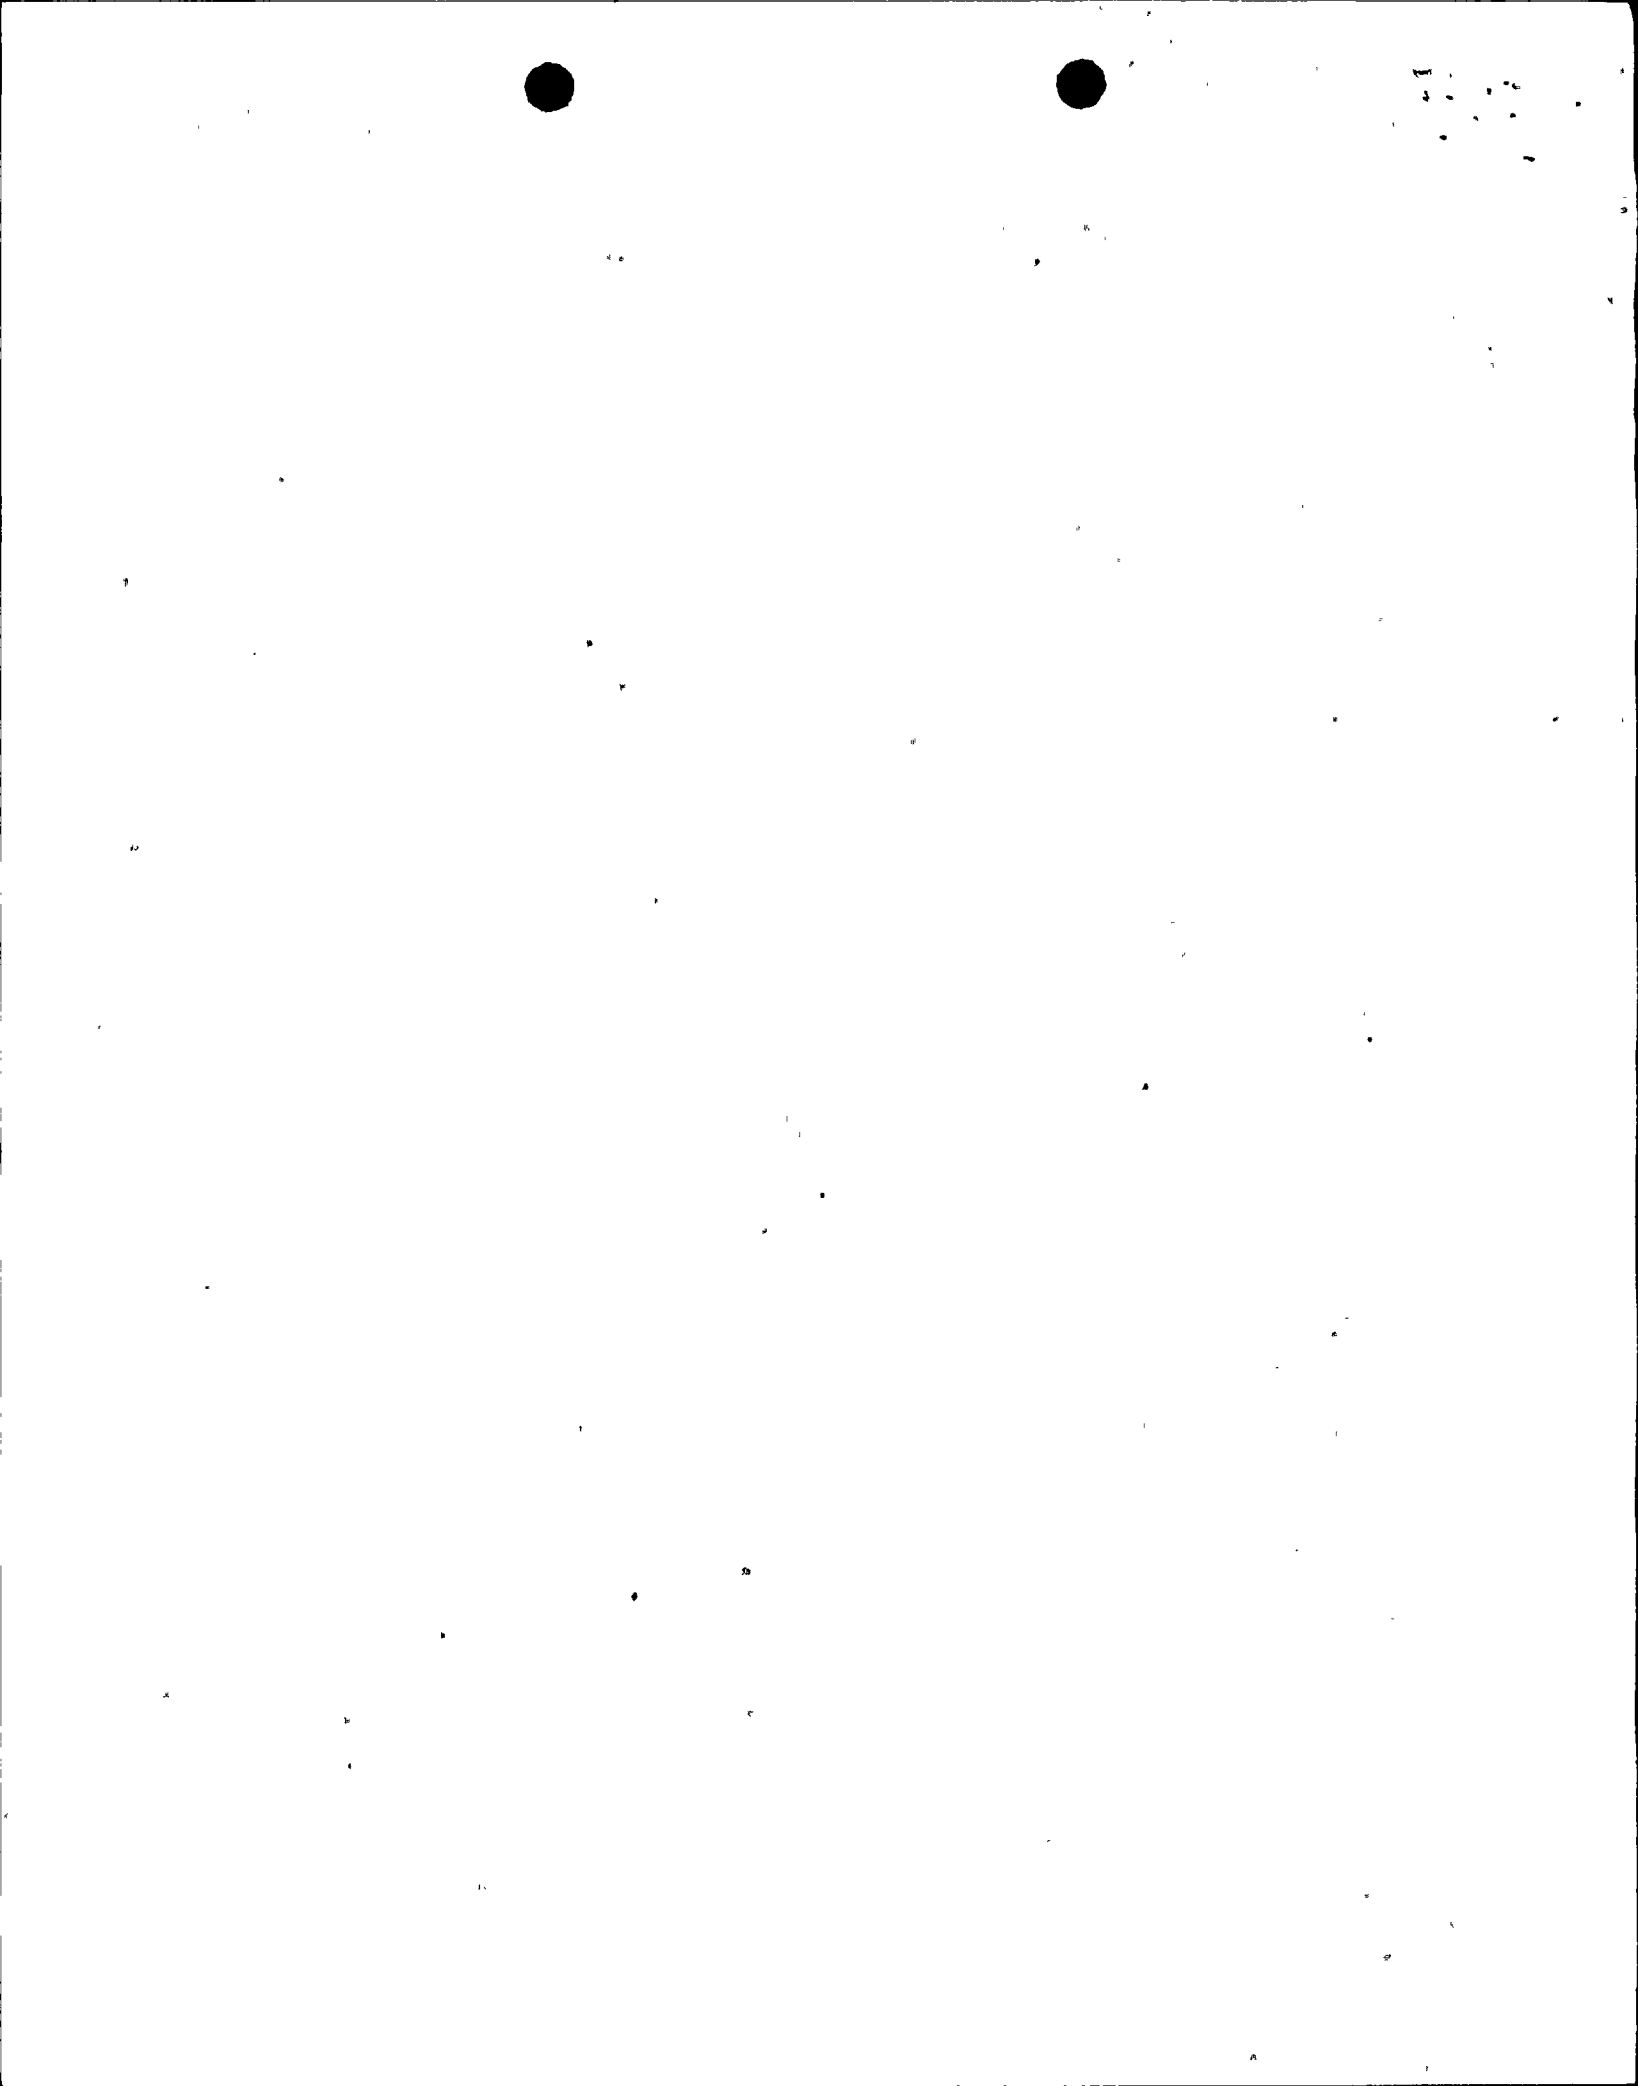



**Breakdown of Confirmed Positive Tests for Specific Substances \*\***

	Marijuana	Cocaine	Opiates	Amphetamines	Phencyclidine	Alcohol	Refusal to Test	1	2	3	4	5	
Licensee Employees	2												
Long-Term Contractors													
Short-Term Contractors	2					1							A
<b>PSL TOTALS</b>	<b>4</b>					<b>1</b>							<b>5</b>

**\*\* All of the positive drug tests listed above exceeded the DHHS/NRC cutoff levels with the exception of one random test for cannabinoids. The test resulted in a confirmation for cannabinoids at 14ng/ml.**

**Fitness for Duty Program  
Performance Data  
Personnel Subject to 10CFR Part 26**

<b><u>Florida Power &amp; Light</u></b>	<b><u>June 30, 1997</u></b>				
Company	6 Months Ending				
<b><u>St. Lucie Plant</u></b>					
Location					
<b><u>Arthur R. Cummings</u></b>	<b><u>(561) 467-7008</u></b>				
Contact Name	Phone (Include Area Code)				
Cutoffs: Screen/Confirmation (ng/ml) <span style="float: right;"><input type="checkbox"/> Appendix A to 10 CFR Part 26</span>					
Marijuana	50/10	Amphetamines	1000/500	_____	/
Cocaine	300/150	Phencyclidine	25/25	_____	/
Opiates	300/300	Alcohol (%BAC)	.04%	_____	/

TESTING RESULTS		LICENSEE EMPLOYEES		LONG-TERM CONTRACTOR PERSONNEL		SHORT-TERM CONTRACTOR PERSONNEL	
		1122		141		546	
Average Number with Unescorted Access							
CATEGORIES		# TESTED	# POSITIVE	# TESTED	# POSITIVE	# TESTED	# POSITIVE
Pre-Access		105	0	0	0	920	25
For Cause	Post Accident	0	0	0	0	0	0
	Observed Behavior	0	0	0	0	2	0
Random		353	1	39	0	200	2
Follow-up		23	0	4	0	9	0
Other		0	0	0	0	0	0
<b>TOTAL</b>		<b>481</b>	<b>1</b>	<b>43</b>	<b>0</b>	<b>1131</b>	<b>27</b>



Handwritten marks and scribbles in the top right corner.

**Breakdown of Confirmed Positive Tests for Specific Substances \*\***

	Manjuana	Cocaine	Opiates	Amphetamines	Phencyclidine	Alcohol	Refusal to Test	1	2	3	4	5	
Licensee Employees	1												
Long-Term Contractors													
Short-Term Contractors	22	2	1			2							A
<b>PSL TOTALS</b>	<b>23</b>	<b>2</b>	<b>1</b>			<b>2</b>							<b>28</b>

**\*\* All of the positive drug tests listed above exceeded the DHHS/NRC cutoff levels.**

