



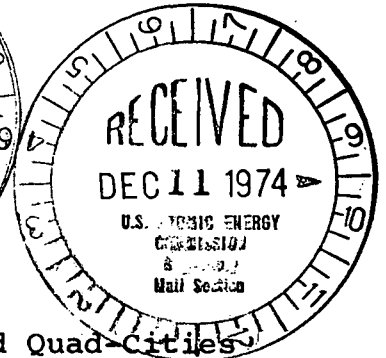

**Commonwealth Edison**  
 One First National Plaza, Chicago, Illinois  
 Address Reply to: Post Office Box 767  
 Chicago, Illinois 60690

Mr. D. L. Ziemann, Chief  
 Operating Reactors - Branch 2  
 Directorate of Licensing  
 Office of Regulation  
 U.S. Atomic Energy Commission  
 Washington, D.C. 20545

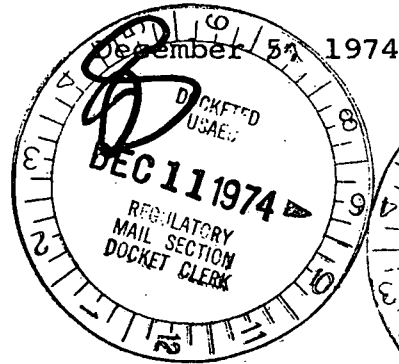

**Subject: Dresden Station Units 2 and 3 and Quad-Cities  
 Station Units 1 and 2 Proposed Changes to  
 Facility Operating Licenses DPR-19, DPR-25,  
 DPR-29 and DPR-30, AEC Dkts 50-237, 50-249,  
 50-254 and 50-265**

Dear Mr. Ziemann:

The subject proposed Technical Specification changes were submitted May 15, 1974 for Quad-Cities Units 1 and 2, May 27, 1974 for Dresden Unit 3, and as part of the Reload No. 1 Licensing Submittal dated August 27, 1974 for Dresden Unit 2. Additional information concerning these proposed changes was submitted October 22, 1974. The proposed specification changes included an error in the equation for adjusting APRM scram and APRM rod block settings. These equations are in Technical Specification Limiting Safety System Settings 2.1.A.1 and 2.1.B and the general form of the equations was proposed as:

$$S_S = 0.65W + 55 \left[ \frac{LTPF}{TPF} \right]$$

and

$$S_{RB} = 0.65W + 43 \left[ \frac{LTPF}{TPF} \right]$$

It is requested that the proposed Technical Specification changes be corrected by deleting the above form of the equations and inserting the following form:

$$S_S = [0.65W + 55] \frac{LTPF}{TPF}$$

$$S_{RB} = [0.65W + 43] \frac{LTPF}{TPF}$$

One signed original and 79 copies of this correction are submitted.

Very truly yours,

*J. S. Abel*  
 J. S. Abel

Nuclear Licensing Administrator  
 Boiling Water Reactors

12440