


Commonwealth Edison Company

ONE FIRST NATIONAL PLAZA ★ CHICAGO, ILLINOIS

Address Reply to:

POST OFFICE BOX 767 ★ CHICAGO, ILLINOIS 60690

Dresden Nuclear Power Station
R. R. #1
Morris, Illinois 60450
May 25, 1972

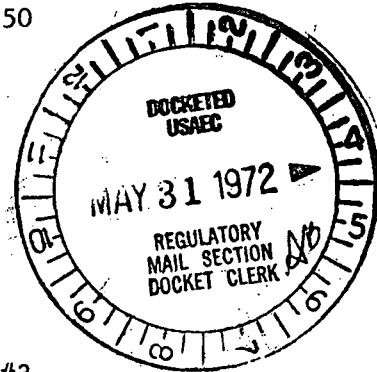

Mr. E. J. Bloch, Director
Division of Reactor Licensing
U.S. Atomic Energy Commission
Washington, D. C. 20545

50 - 249

SUBJECT: LICENSE DPR-25, DRESDEN NUCLEAR POWER STATION UNIT #3
SECTIONS 6.6.A.1 AND 6.6.B.2 OF TECHNICAL SPECIFICATIONS.

Dear Mr. E. J. Bloch:

This is to report a condition relating to the operation of the station in which during monthly surveillance, the High Pressure Coolant Injection (HPCI) turbine would not reset. Failure of the turbine to reset rendered the system incapable of providing coolant injection as required by Section 3.5.C.1 of the Dresden Unit #3 Technical Specifications.

PROBLEM AND INVESTIGATION

HPCI monthly surveillance was being conducted on May 19, 1972, and it was found that the turbine would not reset from the Control Room. The turbine was reset locally and the turbine surveillance test was satisfactorily completed. On Saturday, May 20, 1972, an electrician found a wire broken off the turbine reset solenoid. This wire was reconnected and a new solenoid was ordered. The new solenoid will be installed when received. This surveillance test was last conducted on April 20, 1972, and the turbine reset satisfactorily at this time. In addition, during the plant trip of May 4, 1972, the HPCI turbine was called upon to operate and the turbine reset satisfactorily.

CONCLUSION AND CORRECTIVE ACTION

The cause of the failure appears to be a brittle failure of a terminal on the solenoid. New solenoids have been ordered to replace this solenoid and the similar one on the D-2 HPCI turbine.

pw
misc

Mr. E. J. Bloch

-2-

May 25, 1972

Further investigation of the failure mechanism will be conducted by the Commonwealth Edison Engineering Department and further action will be taken if required.

Sincerely,

W. P. Worden

W. P. Worden
Superintendent

WPW:do