

# ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

## REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 891025030      DOC. DATE: 89/09/30      NOTARIZED: NO      DOCKET #  
 FACIL: 50-244 Robert Emmet Ginna Nuclear Plant, Unit 1, Rochester G      05000244  
 AUTH. NAME      AUTHOR AFFILIATION  
 DODGE, R.E.      Rochester Gas & Electric Corp.  
 MECREY, R.C.      Rochester Gas & Electric Corp.  
 RECIP. NAME      RECIPIENT AFFILIATION

SUBJECT: Monthly operating rept for RE Ginna Nuclear Power Station.  
 W/891016 ltr.

DISTRIBUTION CODE: IE24D      COPIES RECEIVED: LTR 1 ENCL 1      SIZE: 5  
 TITLE: Monthly Operating Report (per Tech Specs)

NOTES: License Exp date in accordance with 10CFR2,2.109(9/19/72).      05000244

	RECIPIENT		COPIES			RECIPIENT		COPIES	
	ID CODE/NAME	LTR	ENCL	ID CODE/NAME		LTR	ENCL		
	PD1-3 LA	3	3	PD1-3 PD	1	1			
	JOHNSON, A	1	1						
INTERNAL:	AEOD/DOA	1	1	AEOD/DSP/TPAB	1	1			
	IRM TECH ADV	2	2	NRR/DLPQ/PEB 10	1	1			
	NRR/DOEA/EAB 11	1	1	NRR/DREP/RPB 10	1	1			
	NUDOCS-ABSTRACT	1	1	<u>REG FILE</u> 01	1	1			
	RGN1	1	1						
EXTERNAL:	EG&G SIMPSON, F	1	1	LPDR	1	1			
	NRC PDR	1	1	NSIC	1	1			


*mon  
RTR*

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,  
 ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION  
 LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 19 ENCL 19

R  
I  
D  
S  
/  
A  
D  
D  
S





ROCHESTER GAS AND ELECTRIC CORPORATION • 89 EAST AVENUE, ROCHESTER, N.Y. 14649-0001

TELEPHONE  
AREA CODE 716 546-2700

GINNA STATION

October 16, 1989


US Nuclear Regulatory Commission  
Document Control Desk  
Washington, DC 20555

Subject: Monthly Report for September, 1989  
Operating Status Information  
R. E. Ginna Nuclear Power Plant  
Docket No. 50-244

Dear Sir:

Pursuant to our Technical Specification 6.9.1, attached herewith is the monthly operating status report for Ginna Station for the month of September, 1989.

Very truly yours, .

  
Robert C. Mecredy  
General Manager  
Nuclear Production

RCM/eeh

Attachments

cc: Mr. William T. Russell NRC (1)

8910250303 890930  
PDR ADOCK 05000244  
R PDC

JE24  
11



2  
2

# OPERATING DATA REPORT

DOCKET NO. 50-244

DATE October 1989

COMPLETED BY Robert E. Dodge  
Robert E. Dodge

TELEPHONE (315)524-4446

## OPERATING STATUS

- 1. Unit Name: R.E. GINNA NUCLEAR POWER PLANT
- 2. Reporting Period: September, 1989
- 3. Licensed Thermal Power (MWt): 1520
- 4. Nameplate Rating (Gross MWe): 490
- 5. Design Electrical Rating (Net MWe): 470
- 6. Maximum Dependable Capacity (Gross MWe): 490
- 7. Maximum Dependable Capacity (Net MWe): 470
- 8. If Changes Occur in Capacity Ratings (Items Number 3 Through 7) Since Last Report, Give Reasons:

Notes: The unit operated at approximately 100% reactor power level for the entire report period.

- 9. Power Level to Which Restricted, If Any (Net MWe): \_\_\_\_\_
- 10. Reasons For Restrictions, If Any: \_\_\_\_\_

	This Month	Yr.-to-Date	Cumulative
11. Hours In Reporting Period	720	6,551	173,975
12. Number of Hours Reactor Was Critical	720	4,439.53	136,137.14
13. Reactor Reserve Shutdown Hours	0	0	1,687.55*
14. Hours Generator On-Line	720	4,362.5	133,634.38
15. Unit Reserve Shutdown Hours	0	0	8.5*
16. Gross Thermal Energy Generated (MWH)	1,080,422	6,348,542	188,318,956
17. Gross Electrical Energy Generated (MWH)	359,586	2,123,159	61,922,488
18. Net Electrical Energy Generated (MWH)	341,923	2,016,640	58,761,098
19. Unit Service Factor	100%	66.56%	76.81%
20. Unit Availability Factor	100%	66.56%	76.82%
21. Unit Capacity Factor (Using MDC Net)	101.04%	65.50%	73.22%
22. Unit Capacity Factor (Using DER Net)	101.04%	65.50%	73.22%
23. Unit Forced Outage Rate	0	8.63%	6.45%

24. Shutdowns Scheduled Over Next 6 Months (Type, Date and Duration of Each):  
Annual refueling and maintenance shutdown - 3/30/90; 35 days

25. If Shut Down At End Of Report Period, Estimated Date of Startup:

26. Units In Test Status (Prior to Commercial Operation):	Forecast	Achieved
INITIAL CRITICALITY	_____	_____
INITIAL ELECTRICITY	_____	_____
COMMERCIAL OPERATION	_____	_____

\*Cumulative total commencing 1/1/75



100

100

100

100

100

100

100

100

AVERAGE DAILY UNIT POWER LEVEL

DOCKET NO. 50-244  
UNIT R.E. Ginna Nuclear Power Plant  
DATE October 15, 1989  
COMPLETED BY Robert E. Dodge  
Robert E. Dodge

TELEPHONE 1 (315) 524-4446  
Ext. 396 at Ginna

MONTH September, 1989

DAY AVERAGE DAILY POWER LEVEL  
(MWe-Net)

DAY AVERAGE DAILY POWER LEVEL  
(MWe-Net)

1. 473  
2. 472  
3. 471  
4. 471  
5. 473  
6. 473  
7. 474  
8. 472  
9. 470  
10. 469  
11. 469  
12. 469  
13. 469  
14. 471  
15. 480  
16. 480

17. 481  
18. 481  
19. 481  
20. 480  
21. 478  
22. 477  
23. 476  
24. 477  
25. 476  
26. 476  
27. 477  
28. 476  
29. 477  
30. 478  
31. \_\_\_\_\_

INSTRUCTIONS

On this format, list the average daily unit power level in MWe-Net for each day in the reporting month. Compute to the nearest whole megawatt.

# UNIT SHUTDOWN AND POWER REDUCTIONS

REPORT MONTH September, 1989

DOCKET NO. 50-244  
 UNIT NAME: R.E. GINNA NUCLEAR POWER PLANT  
 DATE: October, 1989  
 COMPLETED BY: Robert E. Dodge  
 TELEPHONE: (315)524-4446 x396

No.	Date	Type 1	Duration (Hours)	Reason 2	Method of Shutting Down Reactor 3	Licensee Event Report #	System Code 4	Component Code 5	Cause & Corrective Action to Prevent Recurrence
									No unit shutdowns or power reduction this report period.

1  
 F: Forced  
 S: Scheduled


2  
 Reason:  
 A-Equipment Failure (Explain)  
 B-Maintenance or Test  
 C-Refueling  
 D-Regulatory Restriction  
 E-Operator Training & License Examination  
 F-Administrative  
 G-Operational Error (Explain)  
 H-Other (Explain)

3  
 Method:  
 1-Manual  
 2-Manual Scram.  
 3-Automatic Scram.  
 4-Other (Explain)

4  
 Exhibit G - Instructions for Preparation of Data Entry Sheets for Licensee Event Report (LER) File (NUREG-0161)

5  
 Exhibit 1 - Same Source



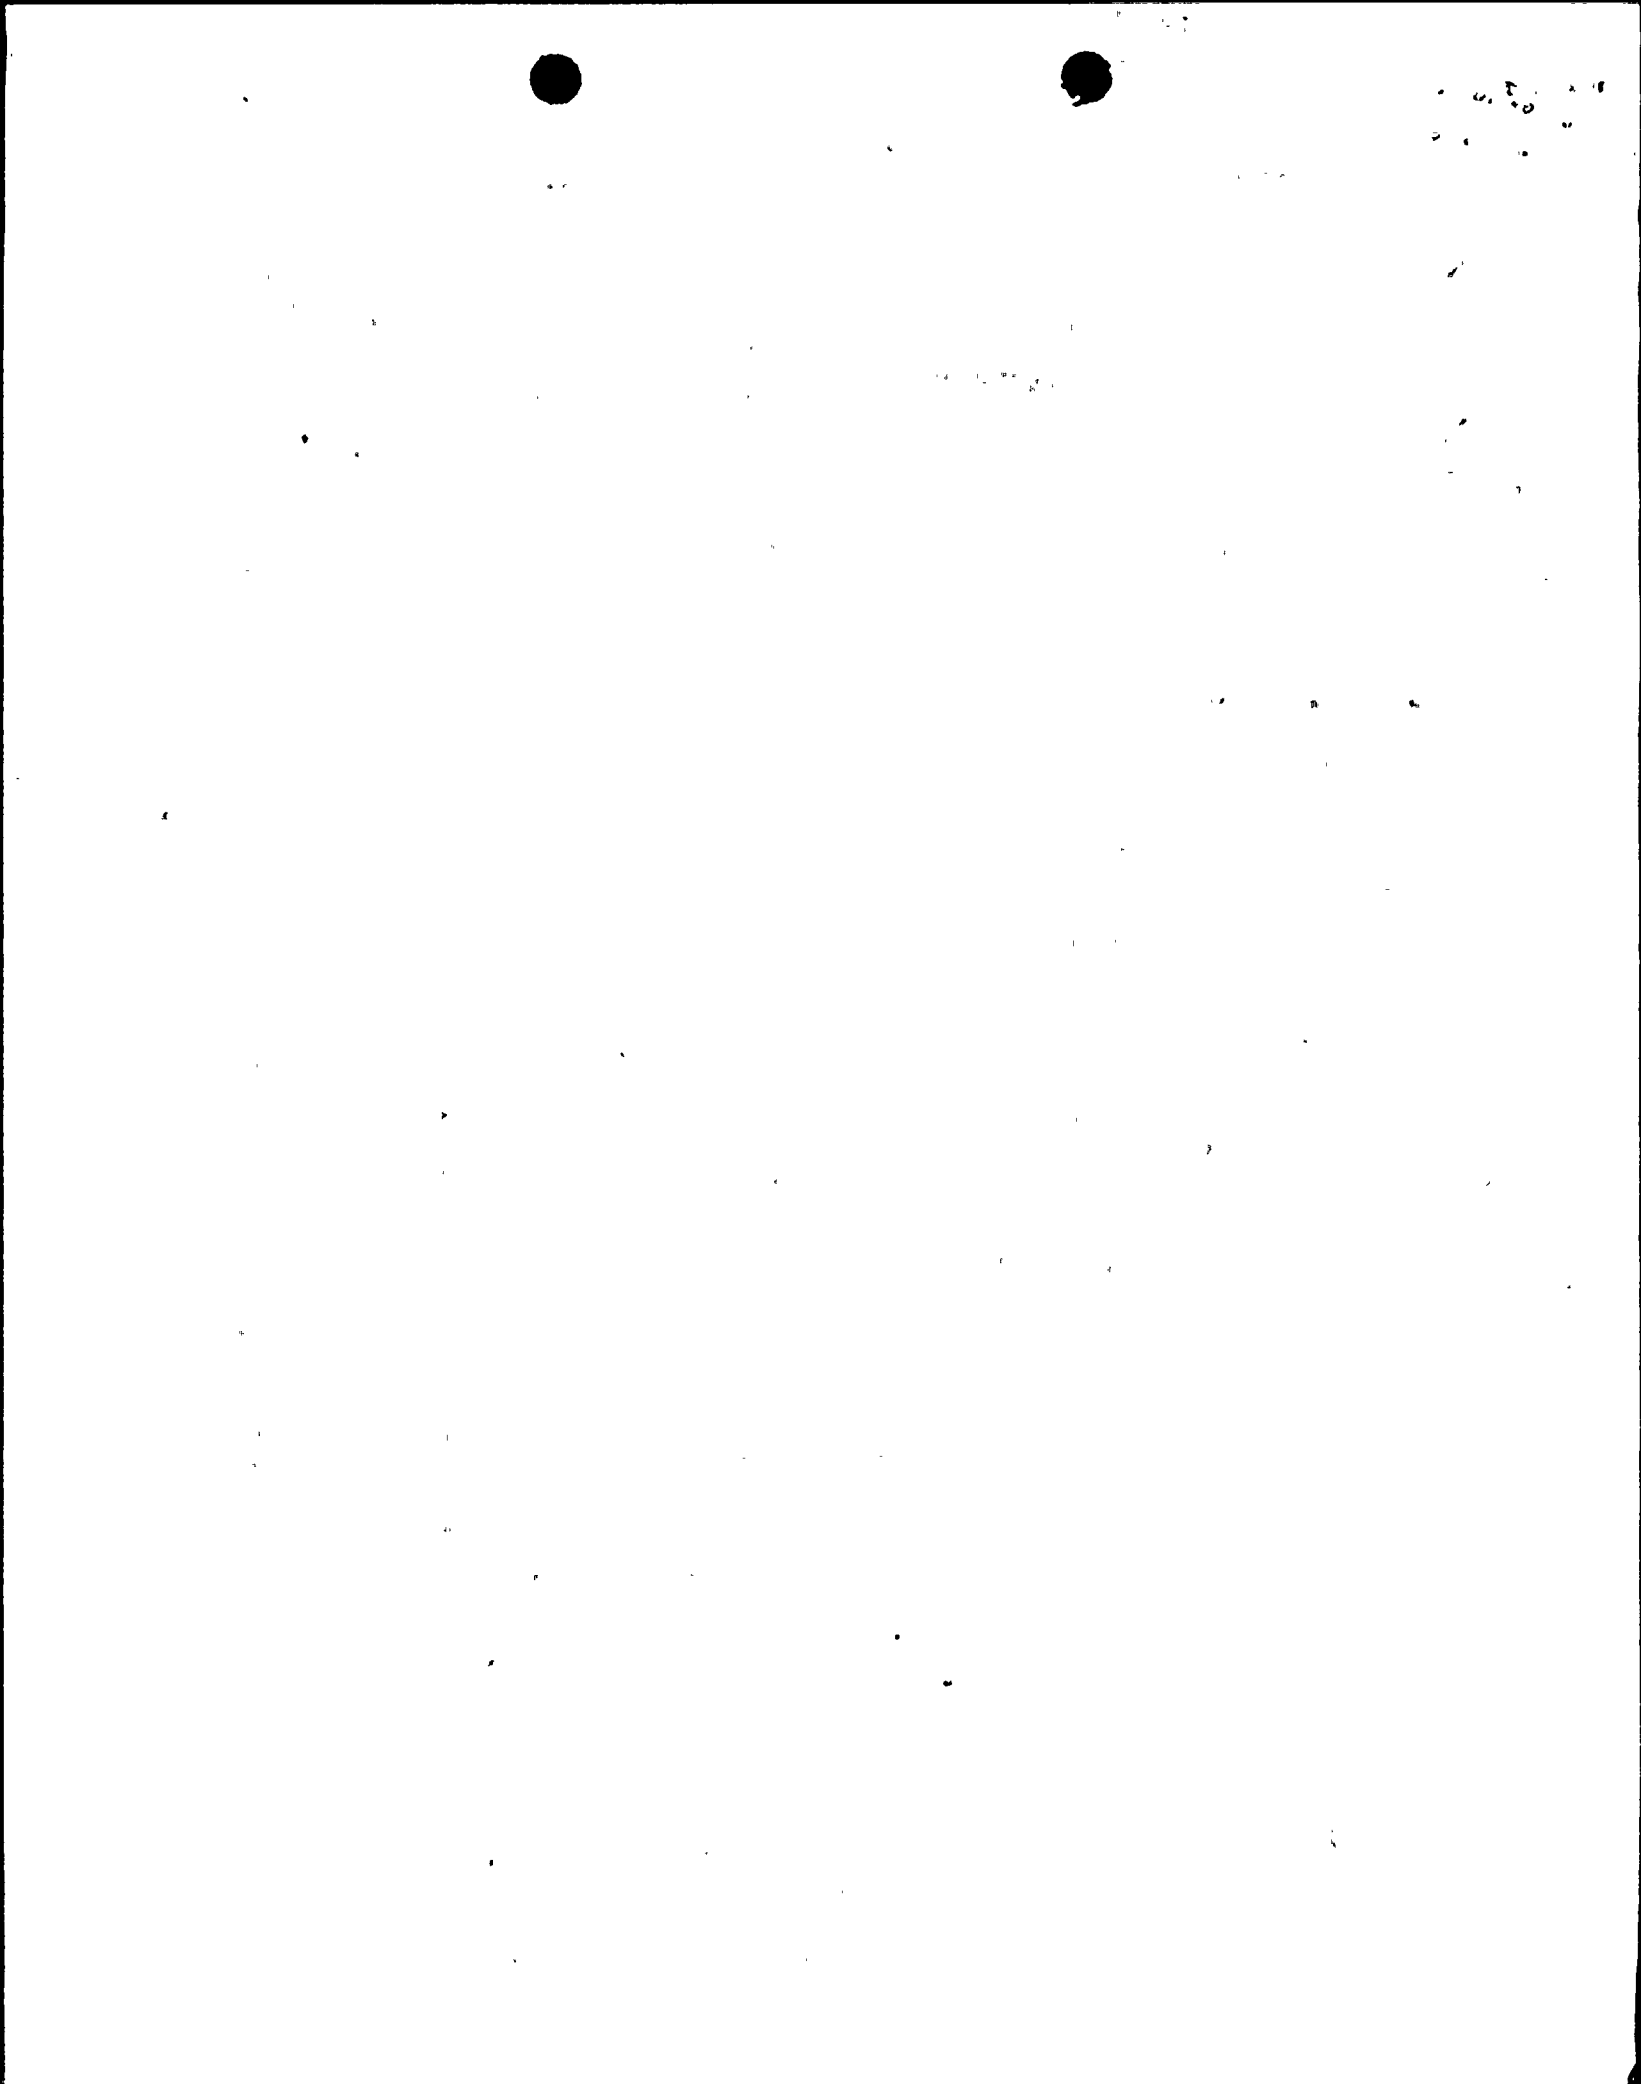

NARRATIVE SUMMARY OF OPERATING EXPERIENCE

DOCKET NO. 50-244  
UNIT R.E. Ginna Nuclear Power Plant  
DATE October 15, 1989  
COMPLETED BY *Robert E. Dodge*  
Robert E. Dodge  
TELEPHONE 1 (315) 524-4446  
EXT. 396 at Ginna

MONTH September, 1989

The unit operated at ~ 100% reactor power level for the entire report period.

