

EOP: ES-3.3	TITLE: POST-SGTR COOLDOWN USING STEAM DUMP	REV: 4 PAGE 1 of 12
----------------	---	------------------------

ROCHESTER GAS AND ELECTRIC CORPORATION

GINNA STATION

CONTROLLED COPY NUMBER 23

TECHNICAL REVIEW

PORC REVIEW DATE 4/4/90

Joseph A. Widay
PLANT SUPERINTENDENT

4/9/90
EFFECTIVE DATE

QA X NON-QA _____ CATEGORY 1.0

REVIEWED BY: _____

GINNA
DATE
TIME
TIME:

9004200721 900409
PDR ADDCK 05000244
P PNU



111

EOP: ES-3.3	TITLE: POST-SGTR COOLDOWN USING STEAM DUMP	REV: 4 PAGE 2 of 12
----------------	---	------------------------

- A. PURPOSE - This procedure provides actions to cool down and depressurize the plant to cold shutdown conditions following a SGTR. This recovery method depressurizes the ruptured S/G by dumping steam.

- B. ENTRY CONDITIONS/SYMPOMS
 - 1. ENTRY CONDITIONS - This procedure is entered from:
 - a. E-3 STEAM GENERATOR TUBE RUPTURE, if plant staff selects backfill method.
 - b. ES-3.2, POST-SGTR COOLDOWN USING BLOWDOWN, when blowdown is not available and plant staff selects steam dump method.



STEP	ACTION/EXPECTED RESPONSE	RESPONSE NOT OBTAINED
------	--------------------------	-----------------------

CAUTION

- o STEAM SHOULD NOT BE RELEASED FROM ANY RUPTURED S/G IF WATER MAY EXIST IN ITS STEAMLINE.
- o AN OFFSITE DOSE EVALUATION SHOULD BE COMPLETED PRIOR TO USING THIS PROCEDURE.

- NOTE:
- o FOLDOUT page should be open AND monitored periodically.
 - o Adverse CNMT values should be used whenever CNMT pressure is greater than 4 psig or CNMT radiation is greater than 10^{-05} R/hr.

- 1 Energize PRZR Heaters As Necessary To Saturate PRZR Water At Ruptured S/G Pressure



EOP:

ES-3.3

TITLE:

POST-SGTR COOLDOWN USING STEAM DUMP

REV: 4

PAGE 4 of 12

STEP

ACTION/EXPECTED RESPONSE

RESPONSE NOT OBTAINED

2 Check If SI ACCUMs Should Be Isolated:

a. Check the following:

- o RCS subcooling based on core exit T/Cs - GREATER THAN 0°F USING FIGURE MIN SUBCOOLING
- o PRZR level - GREATER THAN 5% [30% adverse CNMT]

b. Dispatch AO with locked valve key to locally close breakers for SI ACCUM discharge valves

- MOV-841, MCC C position 12F
- MOV-865, MCC D position 12C

c. Close SI ACCUM outlet valves

- ACCUM A, MOV-841
- ACCUM B, MOV-865

d. Locally reopen breakers for MOV-841 and MOV-865


a. Go to ECA-3.1, SGTR WITH LOSS OF REACTOR COOLANT - SUBCOOLED RECOVERY DESIRED, Step 1.

c. Vent any unisolated ACCUMs:

1) Open vent valves for unisolated SI ACCUMs.

- ACCUM A, AOV-834A
- ACCUM B, AOV-834B

2) Open HCV-945.

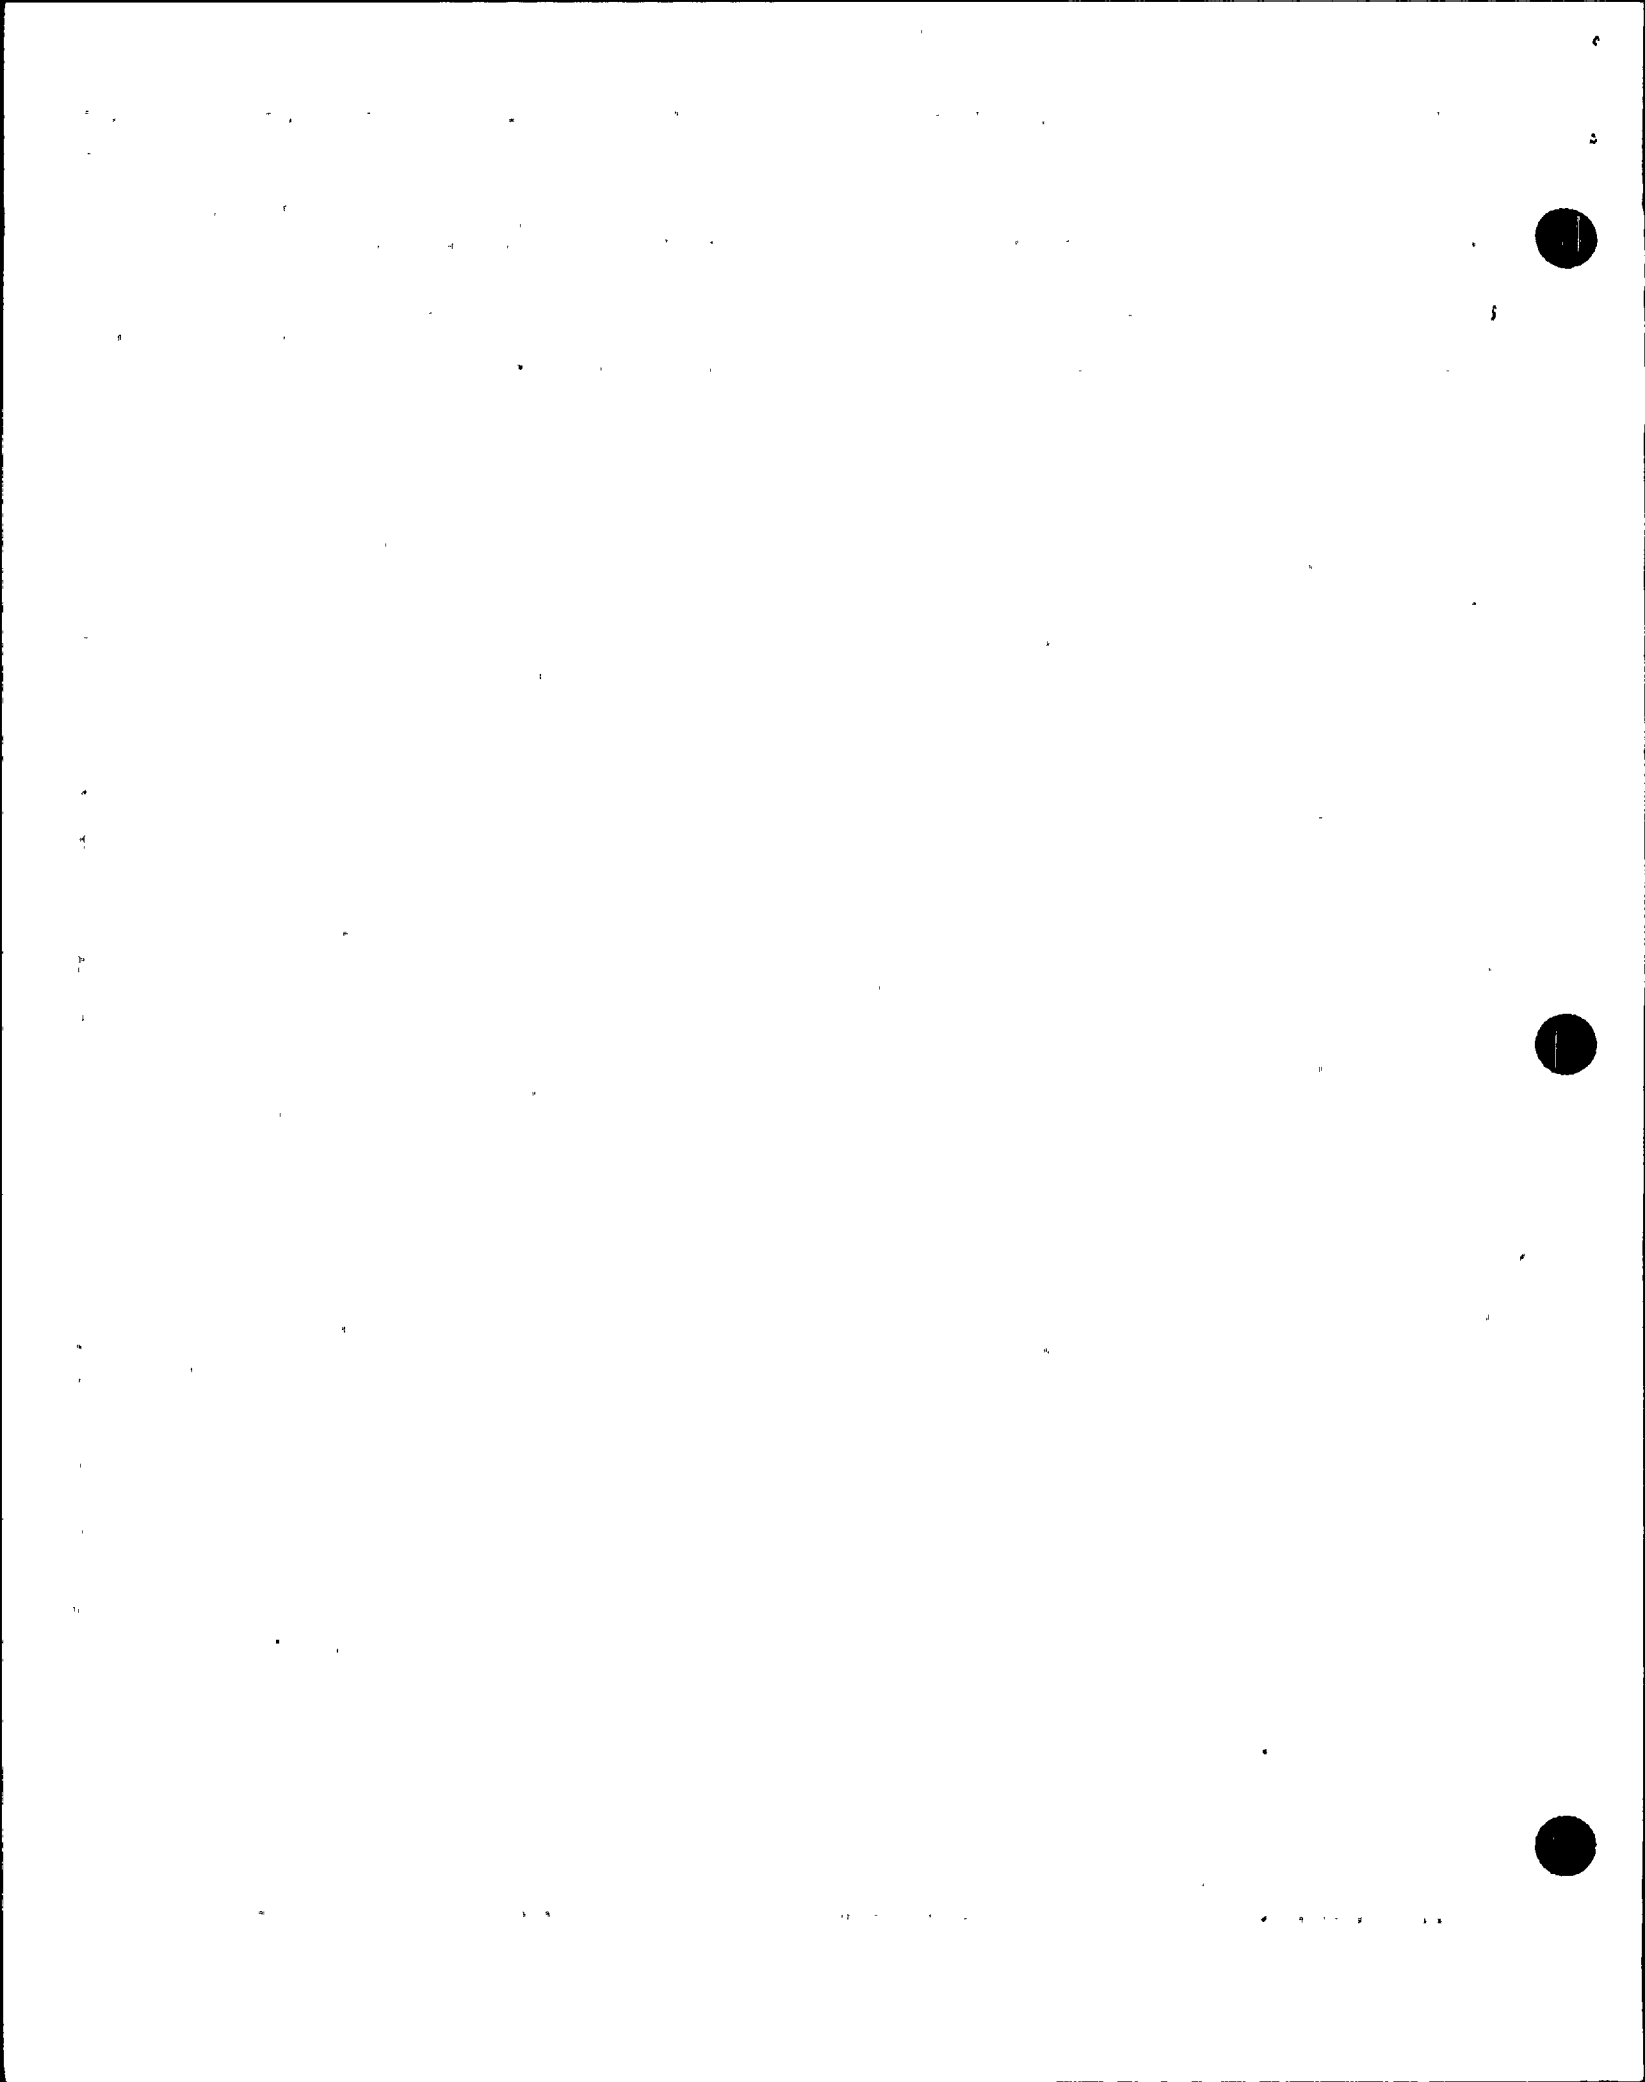

STEP	ACTION/EXPECTED RESPONSE	RESPONSE NOT OBTAINED
------	--------------------------	-----------------------

NOTE: Leakage from ruptured S/G into RCS will dilute RCS boron concentration.

3 Verify Adequate Shutdown Margin

- | | |
|---|-------------------------|
| a. Direct HP to sample RCS and ruptured S/G for boron concentration | b. Borate as necessary. |
| b. Verify boron concentration - GREATER THAN REQUIREMENTS OF FIGURE SDM | |


CAUTION

IF CST LEVEL DECREASES TO LESS THAN 5 FEET, THEN ALTERNATE WATER SOURCES FOR AFW PUMPS WILL BE NECESSARY (REFER TO ER-AFW.1, ALTERNATE WATER SUPPLY TO AFW PUMPS).

NOTE: TDAFW pump flow control valves fail open on loss of IA.

4 Check Intact S/G Level:

- | | |
|--|---|
| a. Narrow range level - GREATER THAN 5% [25% adverse CNMT] | a. Maintain total feed flow greater than 200 gpm until narrow range level greater than 5% [25% adverse CNMT] in intact S/G. |
| b. Control feed flow to maintain narrow range level between 17% [25% adverse CNMT] and 50% | b. <u>IF</u> narrow range level in the intact S/G continues to increase in an uncontrolled manner, <u>THEN</u> go to ECA-3.1, SGTR WITH LOSS OF REACTOR COOLANT - SUBCOOLED RECOVERY DESIRED, Step 1. |

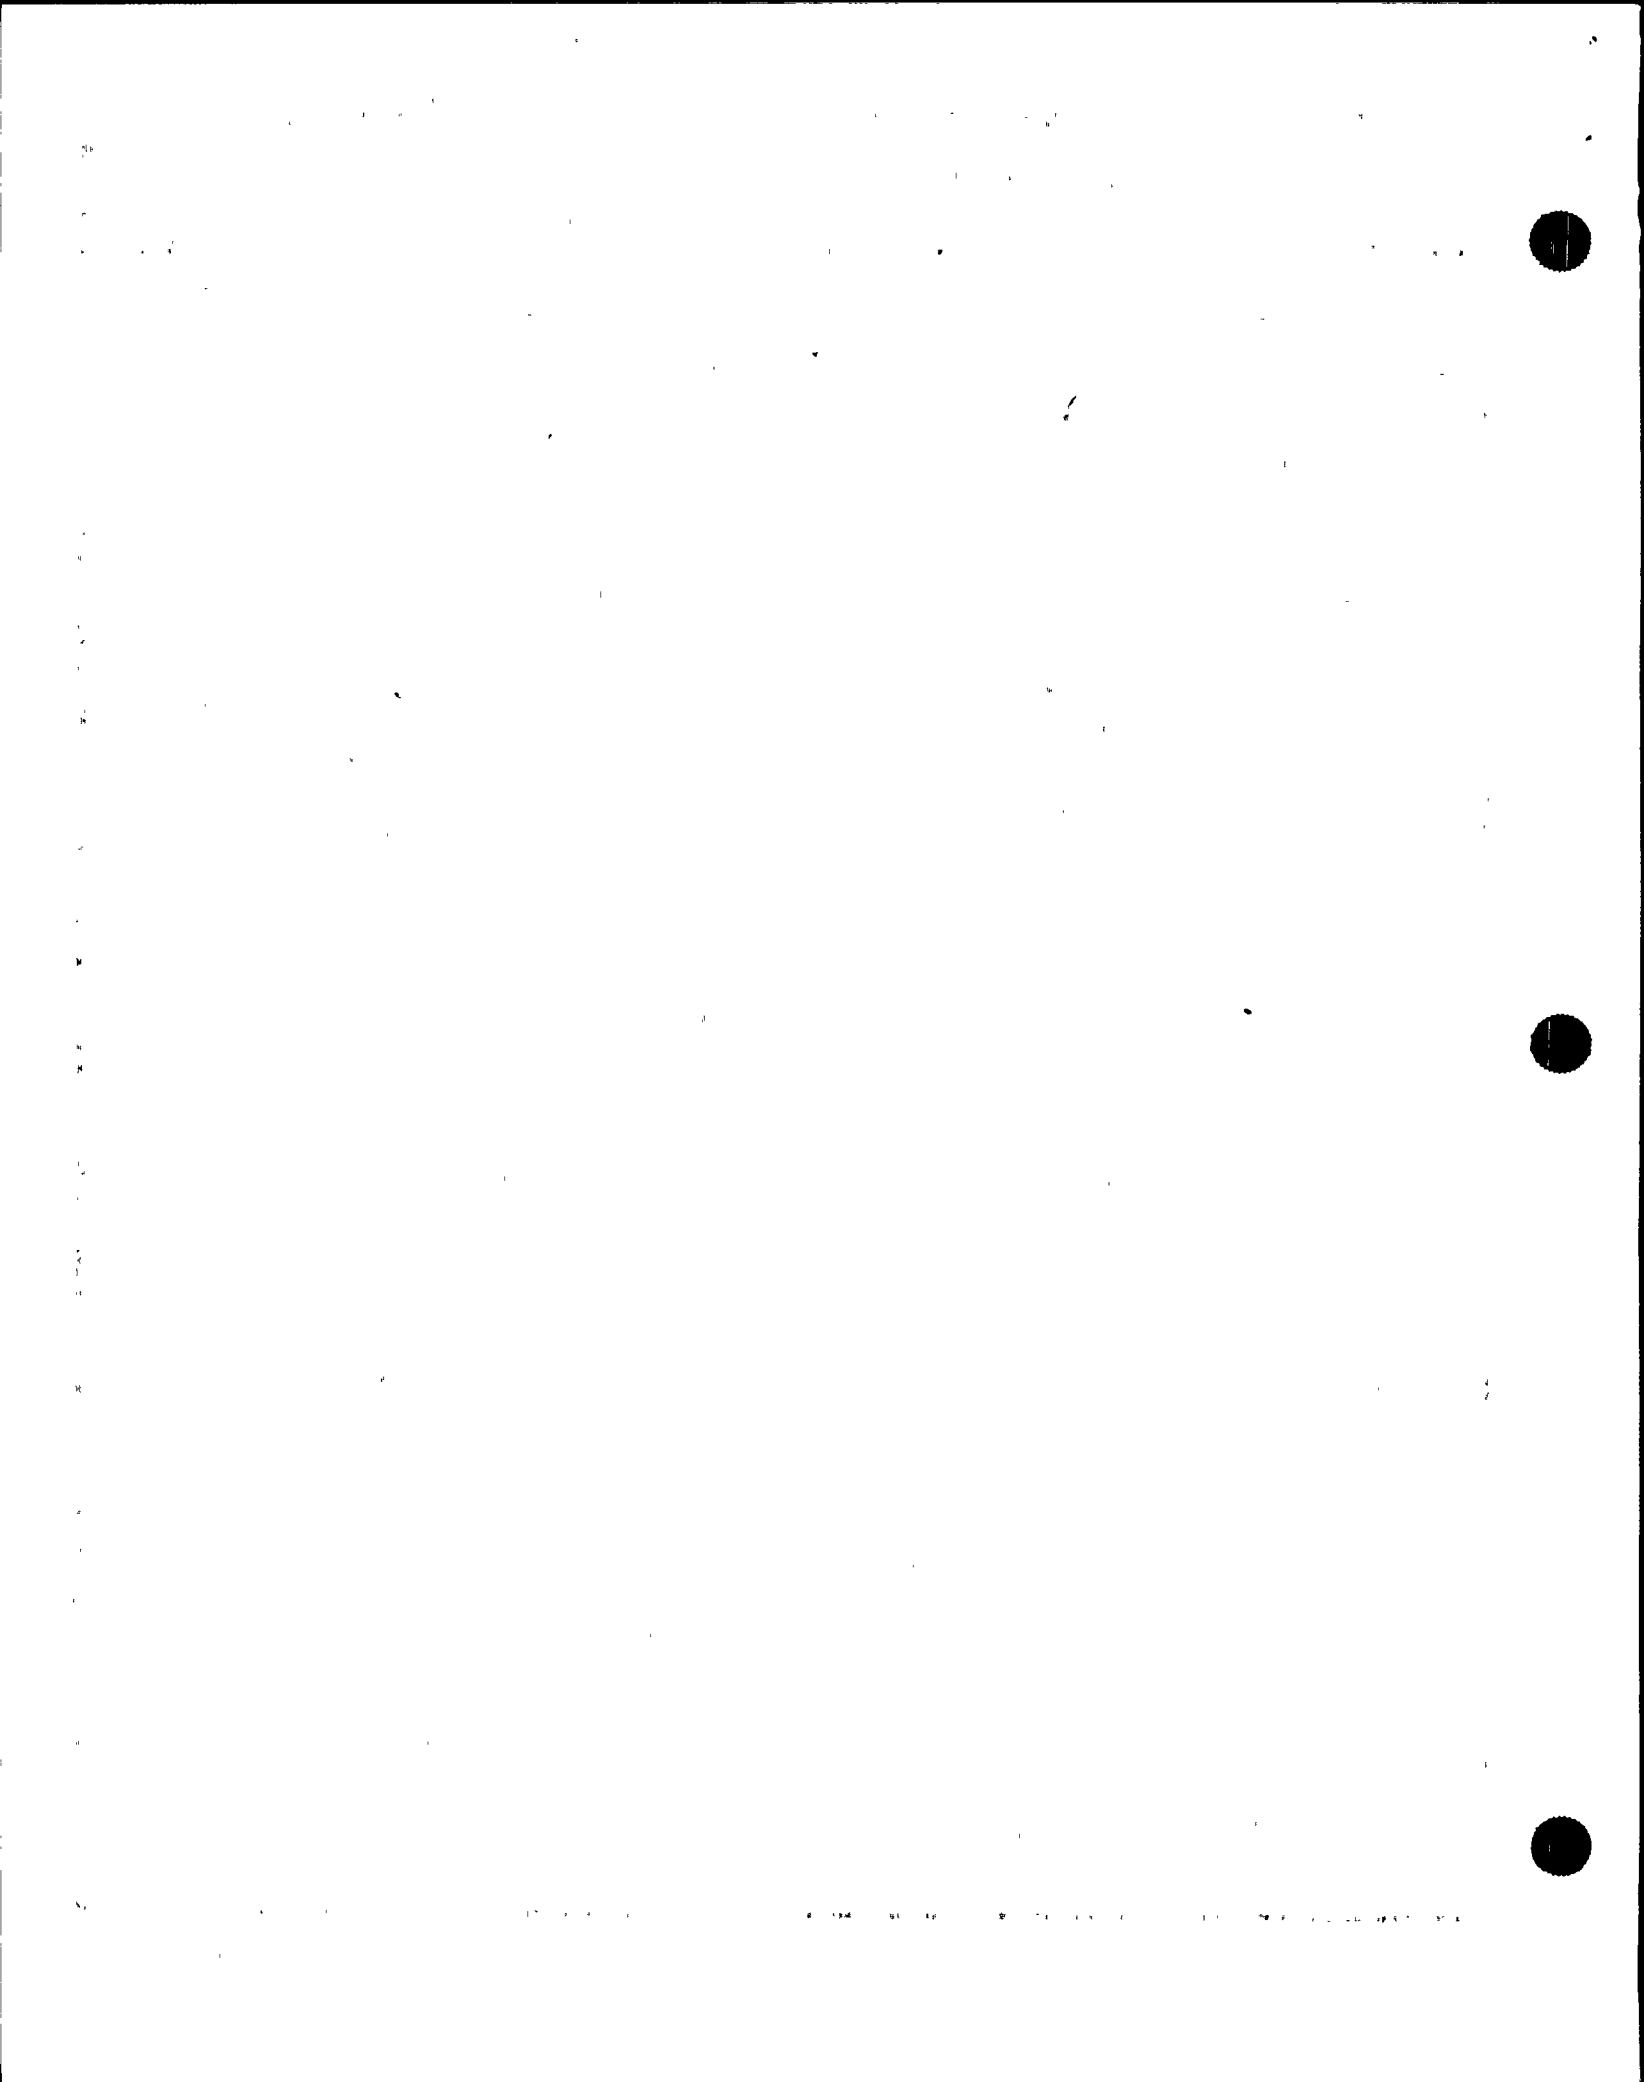

EOP: ES-3.3	TITLE: POST-SGTR COOLDOWN USING STEAM DUMP	REV: 4 PAGE 6 of 12
----------------	---	------------------------

STEP

ACTION/EXPECTED RESPONSE

RESPONSE NOT OBTAINED

NOTE: Since ruptured S/G may continue to depressurize to less than the minimum RCS pressure necessary for continued RCP operation, cooldown to cold shutdown should be completed as quickly as possible, not to exceed 100°F/hr.

5 Initiate RCS Cooldown To 350°F:

- a. Establish and maintain cooldown rate in RCS cold legs - LESS THAN 100°F/HR
- b. Dump steam to condenser from intact S/G

- b. Manually or locally dump steam from intact S/G using S/G ARV.

IF no intact S/G available, THEN perform the following:

- o Use faulted S/G.

-OR-

- o Go to ECA-3.1, SGTR WITH LOSS OF REACTOR COOLANT - SUBCOOLED RECOVERY DESIRED, Step 1.



STEP	ACTION/EXPECTED RESPONSE	RESPONSE NOT OBTAINED
------	--------------------------	-----------------------

CAUTION

RCS AND RUPTURED S/G PRESSURES MUST BE MAINTAINED LESS THAN 1050 PSIG.

6 Control RCS Pressure And Makeup Flow To Minimize RCS-To-Secondary Leakage:

a. Perform appropriate action(s) from table:


PRZR LEVEL	RUPTURED S/G NARROW RANGE LEVEL		
	INCREASING	DECREASING	OFFSCALE HIGH
LESS THAN 13% [40% ADVERSE CNMT]	<ul style="list-style-type: none"> o Increase RCS makeup flow o Depressurize RCS using Step 6b. 	Increase RCS makeup flow	<ul style="list-style-type: none"> o Increase RCS makeup flow o Maintain RCS and ruptured S/G pressure equal
BETWEEN 13% [40% ADVERSE CNMT] AND 50%	Depressurize RCS using Step 6b.	Energize PRZR heaters	Maintain RCS and ruptured S/G pressure equal
BETWEEN 50% AND 75% [65% ADVERSE CNMT]	<ul style="list-style-type: none"> o Depressurize RCS using Step 6b. o Decrease RCS makeup flow 	Energize PRZR heaters	Maintain RCS and ruptured S/G pressure equal
GREATER THAN 75% [65% ADVERSE CNMT]	o Decrease RCS makeup flow	Energize PRZR heaters	Maintain RCS and ruptured S/G pressure equal

b. Use normal PRZR spray to obtain desired results for Step 6a

b. IF letdown is in service, THEN use auxiliary spray (AOV-296).. IF NOT, THEN use one PRZR PORV.



STEP	ACTION/EXPECTED RESPONSE	RESPONSE NOT OBTAINED
7	Establish Required RCS Hydrogen Concentration (Refer to S-3.3C, H2 OR O2 REMOVAL FROM PRIMARY SYSTEM BY BURPING VCT)	
8	Check If RCS Cooldown Should Be Stopped: a. RCS cold leg temperatures - LESS THAN 350°F b. Stop RCS cooldown	a. Return to Step 3.
9	Check Ruptured S/G Narrow Range Level - GREATER THAN 17% [25% adverse CNMT]	Refill ruptured S/G to 67% [55% adverse CNMT] using feed flow. <u>IF</u> either of the following conditions occurs, <u>THEN</u> stop feed flow to ruptured S/G: o Ruptured S/G pressure decreases in an uncontrolled manner. -OR- o Ruptured S/G pressure increases to 1020 psig.



STEP	ACTION/EXPECTED RESPONSE	RESPONSE NOT OBTAINED
------	--------------------------	-----------------------

CAUTION

RUPTURED S/G PRESSURE MAY DECREASE RAPIDLY WHEN STEAM IS RELEASED.

NOTE: Steam release from ruptured S/G may be stopped when RHR System is in service.

10 Initiate Cooldown Of Ruptured S/G:

- | | |
|--|---|
| <ul style="list-style-type: none"> a. Verify condenser available: <ul style="list-style-type: none"> o Intact S/G MSIV - OPEN o Annunciator G-15, STEAM DUMP - LIT b. Dispatch A0 to locally open ruptured S/G MSIV bypass valve c. Dump steam to condenser using steam dump pressure controller | <ul style="list-style-type: none"> a. Manually or locally dump steam using ruptured S/G ARV and go to Step 11. |
|--|---|

11 Control RCS Makeup Flow And Letdown To Maintain PRZR Level:

- | | |
|---|---|
| <ul style="list-style-type: none"> a. PRZR level - GREATER THAN 13% [40% adverse CNMT] b. PRZR level - LESS THAN 75% [65% adverse CNMT] | <ul style="list-style-type: none"> a. Increase RCS makeup flow as necessary and go to Step 12. b. Decrease RCS makeup flow to decrease level and go to Step 13. |
|---|---|

Faint, illegible text covering the majority of the page, possibly bleed-through from the reverse side.



EOP:

ES-3.3

TITLE:

POST-SGTR COOLDOWN USING STEAM DUMP

REV: 4

PAGE 10 of 12

STEP

ACTION/EXPECTED RESPONSE

RESPONSE NOT OBTAINED

NOTE: The upper head region may void during depressurization if RCPs are not running. This may result in a rapidly increasing PRZR level.

12 Depressurize RCS To Minimize
RCS-To-Secondary Leakage:

- | | |
|---|--|
| a. Depressurize using normal PRZR spray associated with running RCP | a. <u>IF</u> letdown is in service, <u>THEN</u> depressurize using auxiliary spray valve (AOV-296). <u>IF NOT</u> , <u>THEN</u> use one PRZR PORV. |
| b. Energize PRZR heaters as necessary | |
| c. Maintain RCS pressure at ruptured S/G pressure | |
| d. Maintain RCS subcooling based on core exit T/Cs - GREATER THAN 0°F USING FIGURE MIN SUBCOOLING | |

13 Check If RCPs Must Be Stopped:


- | | |
|---|-------------------|
| a. RCPs - ANY RUNNING | a. Go to Step 14. |
| b. Check the following: | b. Go to Step 14. |
| o RCP #1 seal D/P - LESS THAN 220 PSID | |
| -OR- | |
| o Check RCP seal leakage - LESS THAN 0.25 GPM | |
| c. Stop affected RCP(s) | |

[Faint, illegible text covering the majority of the page]




Vertical text or markings along the left edge of the page.

STEP	ACTION/EXPECTED RESPONSE	RESPONSE NOT OBTAINED
14	Check If RHR Normal Cooling Can Be Established	
	a. RCS cold leg temperature - LESS THAN 350°F	a. Return to Step 9.
	b. RCS pressure - LESS THAN 400 psig [300 psig adverse CNMT]	b. Return to Step 9.
	c. Place RCS overpressure protection system in service (Refer to 0-7, ALIGNMENT AND OPERATION OF THE REACTOR VESSEL OVERPRESSURE PROTECTION SYSTEM)	c. <u>IF</u> RCS overpressure protection system can <u>NOT</u> be placed in service, <u>THEN</u> notify TSC of potential Tech Spec violation if RHR system is placed in service.
	d. Establish RHR normal cooling (Refer to Attachment RHR COOL)	
15	Continue RCS Cooldown To Cold Shutdown:	
	a. Maintain cooldown rate in RCS cold legs - LESS THAN 100°F/HR	
	b. Use RHR System	
	c. Dump steam to condenser from intact S/G	c. Manually or locally dump steam using intact S/G ARV
		<u>IF</u> no intact S/G available and RHR system <u>NOT</u> in service, <u>THEN</u> perform the following:
		o Use faulted S/G.
		-OR-
		o Go to ECA-3.1, SGTR WITH LOSS OF REACTOR COOLANT - SUBCOOLED RECOVERY DESIRED, Step 1.



STEP	ACTION/EXPECTED RESPONSE	RESPONSE NOT OBTAINED
16	Check Core Exit T/Cs - LESS THAN 200°F	Return to Step 9.
17	Evaluate Long Term Plant Status: a. Maintain cold shutdown conditions (Refer to 0-2.3, PLANT AT COLD OR REFUELING SHUTDOWN) b. Consult TSC	

-END-



EOP: ES-3.3	TITLE: POST-SGTR COOLDOWN USING STEAM DUMP	REV: 4 PAGE 1 of 1
----------------	---	-----------------------

ES-3.3 APPENDIX LIST

	<u>TITLE</u>	<u>PAGES</u>
1)	RED PATH SUMMARY	1
2)	FIGURE MIN SUBCOOLING	1
3)	FIGURE SDM	1
4)	ATTACHMENT RHR COOL	2
5)	FOLDOUT	1



EOP: ES-3.3	TITLE: POST-SGTR COOLDOWN USING STEAM DUMP	REV: 4 PAGE 1 of 1
----------------	---	-----------------------

RED PATH SUMMARY

- a. SUBCRITICALITY - Nuclear power greater than 5%
- b. CORE COOLING - Core exit T/Cs greater than 1200°F
-OR-
Core exit T/Cs greater than 700°F AND
RVLIS level (no RCPs) less than 43% [46%
adverse CNMT]
- c. HEAT SINK - Narrow range level in all S/Gs less than 5%
[25% adverse CNMT] AND total feedwater flow
less than 200 gpm
- d. INTEGRITY - Cold leg temperatures decrease greater than
100°F in last 60 minutes AND RCS cold leg
temperature less than 285°F
- e. CONTAINMENT - CNMT pressure greater than 60 psig


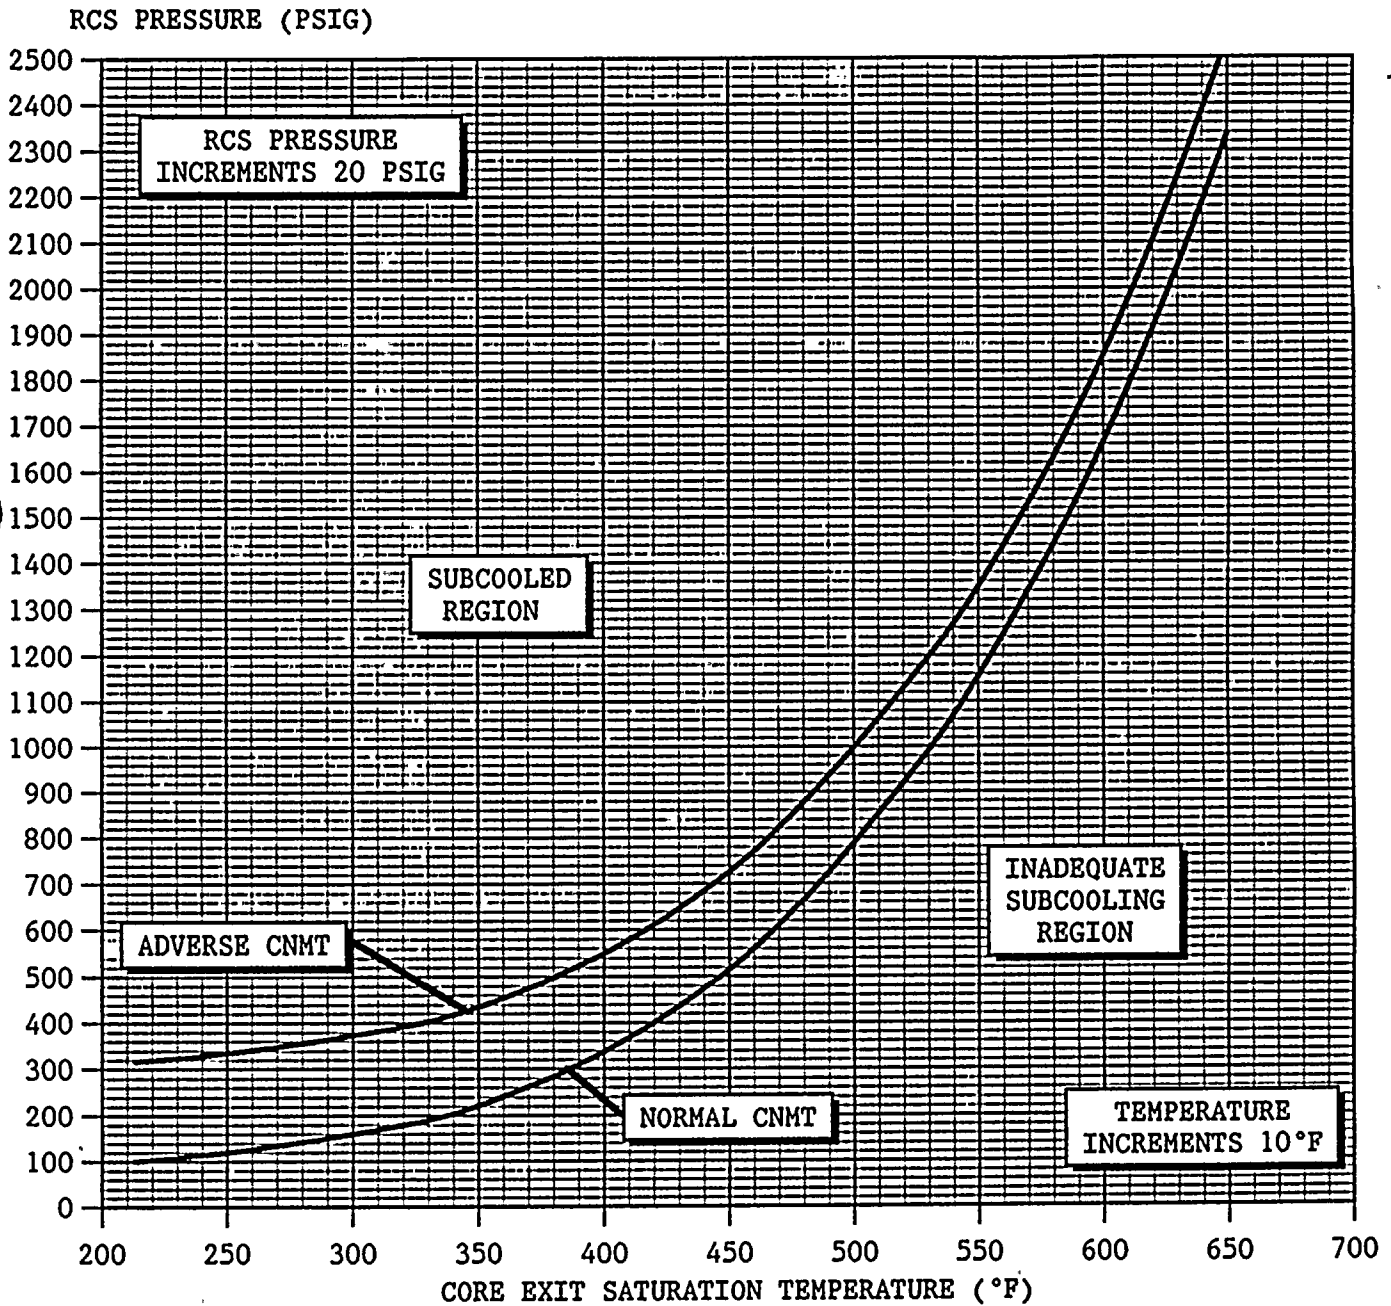


FIGURE MIN SUBCOOLING

NOTE: Subcooling Margin = Saturation Temperature From Figure Below [-] Core Exit T/C Indication







FIGURE SDM



NOTE: To obtain core burnup, use PPCS turn on code BURNUP.

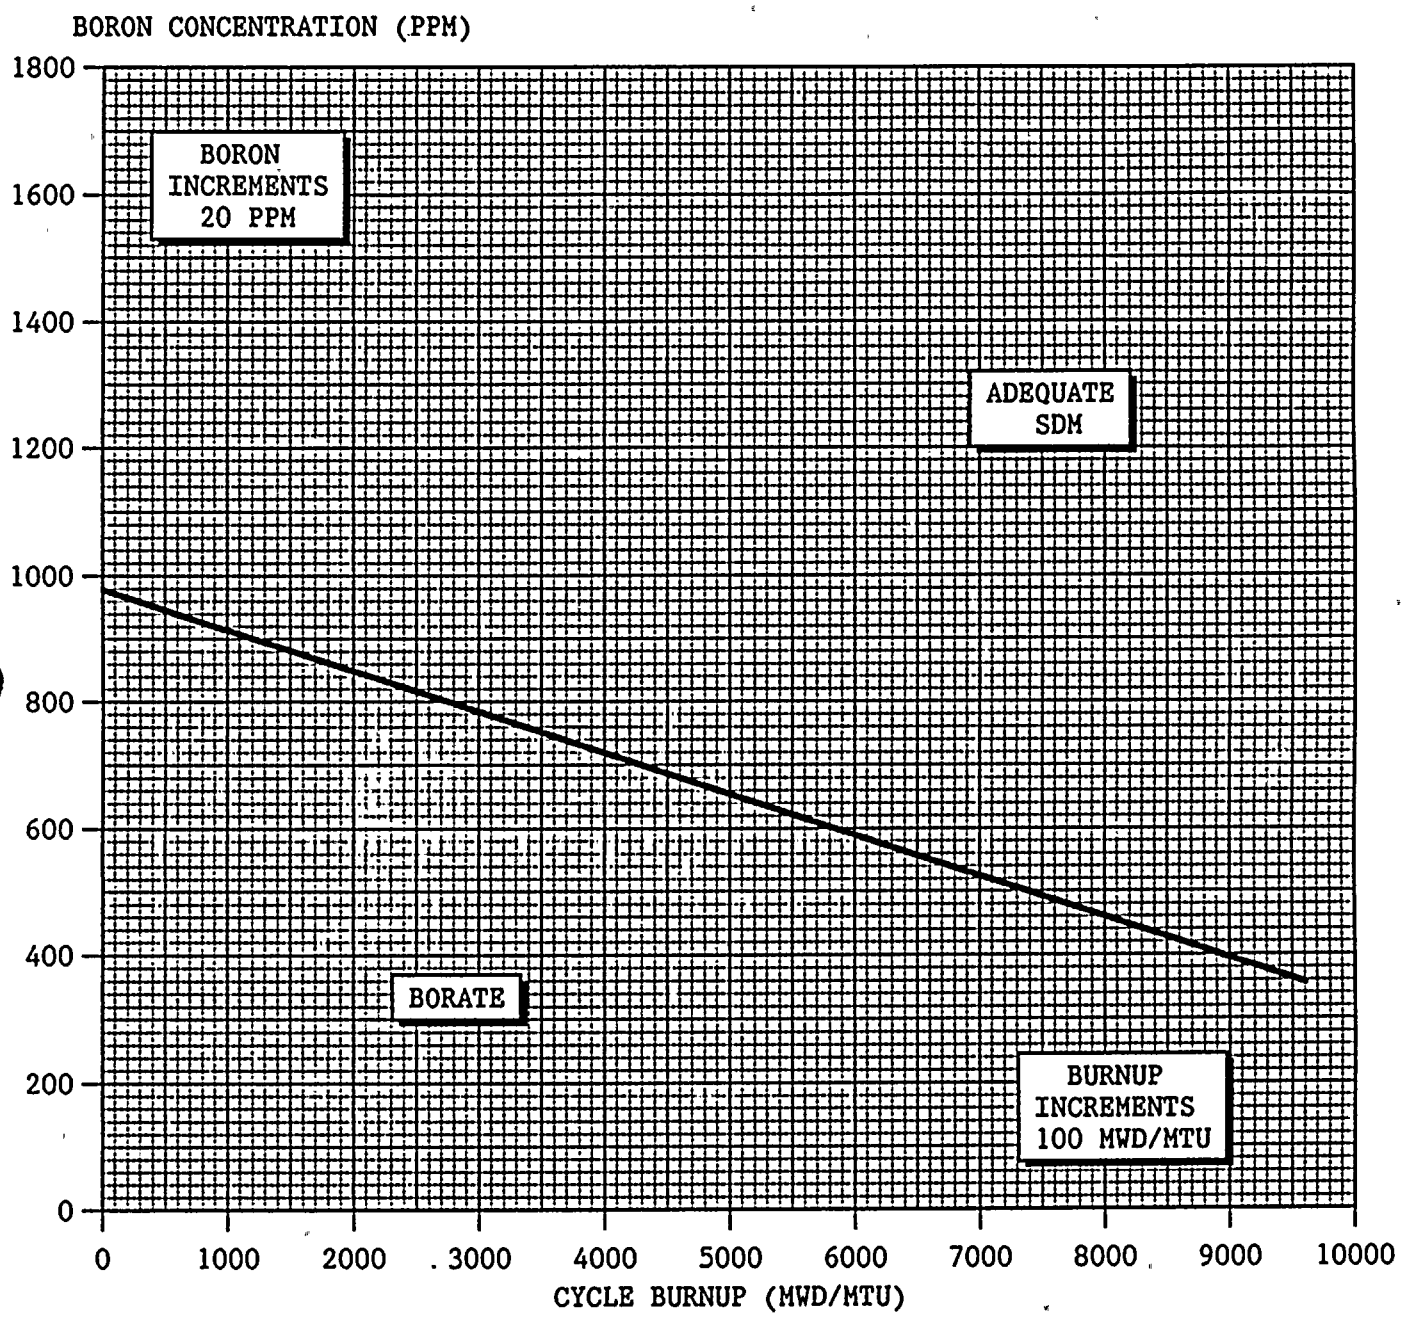

EOP: ES-3.3	TITLE: POST-SGTR COOLDOWN USING STEAM DUMP	REV: 4 PAGE 1 of 1
----------------	---	-----------------------

FOLDOUT PAGE

1. SI REINITIATION CRITERIA

IF either condition listed below occurs, THEN operate SI pumps manually as necessary and go to ECA-3.1, SGTR WITH LOSS OF REACTOR COOLANT - SUBCOOLED RECOVERY DESIRED, Step 1:

- o RCS subcooling based on core exit T/Cs - LESS THAN 0°F USING REQUIREMENTS OF FIGURE MIN SUBCOOLING.

OR

- o PRZR level - CHARGING CAN NOT CONTROL LEVEL GREATER THAN 5% [30% adverse CNMT]

2. SECONDARY INTEGRITY CRITERIA

IF any S/G pressure is decreasing in an uncontrolled manner or is completely depressurized AND has not been isolated, THEN go to E-2, FAULTED S/G ISOLATION, Step 1.

3. COLD LEG RECIRCULATION SWITCHOVER CRITERION

IF RWST level decreases to less than 28%, THEN go to ES-1.3, TRANSFER TO COLD LEG RECIRCULATION, Step 1.

4. AFW SUPPLY SWITCHOVER CRITERION

IF CST level decreases to less than 5 feet, THEN switch to alternate AFW water supply (Refer to ER-AFW.1, ALTERNATE WATER SUPPLY TO AFW PUMPS).

