

ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8809080175 · DOC. DATE: 88/06/30 NOTARIZED: NO DOCKET #
 FACIL: 50-244 Robert Emmet Ginna Nuclear Plant, Unit 1, Rochester G 05000244
 AUTH. NAME: MECREY, R.C. AUTHOR AFFILIATION: Rochester Gas & Electric Corp.
 RECIP. NAME: RECIPIENT AFFILIATION:

SUBJECT: "Semiannual Radioactive Effluent Release Rept, Jan-June 1988." W/880829 ltr.

DISTRIBUTION CODE: IE48D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 15
 TITLE: 50.36a(a)(2) Semiannual Effluent Release Reports


NOTES: License Exp date in accordance with 10CFR2,2.109(9/19/72). 05000244

	RECIPIENT		COPIES			RECIPIENT		COPIES	
	ID	CODE/NAME	LTR	ENCL		ID	CODE/NAME	LTR	ENCL
	PD1-3	LA	1	0		PD1-3	PD	5	5
		STAHLER, C	1	1					
INTERNAL:	AEOD/DOA		1	1	AEOD/DSP/TPAB			1	1
	ARM TECH ADV		1	1	NRR/DEST/PSB 8D			1	1
	NRR/DREP/RPB	10	4	4	NUDOCS-ABSTRACT			1	1
	REG FILE	01	1	1	RGN1 FILE 02			1	1
	RGN2/DRSS/EPRPB		1	1					
EXTERNAL:	BNL TICHLER, J03		1	1	LPDR			1	1
	NRC PDR		1	1					

TOTAL NUMBER OF COPIES REQUIRED: LTR 22 ENCL 21

R
I
D
S
/
A
D
D
S

R
I
D
S
/
A
D
D
S



SEMIANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT

R. E. GINNA NUCLEAR PLANT

ROCHESTER GAS AND ELECTRIC

DOCKET NO. 50-244

JANUARY - JUNE 1988

8809080175 880630
PDR ADOCK 05000244
R PDC

IFCS
1/1



11 2 39


TABLE OF CONTENTS

- 1.0 INTRODUCTION
- 2.0 SUPPLEMENTAL INFORMATION
 - 2.1 REGULATORY LIMITS
 - 2.2 MAXIMUM PERMISSIBLE CONCENTRATIONS
 - 2.3 RELEASE RATE LIMITS
 - 2.4 MEASUREMENTS AND APPROXIMATIONS OF TOTAL RADIOACTIVITY
 - 2.5 BATCH RELEASES
 - 2.6 ABNORMAL RELEASES
- 3.0 SUMMARY OF GASEOUS RADIOACTIVE EFFLUENTS
- 4.0 SUMMARY OF LIQUID RADIOACTIVE EFFLUENTS
- 5.0 SOLID WASTE
- 6.0 LOWER LIMIT OF DETECTION
- 7.0 RADIOLOGICAL IMPACT
- 8.0 METEOROLOGICAL DATA
- 9.0 LAND USE CENSUS CHANGES
- 10.0 ANNUAL TABULATION OF PERSONNEL EXPOSURE
- 11.0 LEAK TEST OF SEALED SOURCES
- 12.0 CHANGES TO THE OFFSITE DOSE CALCULATION MANUAL
- 13.0 CHANGES TO THE PROCESS CONTROL PROGRAM
- 14.0 MAJOR CHANGES TO RADWASTE TREATMENT SYSTEMS



LIST OF TABLES

Table	1A	Gaseous Effluents - Gaseous Summation of all Releases
Table	1B	Gaseous Effluents - Continuous and Batch Releases
Table	2A	Liquid Effluents - Summation of all Releases
Table	2B	Liquid Effluents - Continuous and Batch Releases
Table	3	Solid Waste and Irradiated Fuel Shipments
Table	4	Release Permits Not Meeting LLD Requirements

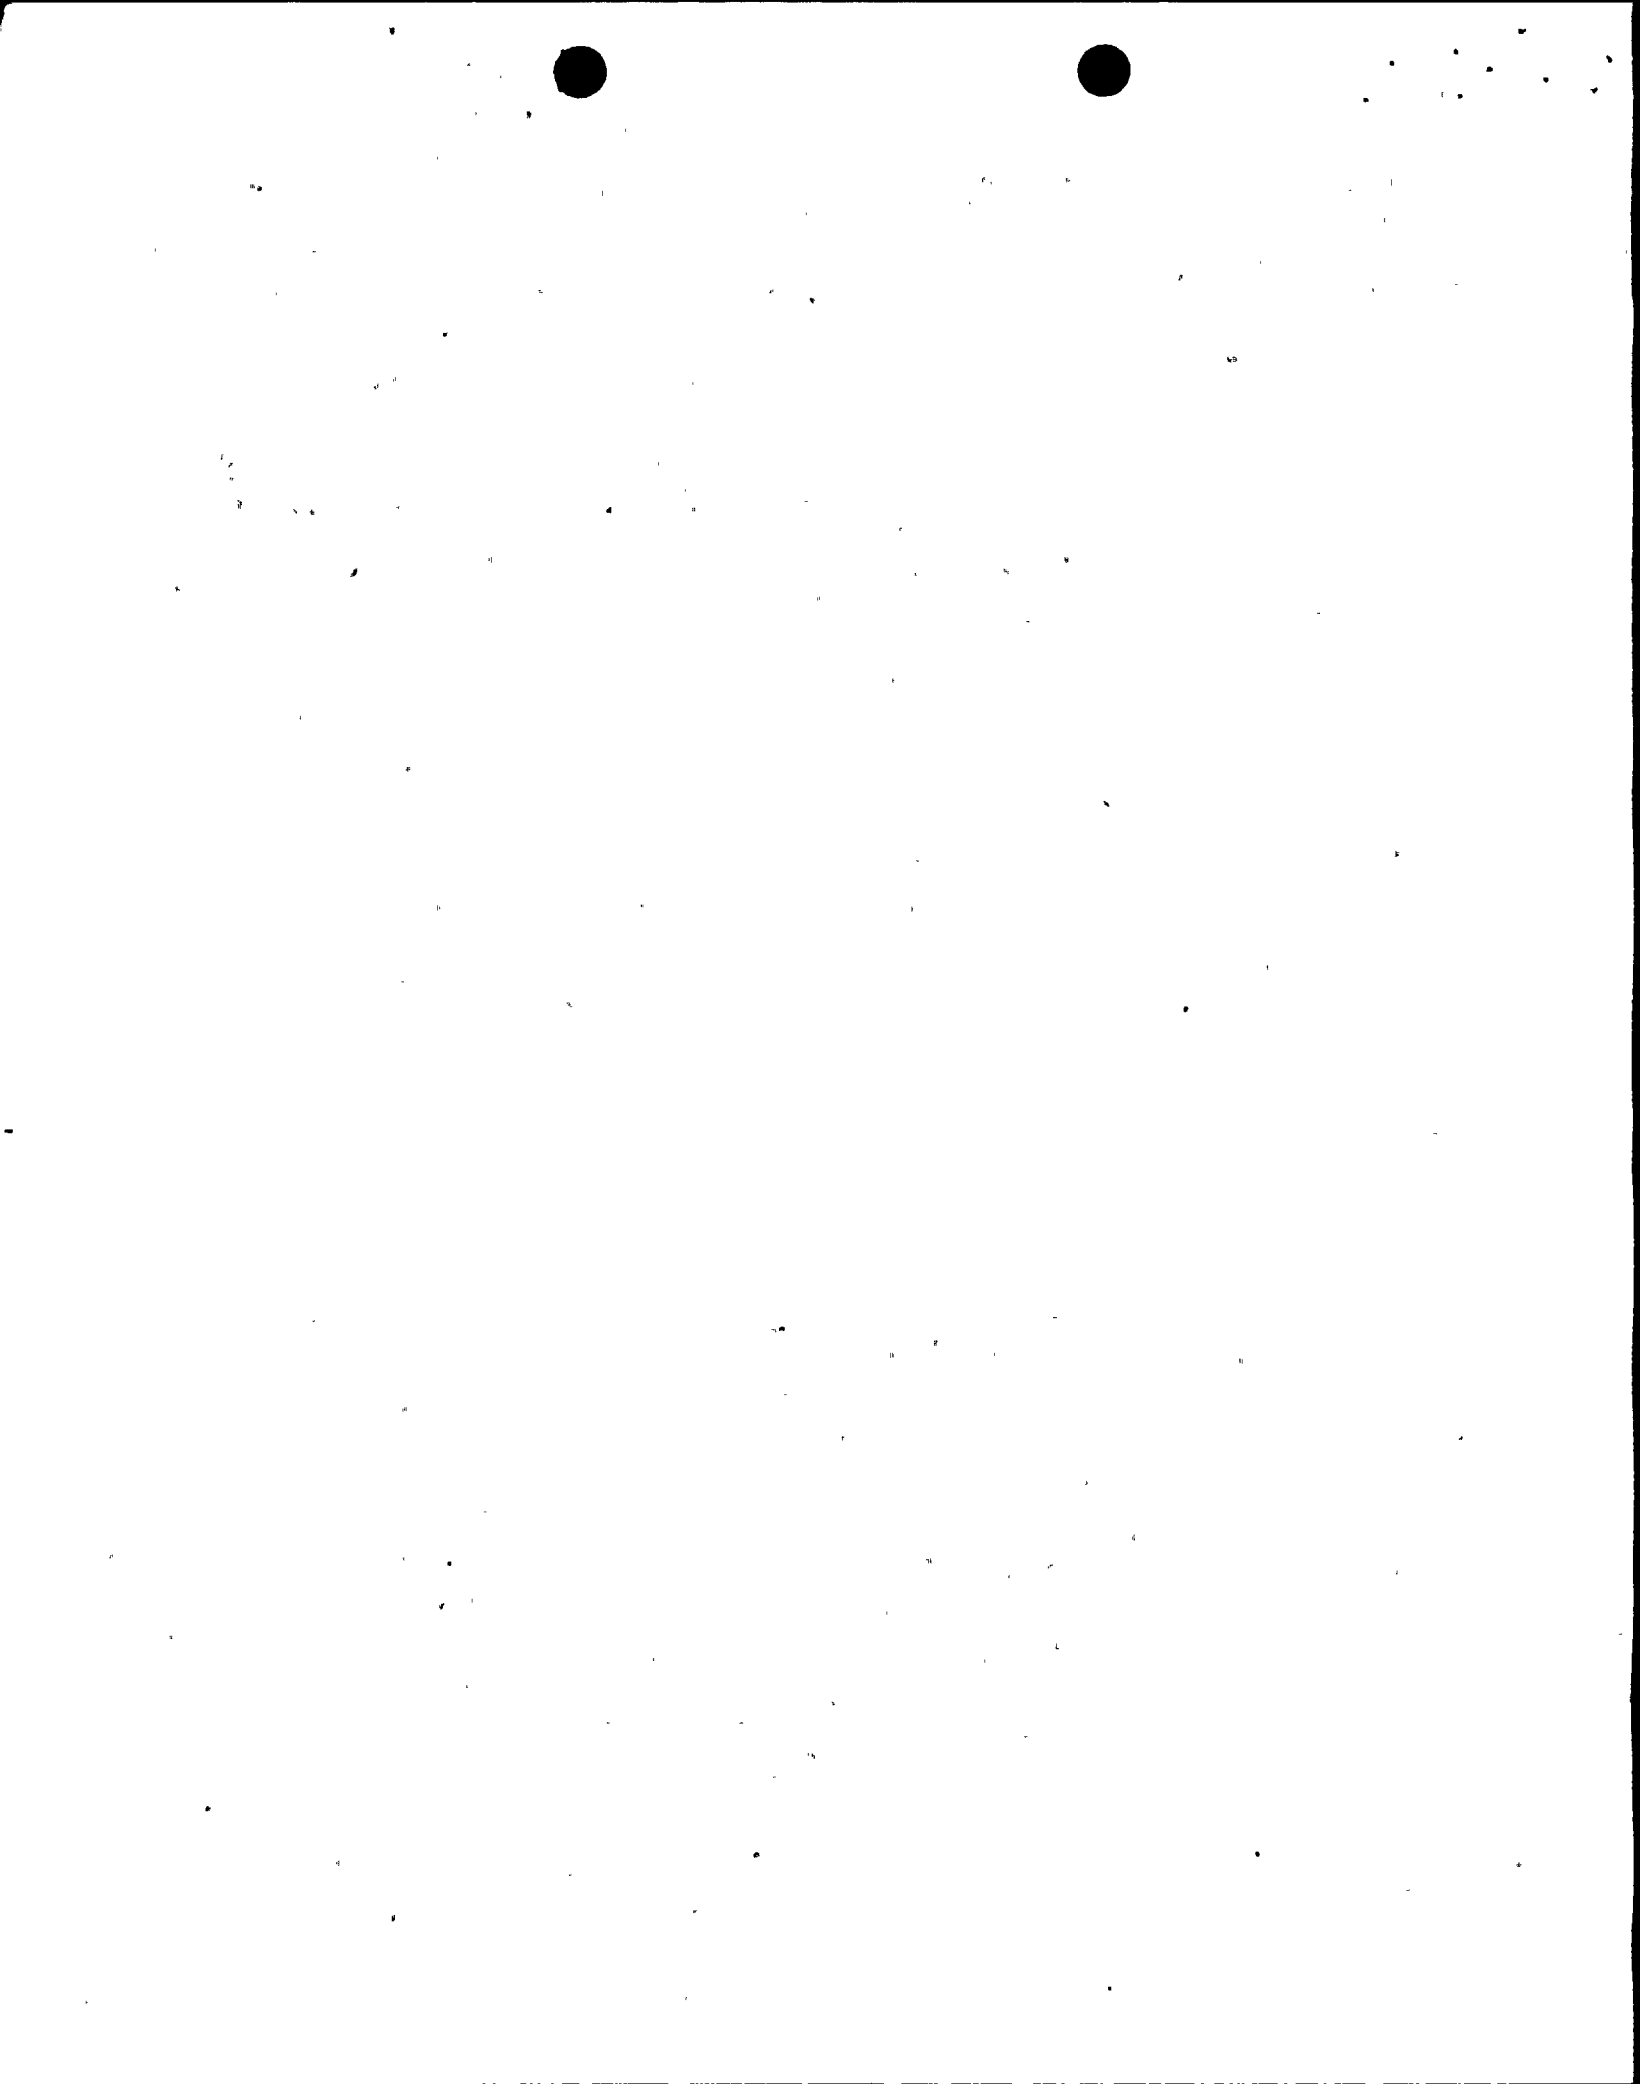

1.0 INTRODUCTION

This Semiannual Radioactive Effluent Release Report is for Rochester Gas and Electric Company's R.E. Ginna plant and is submitted in accordance with the requirements of Technical Specification Section 6.9.1.4. The report covers the period from January 1, 1988 through June 30, 1988.

This report includes a summary of the quantities of radioactive gaseous and liquid effluents and solid waste released from the plant presented in the format outlined in appendix B of Regulatory Guide 1.21, Revision 1, June 1974.

All gaseous and liquid effluents discharged during this reporting period were in compliance with the limits of the R.E. Ginna Technical Specifications.

2.0 SUPPLEMENTAL INFORMATION

2.1 Regulatory Limits

The Technical Specification limits applicable to release of radioactive material in liquid and gaseous effluents are:

2.1.1 Fission and Activation Gases

The instantaneous dose rate, as calculated in the ODCM, due to noble gases released in gaseous effluents from the site shall be limited to a release rate which would yield ≤ 500 mrem/yr to the total body and ≤ 3000 mrem/yr to the skin if allowed to continue for a full year.

The air dose, as calculated in the ODCM, due to noble gases released in gaseous effluents from the site shall be limited to the following:

- (i) During any calendar quarter to ≤ 10 mrad for gamma radiation and to ≤ 20 mrad for beta radiation.

2.1.2 Radioiodine, Tritium and Particulates

The instantaneous dose rate, as calculated in the ODCM, due to radioactive materials released in gaseous effluents from the site as radioiodines, radioactive materials in particulate form, and radionuclides other than noble gases with half-lives greater than 8 days shall be limited to a release rate which would yield ≤ 1500 mrem/yr to any organ if allowed to continue for a full year.



Small, faint, illegible marks or characters in the top right corner.

Faint, illegible marks or characters in the upper middle section.

Faint, illegible marks or characters in the middle left section.

Faint, illegible marks or characters in the lower middle section.

Faint, illegible marks or characters in the lower left section.

Faint, illegible marks or characters in the bottom left section.

The dose to an individual, as calculated in the ODCM, from radioiodine, radioactive materials in particulate form and radionuclides other than noble gases with half-lives greater than eight days released with gaseous effluents from the site shall be limited to the following:

- (i) During any calendar quarter to ≤ 7.5 mrem to any organ.
- (ii) During any calendar year to ≤ 15 mrem to any organ.

2.1.3 Liquid Effluents

The release of radioactive liquid effluents shall be such that the concentration in the circulating water discharge does not exceed the limits specified in accordance with Appendix B, Table II, Column 2 and notes thereto of 10CFR20. For dissolved or entrained noble gases the total activity due to dissolved or entrained noble gases shall not exceed 2 E-4 uCi/ml .


The dose or dose commitment to an individual as calculated in the ODCM from radioactive materials in liquid effluents released to unrestricted areas shall be limited:

- (i) During any calendar quarter to ≤ 1.5 mrem to the total body and to ≤ 5 mrem to any organ, and
- (ii) During any calendar year to ≤ 3 mrem to the total body and to ≤ 10 mrem to any organ.

2.2 Maximum Permissible Concentrations (MPC)

2.2.1 For gaseous effluents, maximum permissible concentrations are not directly used in release rate calculations since the applicable limits are stated in terms of dose rate at the unrestricted area boundary.

2.2.2 For liquid effluents, the maximum permissible concentration values specified in 10CFR20, Appendix B, Table II, column 2 are used to calculate release rates and permissible concentrations at the unrestricted area boundary. A value of 2E-04 uCi/ml is used as the MPC for dissolved and entrained noble gases in liquid effluents.

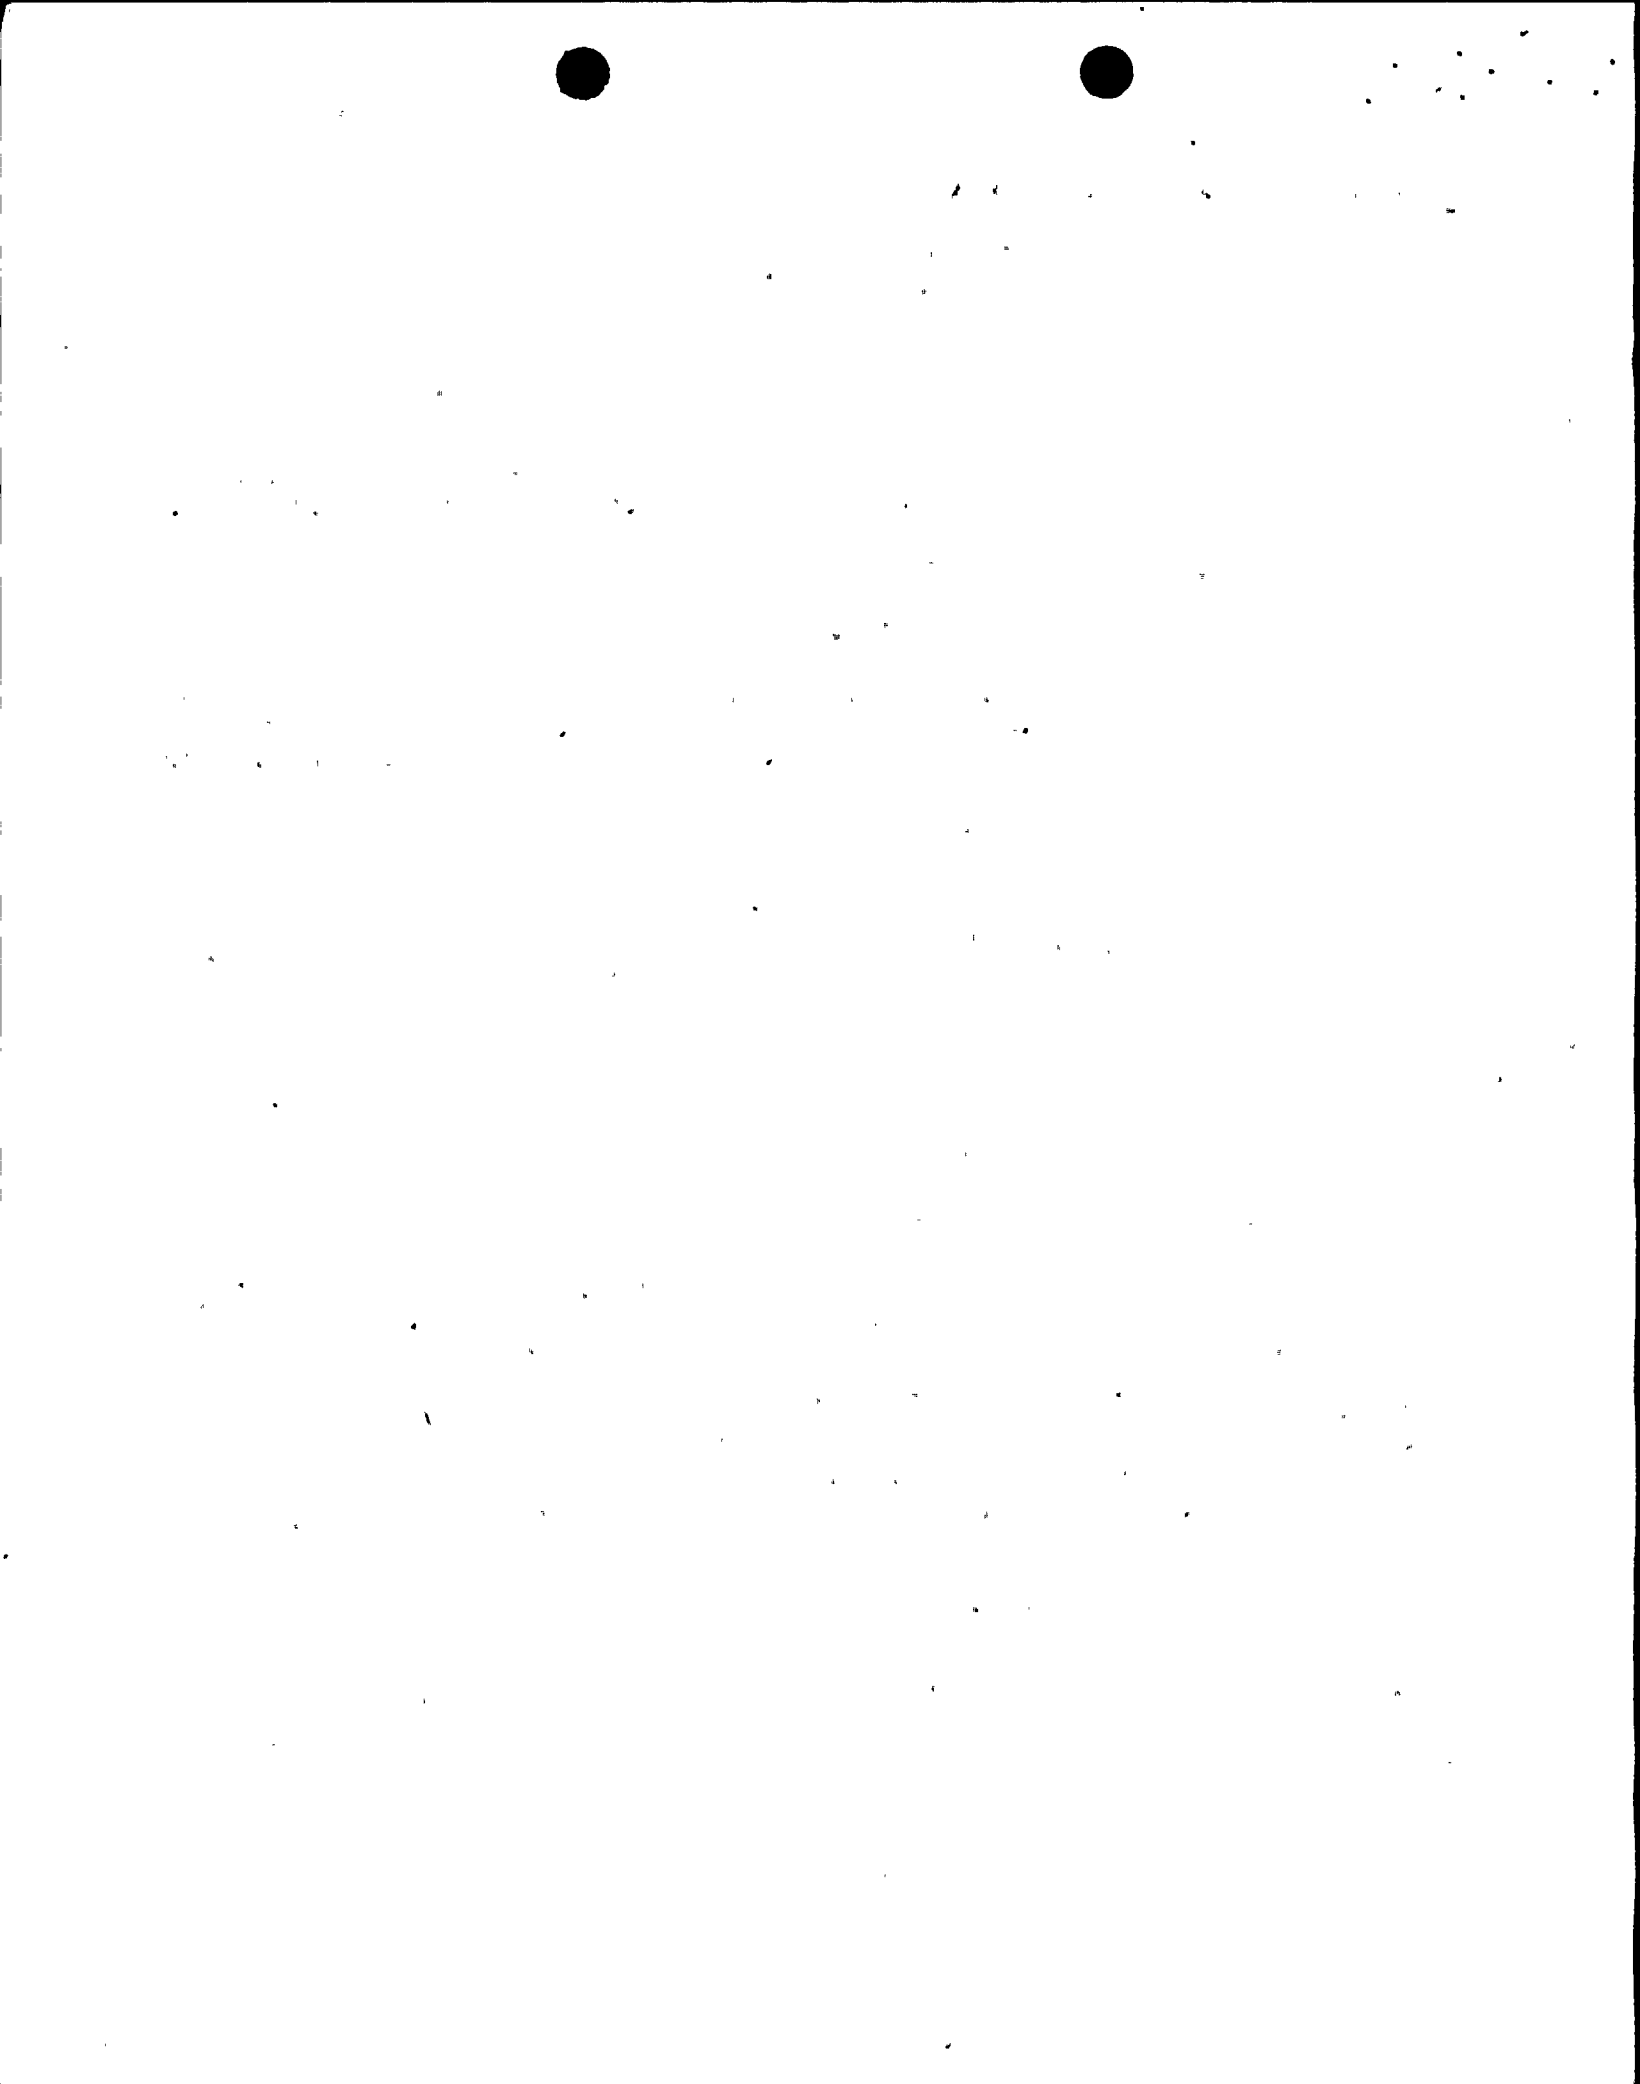

2.3 Average Energy

The average energy of the radionuclide mixture of fission and activation gases released during the time period of this report was 0.285 Mev.

2.4 Measurements and Approximations of Total Radioactivity

Gamma spectroscopy was the primary analysis method used to determine the radionuclide composition and concentration of gaseous and liquid effluents. Composite samples were analyzed for Sr-89, Sr-90 and Fe-55 by a contract laboratory. Tritium and alpha analysis were done using liquid scintillation and gas flow proportional counting respectively.

The total radioactivity in effluent release was determined from the measured concentration of each radionuclide present and the total volume of effluents released.

2.5 Batch Releases

2.5.1 Liquid

1.	Number of batch release:	4.51 E+02
2.	Total time period for batch releases:	3.80 E+04 min
3.	Maximum time period for a batch release:	3.63 E+03 min
4.	Average time period for batch releases:	8.4 E+01 min
5.	Minimum time period for a batch release:	1.4 E+01 min
6.	Average stream flow (LPM) during periods of effluent releases into the flowing stream:	1.07 E+06

2.5.2 Gaseous

1.	Number of batch releases:	1.4E+01
2.	Total time period for batch releases:	6.28E+03 min
3.	Maximum time period for a batch release:	7.47E+02 min
4.	Average time period for batch releases:	4.48E+02 min
5.	Minimum time period for a batch release:	2.47E+02 min



Small, faint, illegible marks or characters in the top right corner.

Faint, illegible marks or characters in the upper middle section.

Large block of very faint, illegible marks or characters in the upper middle section.

Faint, illegible marks or characters in the middle left section.

Faint, illegible marks or characters in the middle right section.

Faint, illegible marks or characters in the lower middle section.

Faint, illegible marks or characters in the lower right section.

Faint, illegible marks or characters in the lower middle section.

Faint, illegible marks or characters in the bottom center section.

2.6 Abnormal Releases

There were no abnormal releases of liquid or gaseous effluents during the reporting period.

3.0 SUMMARY OF GASEOUS RADIOACTIVE EFFLUENTS

The quantities of radioactive material released in gaseous effluents are summarized in tables 1A and 1B. All releases were considered to be elevated releases.

4.0 SUMMARY OF LIQUID RADIOACTIVE EFFLUENTS

The quantities of radioactive material released in liquid effluents are summarized in tables 2A and 2B.

5.0 SOLID WASTES

The quantities of radioactive material released in shipments of solid waste transported from the site during the reporting period are summarized in table 3. Principal nuclides were determined by gamma spectroscopy and non-gamma emitters were calculated from scaling factors determined by an independent laboratory from representative samples of that waste type.

6.0 LOWER LIMIT OF DETECTION NOT MET

There were 5 liquid releases for which 1 or more gamma emitting radionuclide for which the LLD specification applies which did not meet the required lower limit for detection. These are listed by release number in table 4.

7.0 RADIOLOGICAL IMPACT

An assessment of doses to the maximally exposed individual from gaseous and liquid effluents will be performed and reported in the July - December, 1988 Semi-Annual Report for the year of 1988.

8.0 METEOROLOGICAL DATA

Not applicable for this report.

9.0 LAND USE CHANGES

Not applicable for this report.

10.0 ANNUAL TABULATION OF PERSONNEL EXPOSURE

This data will be in the report issued for July-December, 1988.



Small, faint, illegible markings or characters in the top right corner.

Faint, illegible markings or characters near the top center of the page.

Faint, illegible markings or characters in the upper middle section of the page.

Faint, illegible markings or characters in the middle section of the page.

Faint, illegible markings or characters in the lower middle section of the page.

Faint, illegible markings or characters in the lower section of the page.

Faint, illegible markings or characters in the lower section of the page.

Faint, illegible markings or characters in the lower section of the page.

Faint, illegible markings or characters in the lower section of the page.

Faint, illegible markings or characters in the lower section of the page.

Faint, illegible markings or characters in the lower section of the page.

Faint, illegible markings or characters in the lower section of the page.

Faint, illegible markings or characters in the lower section of the page.

11.0 LEAK TEST OF SEALED SOURCES

No sealed sources were found to be leaking when smeared by both wet and dry smears.

12.0 CHANGES TO THE OFFSITE DOSE CALCULATION MANUAL (ODCM)

There were no changes to the ODCM during the report period.

13.0 CHANGES TO THE PROCESS CONTROL PROGRAM (PCP)

There were no changes to the PCP during the reporting period.

In the August 29, 1987 Semi-Annual Effluent Report, a change in the pH for solidification was noted without a negative impact statement. Tests had been conducted on the solidified product prior to that date and there has been no change in the integrity of the final solidified mass.

14.0 MAJOR CHANGES TO RADWASTE TREATMENT SYSTEMS

There were no major changes to the Radwaste Treatment Systems during the reporting period.



Small, faint, illegible marks or characters in the top right corner.

Small, faint, illegible marks or characters in the upper center.

Table 1A

EFFLUENT AND WASTE DISPOSAL SEMIANNUAL REPORT

GASEOUS EFFLUENTS - SUMMATION OF ALL RELEASES

January 1 - June 30, 1988

	Unit	Quarter 1	Quarter 2	Est. Total Error %
A. Fission & activation gases				
1. Total release	Ci	1.90E+01	5.45E+00	7.0E+00
2. Average release rate for period	uCi/sec	2.42E+00	6.93E-01	
3. Percent of technical specification limit	%	2.3 E-04	6.5 E-05	
B. Iodines				
1. Total iodine-131	Ci	2.64E-03	1.77E-04	4.3E+01
2. Average release rate for period	uCi/sec	3.36E-04	2.25E-05	
3. Percent of technical specification limit	%	5.9 E-01	3.1 E-01	
C. Particulates				
1. Particulates with half-lives > 8 days	Ci	1.28E-05	2.73E-06	4.3E+01
2. Average release rate for period	uCi/sec	1.63E-06	3.47E-07	
3. Percent of technical specification limit	%	1.2 E-04	2.6 E-05	
4. Gross alpha radioactivity	Ci	4.51E-07	3.23E-08	
D. Tritium				
1. Total release	Ci	3.84E+01	5.86E+01	3.2E+00
2. Average release rate for period	uCi/sec	4.88E+00	7.45E+00	
3. Percent of technical specification limit	%	5.7 E-04	8.8 E-04	



Table 1B

EFFLUENT AND WASTE DISPOSAL SEMIANNUAL REPORT

GASEOUS EFFLUENTS - ELEVATED RELEASE

Nuclides Released	Unit	CONTINUOUS MODE		BATCH MODE	
		Quarter	Quarter	Quarter	Quarter
1. Fission gases		1	2	1	2
krypton-85	Ci				
krypton-85m	Ci	1.63E-02	3.63E-02		
krypton-87	Ci	2.49E-02	5.92E-02		
krypton-88	Ci	3.40E-02	7.91E-02		
xenon-133	Ci	7.14E+00	2.15E+00	2.42E+00	1.87E-01
xenon-135	Ci	8.51E+00	1.54E+00	6.91E-02	3.84E-03
xenon-135m	Ci	2.79E-01	5.92E-01		
xenon-138	Ci	1.11E-01	2.07E-01		
Others (specify)	Ci				
argon-41	Ci	2.10E-01	4.58E-01	8.95E-02	6.27E-02
xenon-131m	Ci	3.21E-02	7.71E-02	1.61E-03	
xenon-133m	Ci			2.10E-02	
Total for period	Ci	1.64E+01	5.20E+00	2.58E+00	2.54E-01
2. Iodines					
iodine-131	Ci	9.86E-06	1.08E-05	1.44E-05	
iodine-133	Ci	2.40E-03	1.66E-04	2.20E-04	
iodine-135	Ci				
Total for period	Ci	2.41E-03	1.77E-04	2.34E-04	
3. Particulates					
strontium-89	Ci		*		*
strontium-90	Ci		*		*
cesium-134	Ci				
cesium-137	Ci				
barium-lanthanum-140	Ci				
Others (specify)	Ci				
	Ci				
	Ci				
unidentified	Ci				

Note: Isotopes for which no value is given were not identified in applicable releases.

* Sample sent out for analysis but results not yet received. Data for identified isotopes will be included with next semi-annual report for July - December, 1988.



Small, faint, illegible marks or characters in the top right corner.

Table 2A

EFFLUENT AND WASTE DISPOSAL SEMIANNUAL REPORT

LIQUID EFFLUENTS - SUMMATION OF ALL RELEASES

January 1 - June 30, 1988

	Unit	Quarter 1	Quarter 2	Est. Total Error, %
A. Fission and activation products				
1. Total release (not including tritium, gases, alpha)	Ci	9.86E-03	1.45E-02	1.1E+01
2. Average diluted concentration during period	uCi/ml	8.57E-11	8.73E-11	
3. Percent of applicable limit	%	3.6 E-03	1.2 E-02	
B. Tritium				
1. Total release	Ci	1.69E+02	4.53E+01	3.2E+00
2. Average diluted concentration during period	uCi/ml	1.47E-06	2.72E-07	
3. Percent of applicable limit	%	4.9 E-02	9.1 E-03	
C. Dissolved and entrained gases				
1. Total release	Ci	1.93E-04	2.33E-03	3.4E+01
2. Average diluted concentration during period	uCi/ml	1.68E-12	1.40E-11	
3. Percent of applicable limit	%	1.7 E-06	1.4 E-05	
D. Gross alpha radioactivity				
1. Total release	Ci			
E. Volume of waste released (prior to dilution)				
	liters	2.41E+07	2.59E+07	5.0E+00
F. Volume of dilution water used during period				
	liters	1.15E+11	1.66E+11	5.0E+00



1. 2. 3.

Table 2B

EFFLUENT AND WASTE DISPOSAL SEMIANNUAL REPORT

LIQUID EFFLUENTS

Nuclides Released	Unit	CONTINUOUS MODE		BATCH MODE	
		Quarter 1	Quarter 2	Quarter 1	Quarter 2
strontium-89	Ci		*	1.13E-04	*
strontium-90	Ci		*	4.51E-05	*
cesium-134	Ci	1.14E-04	1.19E-04	2.03E-03	6.04E-04
cesium-137	Ci	3.06E-04	3.17E-04	3.28E-03	1.52E-03
iodine-131	Ci	7.58E-07	5.67E-06	6.23E-04	3.62E-03
cobalt-58	Ci	7.53E-07	1.35E-07	6.78E-04	1.80E-04
cobalt-60	Ci	3.00E-05	3.70E-07	3.41E-04	7.92E-04
iron-59	Ci				
zinc-65	Ci				
manganese-54'	Ci			5.36E-05	6.61E-05
chromium-51	Ci			2.70E-04	
zirconium-niobium-95	Ci			3.20E-05	4.57E-05
molybdenum-99	Ci			2.25E-05	8.83E-05
technetium-99m	Ci				
barium-lanthanum-140	Ci				
cerium-141	Ci				
Other (specify)	Ci				
iodine-133	Ci	3.27E-06	2.00E-05	1.03E-03	5.43E-03
iodine-135	Ci	3.37E-06	1.70E-05	7.40E-04	1.62E-03
iron-55	Ci		*	2.47E-05	*
silver-110m	Ci			1.14E-04	
unidentified	Ci				
Total for period (above)	Ci	4.58E-04	4.79E-04	9.40E-03	1.40E-02
xenon-133	Ci			6.91E-05	1.47E-03
xenon-135	Ci			1.24E-04	8.55E-04

NOTE: Isotopes for which no value is given were not identified in applicable releases.

* Sample sent out for analysis but results not yet received. Data for identified isotopes will be included with next Semi-Annual Report for July - December, 1988.



012 25*

Table 3

EFFLUENT AND WASTE DISPOSAL SEMIANNUAL REPORT

SOLID WASTE AND IRRADIATED FUEL SHIPMENTS

A. SOLID WASTE SHIPPED OFFSITE FOR BURIAL OR DISPOSAL (Not irradiated fuel)

1. Type of waste	Unit	6-month Period	Est. Total Error %
a. Spent resins, filter sludges, evaporator bottoms, etc.	m ³	1.466E+01	2E+00
	Ci	1.68 E+02	5E+00
b. Dry compressible waste, contaminated equip, etc.	m ³	3.12 E+01	2E+00
	Ci	1.25 E+01	5E+00
c. Irradiated components, control rods, etc.	m ³		
	Ci		
d. Other (describe)	m ³		
	Ci		

2. Estimate of major nuclide composition (by type of waste)

a. Cobalt-60	%	5.33E+01
Iron-55	%	4.70E+00
Cesium-137	%	1.01E+01
Hydrogen-3	%	2.62E+00
Nickel-63	%	1.88E+01
Cesium-134	%	1.07E+01
b. Cobalt-60	%	2.76E+01
Iron-55	%	5.36E+01
Nickel-63	%	1.12E+01
Cesium-137	%	8.00E+00

3. Solid Waste Disposition

<u>Number of Shipments</u>	<u>Mode of Transportation</u>	<u>Destination</u>
6	Highway Vehicle	Barnwell, SC

B. IRRADIATED FUEL SHIPMENTS (Disposition)

<u>Number of Shipments</u>	<u>Mode of Transportation</u>	<u>Destination</u>
None		



Small, illegible marks and artifacts in the top right corner.

Faint, illegible marks in the upper center.

A single small black dot.

A single small black dot.

A single small black dot.

A single small black dot.

A single small black dot.

A single small black dot.

A single small black dot.

A single small black dot.

A single small black dot.

A single small black dot.

A single small black dot.

A single small black dot.

A single small black dot.

A single small black dot.

A single small black dot.

A single small black dot.

A single small black dot.

A single small black dot.

A single small black dot.


Table 4

RELEASE PERMITS NOT MEETING LLD REQUIREMENTS

No.	Date	Isotopes	Cause
121	2/13/88	Ce-141	a.
177	3/1/88	Fe-59, Zn-65, Cs-137, Ce-141	a.
258	3/18/88	Fe-59, Zn-65, Ce-141	a.
432	6/2/88	Ce-141	a.
487	6/17/88	Co-58, Fe-59, Zn-65, Ce-141	a.

- a. Activity from other isotopes caused an increased background resulting in the LLD calculation exceeding $5E-07$ uCi/ml for the listed isotopes.





ROCHESTER GAS AND ELECTRIC CORPORATION • 89 EAST AVENUE, ROCHESTER, N.Y. 14649-0001

TELEPHONE
AREA CODE 716 546-2700

August 29, 1988

U.S. Nuclear Regulatory Commission
Document Control Desk
Washington, DC 20555

Dear Sirs:

This Semi-Annual Radioactive Effluent Release Report is being forwarded to you in accordance with the requirements of Technical Specification Section 6.9.1.4.

Very truly yours,

Robert C. Mecredy

xc: Mr. William T. Russell
Regional Administrator
U.S. Nuclear Regulatory Commission
Region 1
475 Allendale Road
King of Prussia, PA 19406

15
JE48
1/1

