

DEC 08 1988

Docket No. 50-244

Rochester Gas and Electric Corporation  
ATTN: Mr. Robert C. Mecredy  
General Manager  
Nuclear Production  
49 East Avenue  
Rochester, New York 14649

Gentlemen:

Subject: Request for Additional Information Concerning Response to IE Bulletin  
85-03, "Motor-Operated Valve Common Mode Failures During Plant  
Transients Due to Improper Switch Settings"

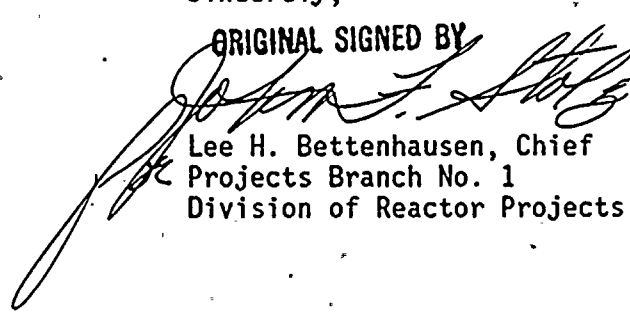
During the NRC review of your response to IEB 85-03, we have identified the need for additional information in order to provide a thorough evaluation prior to approval of the program to assure valve operability.

The specific information necessary for the completion of our review is enclosed with this letter. Please provide the additional information within 30 days of the date of this letter.

Your cooperation with us in this matter is appreciated.

Sincerely,

ORIGINAL SIGNED BY

  
Lee H. Bettenhausen, Chief  
Projects Branch No. 1  
Division of Reactor Projects

Enclosure: As Stated

cc w/encl:  
Harry H. Voigt, Esquire  
Central Records (4 copies)  
Director, Power Division  
State of New York, Department of Law  
Public Document Room (PDR)  
Local Public Document Room (LPDR)  
Nuclear Safety Information Center (NSIC)  
NRC Resident Inspector  
State of New York

OFFICIAL RECORD COPY

126/BAUNACK/12/7/88 - 0001.0.0  
12/07/88

8812230062 881208  
PDR ADOCK 05000244  
Q PDC

AO1 CC  
IE 11  
11

Rochester Gas and Electric Corporation 2

DEC 08 1988

bcc w/encl:  
Region I Docket Room (with concurrences)  
Management Assistant, DRMA (w/o encl)  
DRP Section Chief  
C. Stahle, PM, NRR  
R. Kiessle, NRR  
Robert J. Bores, DRSS

RI:DRP  
*[Signature]*  
Baunack/meo  
12/7/88

RI:DRP  
*[Signature]*  
Cowgill  
12/7/88

RI:DRP  
*[Signature]*  
Bettenhausen  
12/8/88

OFFICIAL RECORD COPY

126/BAUNACK/12/7/88 - 0002.0.0  
12/07/88

REQUEST FOR ADDITIONAL INFORMATION (RAI) RE:

Review of Responses to Action Item e of IE Bulletin 85-03

Licensee:  
Rochester Gas and Electric Corporation  
89 East Avenue  
Rochester, New York 14649-0001

Unit(s): Ginna  
Date of Response to RAI Issued 9/9/87:  
10/9/87  
Respondent:  
Roger W. Kober  
Vice President  
Electric Production

The information provided in your response listed above to Action Item e of IE Bulletin 85-03 was found to be deficient in some areas. Provide the additional information necessary to resolve the following comments and questions:

Revise your response of 10/9/87 to Question 2 about water hammer to indicate that factors such as valve closure times, piping lengths, flow conditions, procedures, and experience have been considered.

