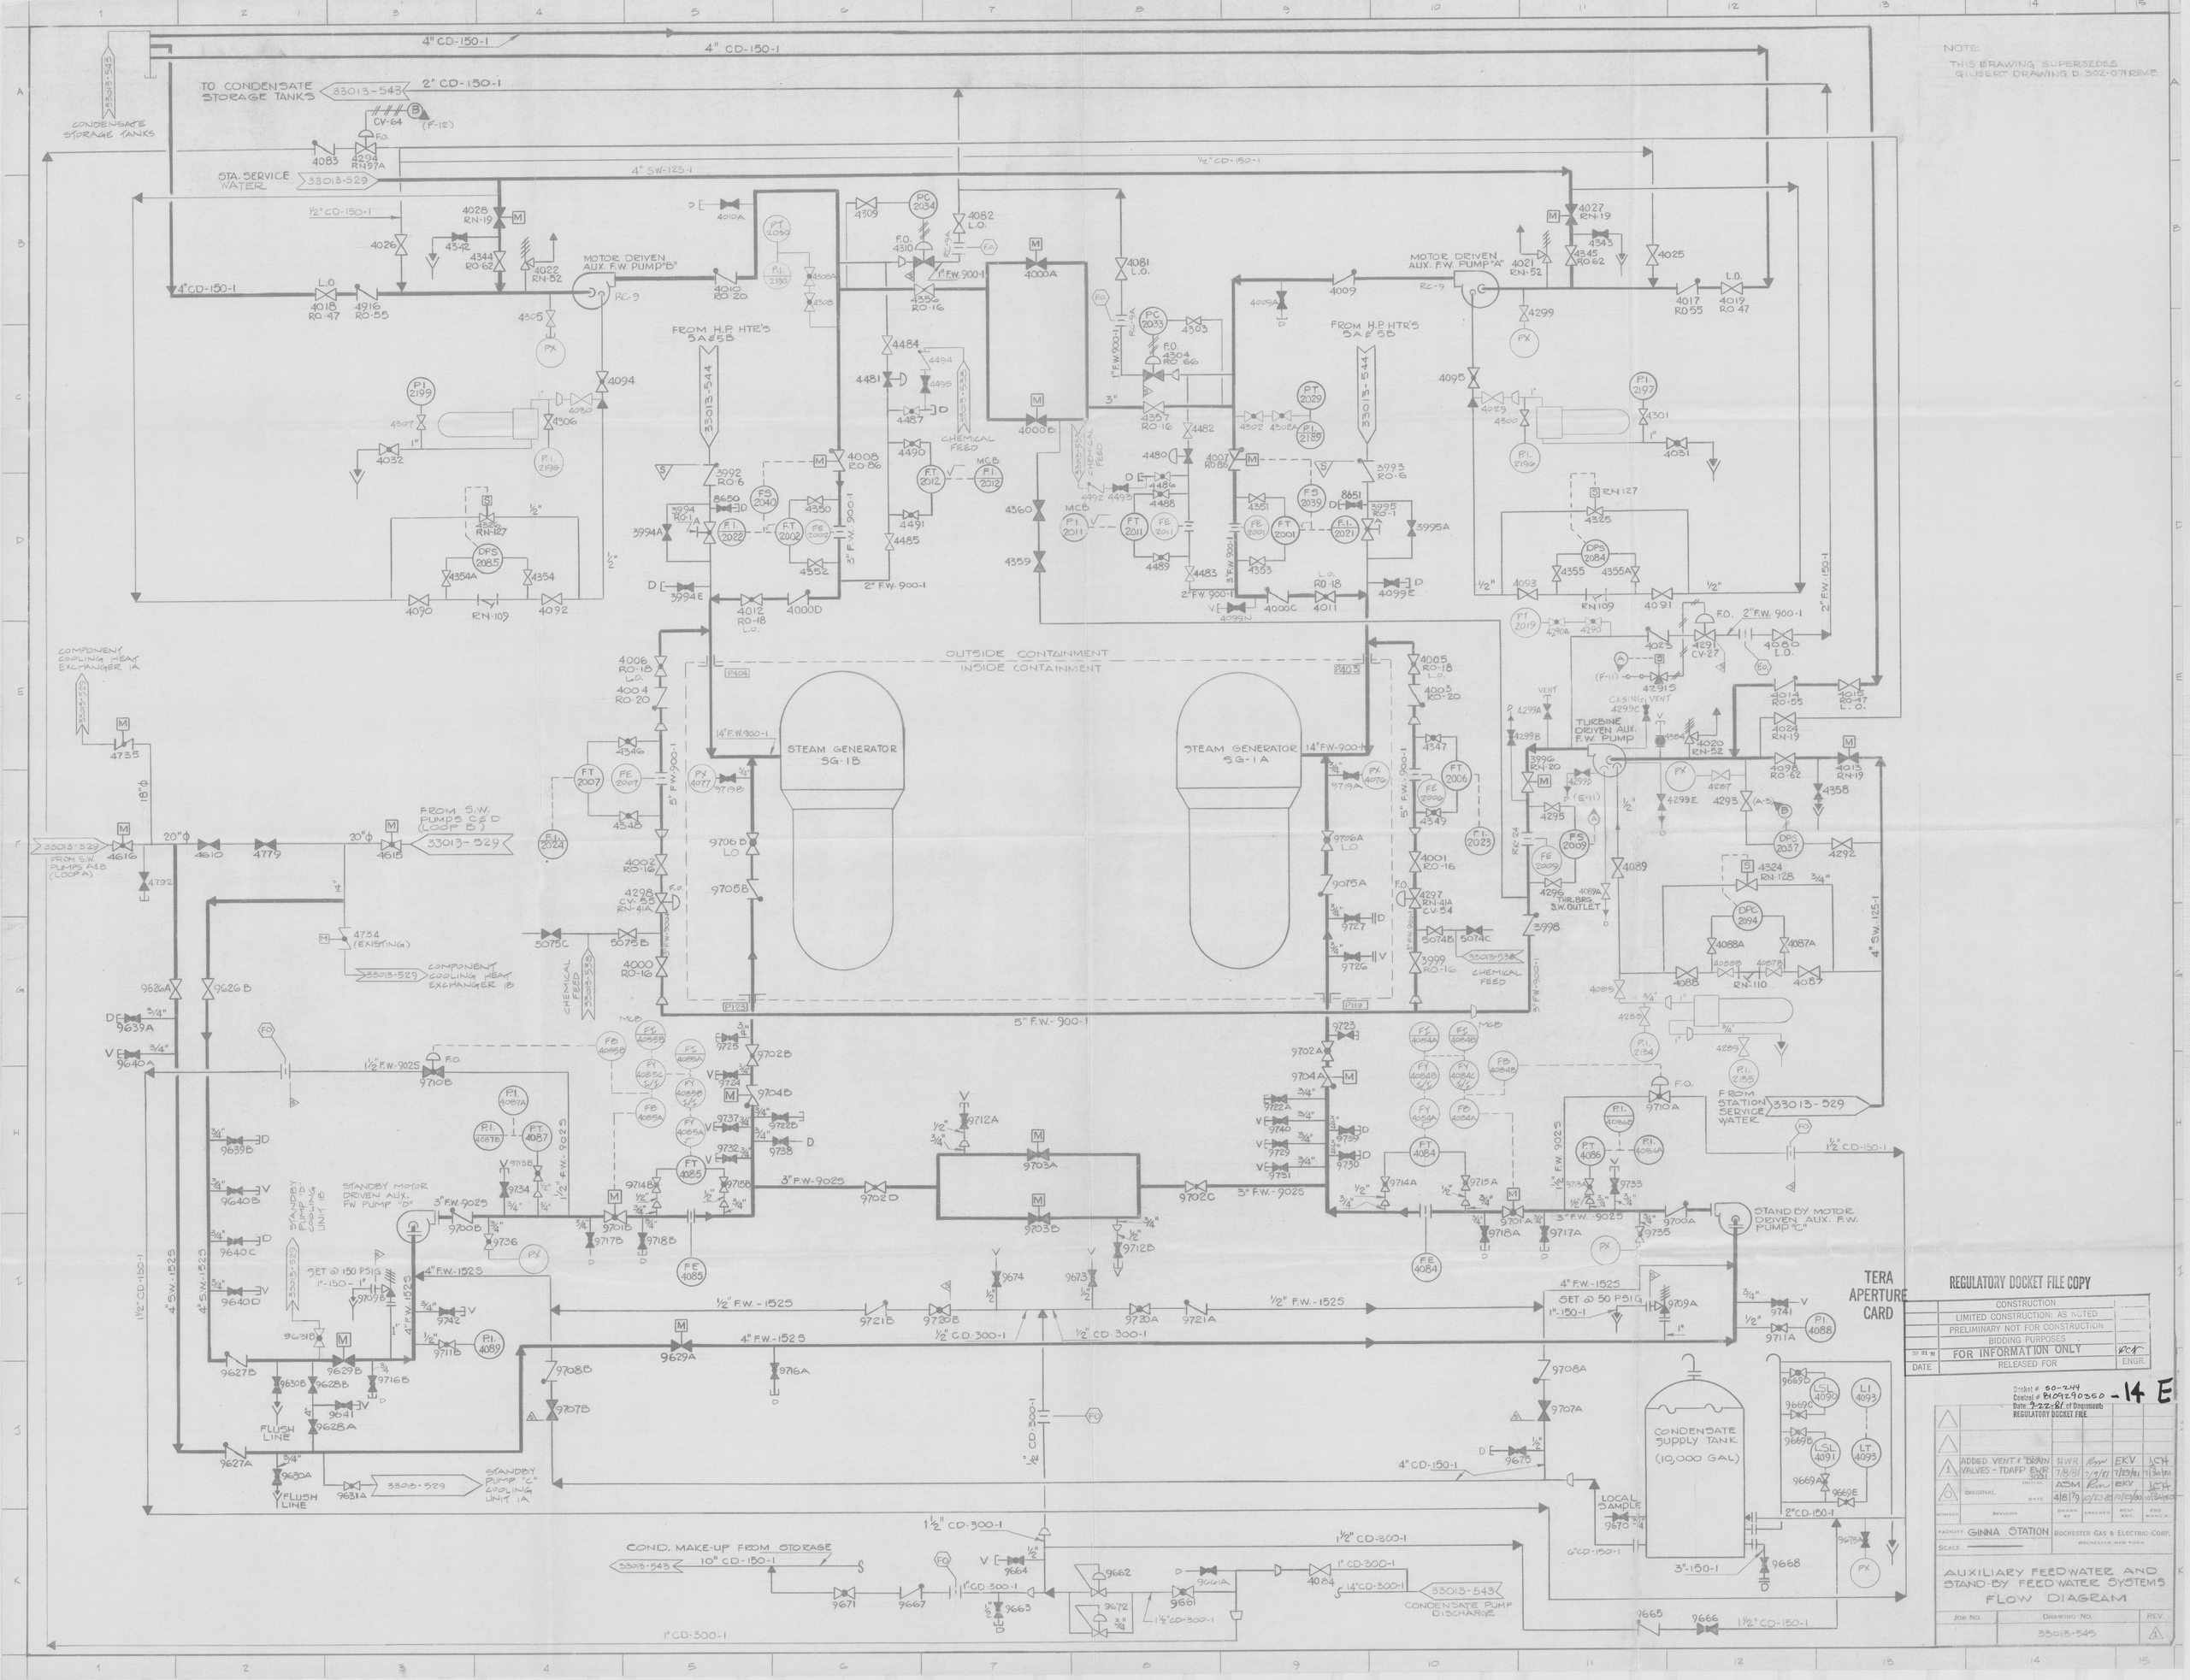
NOTE
THIS DRAWING SUPERSEDES GILBERT DRAWING D-302-071 REV.E
TO CONDENSATE STORAGE TANKS
CONDENSATE STORAGE TANKS
STA. SERVICE WATER
MOTOR DRIVEN AUX. F.W. PUMP "B"
MOTOR DRIVEN AUX. F.W. PUMP "A"
FROM H.P. HTR'S 5A & 5B
CHEMICAL FEED
OUTSIDE CONTAINMENT
INSIDE CONTAINMENT
STEAM GENERATOR SG-1B
STEAM GENERATOR SG-1A
TURBINE DRIVEN AUX. F.W. PUMP
COMPONENT COOLING HEAT EXCHANGER 1A
COMPONENT COOLING HEAT EXCHANGER 1B
FROM S.W. PUMPS C & D (LOOP B)
FROM S.W. PUMPS A & B (LOOP A)
STANDBY MOTOR DRIVEN AUX. FW PUMP "D"
STANDBY MOTOR DRIVEN AUX. F.W. PUMP "C"
STANDBY PUMP "D" COOLING UNIT 1B
STANDBY PUMP "C" COOLING UNIT 1A
FLUSH LINE
CONDENSATE SUPPLY TANK (10,000 GAL)
LOCAL SAMPLE
FROM STATION SERVICE WATER
COND. MAKE-UP FROM STORAGE
CONDENSATE PUMP DISCHARGE
TERA APERTURE CARD
REGULATORY DOCKET FILE COPY
CONSTRUCTION
LIMITED CONSTRUCTION: AS NOTED
PRELIMINARY NOT FOR CONSTRUCTION
BIDDING PURPOSES
FOR INFORMATION ONLY
RELEASED FOR
DATE
ENGR.
Docket # 50-244
Control # 8109290350 -14 E
Date 9-22-81 of Document:
REGULATORY DOCKET FILE
ADDED VENT & DRAIN VALVES - TDAFP EWR 3091
ORIGINAL
NUMBER
REVISION
DRAWN BY
CHECKED
RESP. ENG.
ENG. MANG'R.
FACILITY GINNA STATION
ROCHESTER GAS & ELECTRIC CORP.
ROCHESTER, NEW YORK
SCALE
AUXILIARY FEEDWATER AND STAND-BY FEEDWATER SYSTEMS FLOW DIAGRAM
JOB NO.
DRAWING NO.
REV.
33013-545