

H.S. 19 11536







CONTROL BOARD
120 VAC DIST. PNL.
BRKR. #18

MANUAL STATION
AFW-1A
FOXBORO 67 HTG.

(NOTE #1)
Φ L1
N L2

CONTROL BOARD
120 VAC DIST. PNL.
BRKR. #18

MANUAL STATION
AFW-1B
FOXBORO 67 HTG.

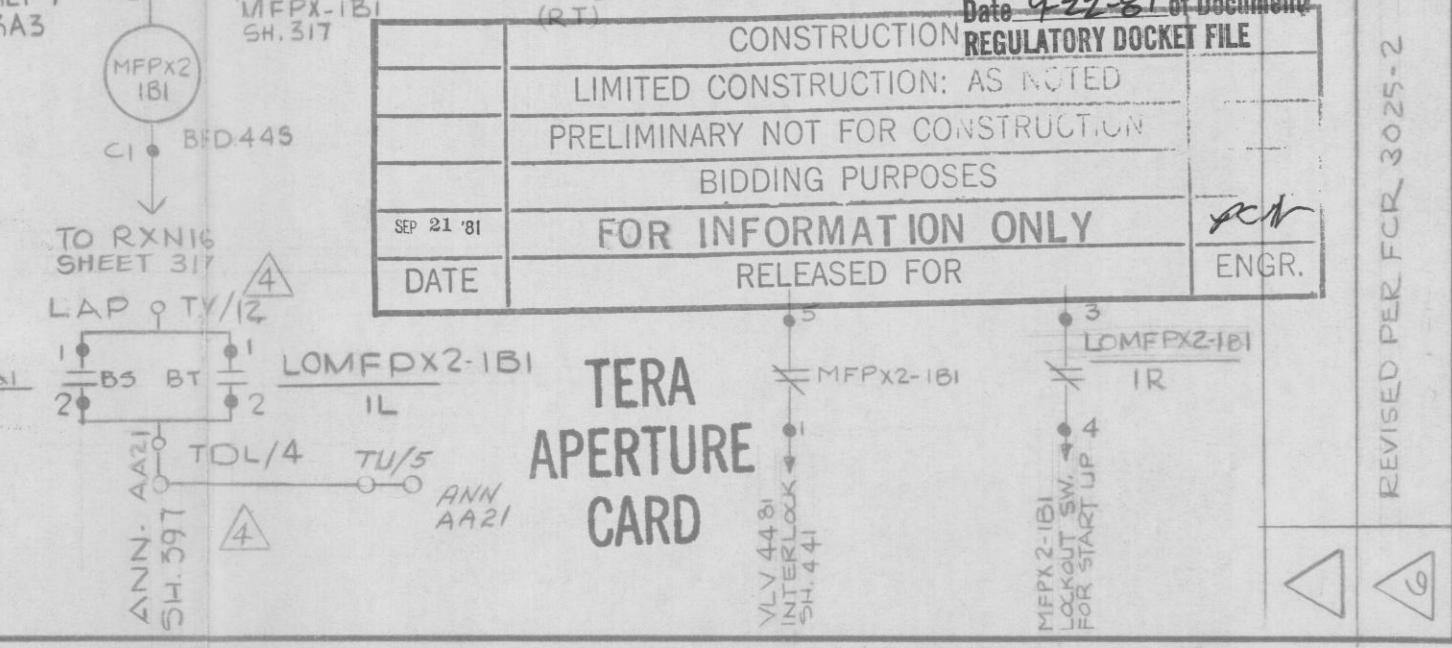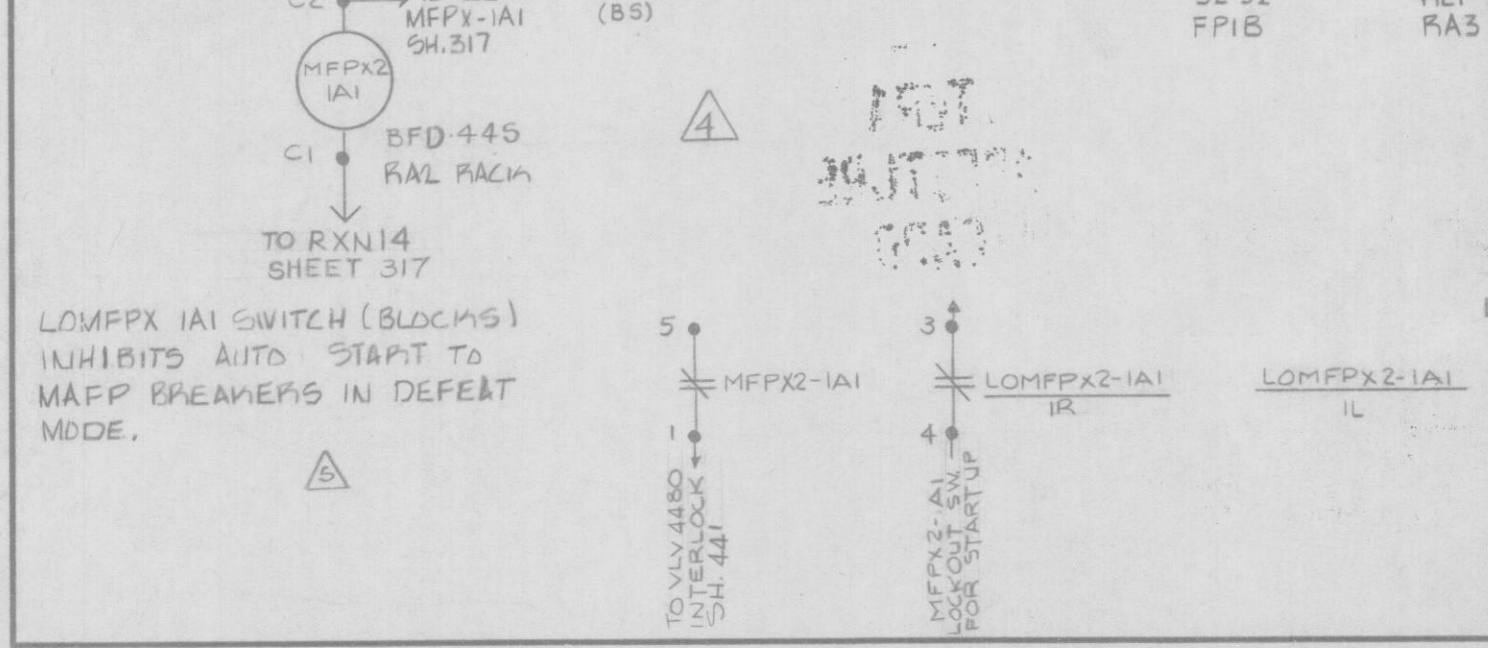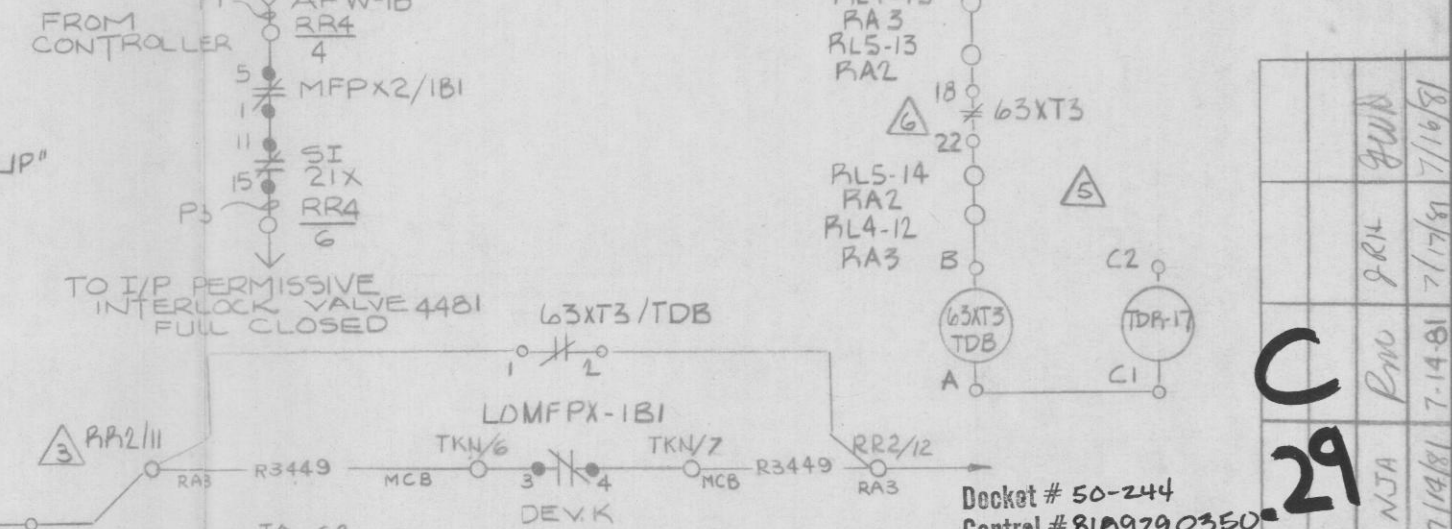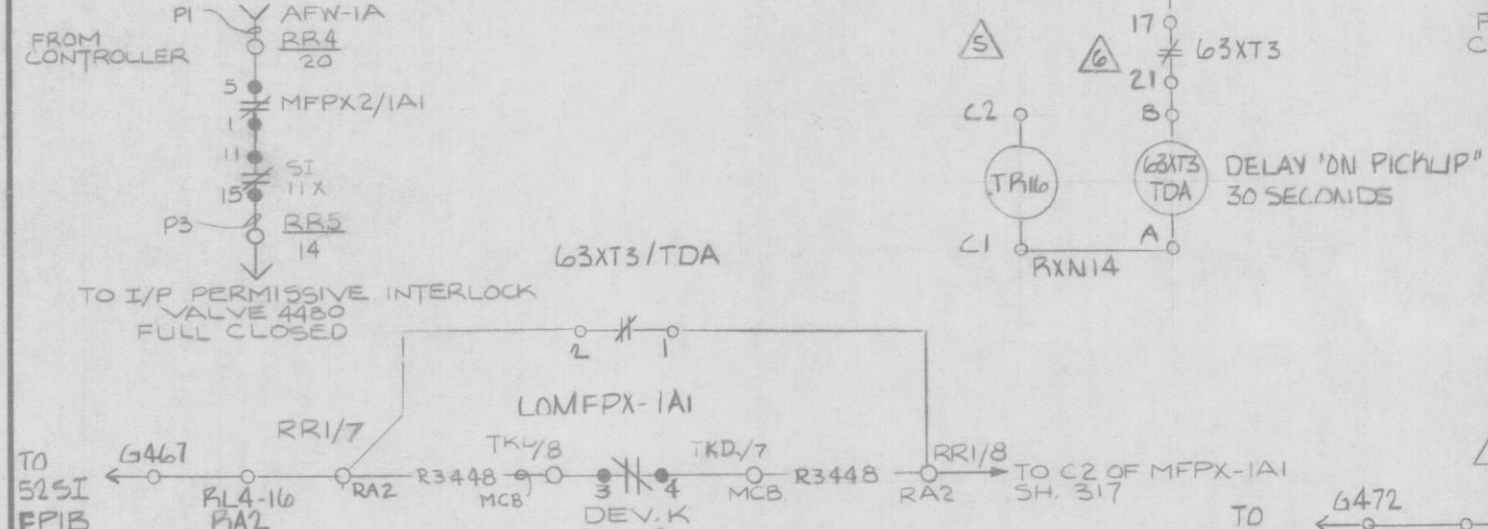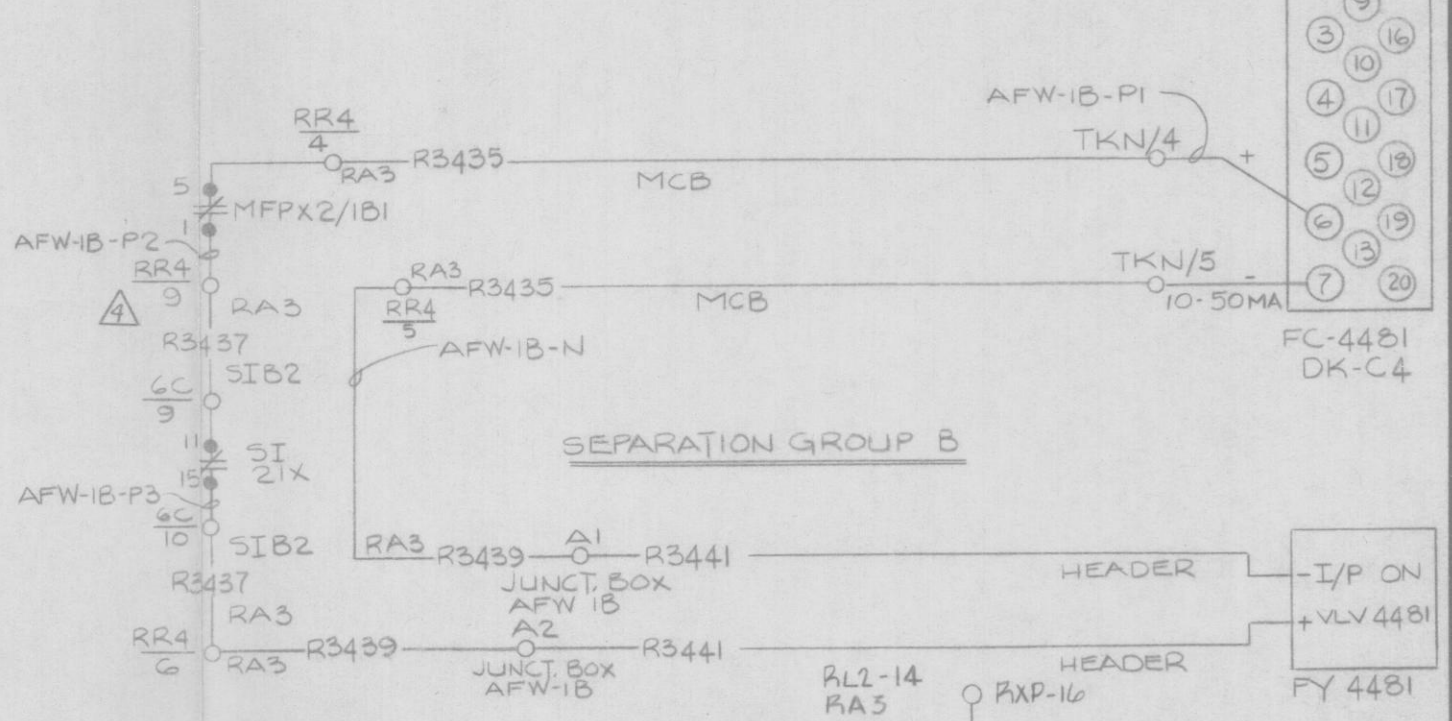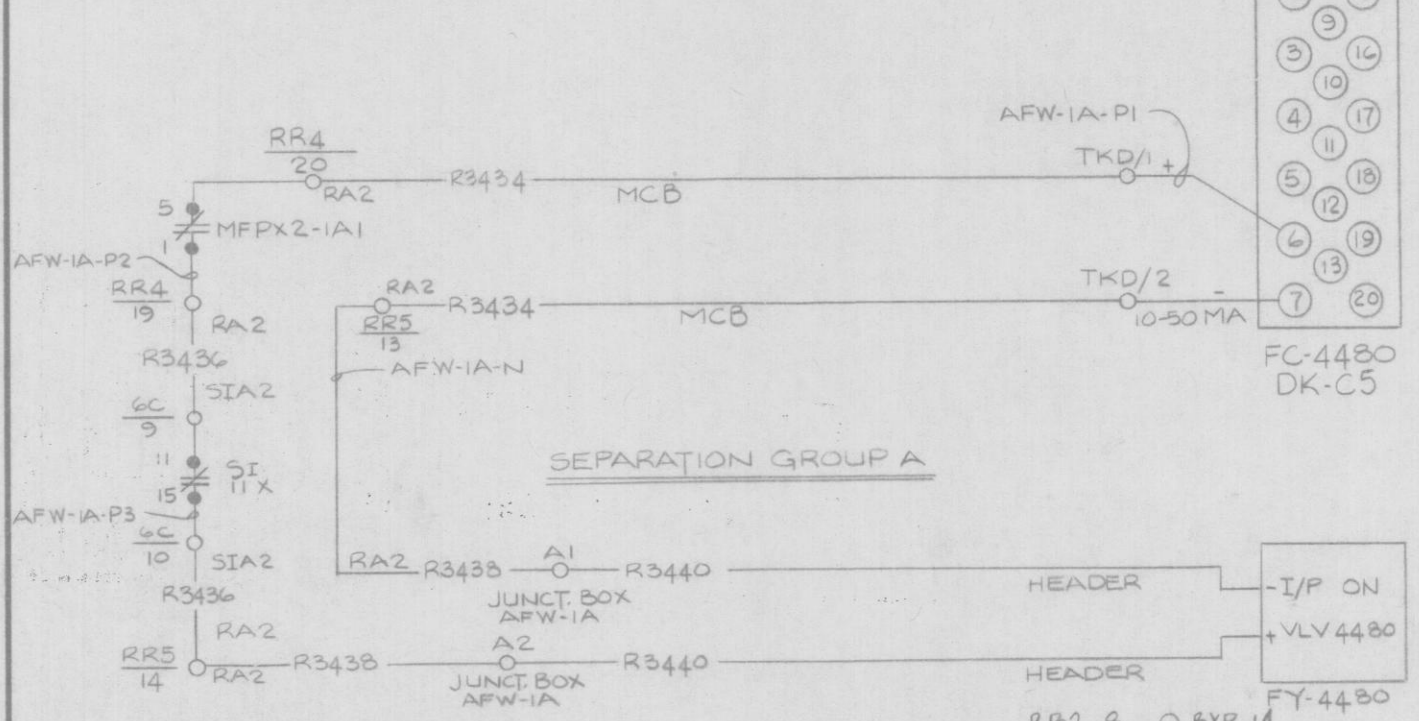

CONSTRUCTION
LIMITED CONSTRUCTION: AS NOTED
PRELIMINARY NOT FOR CONSTRUCTION
BIDDING PURPOSES
FOR INFORMATION ONLY
RELEASED FOR

DATE: SEP 21 '81

ENGR.

29

Docket # 50-244
Control # 8109290350
Date 9-22-81 of Document
REGULATORY DOCKET FILE

REVISION	DATE	INITIAL	REVISION
6	7/16/81	JWA	ENGR. MANGR.
5	7/17/81	JWA	RESP. ENGR.
4	6/1/81	RAB	CHECKED
3	7/19/79	RAB	DRAWN BY
2	2/26/79	RST	DATE
1	2-23-79	RST	ORIGINAL

AUXILIARY FEEDWATER BYPASS
CONTROL ELEMENTARY

FACILITY GINNA STA
SCALE NONE

ROCHESTER GAS & ELECTRIC CORP.
ROCHESTER, NEW YORK

JOB NO. EWR 1451
DRAWING NO. 10905-441