

QUALITY ASSURANCE MANUAL GINNA STATION ROCHESTER GAS & ELECTRIC CORPORATION	---	REV. 11	PAGE 1 OF 27
	EFFECTIVE DATE: November 1, 1987		
TITLE: APPENDIX B Ginna Station Inservice Inspection Program For the 1980-1989 Interval		SIGNATURE	DATE
	PREPARED BY:	<i>W.P. Falley</i>	7/24/87
	QUALITY ASSURANCE REVIEW	<i>C.R. Anderson</i>	7/24/87
	APPROVED BY:	<i>W.E. Curtis, Jr.</i>	7/24/87

Program Table of Contents

Introduction:	Discussion
Program:	ISI 1.0 Scope and Responsibility
	ISI 2.0 Inspection Intervals
	ISI 3.0 Extent and Frequency
	ISI 4.0 Examination Methods
	ISI 5.0 Evaluation of Examination Results
	ISI 6.0 Repair Requirements
	ISI 7.0 System Pressure Testing
	ISI 8.0 Snubbers
	ISI 9.0 Records and Reports
	ISI 10.0 Exemptions
References:	
Tables:	ISI 1.1 Quality Group A Components, Parts and Method of Examination
	ISI 1.2 Quality Group B Components, Parts and Method of Examination
	8.1 Safety Related Hydraulic Snubbers
	8.2 Safety Related Mechanical Snubbers
	Attachment A - Quality Groups A, B, and C Exemptions

QUALITY ASSURANCE MANUAL GINNA STATION	TITLE: APPENDIX B Ginna Station Inservice Inspection Program For the 1980-1989 Interval	DATE 11/1/87
		PAGE 2 OF 27

INTRODUCTION

Appendix B of this Quality Assurance Manual describes Ginna's Inservice Inspection Program for the 120 month inspection interval commencing January 1, 1980 and ending December 31, 1989. Included in this program are the following portions of systems and/or components:

- Quality Group A Components - Quality Group B Components - Quality Group C Components - High Energy Piping Outside of Containment - Steam Generator Tubing - Reactor Coolant Pump Flywheels

Following the guidance of Reference 1, Section XI of the Code, Ginna's Inservice Inspection Program adheres to the requirements of Section 50.55a of the Code of Federal Regulations, Reference 2. This program, however, excludes the controls of the Authorized Nuclear Inspector, Enforcement Authority, Reporting Systems, and N-Stamp Symbol.

The Inservice Inspection Program for Quality Groups A, B and C components, as defined in Regulatory Guide 1.26, Reference 3, is controlled by Ginna's Quality Assurance Program for Station Operation. This same program which is also in compliance with the referenced Section XI, provides the most acceptable guidelines and latest techniques currently being utilized in the performance of an inservice inspection.

Repairs to Quality Groups A, B and C components shall be performed in accordance with the Owner's Design Specification and Construction Code of the component or system. Later editions of the Construction Code or ASME Section III, either in its entirety or portions thereof, can also be used. If repair welding can not be performed in accordance with these requirements, then Article 4000 of Reference 11 will be used.

As indicated in Rochester Gas and Electric's report, Reference 4, and Augmented Inservice Inspection Program for high energy piping outside of containment has been established. The inspection program provides for volumetric examination on all circumferential butt welds situated at design break locations or at discontinuity locations where probable failure could occur. Surveillance of these welds can detect material

QUALITY ASSURANCE MANUAL GINNA STATION	TITLE: APPENDIX B Ginna Station Inservice Inspection Program For the 1980-1989 Interval	DATE 11/1/87
		PAGE 3 OF 27

changes in advance of a potential failure, thereby assuring that the design basis or consequential main steam or feedwater break will not occur.

The Inservice Inspection Program for steam generator tubes was developed to meet the guidance of Reference 5. At regular intervals, tubes within each leg of the steam generator are examined and evaluated for acceptable tube wall thickness.

The Inservice Inspection Program for reactor coolant pump flywheels was developed to meet the guidance of Reference 12. At the intervals suggested, the reactor coolant pump flywheel will be examined by either the volumetric or surface examination method, and evaluated to the specified acceptance criteria.

The Inservice Inspection Program for snubbers is developed based on the guidance of Reference 13.

Identification is given in Section 10.0 of Ginna's Inservice Inspection Program for those areas which deviate from the requirements of Reference 1. Where applicable, currently approved edition and addendas of Section XI will be utilized for clarification and guidance. It is the intent of Rochester Gas and Electric Corporation to continually apply appropriate changes in the Code which improves the overall quality of Ginna's total Inservice Inspection Program.

PROGRAM

ISI 1.0 Scope and Responsibility

- 1.1 Components of Quality Groups A and B are listed in Tables ISI-1.1 and 1.2, respectively. Quality Group C components are identified in Appendix A of Ginna's Quality Assurance Manual. The specific components to be examined for each Quality Group shall be defined in the Examination Plans by title and/or number.
- 1.2 The Inservice Inspection Program for high energy piping outside of containment consists of main steam and feedwater piping welds is detailed in the Examination Plan for High Energy Piping.



10
11
12

13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65
66
67
68
69
70
71
72
73
74
75
76
77
78
79
80
81
82
83
84
85
86
87
88
89
90
91
92
93
94
95
96
97
98
99
100
101
102
103
104
105
106
107
108
109
110
111
112
113
114
115
116
117
118
119
120
121
122
123
124
125
126
127
128
129
130
131
132
133
134
135
136
137
138
139
140
141
142
143
144
145
146
147
148
149
150
151
152
153
154
155
156
157
158
159
160
161
162
163
164
165
166
167
168
169
170
171
172
173
174
175
176
177
178
179
180
181
182
183
184
185
186
187
188
189
190
191
192
193
194
195
196
197
198
199
200
201
202
203
204
205
206
207
208
209
210
211
212
213
214
215
216
217
218
219
220
221
222
223
224
225
226
227
228
229
230
231
232
233
234
235
236
237
238
239
240
241
242
243
244
245
246
247
248
249
250
251
252
253
254
255
256
257
258
259
260
261
262
263
264
265
266
267
268
269
270
271
272
273
274
275
276
277
278
279
280
281
282
283
284
285
286
287
288
289
290
291
292
293
294
295
296
297
298
299
300
301
302
303
304
305
306
307
308
309
310
311
312
313
314
315
316
317
318
319
320
321
322
323
324
325
326
327
328
329
330
331
332
333
334
335
336
337
338
339
340
341
342
343
344
345
346
347
348
349
350
351
352
353
354
355
356
357
358
359
360
361
362
363
364
365
366
367
368
369
370
371
372
373
374
375
376
377
378
379
380
381
382
383
384
385
386
387
388
389
390
391
392
393
394
395
396
397
398
399
400
401
402
403
404
405
406
407
408
409
410
411
412
413
414
415
416
417
418
419
420
421
422
423
424
425
426
427
428
429
430
431
432
433
434
435
436
437
438
439
440
441
442
443
444
445
446
447
448
449
450
451
452
453
454
455
456
457
458
459
460
461
462
463
464
465
466
467
468
469
470
471
472
473
474
475
476
477
478
479
480
481
482
483
484
485
486
487
488
489
490
491
492
493
494
495
496
497
498
499
500
501
502
503
504
505
506
507
508
509
510
511
512
513
514
515
516
517
518
519
520
521
522
523
524
525
526
527
528
529
530
531
532
533
534
535
536
537
538
539
540
541
542
543
544
545
546
547
548
549
550
551
552
553
554
555
556
557
558
559
560
561
562
563
564
565
566
567
568
569
570
571
572
573
574
575
576
577
578
579
580
581
582
583
584
585
586
587
588
589
590
591
592
593
594
595
596
597
598
599
600
601
602
603
604
605
606
607
608
609
610
611
612
613
614
615
616
617
618
619
620
621
622
623
624
625
626
627
628
629
630
631
632
633
634
635
636
637
638
639
640
641
642
643
644
645
646
647
648
649
650
651
652
653
654
655
656
657
658
659
660
661
662
663
664
665
666
667
668
669
670
671
672
673
674
675
676
677
678
679
680
681
682
683
684
685
686
687
688
689
690
691
692
693
694
695
696
697
698
699
700
701
702
703
704
705
706
707
708
709
710
711
712
713
714
715
716
717
718
719
720
721
722
723
724
725
726
727
728
729
730
731
732
733
734
735
736
737
738
739
740
741
742
743
744
745
746
747
748
749
750
751
752
753
754
755
756
757
758
759
760
761
762
763
764
765
766
767
768
769
770
771
772
773
774
775
776
777
778
779
780
781
782
783
784
785
786
787
788
789
790
791
792
793
794
795
796
797
798
799
800
801
802
803
804
805
806
807
808
809
810
811
812
813
814
815
816
817
818
819
820
821
822
823
824
825
826
827
828
829
830
831
832
833
834
835
836
837
838
839
840
841
842
843
844
845
846
847
848
849
850
851
852
853
854
855
856
857
858
859
860
861
862
863
864
865
866
867
868
869
870
871
872
873
874
875
876
877
878
879
880
881
882
883
884
885
886
887
888
889
890
891
892
893
894
895
896
897
898
899
900
901
902
903
904
905
906
907
908
909
910
911
912
913
914
915
916
917
918
919
920
921
922
923
924
925
926
927
928
929
930
931
932
933
934
935
936
937
938
939
940
941
942
943
944
945
946
947
948
949
950
951
952
953
954
955
956
957
958
959
960
961
962
963
964
965
966
967
968
969
970
971
972
973
974
975
976
977
978
979
980
981
982
983
984
985
986
987
988
989
990
991
992
993
994
995
996
997
998
999
1000

QUALITY ASSURANCE MANUAL GINNA STATION	TITLE:	APPENDIX B Ginna Station Inservice Inspection Program For the 1980-1989 Interval	DATE 11/1/87
			PAGE 4 OF 27

1.3 The Inservice Inspection Program for steam generator tubes, which is outlined in this program, was developed to the guidance provided in Reference 5, is detailed in Ginna's station procedures.


1.4 The Inservice Inspection Program for reactor coolant pump flywheels, which is outlined in this program, was developed to the guidance provided in Reference 12, is detailed in Ginna's station procedures.

ISI 2.0 Inspection Intervals

2.1 The inservice inspection (ISI) intervals for Quality Group A components shall be ten year intervals of service commencing January 1, 1970. This program defines the ISI requirements for the second interval for Quality Group A components. The ten year examination plan shall describe the distribution of examinations within the inspection interval in accordance with IWB-2400 of Reference 1.

2.2 The inservice inspection intervals for Quality Group B components shall be ten year intervals of service beginning on May 1, 1973, January 1, 1980, 1990 and 2000, respectively. This program defines the ISI requirements for the second interval for Quality Group B components. The ten year examination plan shall describe the distribution of examinations within the inspection interval in accordance with IWC-2400 of Reference 1.

2.3 The inservice inspection intervals for Quality Group C components shall be ten year intervals of service beginning on May 1, 1973, January 1, 1980, 1990 and 2000, respectively. This program defines the ISI requirements for the second interval Quality Group C components. The ten year examination plan shall describe the distribution of examinations within the inspection interval in accordance with IWD-2400 of Reference 1.

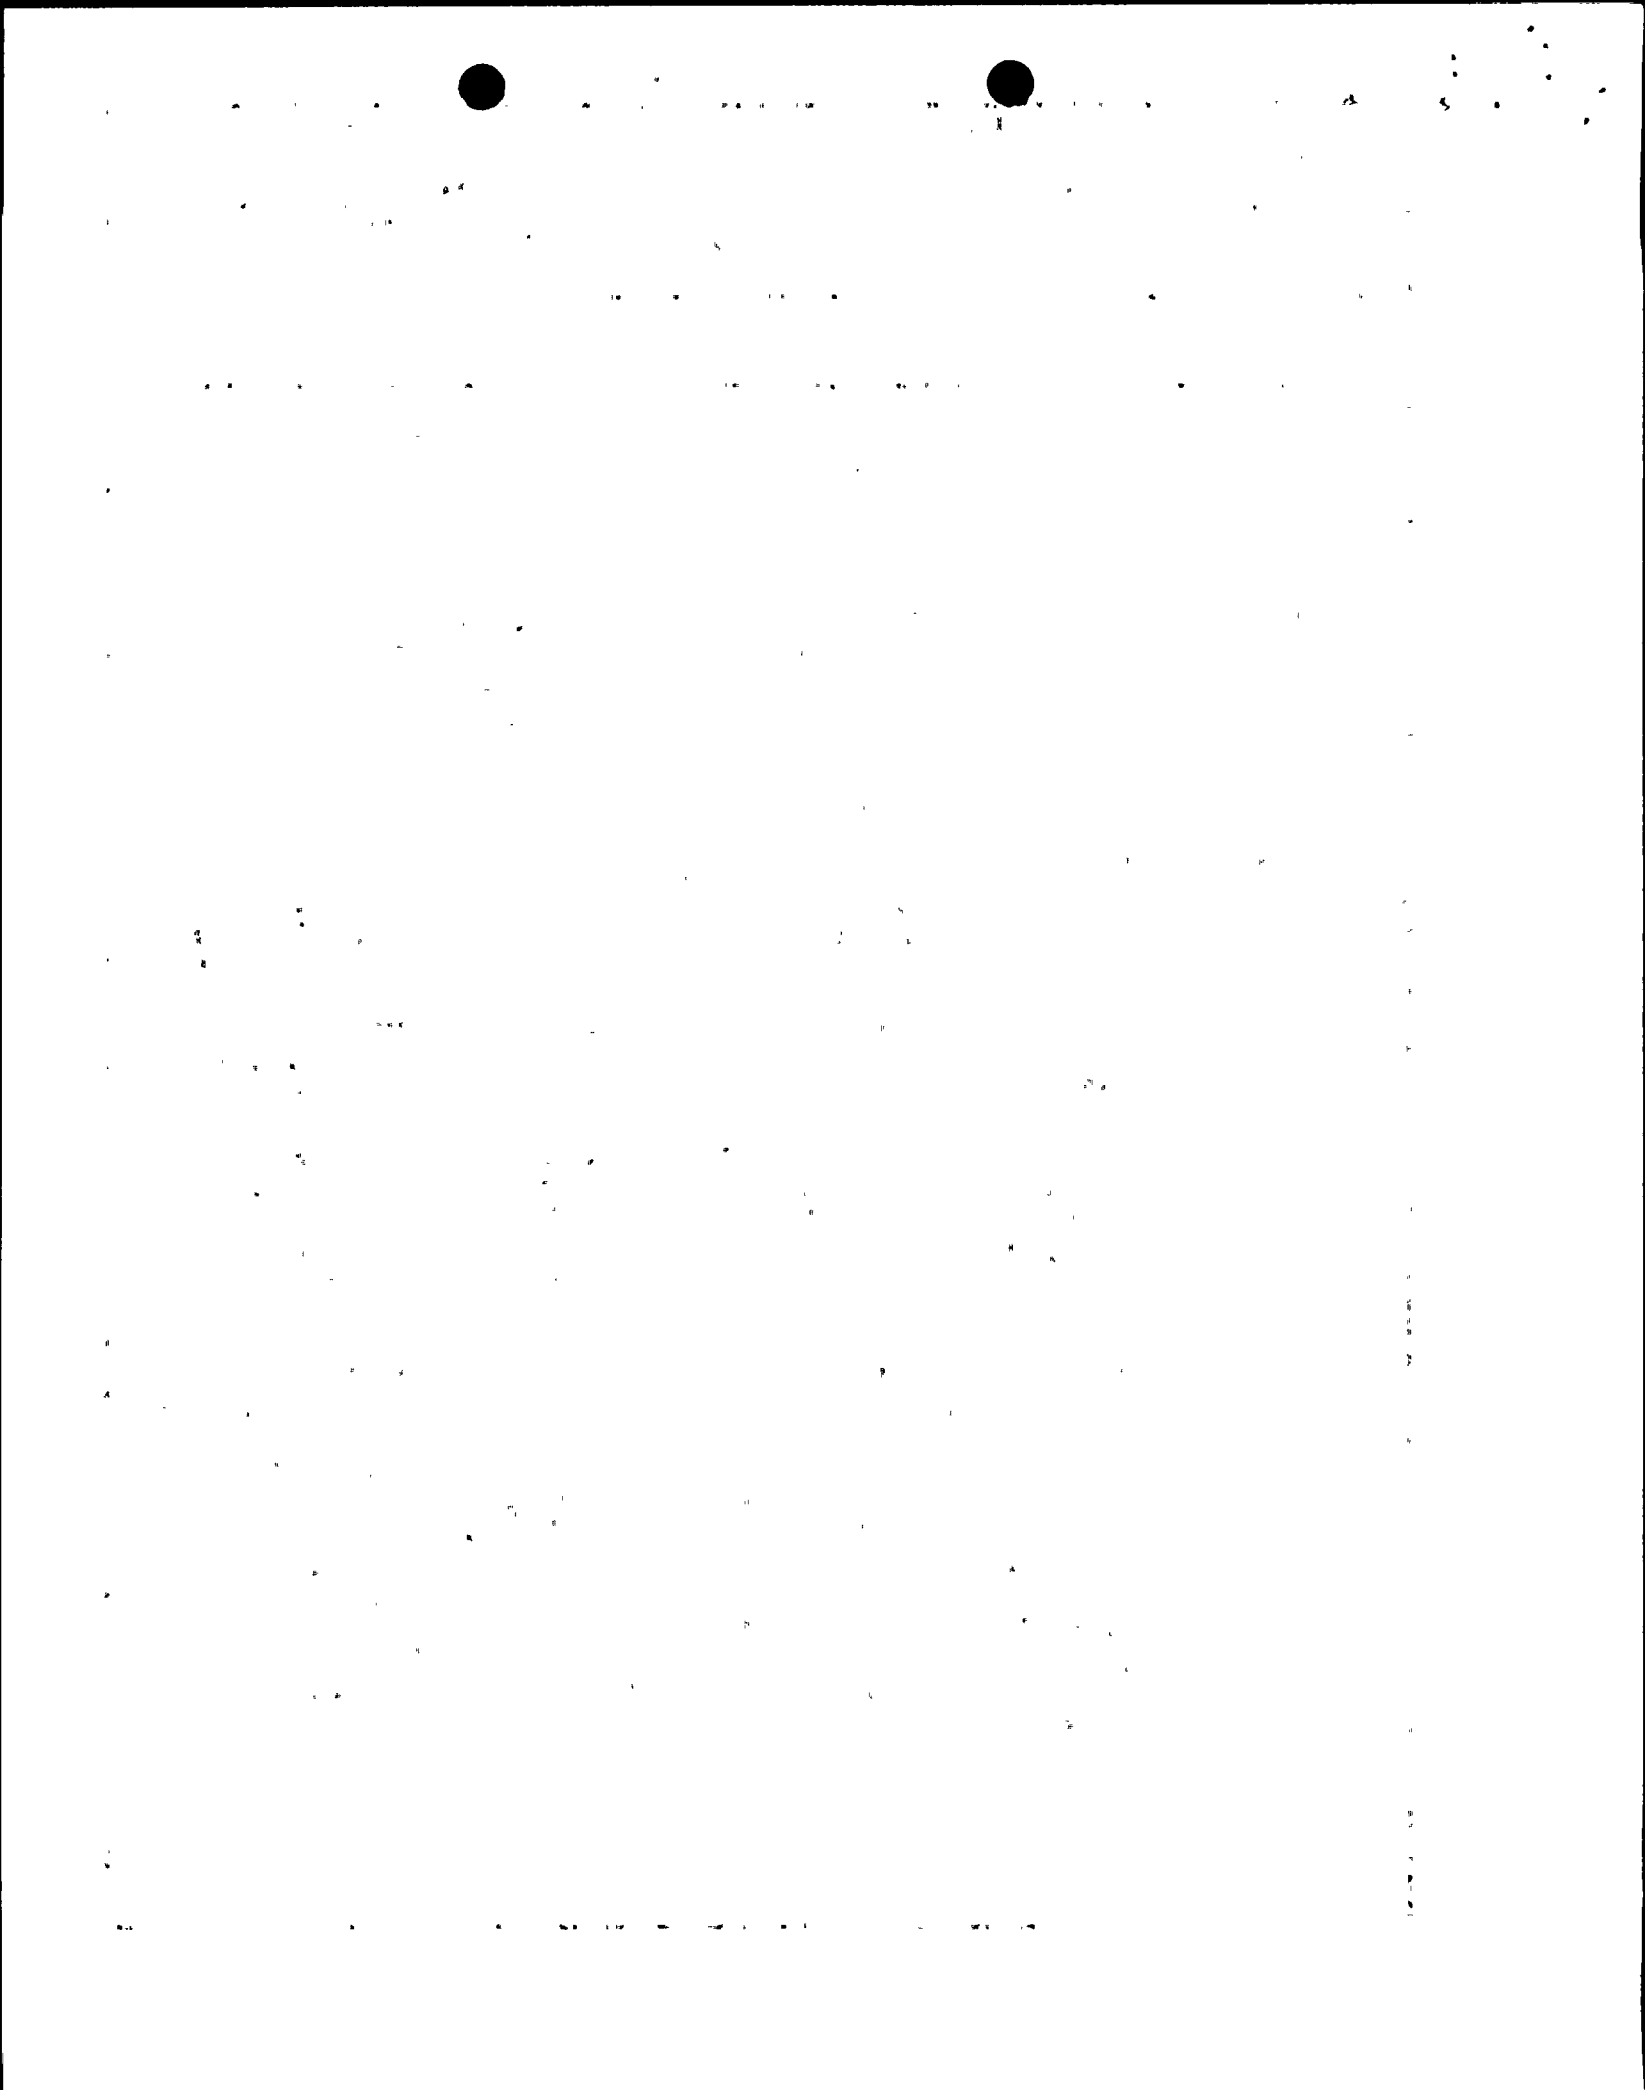

QUALITY ASSURANCE MANUAL GINNA STATION	TITLE:	APPENDIX B Ginna Station Inservice Inspection Program For the 1980-1989 Interval	DATE	11/1/87
			PAGE	5 OF 27

- 2.4 The inservice inspection intervals for the high energy piping outside of containment shall be ten year intervals of service beginning May 1, 1973, January 1, 1980, 1990 and 2000, respectively. The ten year examination plan shall describe the distribution of examinations within the inspection interval in accordance with the requirements of Reference 4.
- 2.5 The inservice inspection intervals for the examination of steam generator tubes shall not be more than 24 months. However, if over a nominal 2 year period (e.g., two normal fuel cycles) at least 2 examinations of the separate legs result in less than 10% of the tubes with detectable wall penetration (greater than 20%) and no significant (greater than 10%) further penetration of tubes with previous indications, the inspection interval of the individual legs may be extended to once every 40 months.
- 2.6 As permitted by IWA-2400 of Reference 1, the inservice inspection interval for Quality Groups A, B and C and high energy piping outside containment may be extended as necessary.
- 2.7 The inservice inspection intervals for the reactor coolant pump flywheel shall be approximately 10 year intervals of service commencing on January 1, 1970. For areas of high stress concentration at the bore and keyway, a reduced interval of approximately 3 years shall be applied. The ten year examination plan shall describe the distribution of examinations within the inspection interval in accordance with the requirements of Reference 12.
- ISI 3.0 Extent and Frequency
- 3.1 Quality Group A components, as listed in Table ISI-1.1 shall be examined to the extent and frequency as required in Table IWB-2500 of Reference 1.




Faint, illegible text at the top of the page, possibly a header or title area.

Main body of faint, illegible text, appearing as a large block of scattered characters and noise.

QUALITY ASSURANCE MANUAL GINNA STATION	TITLE: APPENDIX B Ginna Station Inservice Inspection Program For the 1980-1989 Interval	DATE 11/1/87
		PAGE 6 OF 27

3.2	Quality Group B components, as listed in Table ISI-1.2, shall be examined to the extent and frequency as required in IWC-2400 and Table IWC-2500 of Reference 1.
3.3	Quality Group C components as described in the ten year examination plan shall be examined to the extent and frequency required in IWD-2400 and IWD-2600 of Reference 1.
3.4	High energy piping welds outside of containment shall be examined to the following extent and frequency:
3.4.1	During each period of the first inspection interval, all welds at design break locations and one-third of all welds at locations where a weld failure would result in unacceptable consequences, will be volumetrically examined.
3.4.2	During each period of succeeding intervals, one-third of all welds at design break locations and one-third of all welds at locations where a weld failure would result in unacceptable consequences, shall be volumetrically examined.
3.5	The extent and selection of steam generator tube examinations shall be as described in Sections C.4 and C.5 of Reference 5, with the interpretation that examination in a leg of all previously defective tubes (greater than 20% detectable wall penetration) and up to a maximum of two hundred previously defect-free tubes (less than 20% detectable wall penetration) is deemed sufficient in meeting the requirements of Reference 5.
3.5.1	In the event a primary to secondary leak exceeds technical specification limit, a limited number of tubes shall be examined at the next refueling outage.
3.5.2	In the event of a seismic occurrence greater than that for which the plant is designed to continue operation, Reference 6, a special examination of a limited number of tubes shall be conducted.

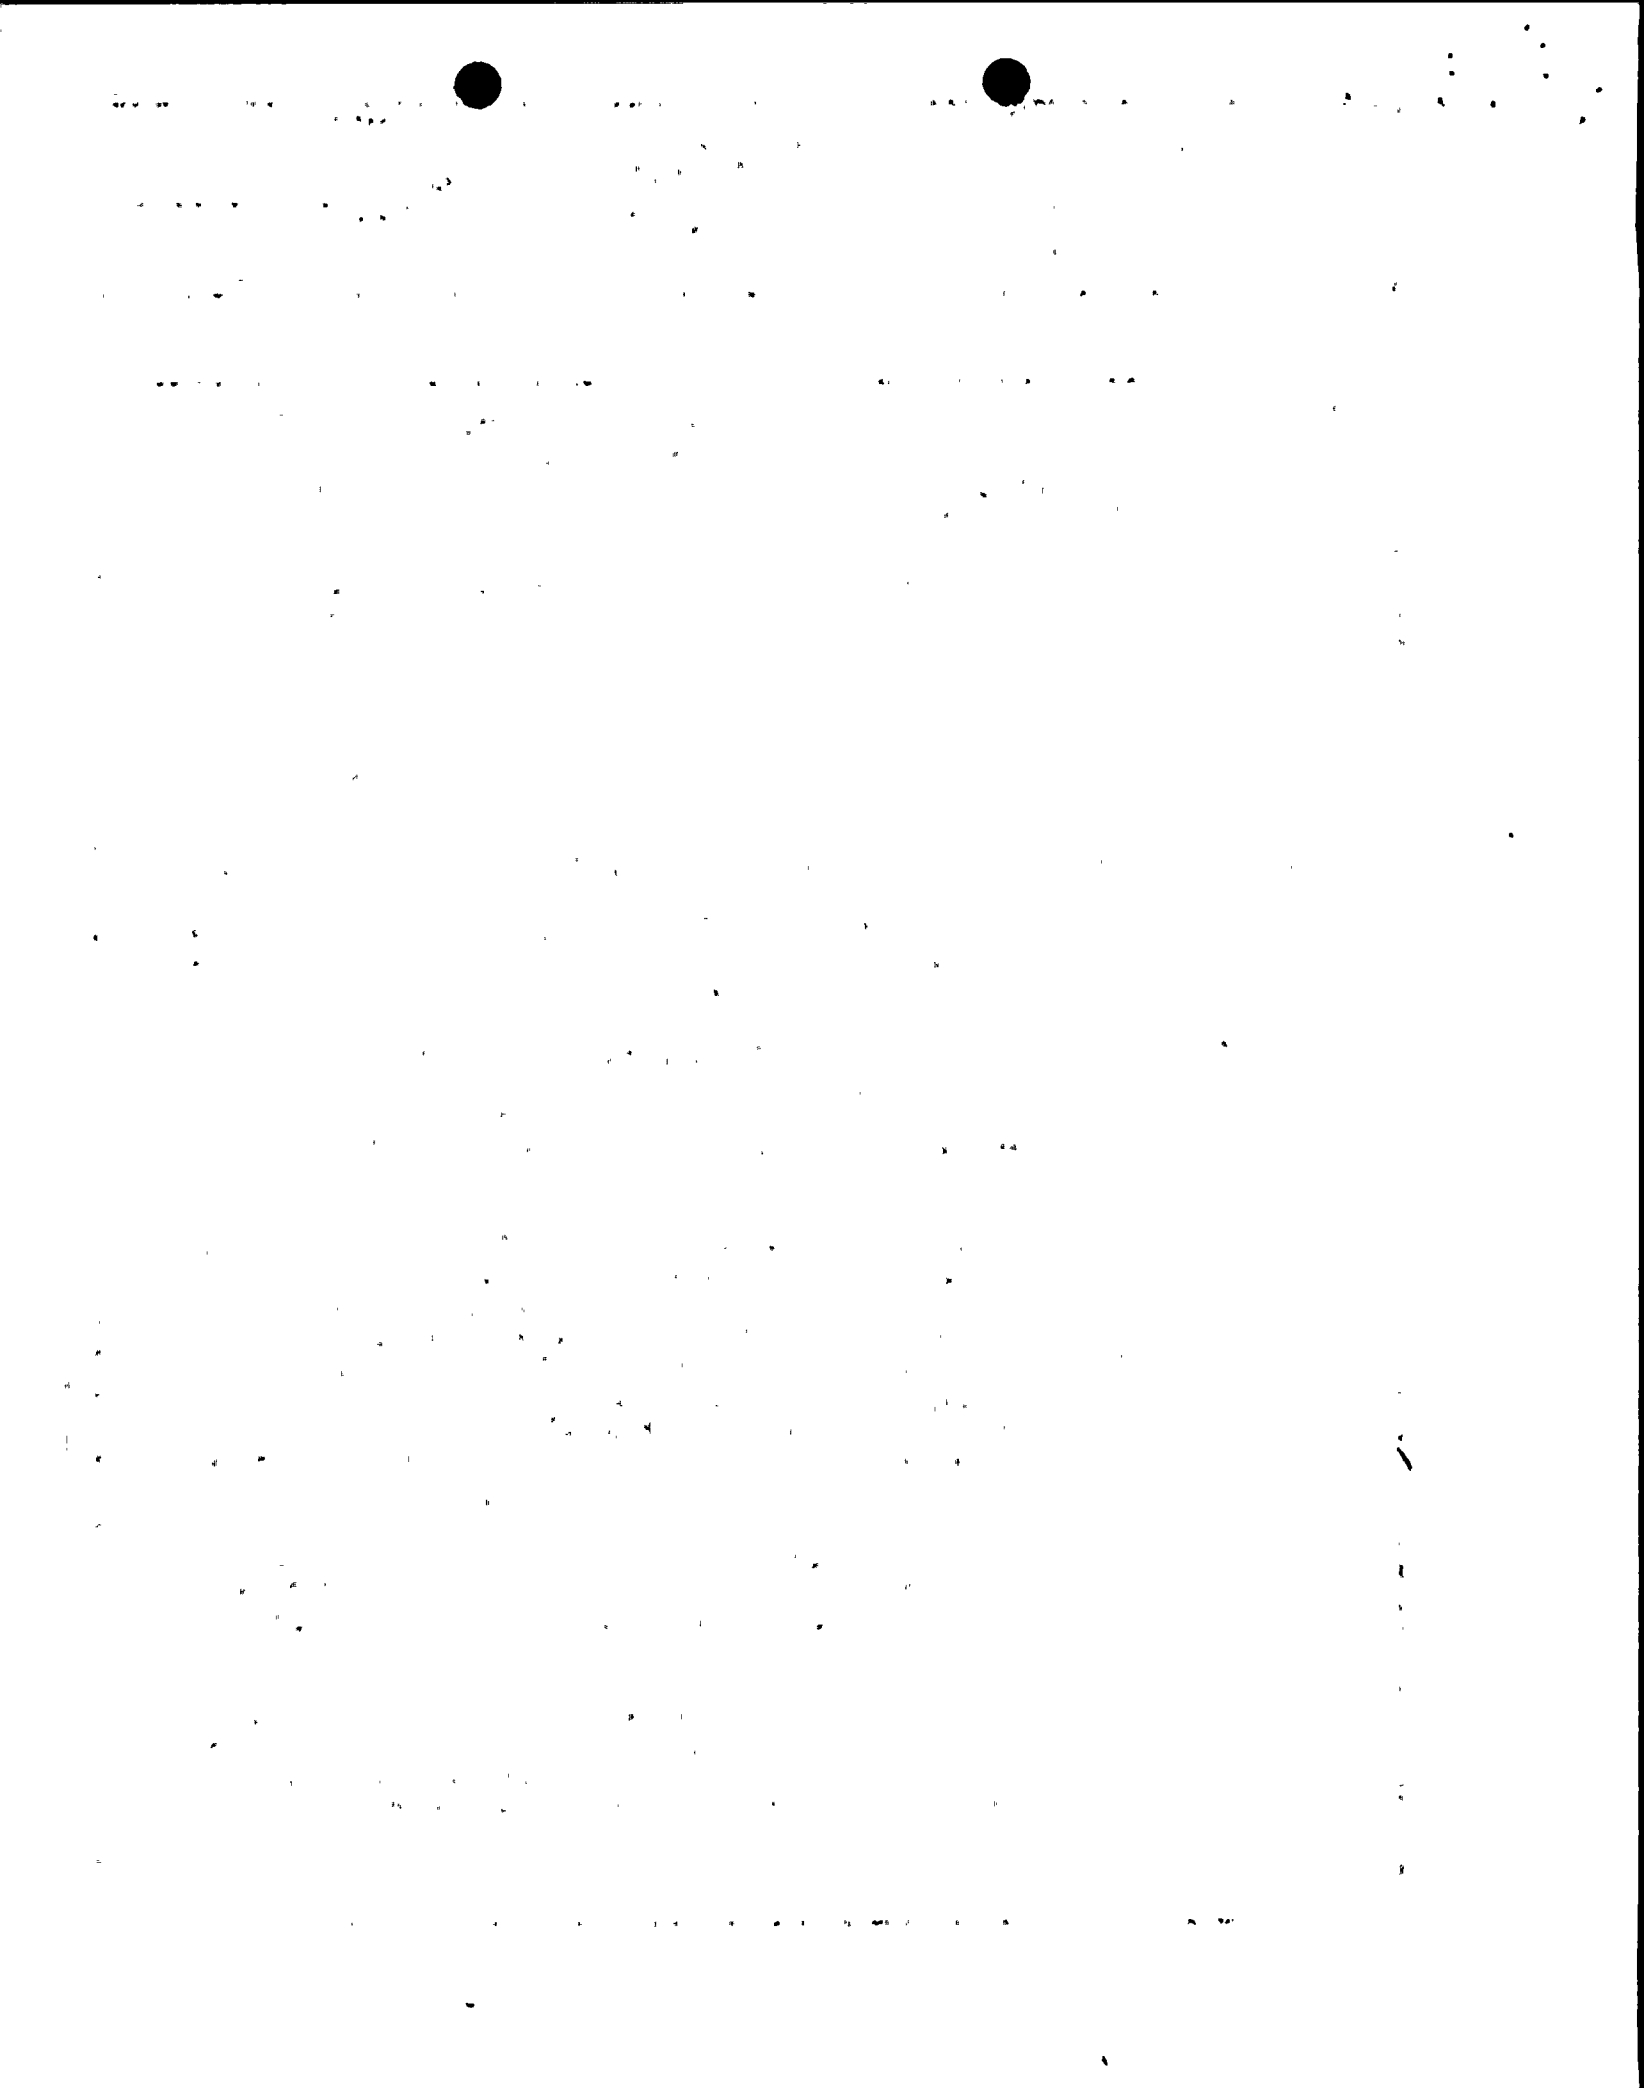

QUALITY ASSURANCE MANUAL GINNA STATION	TITLE: APPENDIX B Ginna Station Inservice Inspection Program For the 1980-1989 Interval	DATE 11/1/87
		PAGE 7 OF 27

3.5.3 In the event of a major steam line or feedwater line break, or a loss-of-coolant accident (LOCA) which imposes a significant pressure transient on the steam generators and requires actuation of the engineered safe-guards, a special examination of a limited number of tubes shall be conducted.

3.6 The reactor coolant pump flywheel, listed in Table ISI-1.1, shall be examined to the extent and frequency as required in Reference 12.

ISI 4.0 Examination Methods

4.1 Quality Groups A and B components shall be examined by the required visual, surface or volumetric methods. These examinations shall include one or a combination of the following: visual, liquid penetrant, magnetic particle, ultrasonic, eddy-current or radiographic examination. These methods, shall as a minimum, be in accordance with the rules of IWA-2000 of Reference 1.


4.1.1 Ultrasonic examinations shall be performed in accordance with the following:

4.1.1.1 For ferritic vessels with wall thickness of 2-1/2 inches or greater, an ultrasonic examination shall be conducted in accordance with the rules of Appendix I of Reference 1.

4.1.1.2 For ferritic piping systems, an ultrasonic examination shall be conducted in accordance with the rules of Appendix III of Reference 7.

4.1.1.3 For components other than those listed in 4.1.1.1 and 4.1.1.2, an ultrasonic examination shall be conducted in accordance with the rules of Article 5 of Reference 8.

4.1.1.4 All indications which produce a response greater than 50% of the reference level shall be recorded.



QUALITY ASSURANCE MANUAL GINNA STATION	TITLE:	APPENDIX B Ginna Station Inservice Inspection Program For the 1980-1989 Interval	DATE 11/1/87
			PAGE 8 OF 27

- 4.1.1.5 All indications which produce a response greater than or equal to 100% of the reference level shall be investigated to the extent that the operator can evaluate the shape, identity, and location of all such reflectors in terms of the acceptance/rejection standards of IWA-3100 (b) of Reference 1. The length of reflectors shall be measured between points which give amplitudes equal to 100% of the reference level.
- 4.2 Quality Group C components shall be visually examined for leakage during a system pressure test in accordance with IWA-2200 of Reference 11. Supports and hangers shall be visually inspected in accordance with IWD-2600 of Reference 1.
- 4.3 High energy piping welds outside of containment shall be radiographically examined.
- 4.4 Steam generator tubes shall be examined by a volumetric method (e.g. eddy current) or alternative method which is acceptable.
- 4.5 Reactor coolant pump flywheels shall be examined by the required surface and volumetric methods, in accordance with the requirements of IWA-2200 of Reference 1.
- ISI 5.0 Evaluation of Examination Results
- 5.1 The evaluation of nondestructive examination results shall be in accordance with Article IWB-3000 of Reference 1. All reportable indications shall be subject to comparison with previous data to aid in its characterization and in determining its origin.
- 5.2 Quality Group B Components
- 5.2.1 The evaluation of nondestructive examination results shall be in accordance with Article IWC-3000 of Reference 1. All reportable indications shall be subject to comparison with previous data to aid in its characterization and in determining its origin.
- 5.3 Quality Group C Components

QUALITY ASSURANCE MANUAL GINNA STATION	TITLE:	APPENDIX B Ginna Station Inservice Inspection Program For the 1980-1989 Interval	DATE 11/1/87
			PAGE 9 OF 27

- 5.3.1 The evaluation of the visual examination results shall be in accordance with Article IWA-5000 of Reference 1 for hangers and supports and Reference 11 for pressure tests.
- 5.4 High Energy Piping
- 5.4.1 The evaluation of nondestructive examination results shall be in accordance with Reference 9.
- 5.5 Indications that were recorded in previous pre-service or inservice inspections and which were not characterized as propagating flaws are acceptable for continued service.
- 5.6 The evaluation of any corroded area shall be performed in accordance with Article IWA-5000 of Reference 11.
- 5.7 Steam Generator Tubes and Tube Sleeve Combinations
- 5.7.1 Repair
- 5.7.1.1 Steam generator tubes that have imperfections greater than 40% through wall, as indicated by eddy current, shall be repaired by plugging or sleeving.
- 5.7.1.2 Steam generator sleeves that have imperfections greater than 30% through wall, as indicated by eddy current, shall be repaired by plugging.
- 5.7.2 Reporting
- 5.7.2.1 Within 15 days following the completion of the evaluation of each inservice inspection of steam generator tubes, the number of tubes required by 5.7.1 above to be plugged or sleeved in each steam generator shall be reported to the Commission in a Special Report pursuant to Technical Specification 6.9.3.4.
- 5.7.2.2 The complete results of the steam generator tube inservice inspection shall be submitted to the

QUALITY ASSURANCE MANUAL GINNA STATION	TITLE:	APPENDIX B Ginna Station Inservice Inspection Program For the 1980-1989 Interval	DATE	11/1/87
			PAGE	10 OF 27

Commission in a Special Report pursuant to Technical Specification 6.9.3.4 within 12 months following the completion of the inspection. This Special Report shall include:

1. Number and extent of tubes inspected.
2. Location and percent of wall-thickness penetration for each indication of an imperfection.
3. Identification of tubes plugged or sleeved.

5.7.2.3 If the number of tubes in a generator falling into categories (a) or (b) below exceeds the criteria, then results of the inspection shall be considered a Reportable Event pursuant to 10 CFR 50.73. Oral notification of NRR shall be accomplished within 48 hours, but no sooner than the next normal working day after the final review of the eddy current results. A written followup report shall provide a description of investigations conducted to determine the course of the tube degradation and corrective measures taken to preclude recurrence. Categories (a) and (b) are:

- (a) More than 10% of the total tubes inspected are degraded (imperfections greater than 20% of the nominal wall thickness). However, previously degraded tubes must exhibit at least 10% further wall penetration to be included in this calculation.
- (b) More than 1% of the total tubes inspected are degraded (imperfections greater than the plugging limit).

ISI 6.0 Repair Requirements

- 6.1 Repair of Quality Groups A, B and C components shall be performed in accordance with the applicable Subsections of Reference 11.
- 6.2 Examinations associated with repairs or modifications shall meet the applicable design and inspection Code requirements as described in the following paragraphs:



Small handwritten marks and characters in the top right corner.

Main body of the page containing faint, illegible text or markings.

QUALITY ASSURANCE MANUAL GINNA STATION	TITLE:	APPENDIX B Ginna Station Inservice Inspection Program For the 1980-1989 Interval	DATE	11/1/87
			PAGE	11 OF 27

- 6.2.1 Whenever Quality Groups A, B or C System modifications or repairs have been made which involve new strength welds on components greater than 2 inches diameter, the new welds shall receive both surface and 100 percent volumetric nondestructive examinations.
- 6.2.2 Whenever system modifications or repairs have been made which involve new strength welds on Quality Groups A, B or C components of 2 inches or less, a surface examination shall be performed.
- 6.3 Surface defects in Quality Groups A, B or C bolts, studs, nuts and ligaments may be removed by mechanical means provided the removal of that defect does not alter the basic configuration of the item. Bolts, studs and nuts that have defects that cannot be removed by mechanical means shall be replaced.
- 6.4 Repair of high energy piping welds outside of containment shall be performed in accordance with the applicable Code specified in Reference 11.
- 6.5 Repair of Steam Generator Tubes
- 6.5.1 Repair of steam generator tubes that have unacceptable defects shall be performed by using a tube plugging technique or by sleeving.
- 6.5.2 Preventative sleeving of tubes as part of a preventative maintenance program may also be accomplished.
- 6.6 Repair of steam generator sleeves that have unacceptable defects shall be performed by using a tube plugging technique.
- 6.7 Repair of reactor coolant pump flywheel that have unacceptable defects shall be performed in accordance with Reference 12.
- ISI 7.0 System Pressure Testing
- 7.1 General Requirements
- 7.1.1 System pressure test shall be conducted in accordance with Article IWA-5000 of Reference 11.

[The body of the document contains extremely faint and illegible text, likely bleed-through from the reverse side of the page. The text is scattered across the page and does not form any recognizable words or sentences.]

QUALITY ASSURANCE MANUAL GINNA STATION	TITLE: APPENDIX B Ginna Station Inservice Inspection Program For the 1980-1989 Interval	DATE 11/1/87
		PAGE 12 OF 27

7.1.2 Repairs of corroded areas shall be performed in accordance with Section 6.0 of this program.

7.2 Quality Group A Components

7.2.1 Whenever the reactor coolant system is closed after it has been opened, the system shall be leak tested to the requirements of Article IWB-5000 of Reference 11. Temperature and pressure requirements of Figure 3.1-1, Section 3.1 of Ginna's "Technical Specifications" shall not be exceeded.

7.2.2 At or near the end of each inspection interval, a hydrostatic pressure test shall be performed on the reactor coolant system components. This test shall be conducted in accordance with the requirements of Article IWB-5000 of Reference 11. Test pressures and temperatures shall be maintained for at least four hours prior to performing the visual examination. Section 3.1 of Ginna's "Technical Specification" shall not be exceeded.

7.3 Quality Group B Components

7.3.1 At or near the end of each inspection interval, a hydrostatic pressure test shall be performed on Quality Group B Systems and Components. This test shall be conducted in accordance with the requirements of Article IWC-5000 of Reference 11. When Quality Group A systems and components are also being pressurized, the pressure and temperature shall comply with the requirements of Paragraph 7.2.2 of this Appendix. This test temperature and pressure shall be maintained for at least 10 minutes prior to the performance of the visual examination for uninsulated pipes and 4 hours for insulated pipes. During each period, systems or portions of systems not required to operate during normal reactor operation shall be pressure tested in accordance with IWC 5221. Inservice leakage tests may also be performed on other systems and components which are normally in service once each period.

QUALITY ASSURANCE MANUAL GINNA STATION	TITLE:	APPENDIX B Ginna Station Inservice Inspection Program For the 1980-1989 Interval	DATE	11/1/87
			PAGE	13 OF 27

7.4 Quality Group C Components

7.4.1 Quality Group C components shall have system pressure test in accordance with Article IWD-5000 of Reference 11.

ISI 8.0 Snubbers

8.1 Each snubber listed in Tables 8.1 and 8.2 shall be demonstrated to be operable by performance of the inservice inspection program defined in Technical Specification 4.14.

ISI 9.0 Records and Reports

9.1 Records and reports developed from those examinations performed in accordance with this Appendix shall be maintained in accordance with Article IWA-6000 of Reference 11.

ISI 10.0 Exemptions

10.1 Quality Groups A, B and C components exemptions are identified in Attachment A to this Appendix. However, Paragraphs IWB-1220 and IWC-1220 of Reference 1 exempt certain components from examinations, where certain conditions are met. These exemptions will be applied to the components listed on Tables ISI-1.1 and 1.2 with the result that only those non-exempt components are listed herein.

MEMORANDUM FOR THE DIRECTOR

DATE: 10/15/54

RE: [Illegible]

[Illegible]

SUBJECT: [Illegible]

[Illegible]

[Illegible]

[Illegible]

[Illegible]

[Illegible]

[Illegible]

QUALITY ASSURANCE MANUAL GINNA STATION	TITLE:	APPENDIX B Ginna Station Inservice Inspection Program For the 1980-1989 Interval	DATE 11/1/87
			PAGE 14 OF 27

REFERENCES

1. American Society of Mechanical Engineers (ASME) Boiler and Pressure Vessel Code (B&PVC) Section XI "Rules for Inservice Inspection of Nuclear Power Plant Components", 1974 Edition through Summer 1975 Addenda.
2. Code of Federal Regulations, Title 10, Part 50, dated January 1, 1978.
3. Nuclear Regulatory Commission, Regulatory Guide 1.26, Revision 1, dated February 1976 "Quality Group Classifications and Standards for Water, Steam, and Radioactive Waste-Containing Components of Nuclear Power Plants".
4. Rochester Gas and Electric Corporation Report "Effects of Postulated Pipe Breaks Outside the Containment Building", dated October 29, 1973.
5. Nuclear Regulatory Commission, Regulatory Guide 1.83, Revision 1, dated July 1975, "Inservice Inspection of Pressurized Water Reactor Steam Generator Tubes".
6. Ginna's Final Safety Analysis Report, Section 2.9.3.
7. ASME, B&PVC, Section XI, 1974 Edition through Summer 1976 Addenda.
8. ASME, B&PVC, Section V, 1974 Edition through Summer 1975 Addenda.
9. USAS B31.1.0 - 1967, "Power Piping".
10. ASME, B&PVC, Section III, 1974 Edition through Summer 1975 Addenda.
11. ASME, B&PVC Section XI, 1977 Edition through Summer 1978 Addenda.
12. Nuclear Regulatory Commission, Regulatory Guide 1.14, Revision 1, dated August 1975, "Reactor Coolant Pump Flywheel Integrity".
13. Letter dated March 23, 1981 from Darrell G. Eisenhut, Director, Division of Licensing, USNRC, regarding Technical Specification Revisions for Snubber Surveillance.

TABLE ISI 1.1
 QUALITY GROUP A
 COMPONENTS, PARTS, AND METHODS OF EXAMINATION

ITEM No.	EXAMINATION CATEGORY TABLE IWB-2500	COMPONENTS AND PARTS TO BE EXAMINED	METHOD
Reactor Vessel			
B1.1	B-A	Longitudinal and circumferential shall welds in core region.	Volumetric
B1.2	B-B	Longitudinal and circumferential welds in shell (other than those of Category B-A and B-C) and meridional and circumferential beam welds in bottom head and closure head (other than those of Category B-C).	Volumetric
B1.3	B-C	Vessel-to-flange and head-to-flange circumferential welds.	Volumetric
B1.4	B-D	Primary nozzle-to-vessel welds and nozzle internal welds.	Volumetric
B1.5	B-E	Vessel penetrations, including control rod drive and instrumentation penetrations.	Visual (IWA-5000)
B1.6	B-F	Nozzle-to-safe-end welds.	Volumetric and Surface
B6.10	B-G-1	Closure head nuts.	Surface
B6.20	B-G-1	Closure studs, in place.	Volumetric
B6.30	B-G-1	Closure studs, when removed.	Volumetric and Surface

QUALITY
 ASSURANCE
 MANUAL
 GINNA STATION

TITLE:
 APPENDIX B
 Ginna Station
 Inservice Inspection Program
 For the 1980-1989 Interval

DATE
 11/1/87

PAGE
 15 OF 27




TABLE ISI 1.1 (Cont'd)
COMPONENTS, PARTS, AND METHODS OF EXAMINATION

ITEM No.	EXAMINATION CATEGORY TABLE IWB-2500	COMPONENTS AND PARTS TO BE EXAMINED	METHOD
Reactor Vessel			
B6.40	B-G-1	Ligaments between stud holes.	Volumetric
B6.50	B-G-1	Closure Washers, bushings.	Visual
B7.10	B-G-2	Bolts, studs and nuts.	Visual
B8.10	B-H	Integrally-welded attachments.	Surface
B1.15	B-N-1	Vessel Interior.	Visual
B1.17	B-N-3	Core-support structures.	Visual
B1.18	B-0	Control rod drive housings.	Volumetric
B1.19	B-F	Exempted components.	Visual (IWA-5000)
Pressurizer			
B2.1	B-B	Longitudinal and circumferential welds.	Volumetric
B2.2	B-D	Nozzle-to-vessel welds and nozzle-to-vessel radiused section.	Volumetric
B2.3	B-E	Heater penetrations.	Visual (IWA-5000)
B2.4	B-F	Nozzle-to-safe-end welds.	Volumetric and Surface

QUALITY ASSURANCE MANUAL GINNA STATION

TITLE: APPENDIX B
Ginna Station Inservice Inspection Program For the 1980-1989 Interval

DATE 11/1/87
PAGE 16 OF 27

TABLE ISI 1.1 (Cont'd)
COMPONENTS, PARTS, AND METHODS OF EXAMINATION

ITEM No.	EXAMINATION CATEGORY TABLE IWB-2500	COMPONENTS AND PARTS TO BE EXAMINED	METHOD
Pressurizer			
B6.60	B-G-1	Bolts and studs, in place.	Volumetric
B6.70	B-G-1	Bolts and studs, when removed.	Volumetric and Surface
B6.80	B-G-1	Bolting.	Visual
B8.20	B-H	Integrally-welded attachments.	Surface
B2.10	B-P	Exempted components.	Visual (IWA-5000)
B7.20	B-G-2	Bolts, studs, and nuts.	Visual
Heat Exchangers and Steam Generators			
B3.1	B-B	Longitudinal and circumferential welds, including Tube sheet-to-head or shell welds on the primary side.	Volumetric
B3.2	B-D	Nozzle-to-head welds and nozzle inside radiused section on the primary side.	Volumetric
B3.3	B-F	Nozzle-to-safe-end welds.	Volumetric and Surface
B6.90	B-G-1	Bolts and studs, in place.	Volumetric

QUALITY ASSURANCE MANUAL
GINNA STATION

TITLE:
APPENDIX B
Ginna Station
Inservice Inspection Program
For the 1980-1989 Interval

DATE
11/1/87
PAGE
17 OF 27

TABLE ISI 1.1 (Cont'd)
COMPONENTS, PARTS, AND METHODS OF EXAMINATION

ITEM No.	EXAMINATION CATEGORY TABLE IWB-2500	COMPONENTS AND PARTS TO BE EXAMINED	METHOD
Heat Exchangers and Steam Generators			
B6.100	B-G-1	Bolts and studs, when removed.	Volumetric and Surface
B6.110	B-G-1	Bolting.	Visual
B8.30, B8.40	B-H	Integrally-welded attachments.	Surface
B3.9	B-P	Exempted components.	Visual (IWA-5000)
B7.30, B7.40	B-G-2	Bolts, studs, and nuts.	Visual
Piping Pressure Boundary			
B4.1	B-F	Safe-end to piping welds and safe-end in branch piping welds.	Volumetric and Surface
B6.150	B-G-1	Bolts and studs, in place.	Volumetric
B6.160	B-G-1	Bolts and studs, when removed.	Volumetric and Surface
B6.170	B-G-1	Bolting.	Visual
B4.5	B-J	Circumferential and longitudinal pipe welds.	Volumetric

QUALITY ASSURANCE MANUAL GINNA STATION

TITLE: APPENDIX B
Ginna Station
Inservice Inspection Program
For the 1980-1989 Interval

DATE 11/1/87
PAGE 18 OF 27

TABLE ISI 1.1 (Cont'd)
COMPONENTS, PARTS, AND METHODS OF EXAMINATION

ITEM No.	EXAMINATION CATEGORY TABLE IWB-2500	COMPONENTS AND PARTS TO BE EXAMINED	METHOD
Piping Pressure Boundary			
B4.6	B-J	Branch pipe connection welds exceeding six inch diameter.	Volumetric
B4.7	B-J	Branch pipe connection welds six inch diameter and smaller.	Surface
B4.8	B-J	Socket welds.	Surface
B10.10	B-K-1	Integrally welded attachments.	Surface
B11.10	B-K-2	Component supports.	Visual
B4.11	B-P	Exempted components.	Visual (IWA-5000)
B7.50	B-G-2	Bolts, studs and nuts.	Visual
Pump Pressure Boundary			
B6.180	B-G-1	Bolts and studs, in place.	Volumetric
B6.190	B-G-1	Bolts and studs, when removed.	Volumetric and Surface
B6.200	B-G-1	Bolting.	Visual
B10.20	B-K-1	Integrally-welded attachments.	Surface
B11.20	B-K-2	Component supports.	Visual

QUALITY ASSURANCE MANUAL GINNA STATION		TITLE: APPENDIX B Ginna Station Inservice Inspection Program For the 1980-1989 Interval	
PAGE 19		DATE 11/1/87	
OF 27			




TABLE ISI 1.1 (Cont'd)
COMPONENTS, PARTS, AND METHODS OF EXAMINATION

ITEM No.	EXAMINATION CATEGORY TABLE IWB-2500	COMPONENTS AND PARTS TO BE EXAMINED	METHOD
Pump Pressure Boundary			
B5.6	B-L-1	Pump casing welds.	Volumetric
B5.8	B-P	Exempted components.	Visual
B7.60	B-G-2	Bolts, studs, and nuts.	Visual
---	---	Reactor Coolant Pump Flywheel.	Volumetric and Surface
Valve Pressure Boundary			
B6.210	B-G-1	Bolts and studs, in place.	Volumetric
B6.220	B-G-1	Bolts and studs, when removed.	Volumetric and Surface
B6.230	B-G-1	Bolting.	Visual
B10.30	B-K-1	Integrally welded attachments.	Volumetric
B11.30	B-K-2	Component supports.	Visual
B6.6	B-M-1	Valve-body welds.	Volumetric
B6.8	B-P	Exempted components.	Visual (IWA-5000)
B7.70	B-G-2	Bolts, studs, and nuts.	Visual

QUALITY ASSURANCE MANUAL GINNA STATION

TITLE: APPENDIX B
Ginna Station Inservice Inspection Program For the 1980-1989 Interval

DATE 11/1/87
PAGE 20 OF 27

TABLE ISI 1.2
 QUALITY GROUP B
 COMPONENTS, PARTS, AND METHODS OF EXAMINATION

ITEM No.	EXAMINATION CATEGORY TABLE IWC-2520	COMPONENTS AND PARTS TO BE EXAMINED	METHOD
Pressure Vessels			
C1.1	C-A	Circumferential butt welds.	Volumetric
C1.2	C-B	Nozzle-to-vessle welds.	Volumetric
C3.10	C-C	Integrally-welded support attachments.	Surface
C4.10	C-D	Bolts and studs.	Volumetric
C3.20	C-E	Component supports.	Visual
C3.30	C-E	Supports mechanical and hydraulic.	Visual
Piping			
C2.1	C-F, C-G	Circumferential butt welds.	Volumetric
C2.2	C-F, C-G	Longitudinal weld joints in fittings.	Volumetric
C2.3	C-F, C-G	Branch pipe-to-pipe weld joints.	Volumetric
C4.20	C-D	Bolts and studs.	Volumetric
C3.40	C-E-1	Integrally welded support attachments.	Surface
C3.50	C-E-2	Component supports.	Visual
C3.60	---	Supports mechanical and hydraulic.	Visual

QUALITY ASSURANCE MANUAL
 GINNA STATION

TITLE:
 APPENDIX B
 Ginna Station
 Inservice Inspection Program
 For the 1980-1989 Interval

DATE
 11/1/87

PAGE
 21

OF
 27




TABLE ISI 1.2 (Cont'd)
COMPONENTS, PARTS, AND METHODS OF EXAMINATION

ITEM No.	EXAMINATION CATEGORY TABLE IWC-2520	COMPONENTS AND PARTS TO BE EXAMINED	METHOD
Pumps			
C3.1	C-F, C-G	Pump casing welds.	Volumetric
C4.30	C-D	Bolts and studs.	Volumetric
C3.20	C-E-1	Integrally welded support attachments.	Surface
C3.80	C-E-2	Component supports.	Visual
C3.90	---	Supports mechanical and hydraulic.	Visual
Valves			
C4.1	C-F, C-G	Valve body welds.	Volumetric
C4.40	C-D	Bolts and studs.	Volumetric
C3.100	C-E-1	Integrally welded support attachments.	Surface
C3.110	C-E-2	Component supports.	Visual
C3.120	---	Supports mechanical and hydraulic.	Visual

QUALITY ASSURANCE MANUAL
GINNA STATION

TITLE:
APPENDIX B
Ginna Station
Inservice Inspection Program
For the 1980-1989 Interval

DATE
11/1/87
PAGE
22 OF 27

QUALITY ASSURANCE MANUAL GINNA STATION	TITLE:	APPENDIX B Ginna Station Inservice Inspection Program For the 1980-1989 Interval	DATE 11/1/87
			PAGE 23 OF 27

Table 8.1

Safety Related Hydraulic Snubbers

<u>Snubber No.</u>	<u>System Snubber Installed on and Analysis Line Number</u>	<u>Accessible or Inaccessible (A or I)</u>
SGA-1	"A" Steam Generator	I
SGA-2	"A" Steam Generator	I
SGA-3	"A" Steam Generator	I
SGA-4	"A" Steam Generator	I
SGA-5	"A" Steam Generator	I
SGA-6	"A" Steam Generator	I
SGA-7	"A" Steam Generator	I
SGA-8	"A" Steam Generator	I
SGB-1	"B" Steam Generator	I
SGB-2	"B" Steam Generator	I
SGB-3	"B" Steam Generator	I
SGB-4	"B" Steam Generator	I
SGB-5	"B" Steam Generator	I
SGB-6	"B" Steam Generator	I
SGB-7	"B" Steam Generator	I
SGB-8	"B" Steam Generator	I
AFW-10	Standby Auxiliary Feedwater	A
AFW-13	Standby Auxiliary Feedwater	A
AFW-25	Standby Auxiliary Feedwater	A
AFW-26	Standby Auxiliary Feedwater	A
AFW-27	Standby Auxiliary Feedwater	A
AFW-28	Standby Auxiliary Feedwater	A
AFW-29	Standby Auxiliary Feedwater	A
AFW-31	Standby Auxiliary Feedwater	A
AFU-109	Auxiliary Feedwater - 500	A
FWU-3	Feedwater - 100	A
FWU-5	Feedwater - 100	I
FWU-21	Feedwater - 301	A
FWU-44	Feedwater - 300	A
N-601	Pressurizer Relief Discharge	I
N-602	Pressurizer Relief Discharge	I
N-604	Pressurizer Relief Discharge	I
N-605	Pressurizer Relief Discharge	I
N-607	Pressurizer Relief Discharge	I
N-608	Pressurizer Relief Discharge	I
N-615	Pressurizer Relief Discharge	I
N-616	Pressurizer Relief Discharge	I
MSU-8	Main Steam - 200	I

QUALITY ASSURANCE MANUAL GINNA STATION	TITLE: APPENDIX B Ginna Station Inservice Inspection Program For the 1980-1989 Interval	DATE
		11/1/87 <hr/> PAGE 24 OF 27

Table 8.1 (Continued)

Safety Related Hydraulic Snubbers

<u>Snubber No.</u>	<u>System Snubber Installed on and Analysis Line Number</u>	<u>Accessible or Inaccessible (A or I)</u>
PS-2	Pressurizer PORV Discharge	I
PS-4	Pressurizer PORV Discharge	I
PS-5	Pressurizer PORV Discharge	I
PS-6	Pressurizer PORV Discharge	I
PS-8	Pressurizer PORV Discharge	I
PS-9	Pressurizer PORV Discharge	I
PS-10	Pressurizer PORV Discharge	I
PS-11	Pressurizer PORV Discharge	I

QUALITY ASSURANCE MANUAL GINNA STATION	TITLE:	APPENDIX B Ginna Station Inservice Inspection Program For the 1980-1989 Interval	DATE	11/1/87
			PAGE	25 OF 27

Table 8.2

Safety Related Mechanical Snubbers

<u>Snubber No.</u>	<u>System Snubber Installed on and Analysis Line Number</u>	<u>Accessible or Inaccessible (A or I)</u>
AFU-3	Auxiliary Feedwater - 300	A
AFU-31	Auxiliary Feedwater - 100	A
AFU-34	Auxiliary Feedwater - 100	A
AFU-52	Auxiliary Feedwater - 100	A
AFU-75	Auxiliary Feedwater - 200	A
AFU-98	Auxiliary Feedwater - 400	A
AFU-101	Auxiliary Feedwater - 400	A
AFU-103 (East)	Auxiliary Feedwater - 400	A
AFU-103 (West)	Auxiliary Feedwater - 400	A
AFU-111	Auxiliary Feedwater - 500	A
AFU-123	Auxiliary Feedwater - 500	A
AFU-124	Auxiliary Feedwater - 500	A
BDU-16	Steam Generator Blowdown - 200	I
CCU-43	Component Cooling - 450	I
CCU-57	Component Cooling - 700	I
CCU-71	Component Cooling - 600	I
CVU-26	Chemical and Volume Control - 730	I
CVU-46	Chemical and Volume Control - 300	I
CVU-49	Chemical and Volume Control - 700	I
CVU-80	Chemical and Volume Control - 100	I
CVU-103	Chemical and Volume Control - 500	I
CVU-104	Chemical and Volume Control - 500	I
CVU-186	Chemical and Volume Control - 250	I
CVU-345	Chemical and Volume Control - 900	A
CVU-351	Chemical and Volume Control - 900	A
CVU-372	Chemical and Volume Control - 1000	A
FWU-8	Feedwater - 200	A
FWU-12	Feedwater - 200	A
FWU-15	Feedwater - 301	A
FWU-17	Feedwater - 301	A
FWU-18	Feedwater - 301	A
FWU-20	Feedwater - 301	A
FWU-23	Feedwater - 301	A
FWU-24	Feedwater - 301	A
FWU-26 (East)	Feedwater - 301	A
FWU-26 (West)	Feedwater - 301	A
FWU-32	Feedwater - 300	A
FWU-38	Feedwater - 300	A
FWU-39	Feedwater - 300	A
FWU-40	Feedwater - 300	A

QUALITY ASSURANCE MANUAL GINNA STATION	TITLE: APPENDIX B Ginna Station Inservice Inspection Program For the 1980-1989 Interval	DATE 11/1/87
		PAGE 26 OF 27

Table 8.2 (Continued)

Safety Related Mechanical Snubbers

<u>Snubber No.</u>	<u>System Snubber Installed on and Analysis Line Number</u>	<u>Accessible or Inaccessible (A or I)</u>
FWU-42	Feedwater - 300	A
FWU-47	Feedwater - 300	A
FWU-48	Feedwater - 300	A
FWU-51	Feedwater - 300	A
FWU-52	Feedwater - 300	A
FWU-54	Feedwater - 300	A
FWU-57	Feedwater - 300	A
MSU-2	Main Steam - 100	I
MSU-3	Main Steam - 100	I
MSU-7 (Top)	Main Steam - 200	I
MSU-7 (Bottom)	Main Steam - 200	I
MSU-12	Main Steam - 300	A
MSU-13 (East)	Main Steam - 300	A
MSU-13 (West)	Main Steam - 300	A
MSU-15 (North)	Main Steam - 300	A
MSU-15 (South)	Main Steam - 300	A
MSU-16 (North)	Main Steam - 300	A
MSU-16 (South)	Main Steam - 300	A
MSU-18 (North)	Main Steam - 300	A
MSU-18 (South)	Main Steam - 300	A
MSU-19 (North)	Main Steam - 300	A
MSU-19 (South)	Main Steam - 300	A
MSU-22	Main Steam - 300	A
MSU-25	Main Steam - 300	A
MSU-26 (Top)	Main Steam - 300	A
MSU-26 (Bottom)	Main Steam - 300	A
MSU-27	Main Steam - 300	A
MSU-29	Main Steam - 300	A
MSU-31	Main Steam - 300	A
MSU-32	Main Steam - 300	A
MSU-38	Main Steam - 300	A
MSU-39	Main Steam - 300	A
MSU-40	Main Steam - 300	A
MSU-44	Main Steam - 300	A
MSU-55	Main Steam - 300	A
MSU-57	Main Steam - 300	A
MSU-58	Main Steam - 300	A
MSU-60	Main Steam - 300	A
MSU-72	Main Steam - 120	A
MSU-74	Main Steam - 120	A
MSU-75	Main Steam - 120	A
MSU-78	Main Steam - 120	A
MSU-80	Main Steam - 120	A
MSU-82	Main Steam - 120	A

QUALITY ASSURANCE MANUAL GINNA STATION	TITLE:	APPENDIX B Ginna Station Inservice Inspection Program For the 1980-1989 Interval	DATE 11/1/87
			PAGE 27 OF 27

Table 8.2 (Continued)

Safety Related Mechanical Snubbers

<u>Snubber No.</u>	<u>System Snubber Installed on and Analysis Line Number</u>	<u>Accessible or Inaccessible (A or I)</u>
MSU-84 (East)	Main Steam - 120	A
MSU-84 (West)	Main Steam - 120	A
MSU-85	Main Steam - 120	A
RHU-8	Residual Heat Removal - 100	I
RHU-30	Residual Heat Removal - 2500	I
RHU-33	Residual Heat Removal - 2500	I
RHU-36	Residual Heat Removal - 350	A
RHU-51	Residual Heat Removal - 400	A
RHU-53	Residual Heat Removal - 400	A
RHU-61	Residual Heat Removal - 400	A
RHU-63 (North)	Residual Heat Removal - 300	A
RHU-63 (South)	Residual Heat Removal - 300	A
RHU-69	Residual Heat Removal - 300	A
RHU-71 (North)	Residual Heat Removal - 300	A
RHU-71 (South)	Residual Heat Removal - 300	A
RHU-72	Residual Heat Removal - 300	A
RHU-75	Residual Heat Removal - 300	A
RHU-92	Residual Heat Removal - 300	A
RHU-109	Residual Heat Removal - 450	A
RHU-110	Residual Heat Removal - 450	A
RHU-119	Residual Heat Removal - 450	A
RHU-123	Residual Heat Removal - 450	A
SIU-3	Safety Injection - 100	I
SIU-47	Safety Injection - 200	I
SIU-52	Safety Injection - 200	I
SWU-254	Service Water - 1850	A
SWU-308	Service Water - 1400	A
SWU-309	Service Water - 1400	A
SWU-370	Service Water - 1500	A

4
1
2
3
4
5
6
7
8
9
10