2998-G-060

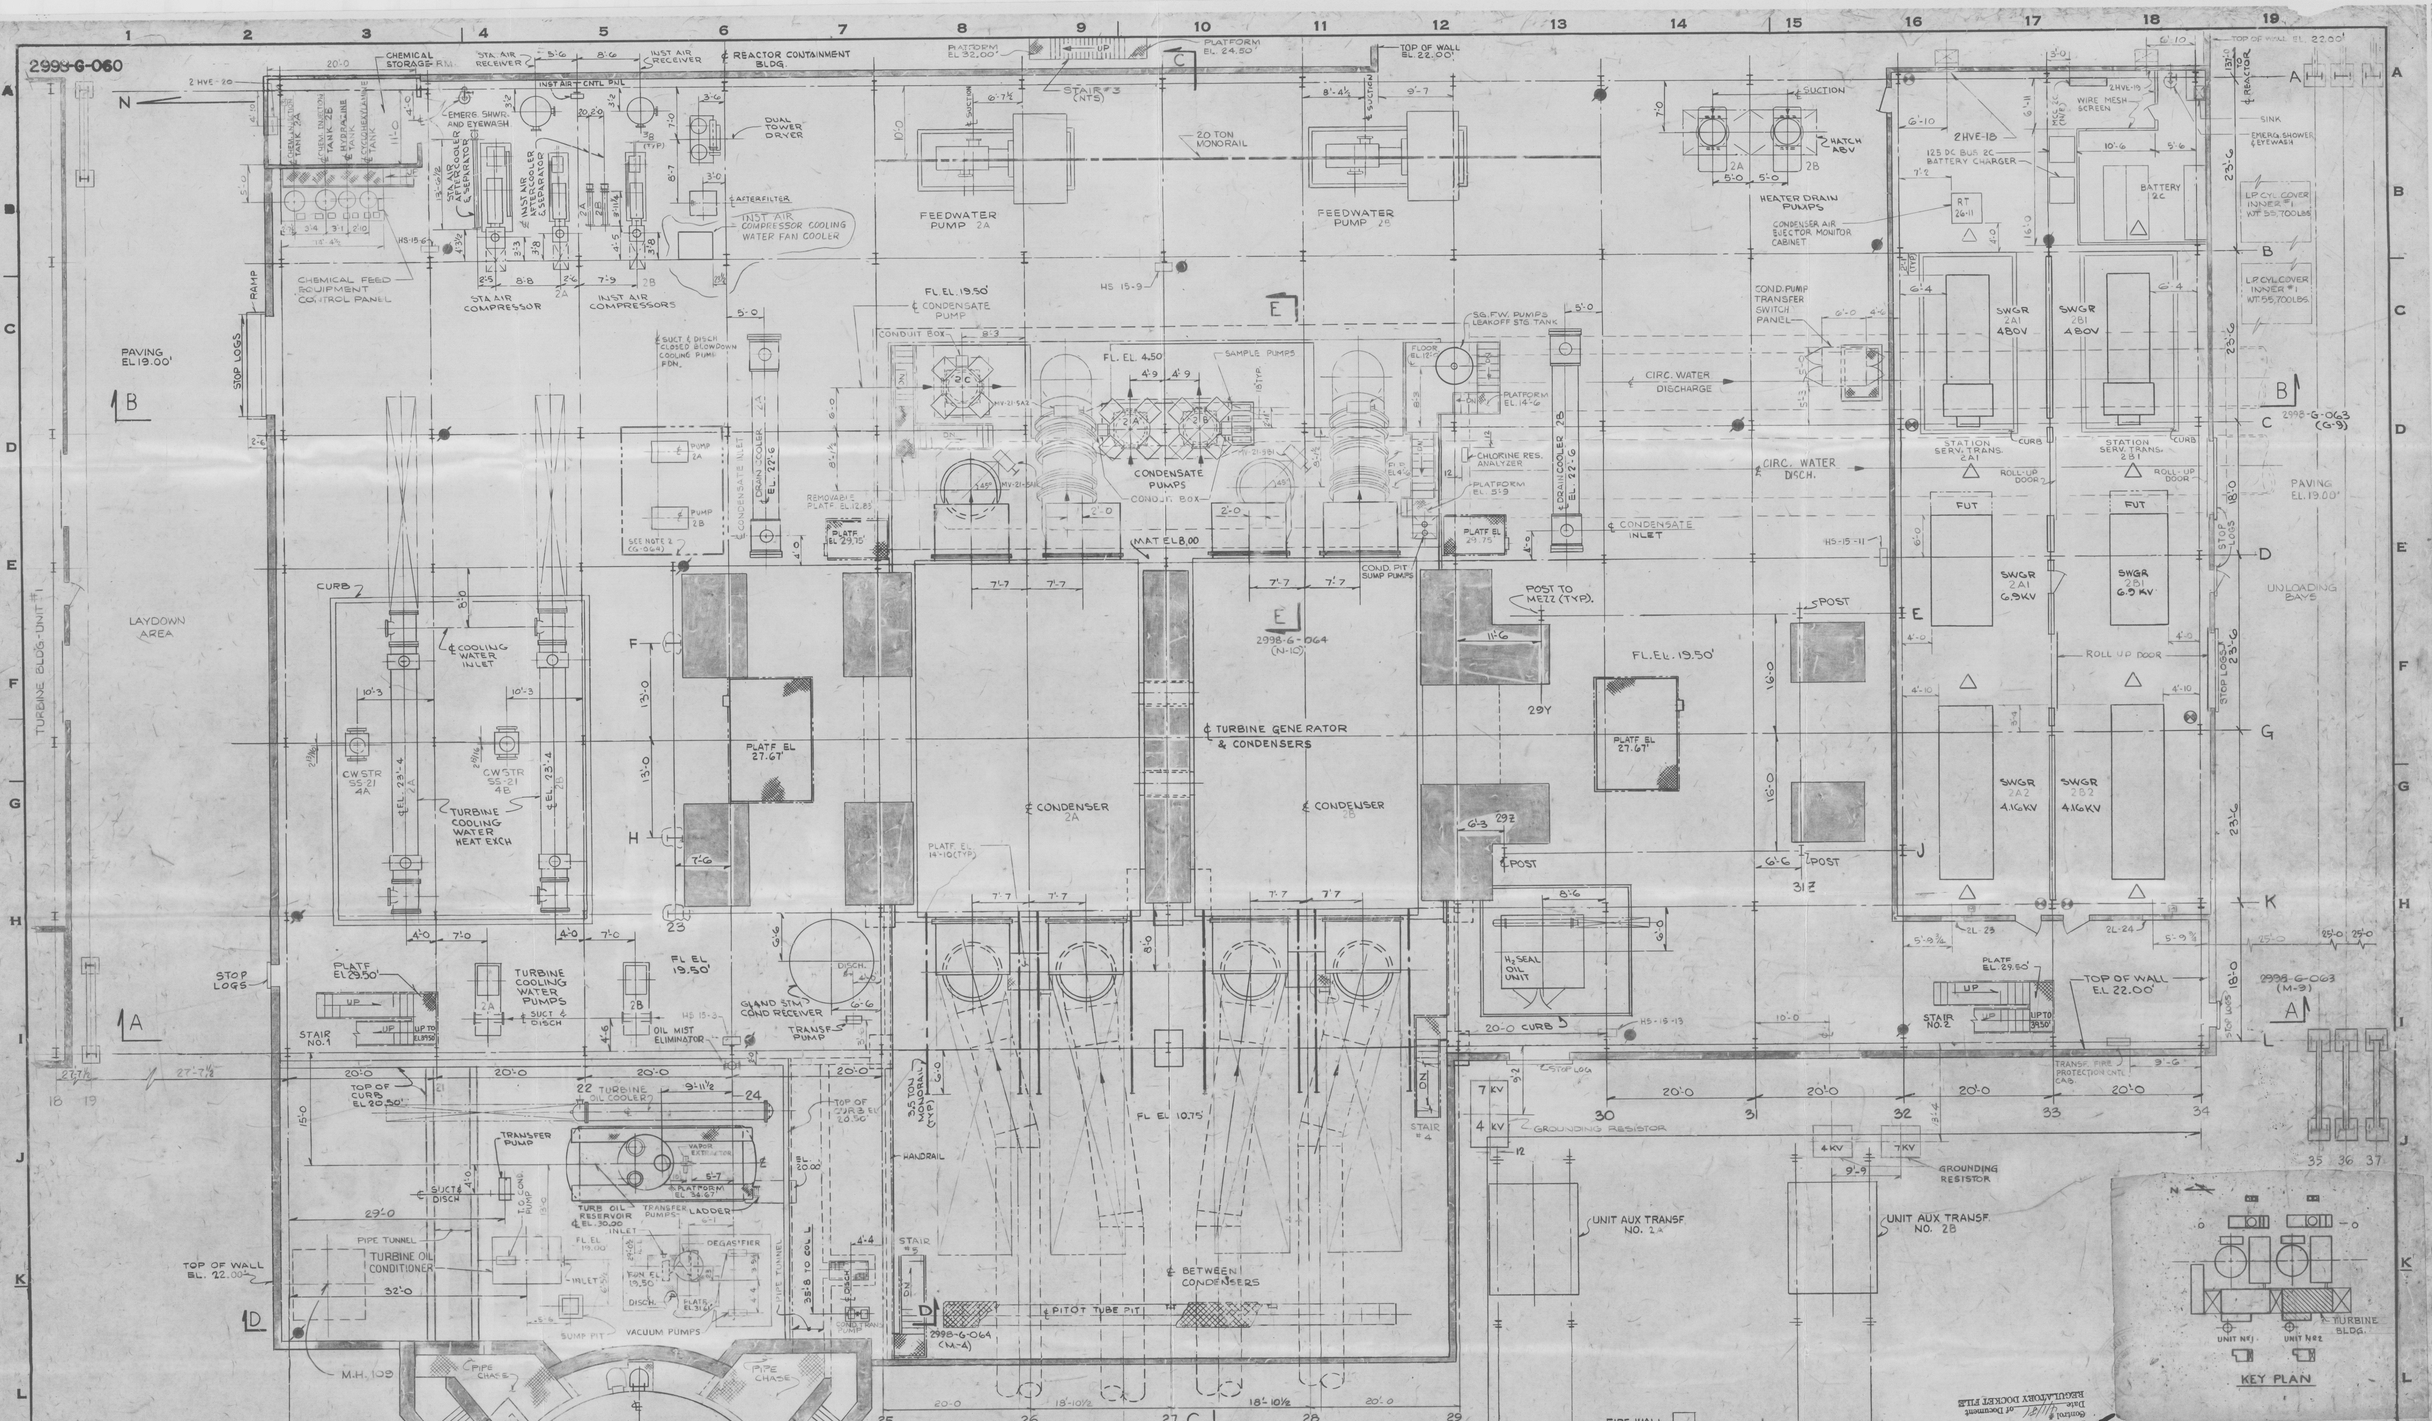

NOTE
1. FOR GENERAL NOTES, REFERENCE DWGS. & LEGEND SEE 2998-G-064

NO	DATE	REVISION	BY	CH	APPROVED
8	11-19-87	INC DCN SLC GAC-071 REVISED: (E5,G5) COL ADDED: (B6) EQUIP	JC UP	CCW	
7	10/2/79	REVISED: (B6) CABINET LOC. PER SL-GAC-044 (I11) LADDER LOC.		SR	G.S.
6	1-11-79	REVISED: (A2, A16, A17, H6, H18, (D8, H11) NOTE: (H5) DEGAS (K4) COND. (I, J, K3) TUNNEL (K5) EL. (I13) STOP LOG (C8, D10) MOTOR (A17) BATTERY ROOM (L3, L6) WALLS (STAIRS ADDED: A1, N6 (H5, H11) PLATF. (D8) FLOW ARROW (A4) EMERG. SHWR. (L15) SWITCH PANEL (L3, E5, N2, L2, A15, D15, D16, G16, E16) FIRE EXTINGUISHER (M5) SUMP PIT (C16, C18) CURB (Z1, B1) STOP LOG (D1) PUMP FDN. DELETED: (E3, D1, (J4) SUMP (I12) BUS FDN	KT	MWJ	MM	
5	1-25-77	RELOC. (F-3, A1) C.W. STR'S ADDED: (E-12) COND. PIT SUMP PUMPS (K-9) DEGASSIFIER (B-7-13) MONORAIL (D-9, 10) (C-9, 10) WALKWAY BOXES: REV. (G-9) TRENCH (D-8, 10) COND. SUMP (J-8, 9) AFTER COOLERS, INSTRUM. AIR COMPRESSORS			
4	8-16-76	REVISED: (A9) STAIR (F4, G4, A1) NOTE: (39) DIM. (K-M, 3-7) COND. ST. TANK (A-3) ADDED: (C12) SEAL OIL TANK (B6) MONITOR CABINET DELETED: (J6) TURB. OIL STG. TANK. NOTE: (41) NOT RELEASED.	JG	JS	MW
3	1-10-75	REVISED: (D-7-12) ACCESS TO COND. PIT (B-3) DIM'S. (D-10) COND. DISCH. (A-E-18) LOC. OF FIRE EQUIP. ADDED (A-2-17) HVE EQUIP. (H-17) L-UNIT (D-10) SAMPLE PUMPS (J-15) DIMS. (E-18) P. PANEL (E-6) NOTE (D-8) COND. PUMP DELETED: (H-17) HVE EQUIP. (A-17) MOTOR OPER. LOUVERS	L.T.	RS	
2	2-21-74	REVISED: (E-13) & (E-15) STOP LOG LOC. (A-9) DOOR CHEM. STOR. RM. (H-16) & (H-18) EXH. FAN LOC. ADDED: (D-12) & (D-14) (D-7) STAIRWAY T.D. NO. 2, (A-14) & (A-18) MOTOR OPER. LOUVERS. DELETED: (N-1) NOTES.	O.L.		HW TOM
1	8-28-73	REVISED: (C-16) & (C-18) DIM. EQUIPMENT NUMBERS (J-12) TN & ANUNITS (S-7) LOCAT'N. OF TRANSFER PUMP, (E-7) & (E-12) PLATF. B.R.C. (N-9) COL. NO. (M-C) NOTE "E" RG WAS RT. ADDED: (C12) DIMS (BAR) (E-18) (D-6) (D-8) (E-16) (F-18) (H16) (H18) IONIZATION DETECTORS (D-5) (L-C1) (D-10) (B16) (B-11) (D-33) (E-32) HOSE STATIONS AND DRY CHEM. EXT. (A-3) FOUNDS. (J3) MAUSTING NOTE 2.0 (C8) TO (C11) CPC. WTR. VALVE ORIENTATION	R_FP	WVL	R_G	HW TOM

NO.	DATE	REVISION	BY	CH	APPROVED
15					
16					
17					
18					
19					

THIS DOCUMENT IS THE PROPERTY OF EBASCO SERVICES INCORPORATED. ITS USE IS EXPRESSLY RESTRICTED BY THE TERMS OF THE CONTRACT, DATED AS OF 9/1/75 BETWEEN EBASCO SERVICES INCORPORATED AND FLORIDA POWER & LIGHT COMPANY.

FLORIDA POWER & LIGHT COMPANY
ST. LUCIE PLANT
1983-890 MW(e) EXTENSION - UNIT NO. 2

GENERAL ARRANGEMENT
TURBINE BUILDING - GROUND FLOOR-PLAN

EBASCO SERVICES INCORPORATED NEW YORK

SCALE 1/8"=1'-0 | APPROVED | DATE 4-18-73
DR. MECH | DR. S. DFRITZ | CH. C. DANGIO
2998-G-060